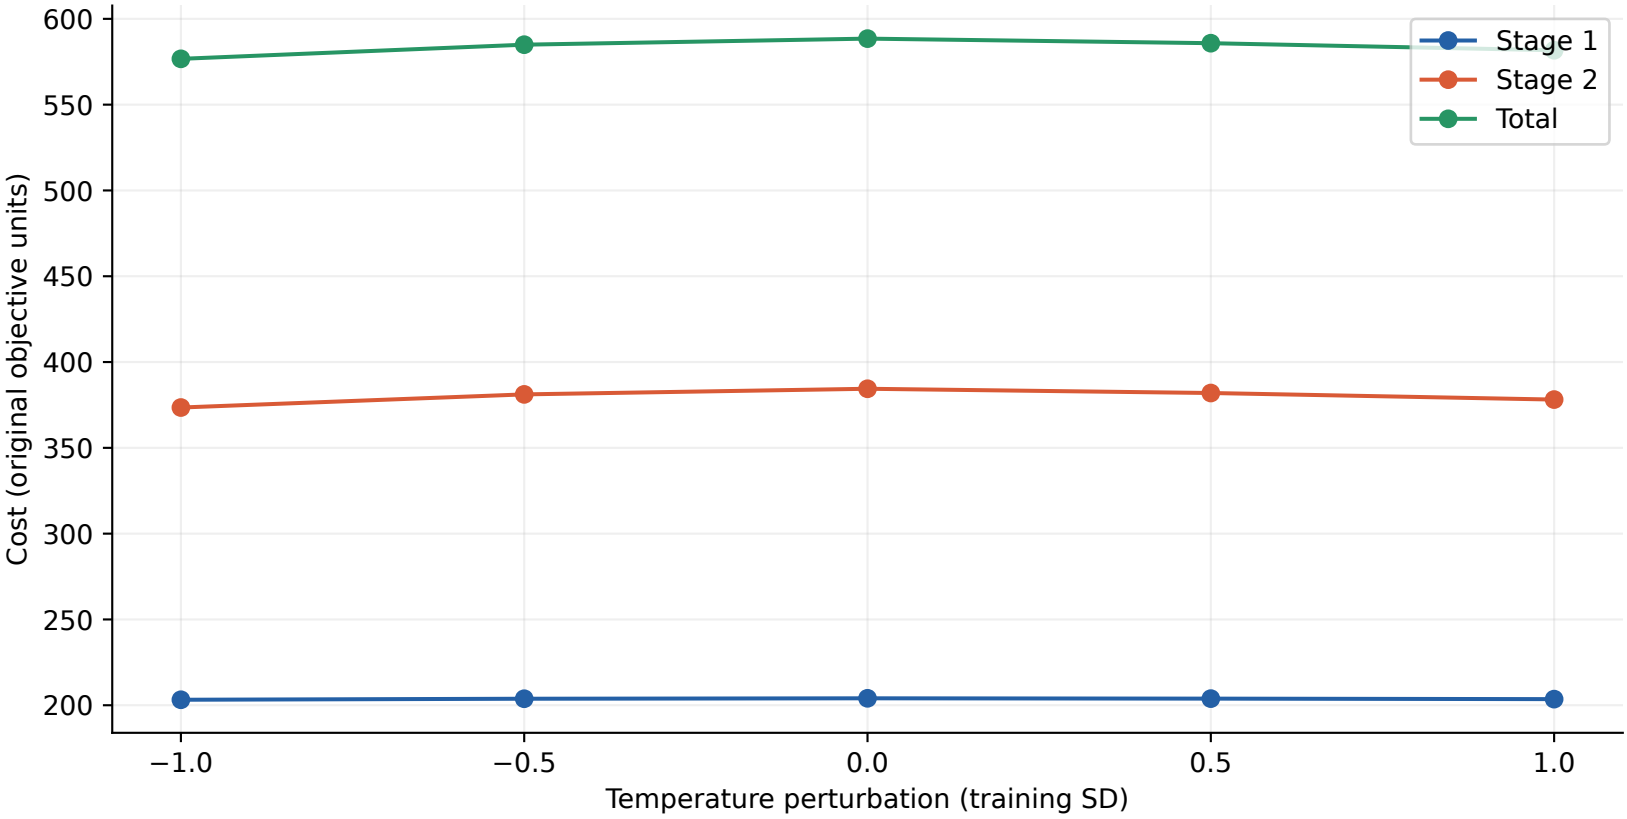
Original CNN: fixed test sample 0, input temperature at grid bus 1
Cost (original objective units)
600
550
500
450
400
350
300
250
200
−1.0
−0.5
0.0
0.5
1.0
Temperature perturbation (training SD)
Stage 1
Stage 2
Total