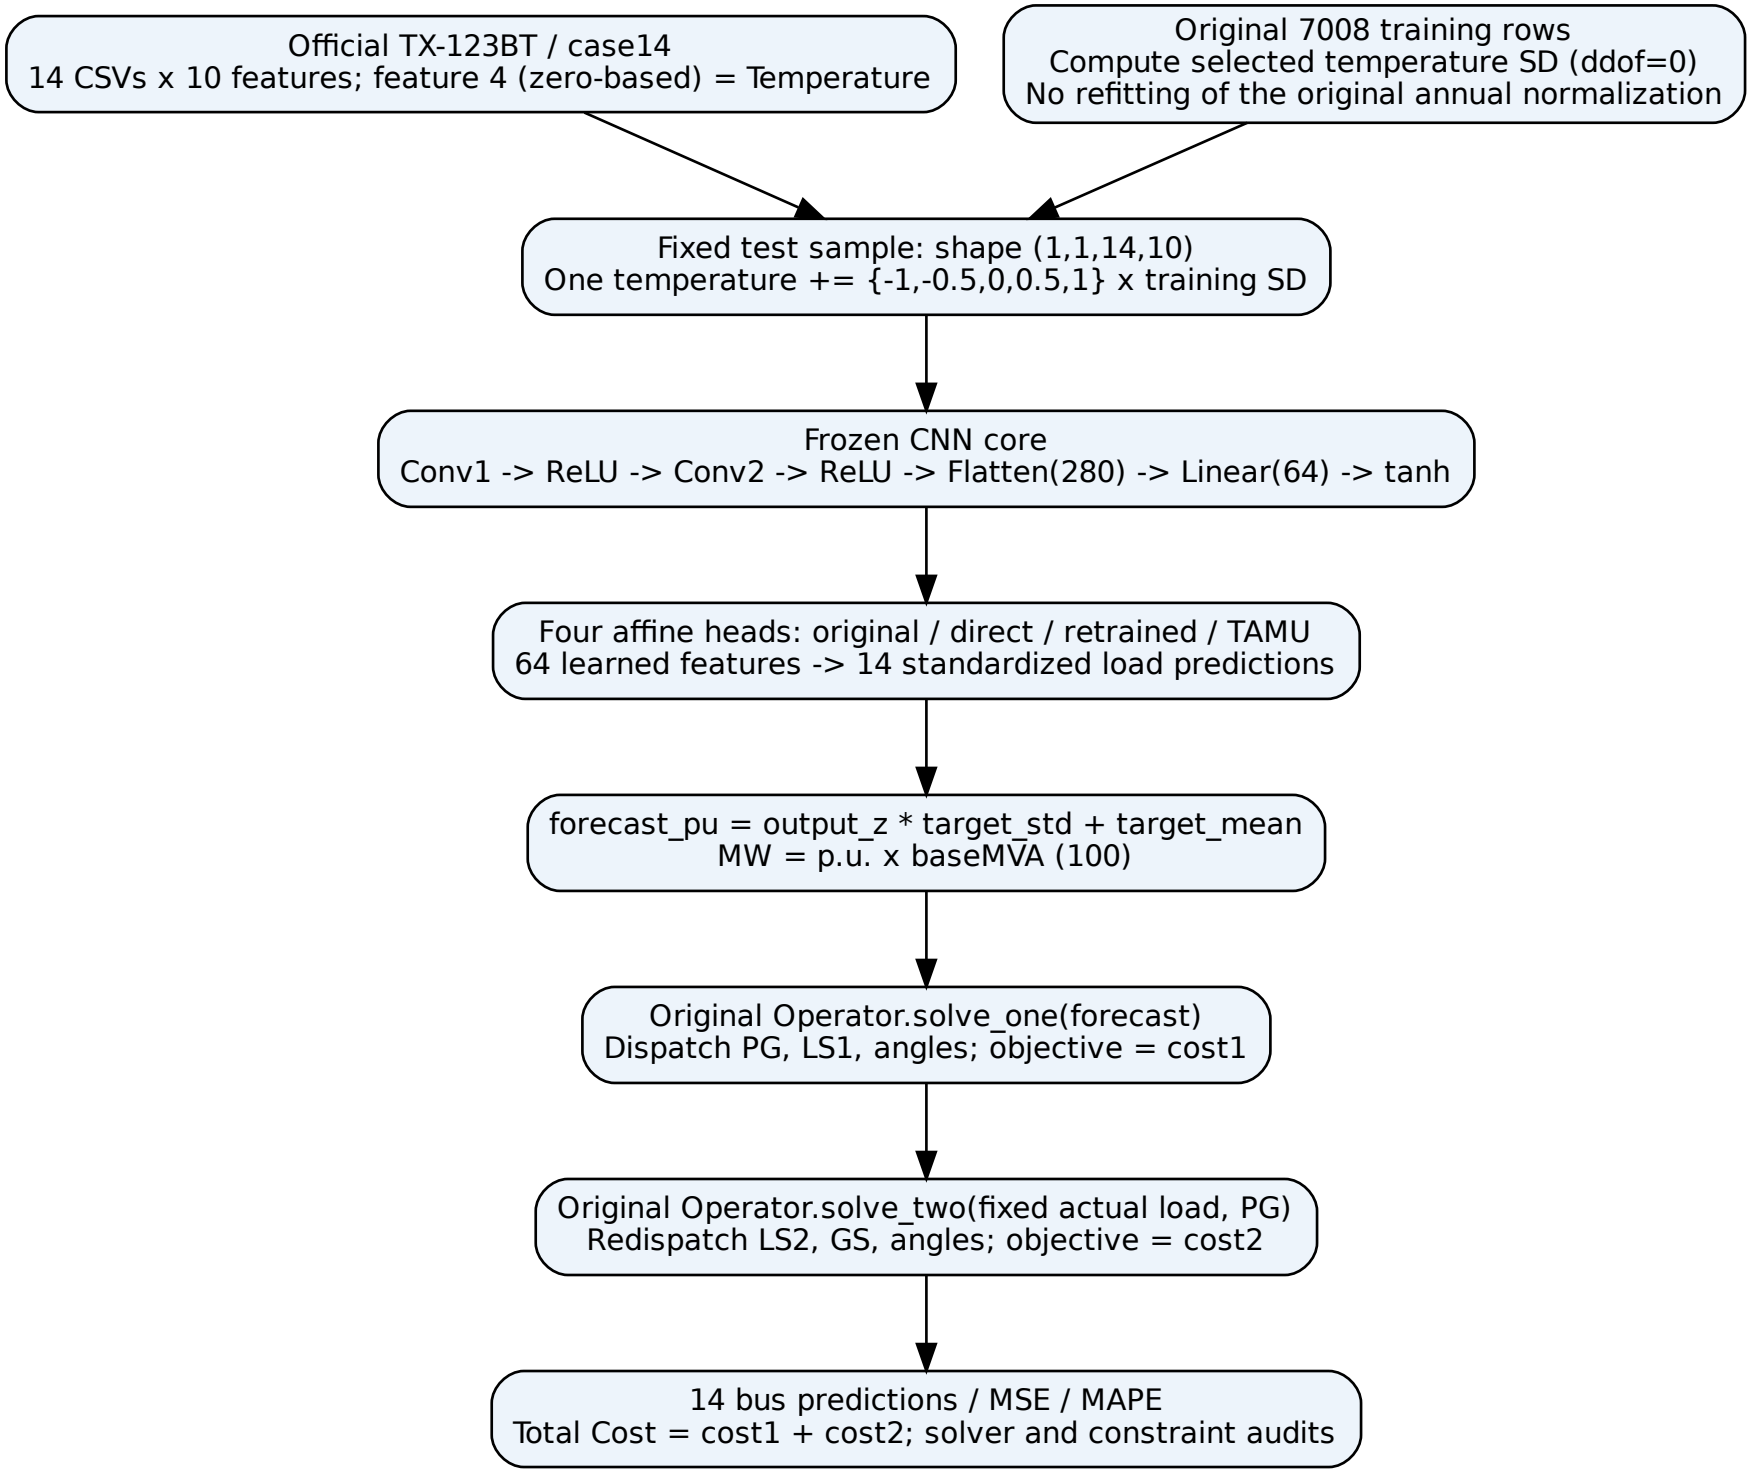
Official TX-123BT / case14
14 CSVs x 10 features; feature 4 (zero-based) = Temperature
Original 7008 training rows
Compute selected temperature SD (ddof=0)
No refitting of the original annual normalization
Fixed test sample: shape (1,1,14,10)
One temperature += {-1,-0.5,0,0.5,1} x training SD
Frozen CNN core
Conv1 -> ReLU -> Conv2 -> ReLU -> Flatten(280) -> Linear(64) -> tanh
Four affine heads: original / direct / retrained / TAMU
64 learned features -> 14 standardized load predictions
forecast_pu = output_z * target_std + target_mean
MW = p.u. x baseMVA (100)
Original Operator.solve_one(forecast)
Dispatch PG, LS1, angles; objective = cost1
Original Operator.solve_two(fixed actual load, PG)
Redispatch LS2, GS, angles; objective = cost2
14 bus predictions / MSE / MAPE
Total Cost = cost1 + cost2; solver and constraint audits