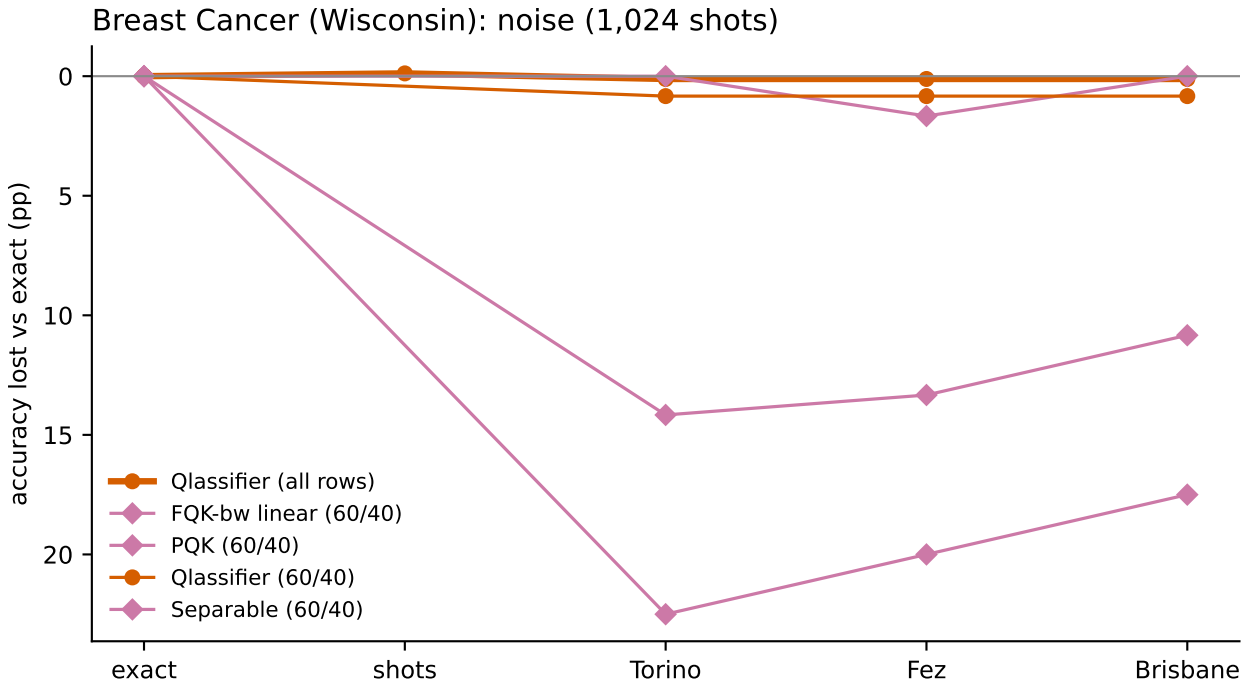
Breast Cancer (Wisconsin): noise (1,024 shots)
accuracy lost vs exact (pp)
0
5
10
15
20
Qlassifier (all rows)
FQK-bw linear (60/40)
PQK (60/40)
Qlassifier (60/40)
Separable (60/40)
exact
shots
Torino
Fez
Brisbane