

Totally Integrated Automation Portal

PLC_1 [CPU 1214C DC/DC/DC]

PLC_1

Project information

Name	PLC_1	Author	JohnWork	Comment	
Slot	1	Rack	0		

Catalog information

Short designation	CPU 1214C DC/DC/DC	Description	Work memory 75 KB; 24VDC power supply with DI14 x 24VDC SINK/ SOURCE, DQ10 x 24VDC and AI2 on board; 6 high-speed counters and 4 pulse outputs on board; signal board expands on-board I/O; up to 3 communication modules for serial communication; up to 8 signal modules for I/O expansion; PROFINET interface for programming, HMI and PLC-to-PLC communication	Article number	6ES7 214-1AG40-0XB0
Firmware version	V4.0		False		

Connection resources

PG communication:	1	OP communication:	1	S7 basic communication:	0
S7 communication:	0	Maximum number of S7 connection resources:	38		

Overview of addresses\Overview of addresses\Overview of addresses

Inputs	True	Outputs	True	Address gaps	False
Slot	True				


Type	Addr. from	Addr. to	Module	PIP	Device name	Device number	Size	Master / IO system	Rack	Slot
I	0	1	DI14/DQ10_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 1
O	0	1	DI14/DQ10_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 1
I	64	67	AI2_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 2
I	1000	1003	HSC_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 16
I	1004	1007	HSC_2	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 17
I	1008	1011	HSC_3	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 18
I	1012	1015	HSC_4	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 19
I	1016	1019	HSC_5	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 20
I	1020	1023	HSC_6	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 21
O	80	81	AQ1 x 12 bits_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 3
O	1000	1001	Pulse_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 32
O	1002	1003	Pulse_2	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 33
O	1004	1005	Pulse_3	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 34
O	1006	1007	Pulse_4	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 35

PLC_1 [CPU 1214C DC/DC/DC] / Program blocks


Main [OB1]

Main Properties							
General							
Name	Main	Number	1	Type	OB	Language	FBD
Numbering	Automatic						
Information							
Title	"Main Program Sweep (Cycle)"	Author		Comment		Family	
Version	0.1	User-defined ID					
Name				Data type		Default value	
Temp							
Constant							


Network 1: Clamp 1 Solenoid

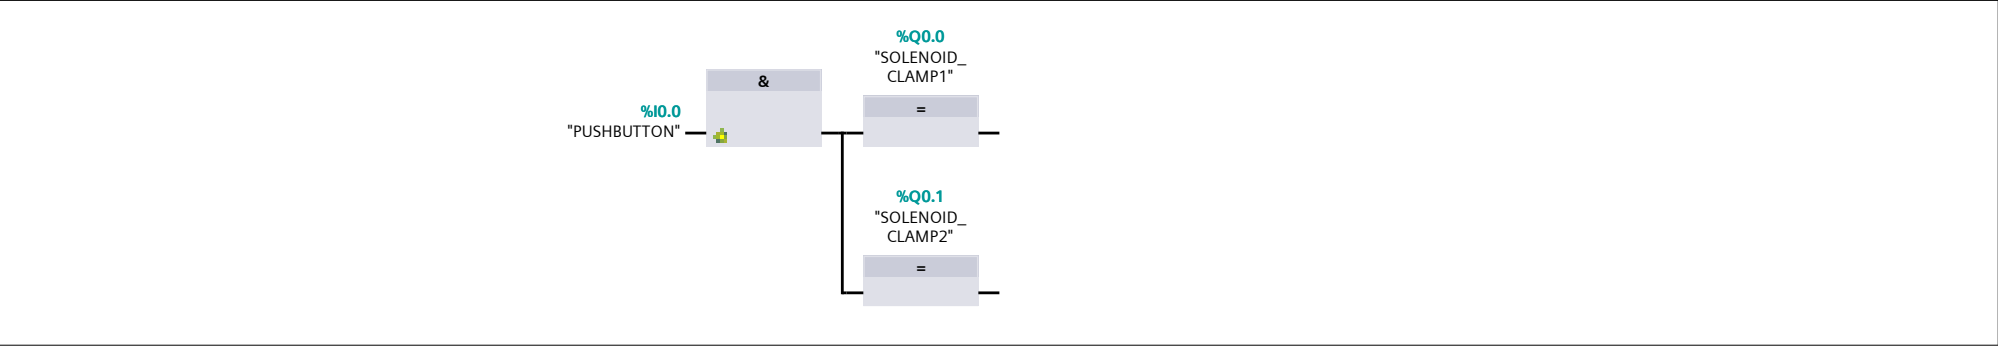

Network 2:

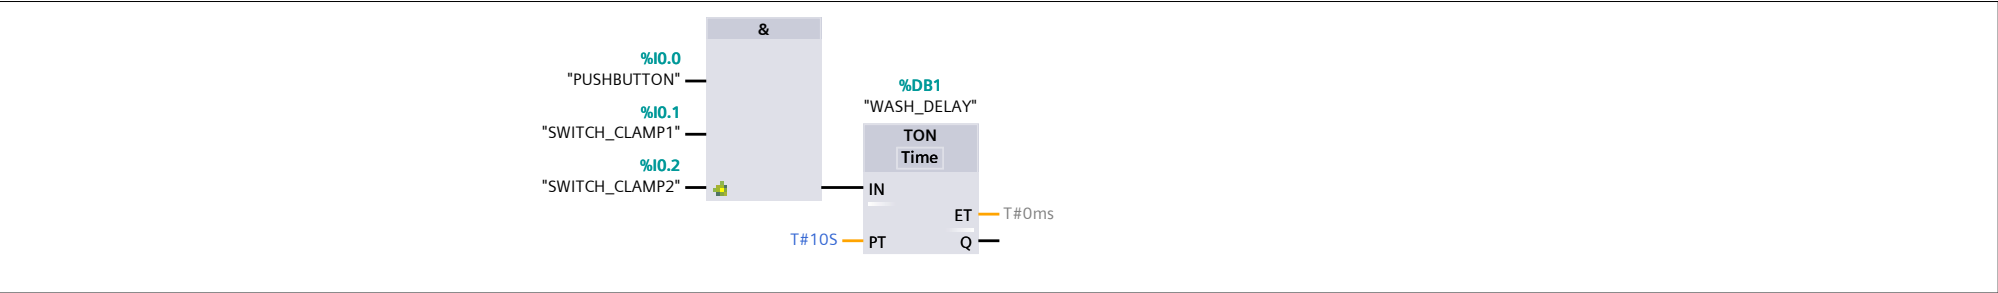

Network 3: Spray Wash Valve

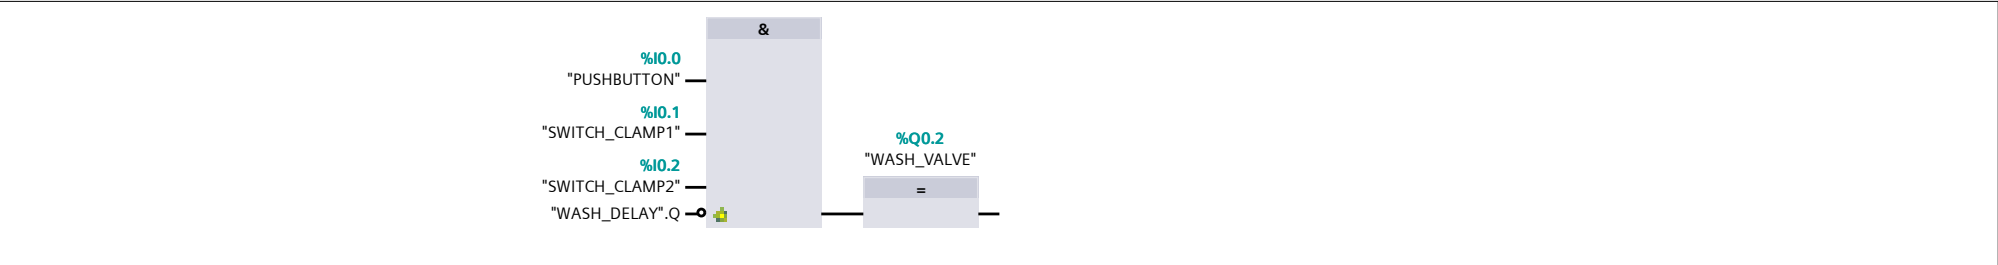

Totally Integrated Automation Portal

PLC_1 [CPU 1214C DC/DC/DC] / Program blocks / System blocks / Program resources

WASH_DELAY [DB1]

WASH_DELAY Properties

General

Name	WASH_DELAY	Number	1	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author	Simatic	Comment		Family	IEC
Version	1.0	User-defined ID	IEC_TMR				

Name	Data type	Start value	Retain
▼ Static			
PT	Time	T#0ms	False
ET	Time	T#0ms	False
IN	Bool	false	False
Q	Bool	false	False

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] Technology objects This folder is empty.		

Totally Integrated Automation Portal

PLC_1 [CPU 1214C DC/DC/DC] / PLC tags / Default tag table [33]

PLC tags

PLC tags				
	Name	Data type	Address	Retain
	PUSHBUTTON	Bool	%I0.0	False
	SWITCH_CLAMP1	Bool	%I0.1	False
	SWITCH_CLAMP2	Bool	%I0.2	False
	SOLENOID_CLAMP1	Bool	%Q0.0	False
	SOLENOID_CLAMP2	Bool	%Q0.1	False
	WASH_VALVE	Bool	%Q0.2	False

Totally Integrated Automation Portal											
PLC_1 [CPU 1214C DC/DC/DC] / PLC tags / Default tag table [33] User constants <table><tr><th colspan="3">User constants</th></tr><tr><th>Name</th><th>Data type</th><th>Value</th></tr><tr><td colspan="3"></td></tr></table>			User constants			Name	Data type	Value			
User constants											
Name	Data type	Value									

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] / PLC data types System data types This folder is empty.		

Totally Integrated Automation Portal										
PLC_1 [CPU 1214C DC/DC/DC] / Watch and force tables Force table <table><tr><th>Name</th><th>Address</th><th>Display format</th><th>Force value</th></tr><tr><td colspan="4"></td></tr></table>			Name	Address	Display format	Force value				
Name	Address	Display format	Force value							

Totally Integrated Automation Portal																																		
PLC_1 [CPU 1214C DC/DC/DC] / Watch and force tables Tom_Watch_Table <table><tr><th>Name</th><th>Address</th><th>Display format</th><th>Modify value</th></tr><tr><td>"PUSHBUTTON"</td><td>%I0.0</td><td>Bool</td><td></td></tr><tr><td>"SOLENOID_CLAMP1"</td><td>%Q0.0</td><td>Bool</td><td></td></tr><tr><td>"SOLENOID_CLAMP2"</td><td>%Q0.1</td><td>Bool</td><td></td></tr><tr><td>"SWITCH_CLAMP1"</td><td>%I0.1</td><td>Bool</td><td></td></tr><tr><td>"SWITCH_CLAMP2"</td><td>%I0.2</td><td>Bool</td><td></td></tr><tr><td>"WASH_VALVE"</td><td>%Q0.2</td><td>Bool</td><td></td></tr><tr><td>"WASH_DELAY".ET</td><td></td><td>Time</td><td></td></tr></table>			Name	Address	Display format	Modify value	"PUSHBUTTON"	%I0.0	Bool		"SOLENOID_CLAMP1"	%Q0.0	Bool		"SOLENOID_CLAMP2"	%Q0.1	Bool		"SWITCH_CLAMP1"	%I0.1	Bool		"SWITCH_CLAMP2"	%I0.2	Bool		"WASH_VALVE"	%Q0.2	Bool		"WASH_DELAY".ET		Time	
Name	Address	Display format	Modify value																															
"PUSHBUTTON"	%I0.0	Bool																																
"SOLENOID_CLAMP1"	%Q0.0	Bool																																
"SOLENOID_CLAMP2"	%Q0.1	Bool																																
"SWITCH_CLAMP1"	%I0.1	Bool																																
"SWITCH_CLAMP2"	%I0.2	Bool																																
"WASH_VALVE"	%Q0.2	Bool																																
"WASH_DELAY".ET		Time																																

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] Traces Name		

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] / Traces Measurements This folder is empty.		

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] / Traces Combined measurements Name		

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] PLC alarm text lists This folder is empty.		

Totally Integrated Automation Portal

PLC_1 [CPU 1214C DC/DC/DC] / Local modules

PLC_1 [CPU 1214C DC/DC/DC]

PLC_1

Project information

Name	PLC_1	Author	JohnWork	Comment	
Slot	1	Rack	0		

Catalog information

Short designation	CPU 1214C DC/DC/DC	Description	Work memory 75 KB; 24VDC power supply with DI14 x 24VDC SINK/ SOURCE, DQ10 x 24VDC and AI2 on board; 6 high-speed counters and 4 pulse outputs on board; signal board expands on-board I/O; up to 3 communication modules for serial communication; up to 8 signal modules for I/O expansion; PROFINET interface for programming, HMI and PLC-to-PLC communication	Article number	6ES7 214-1AG40-0XB0
Firmware version	V4.0		False		

Connection resources

PG communication:	1	OP communication:	1	S7 basic communication:	0
S7 communication:	0	Maximum number of S7 connection resources:	38		

Overview of addresses\Overview of addresses\Overview of addresses

Inputs	True	Outputs	True	Address gaps	False
Slot	True				

Type	Addr. from	Addr. to	Module	PIP	Device name	Device number	Size	Master / IO system	Rack	Slot
I	0	1	DI14/DQ10_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 1
O	0	1	DI14/DQ10_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 1
I	64	67	AI2_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 2
I	1000	1003	HSC_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 16
I	1004	1007	HSC_2	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 17
I	1008	1011	HSC_3	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 18
I	1012	1015	HSC_4	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 19
I	1016	1019	HSC_5	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 20
I	1020	1023	HSC_6	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 21
O	80	81	AQ1 x 12 bits_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 3
O	1000	1001	Pulse_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 32
O	1002	1003	Pulse_2	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 33
O	1004	1005	Pulse_3	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 34
O	1006	1007	Pulse_4	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 35