

Totally Integrated Automation Portal

PLC_1 [CPU 1214C DC/DC/DC]

PLC_1

Project information

Name	PLC_1	Author	OCC	Comment	
Slot	1	Rack	0		

Catalog information

Short designation	CPU 1214C DC/DC/DC	Description	Work memory 75 KB; 24VDC power supply with DI14 x 24VDC SINK/ SOURCE, DQ10 x 24VDC and AI2 on board; 6 high-speed counters and 4 pulse outputs on board; signal board expands on-board I/O; up to 3 communication modules for serial communication; up to 8 signal modules for I/O expansion; PROFINET interface for programming, HMI and PLC-to-PLC communication	Article number	6ES7 214-1AG40-0XB0
Firmware version	V4.0		False		

Connection resources

PG communication:	1	OP communication:	1	S7 basic communication:	0
S7 communication:	0	Maximum number of S7 connection resources:	38		

Overview of addresses\Overview of addresses\Overview of addresses

Inputs	True	Outputs	True	Address gaps	False
Slot	True				


Type	Addr. from	Addr. to	Module	PIP	Device name	Device number	Size	Master / IO system	Rack	Slot
I	0	1	DI14/DQ10_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 1
O	0	1	DI14/DQ10_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 1
I	64	67	AI2_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 2
I	1000	1003	HSC_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 16
I	1004	1007	HSC_2	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 17
I	1008	1011	HSC_3	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 18
I	1012	1015	HSC_4	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 19
I	1016	1019	HSC_5	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 20
I	1020	1023	HSC_6	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 21
O	80	81	AQ1 x 12 bits_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 3
O	1000	1001	Pulse_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 32
O	1002	1003	Pulse_2	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 33
O	1004	1005	Pulse_3	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 34
O	1006	1007	Pulse_4	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 35

PLC_1 [CPU 1214C DC/DC/DC] / Program blocks

Main [OB1]

Main Properties							
General							
Name	Main	Number	1	Type	OB	Language	LAD
Numbering	Automatic						
Information							
Title	"Main Program Sweep (Cycle)"	Author		Comment		Family	
Version	0.1	User-defined ID					
Name				Data type		Default value	
Temp							
Constant							

Network 1:

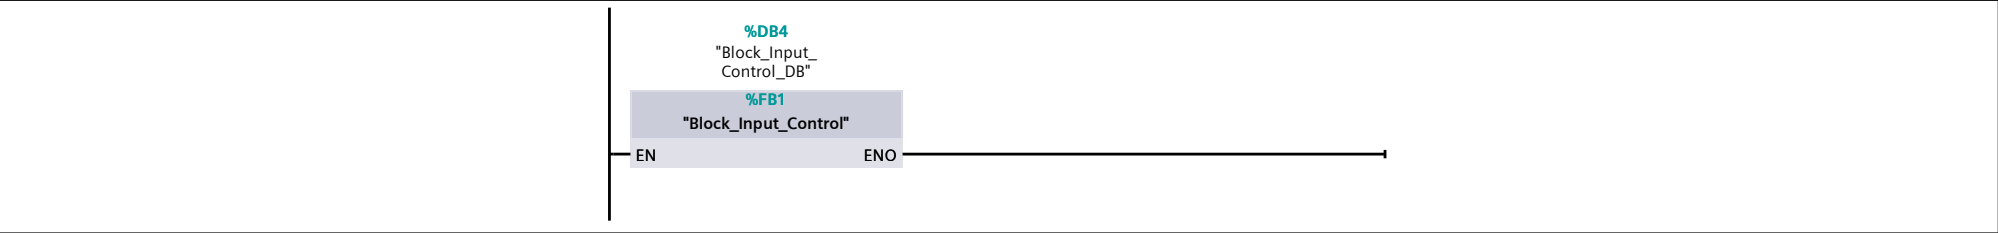

Network 2:



Totally Integrated Automation Portal

PLC_1 [CPU 1214C DC/DC/DC] / Program blocks

Data_block_HMI [DB1]

Data_block_HMI Properties

General

Name	Data_block_HMI	Number	1	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author		Comment		Family	
Version	0.1	User-defined ID					

Name	Data type	Start value	Retain
▼ Static			
HMI_CONVERT_PB	Bool	false	False
HMI_RESET_PB	Bool	false	False
HMI_ENABLE_DISABLE	Bool	false	False

Totally Integrated Automation Portal

PLC_1 [CPU 1214C DC/DC/DC] / Program blocks

Data_block_Temps [DB2]

Data_block_Temps Properties

General

Name	Data_block_Temps	Number	2	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author		Comment		Family	
Version	0.1	User-defined ID					


Name	Data type	Start value	Retain
▼ Static			
C_TEMP	DInt	0	False
C_TEMP_STORAGE	DInt	0	False
F_TEMP	DInt	0	False

PLC_1 [CPU 1214C DC/DC/DC] / Program blocks


Block_Indicators [FC1]

Block_Indicators Properties							
General							
Name	Block_Indicators	Number	1	Type	FC	Language	LAD
Numbering	Automatic						
Information							
Title		Author		Comment		Family	
Version	0.1	User-defined ID					
Name				Data type		Default value	
Input							
Output							
InOut							
Temp							
Constant							
▼ Return							
Block_Indicators				Void			


Network 1: Low Low Indicator

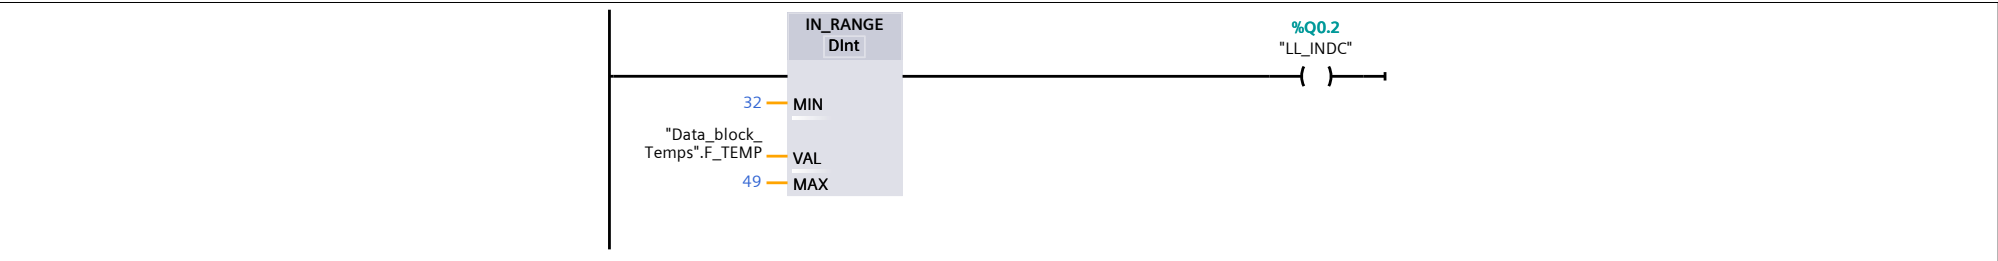


Network 2: Error Indicator

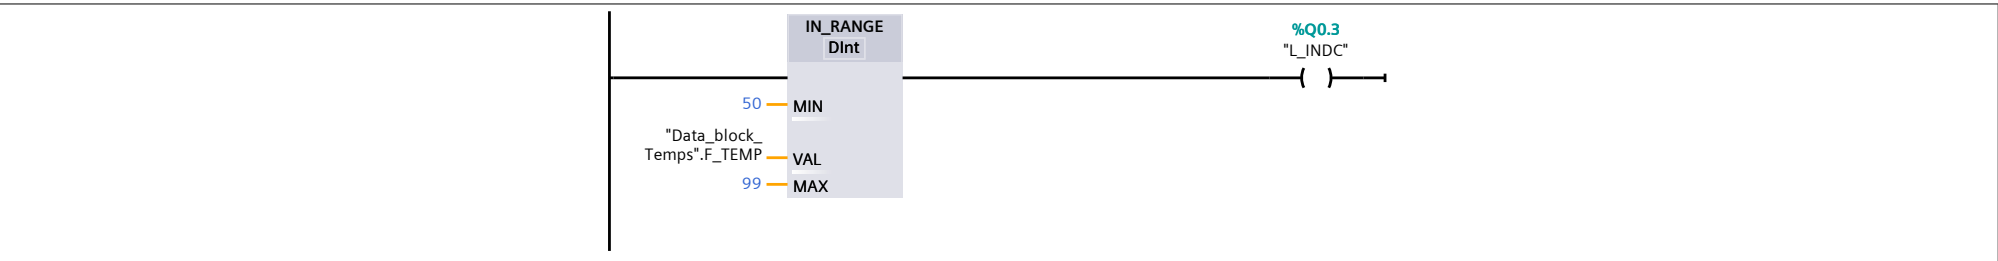


Network 3: Low Low Indicator

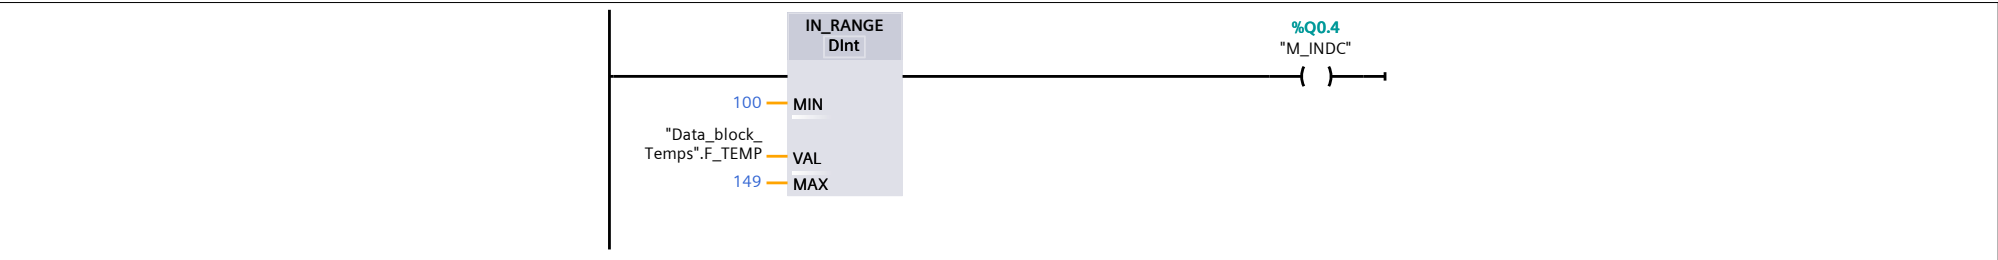

Network 4: Mid Indicator

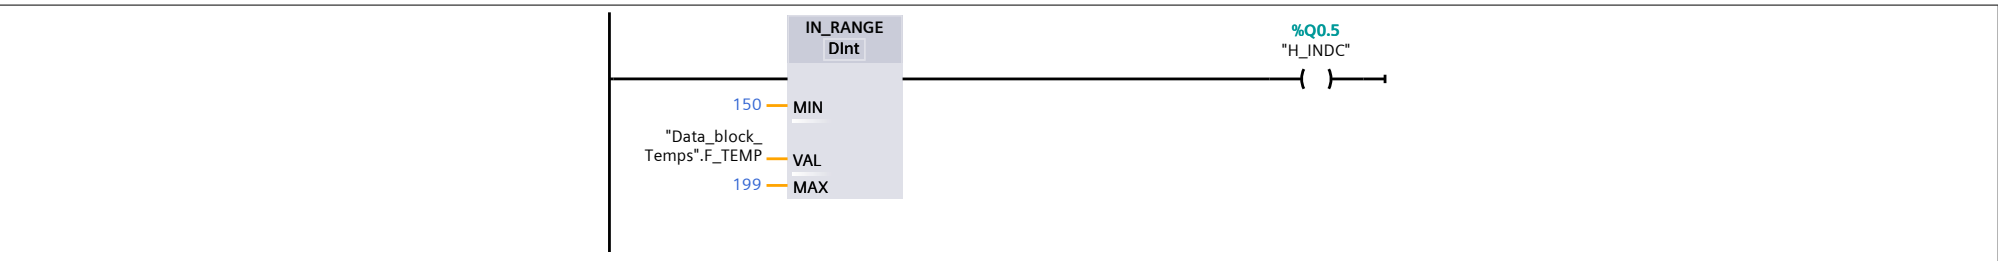

Network 5: High Indicator

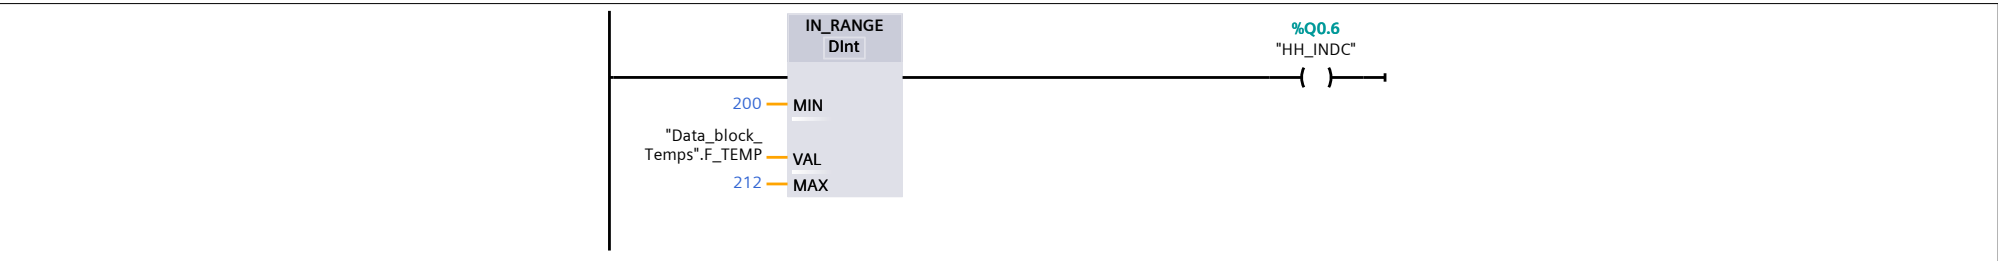


PLC_1 [CPU 1214C DC/DC/DC] / Program blocks


Block_Input_Control [FB1]

Block_Input_Control Properties							
General							
Name	Block_Input_Control	Number	1	Type	FB	Language	LAD
Numbering	Automatic						
Information							
Title		Author		Comment		Family	
Version	0.1	User-defined ID					
Name			Data type	Default value		Retain	
Input							
Output							
InOut							
▼ Static							
ONE_SHOT_CONTROL			Bool	false		Non-retain	
HMI_ONE_SHOT_CONTROL			Bool	false		Non-retain	
INTERNAL_CONVERT			Bool	false		Non-retain	
Temp							
Constant							


Network 1: Internal Control, Enable Convert

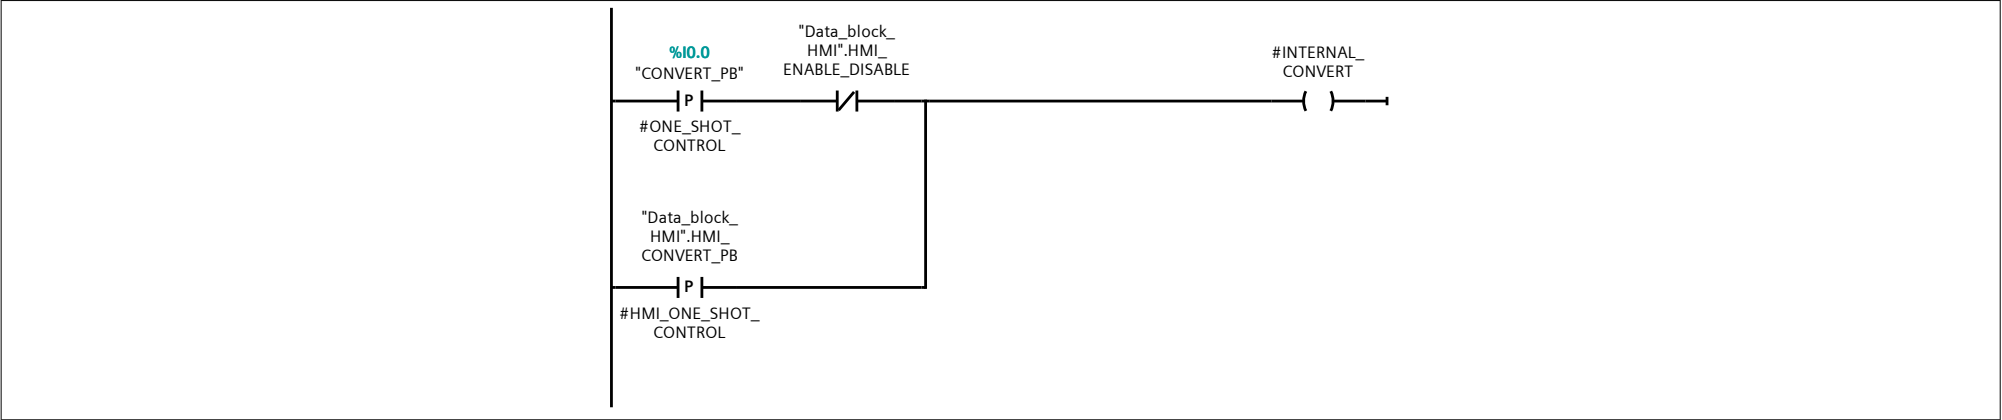


Network 2: Error Indicator

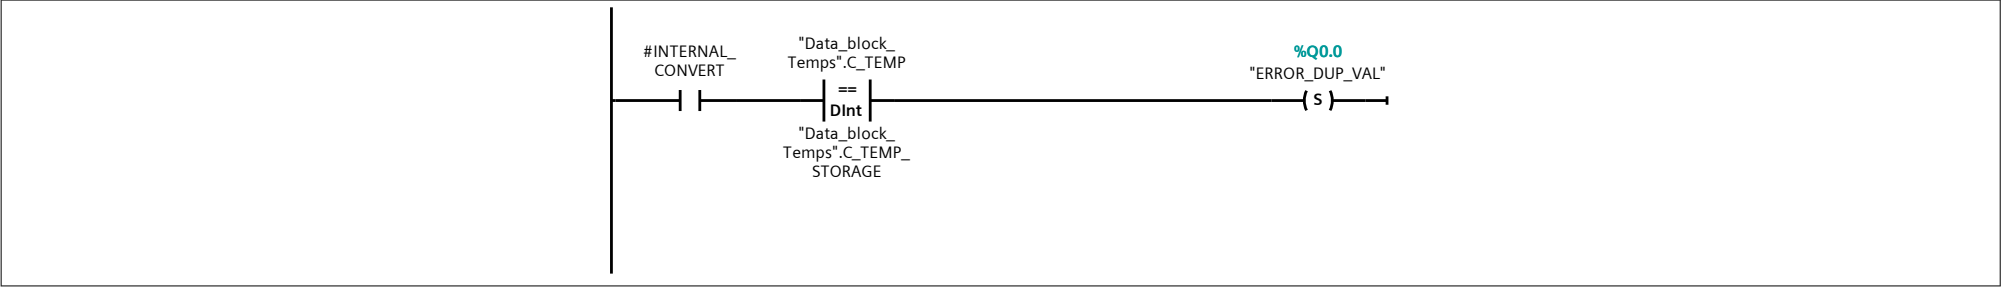


Network 3: Error Indicator

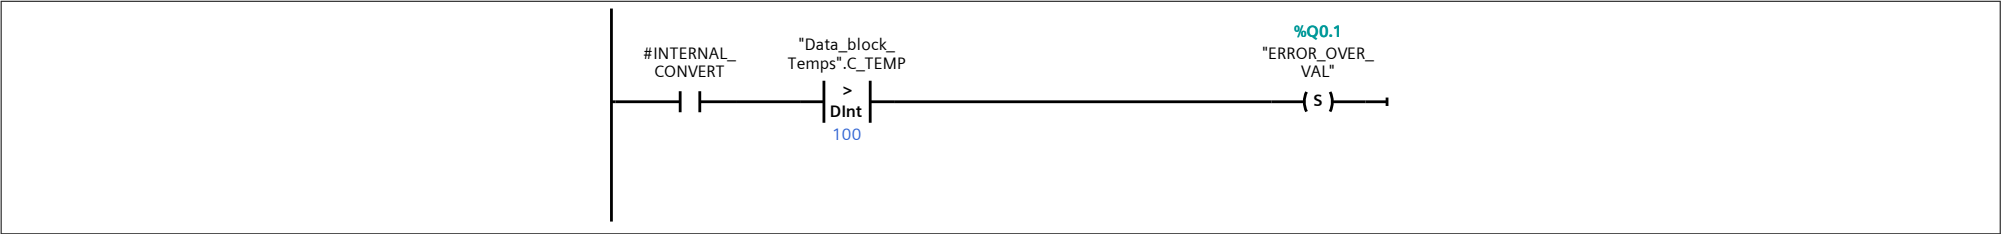


Network 4: Error Indicator

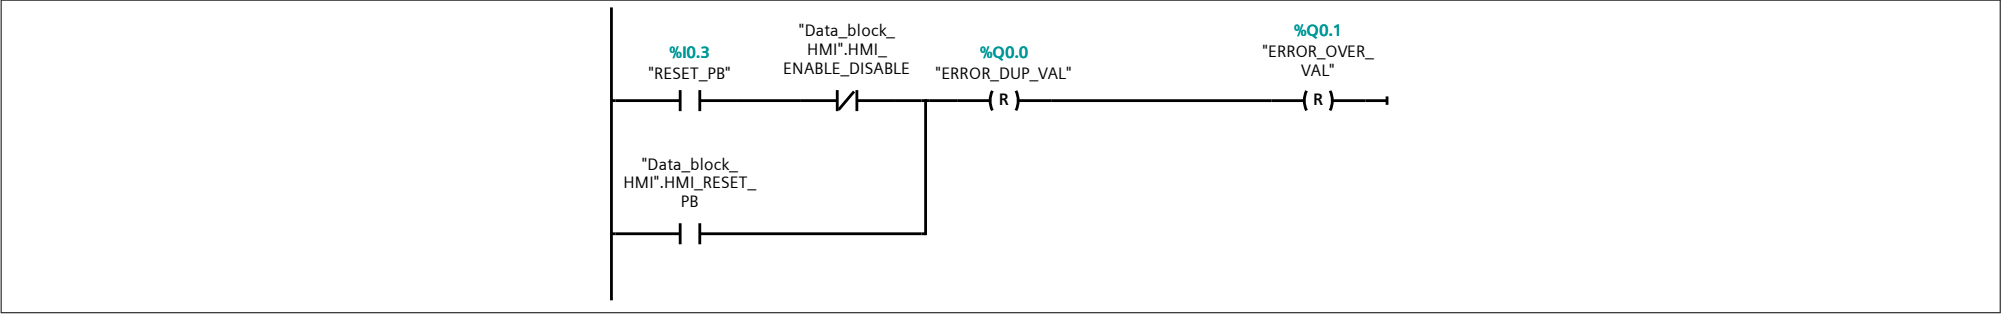

Network 5:

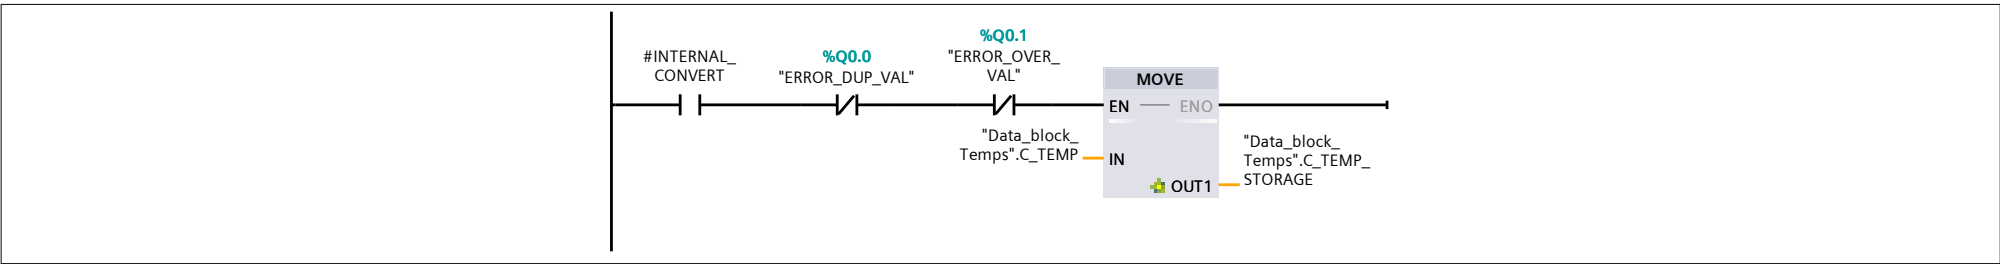

Network 6:

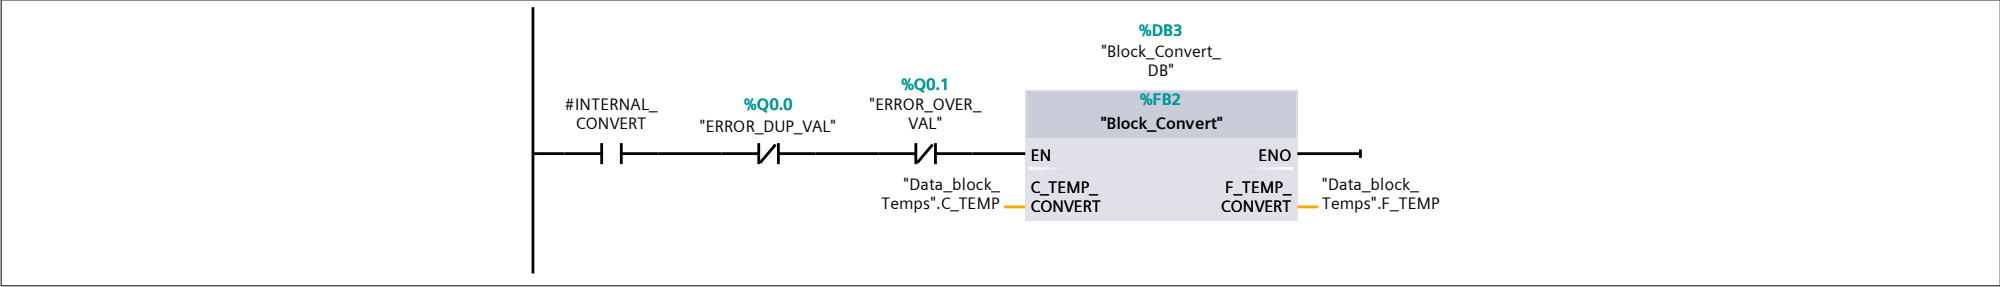


PLC_1 [CPU 1214C DC/DC/DC] / Program blocks

Block_Convert [FB2]

Block_Convert Properties							
General							
Name	Block_Convert	Number	2	Type	FB	Language	LAD
Numbering	Automatic						
Information							
Title		Author		Comment		Family	
Version	0.1	User-defined ID					
Name			Data type	Default value		Retain	
▼ Input							
C_TEMP_CONVERT			DInt	0		Non-retain	
▼ Output							
F_TEMP_CONVERT			DInt	0		Non-retain	
InOut							
▼ Static							
MUL_RESULT			DInt	0		Non-retain	
DIV_RESULT			DInt	0		Non-retain	
Temp							
Constant							

Network 1:

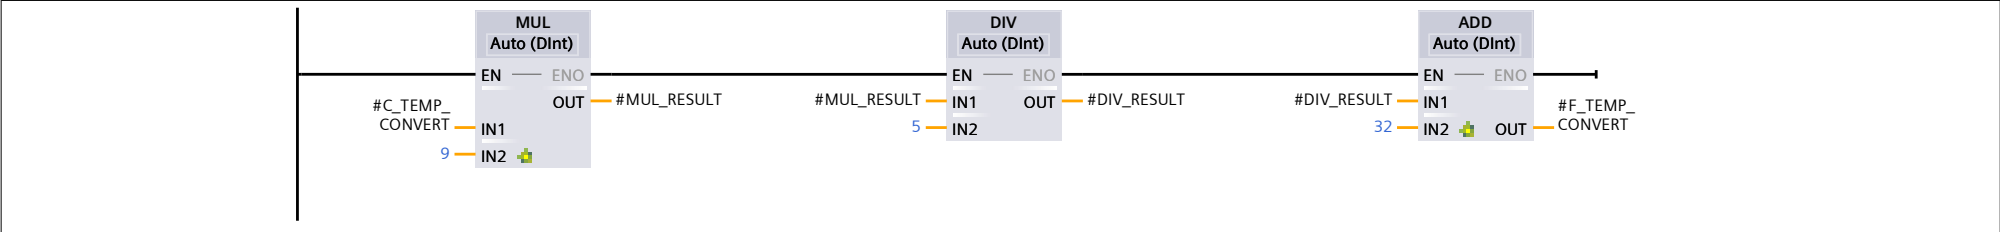

Totally Integrated Automation Portal

PLC_1 [CPU 1214C DC/DC/DC] / Program blocks

Block_Convert_DB [DB3]

Block_Convert_DB Properties

General

Name	Block_Convert_DB	Number	3	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author		Comment		Family	
Version	0.1	User-defined ID					

Name	Data type	Start value	Retain
▼ Input			
C_TEMP_CONVERT	DInt	0	False
▼ Output			
F_TEMP_CONVERT	DInt	0	False
InOut			
▼ Static			
MUL_RESULT	DInt	0	False
DIV_RESULT	DInt	0	False

Totally Integrated Automation Portal

PLC_1 [CPU 1214C DC/DC/DC] / Program blocks

Block_Input_Control_DB [DB4]

Block_Input_Control_DB Properties

General

Name	Block_Input_Control_DB	Number	4	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author		Comment		Family	
Version	0.1	User-defined ID					

Name	Data type	Start value	Retain
Input			
Output			
InOut			
▼ Static			
ONE_SHOT_CONTROL	Bool	false	False
HMI_ONE_SHOT_CONTROL	Bool	false	False
INTERNAL_CONVERT	Bool	false	False

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] Technology objects This folder is empty.		

Totally Integrated Automation Portal																																																				
PLC_1 [CPU 1214C DC/DC/DC] / PLC tags / Default tag table [36] PLC tags PLC tags <table><tr><th></th><th>Name</th><th>Data type</th><th>Address</th><th>Retain</th></tr><tr><td></td><td>CONVERT_PB</td><td>Bool</td><td>%I0.0</td><td>False</td></tr><tr><td></td><td>RESET_PB</td><td>Bool</td><td>%I0.3</td><td>False</td></tr><tr><td></td><td>ERROR_DUP_VAL</td><td>Bool</td><td>%Q0.0</td><td>False</td></tr><tr><td></td><td>ERROR_OVER_VAL</td><td>Bool</td><td>%Q0.1</td><td>False</td></tr><tr><td></td><td>LL_INDC</td><td>Bool</td><td>%Q0.2</td><td>False</td></tr><tr><td></td><td>L_INDC</td><td>Bool</td><td>%Q0.3</td><td>False</td></tr><tr><td></td><td>M_INDC</td><td>Bool</td><td>%Q0.4</td><td>False</td></tr><tr><td></td><td>H_INDC</td><td>Bool</td><td>%Q0.5</td><td>False</td></tr><tr><td></td><td>HH_INDC</td><td>Bool</td><td>%Q0.6</td><td>False</td></tr></table>				Name	Data type	Address	Retain		CONVERT_PB	Bool	%I0.0	False		RESET_PB	Bool	%I0.3	False		ERROR_DUP_VAL	Bool	%Q0.0	False		ERROR_OVER_VAL	Bool	%Q0.1	False		LL_INDC	Bool	%Q0.2	False		L_INDC	Bool	%Q0.3	False		M_INDC	Bool	%Q0.4	False		H_INDC	Bool	%Q0.5	False		HH_INDC	Bool	%Q0.6	False
	Name	Data type	Address	Retain																																																
	CONVERT_PB	Bool	%I0.0	False																																																
	RESET_PB	Bool	%I0.3	False																																																
	ERROR_DUP_VAL	Bool	%Q0.0	False																																																
	ERROR_OVER_VAL	Bool	%Q0.1	False																																																
	LL_INDC	Bool	%Q0.2	False																																																
	L_INDC	Bool	%Q0.3	False																																																
	M_INDC	Bool	%Q0.4	False																																																
	H_INDC	Bool	%Q0.5	False																																																
	HH_INDC	Bool	%Q0.6	False																																																

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] PLC data types This folder is empty.		

Totally Integrated Automation Portal										
PLC_1 [CPU 1214C DC/DC/DC] / Watch and force tables Force table <table><thead><tr><th>Name</th><th>Address</th><th>Display format</th><th>Force value</th></tr></thead><tbody><tr><td>"Data_block_Temps".C_TEMP</td><td></td><td>DEC+/-</td><td></td></tr></tbody></table>			Name	Address	Display format	Force value	"Data_block_Temps".C_TEMP		DEC+/-	
Name	Address	Display format	Force value							
"Data_block_Temps".C_TEMP		DEC+/-								

Totally Integrated Automation Portal

PLC_1 [CPU 1214C DC/DC/DC] / Watch and force tables

TomWatch

Name	Address	Display format	Modify value
"Data_block_Temps".C_TEMP		DEC+/-	50
"Data_block_Temps".F_TEMP		DEC+/-	
"Block_Convert_DB".F_TEMP_CONVERT		DEC+/-	
"Block_Convert_DB".F_TEMP_CONVERT		DEC+/-	

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] Traces Name		

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] / Traces Measurements This folder is empty.		

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] / Traces Combined measurements Name		

Totally Integrated Automation Portal		
PLC_1 [CPU 1214C DC/DC/DC] PLC alarm text lists This folder is empty.		

PLC_1 [CPU 1214C DC/DC/DC] / Local modules

PLC_1 [CPU 1214C DC/DC/DC]

PLC_1											
Project information											
Name		PLC_1			Author		OCC		Comment		
Slot		1			Rack		0				
Catalog information											
Short designation		CPU 1214C DC/DC/DC			Description		Work memory 75 KB; 24VDC power supply with DI14 x 24VDC SINK/ SOURCE, DQ10 x 24VDC and AI2 on board; 6 high-speed counters and 4 pulse outputs on board; signal board expands on-board I/O; up to 3 communication modules for serial communication; up to 8 signal modules for I/O expansion; PROFINET interface for programming, HMI and PLC-to-PLC communication		Article number		6ES7 214-1AG40-0XB0
Firmware version		V4.0					False				
Connection resources											
PG communication:		1			OP communication:		1		S7 basic communication:		0
S7 communication:		0			Maximum number of S7 connection resources:		38				
Overview of addresses\Overview of addresses\Overview of addresses											
Inputs		True			Outputs		True		Address gaps		False
Slot		True									
Type	Addr. from	Addr. to	Module	PIP	Device name	Device number	Size	Master / IO system	Rack	Slot	
I	0	1	DI14/DQ10_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 1	
O	0	1	DI14/DQ10_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 1	
I	64	67	AI2_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 2	
I	1000	1003	HSC_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 16	
I	1004	1007	HSC_2	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 17	
I	1008	1011	HSC_3	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 18	
I	1012	1015	HSC_4	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 19	
I	1016	1019	HSC_5	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 20	
I	1020	1023	HSC_6	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	4 Bytes	-	0	1 21	
O	80	81	AQ1 x 12 bits_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 3	
O	1000	1001	Pulse_1	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 32	
O	1002	1003	Pulse_2	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 33	
O	1004	1005	Pulse_3	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 34	
O	1006	1007	Pulse_4	Automatic update	PLC_1 [CPU 1214C DC/DC/DC]	-	2 Bytes	-	0	1 35	