

STUDIO 5000 - ANALOG IN LAB: INPUT CONDITIONS LIST WORKSHEET


An instruction with a single **asterisk *** is within the holding circuit.

Instructions with double **asterisks **** are in parallel.

COMPLETE THE INSTRUCTIONS AND TAGS


MAIN ROUTINE

RUNG 0:

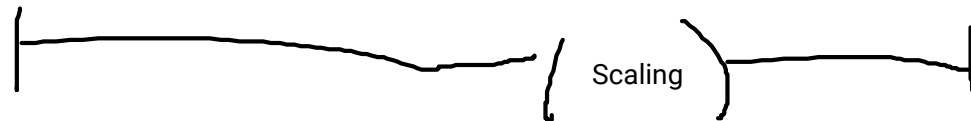

Unconditional Call to routine **Scaling**

RUNG 1:

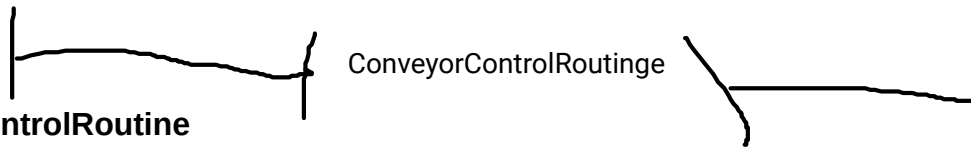

Unconditional Call to routine **ConveyorControlRoutine**

SCALING ROUTINE


RUNG 0:

Add-On Instruction HEIGHT_SCALE

CONVEYOR CONTROL ROUTINE


RUNG 0: CONVEYOR MOTOR (Requires holding circuit)

	ERROR	Part feed error indicator to break the holding circuit.
	STOP N.C. PUSHBUTTON	Stop pushbutton to break the holding circuit.
 *	START N.O. PUSHBUTTON	Start pushbutton to break the holding circuit.
	CONVEYOR MOTOR	Holding Circuit

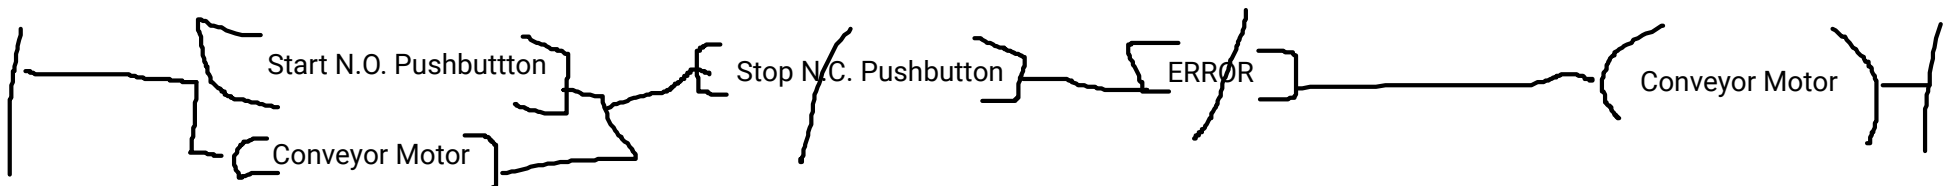

RUNG 1:

PART A ERROR

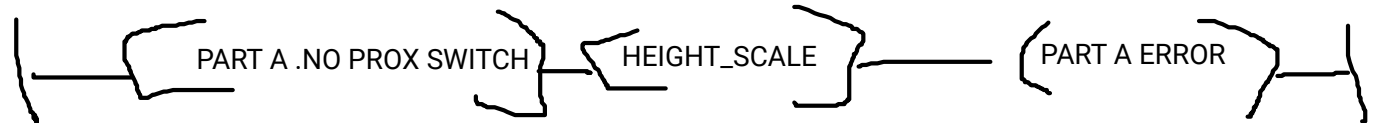

[]

PART A N.O. PROXIMITY SWITCH

Input proximity switch that detects part A.


[]

HEIGHT_SCALE

An instruction that determines if the height sensors reads a value that is at or above for a set point for a double part A.

RUNG 2:

PART B ERROR



[]

PART B N.O. PROXIMITY SWITCH

Input proximity switch that detects part B.

[]

HEIGHT_SCALE

An instruction that determines if the height sensors reads a value that is at or above for a set point for a double part B.

RUNG 3:

ERROR (Latched Output)

[] **


PART_A_ERROR

PART A ERROR detected.

[] **

PART_B_ERROR

PART B ERROR detected.

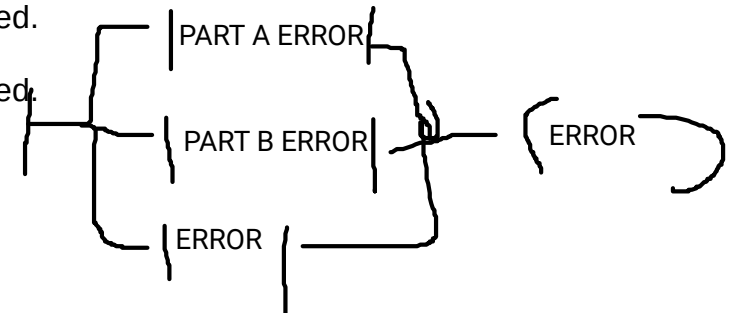

RUNG 4:

ERROR (Unlatched Output)

[]

Reset N.O. Pushbutton

Input for operator reset.

