



Studio 5000 Temperature Conversion

Routine: InputControlRoutine

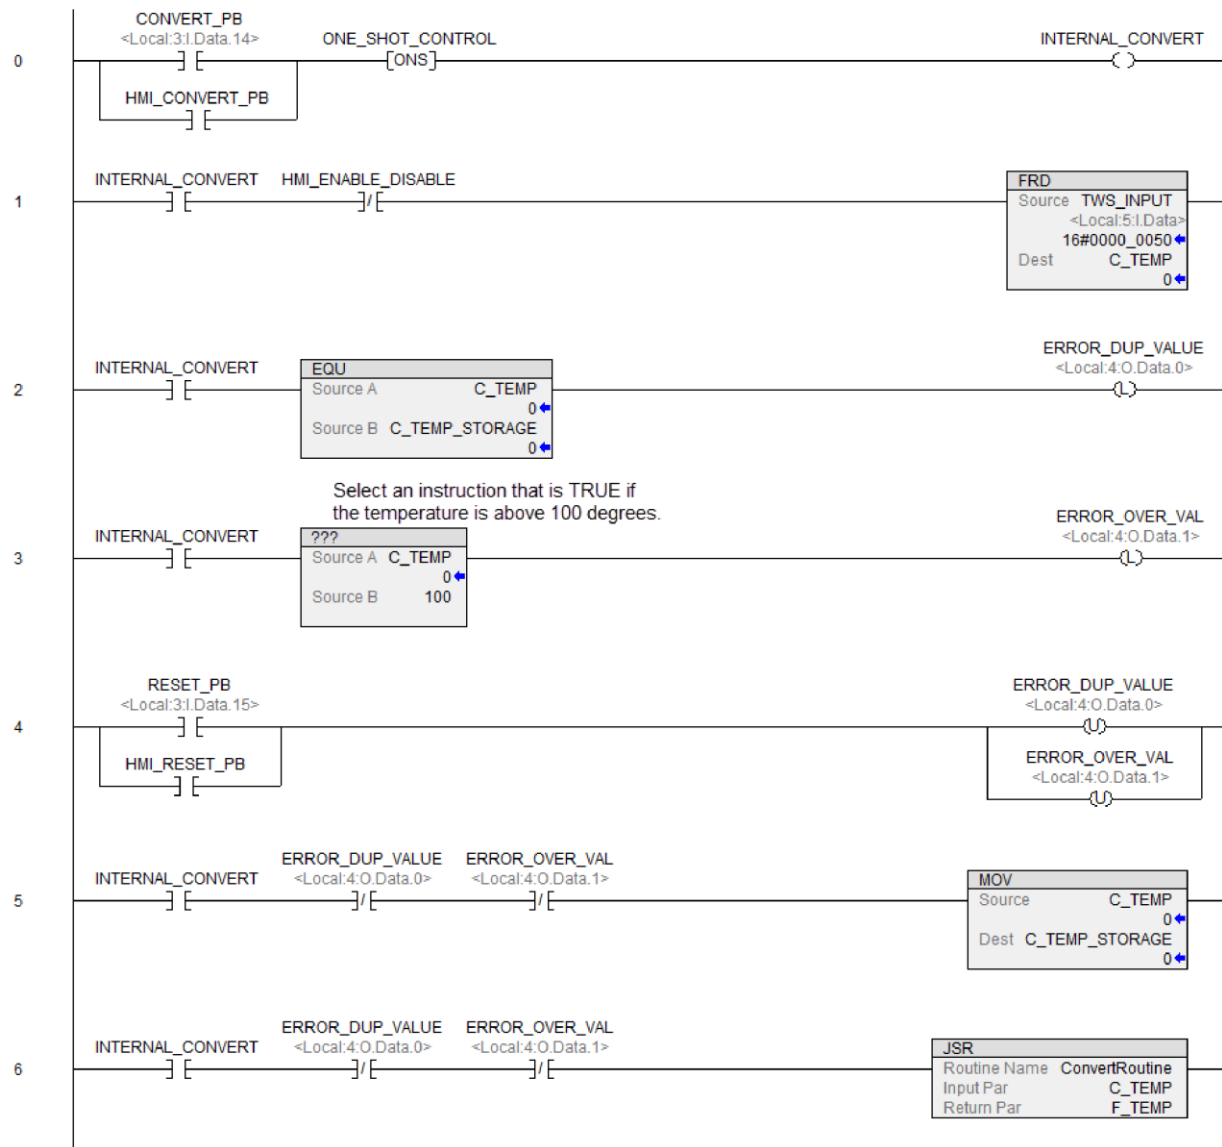


Routine: ConvertRoutine

The C_TEMP tag value is passed to the Tag C_TEMP_CONVERT to be used as the Celsius value in the calculation.





F_TEMP_CONVERT tag, the resulting Fahrenheit value, is returned to tag F_TEMP.

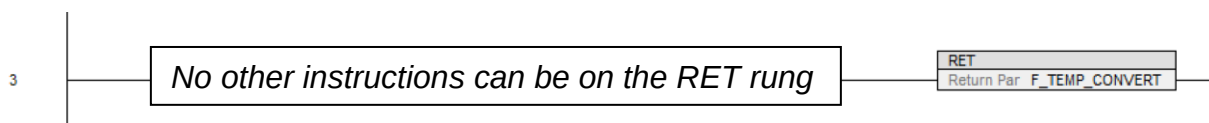

Siemens Temperature Conversion

Function Block: Block_Input_Control

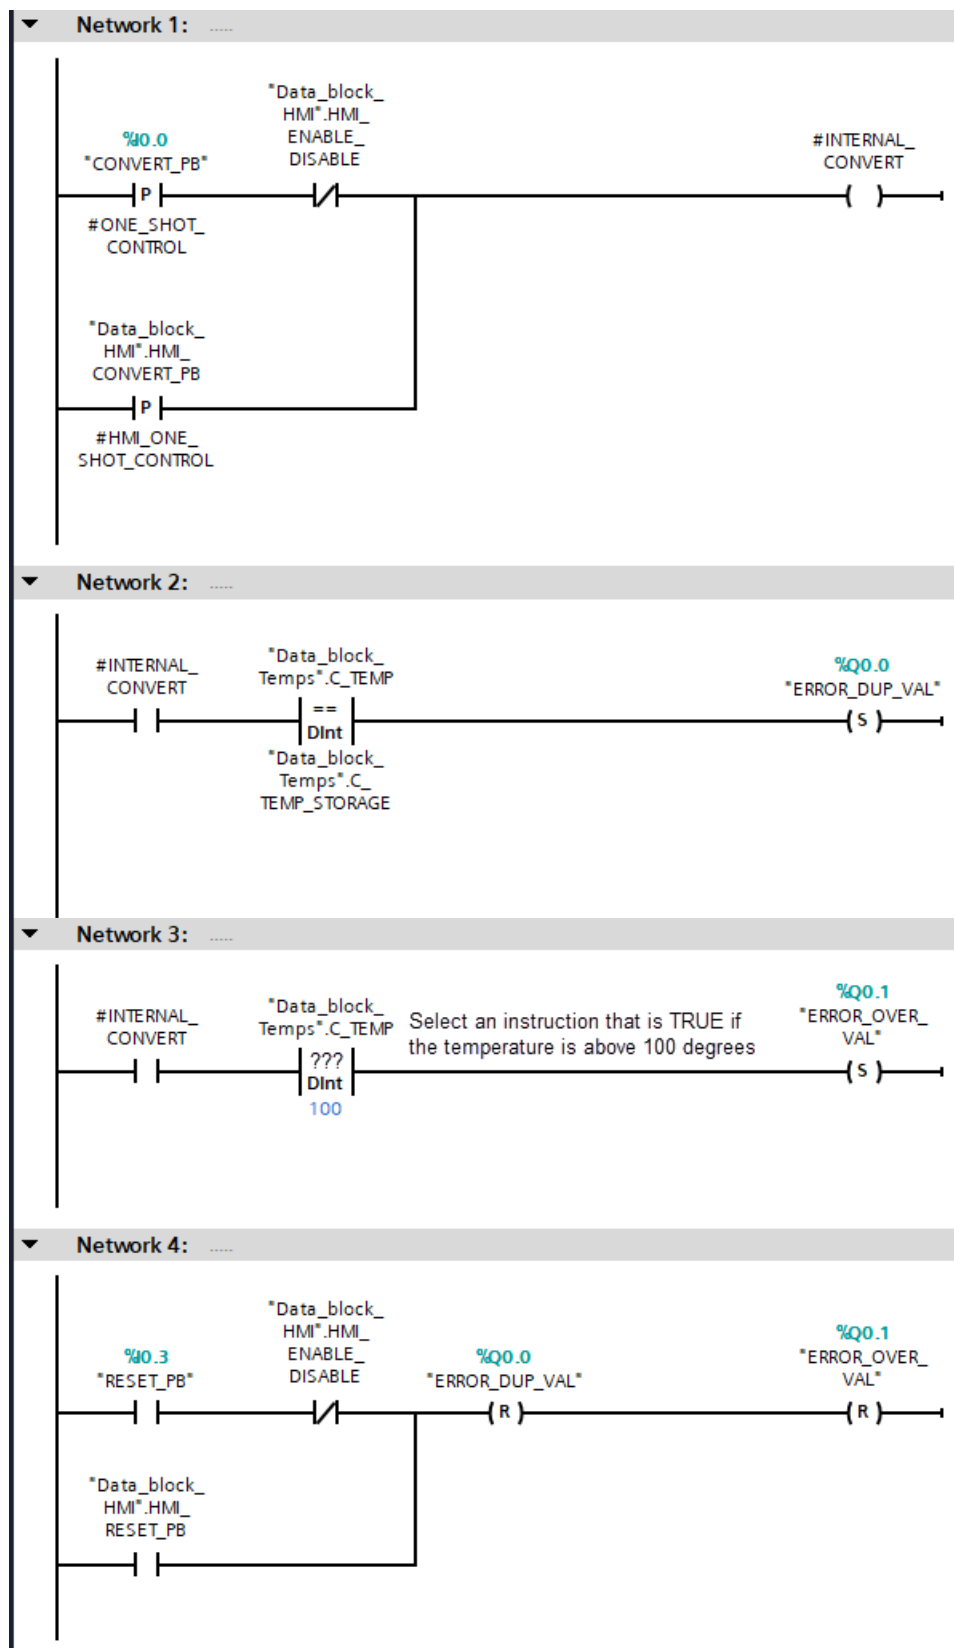

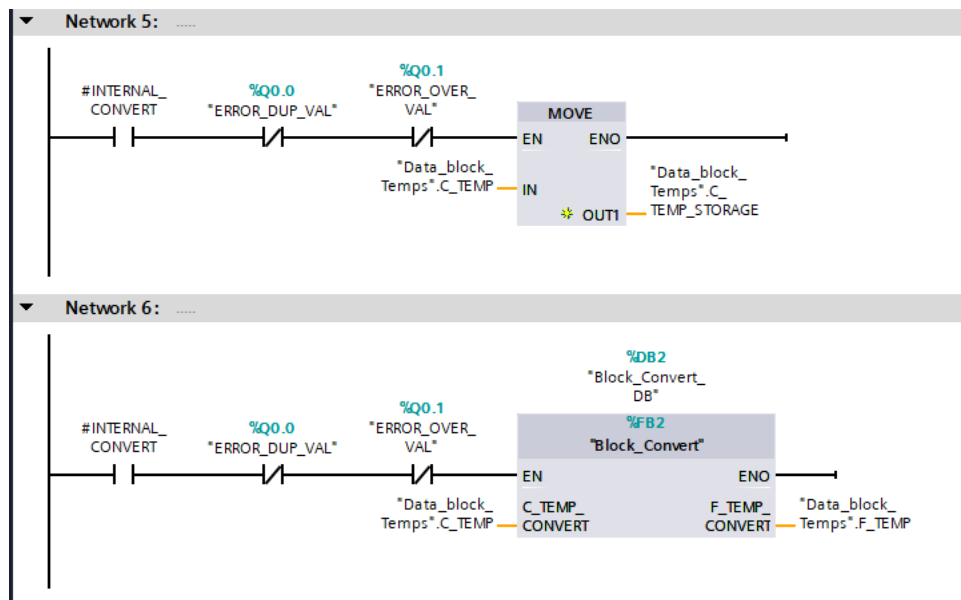

Function Block: Block_Convert

CONVERT ▸ PLC_1 [CPU 1214C DC/DC/DC] ▸ Program blocks ▸ Block_Convert [FB2]

Name	Data type	Default value	Retain	Accessible f...	Writa...	Visible in ...	Setpoint	Comment
Input								
1 C_TEMP_CONVERT	DInt	0	Non-ret...	☒	☒	☒	☐	
Output								
4 F_TEMP_CONVERT	DInt	0	Non-retain	☒	☒	☒	☐	
Static								
8 MUL_RESULT	DInt	0	Non-retain	☒	☒	☒	☐	
9 DIV_RESULT	DInt	0	Non-retain	☒	☒	☒	☐	
Temp								

Block title:

Comment:

Network 1:

Comment:

```

    graph LR
      IN1["C_TEMP_CONVERT IN1"] --> MUL["MUL DInt"]
      IN2["F_TEMP_CONVERT IN2"] --> MUL
      MUL --> OUT1["MUL OUT"]
      OUT1 --> IN1_2["DIV IN1"]
      IN2_2["F_TEMP_CONVERT IN2"] --> DIV["DIV DInt"]
      DIV --> OUT2["DIV OUT"]
      OUT2 --> IN1_3["ADD IN1"]
      IN2_3["F_TEMP_CONVERT IN2"] --> ADD["ADD DInt"]
      ADD --> OUT3["ADD OUT"]
      OUT3 --> OUT["F_TEMP_CONVERT"]
  
```

Complete the logic's Tags and Values assignments.

When “Block_Convert” is called, the tag C_TEMP is passed as an Input Instance to the local tag C_TEMP_CONVERT to be used as the Celsius value in the calculation.

When the calculation is completed, the local tag F_TEMP_CONVERT the resulting Fahrenheit value, is passed as an Output Instance to the tag F_TEMP.