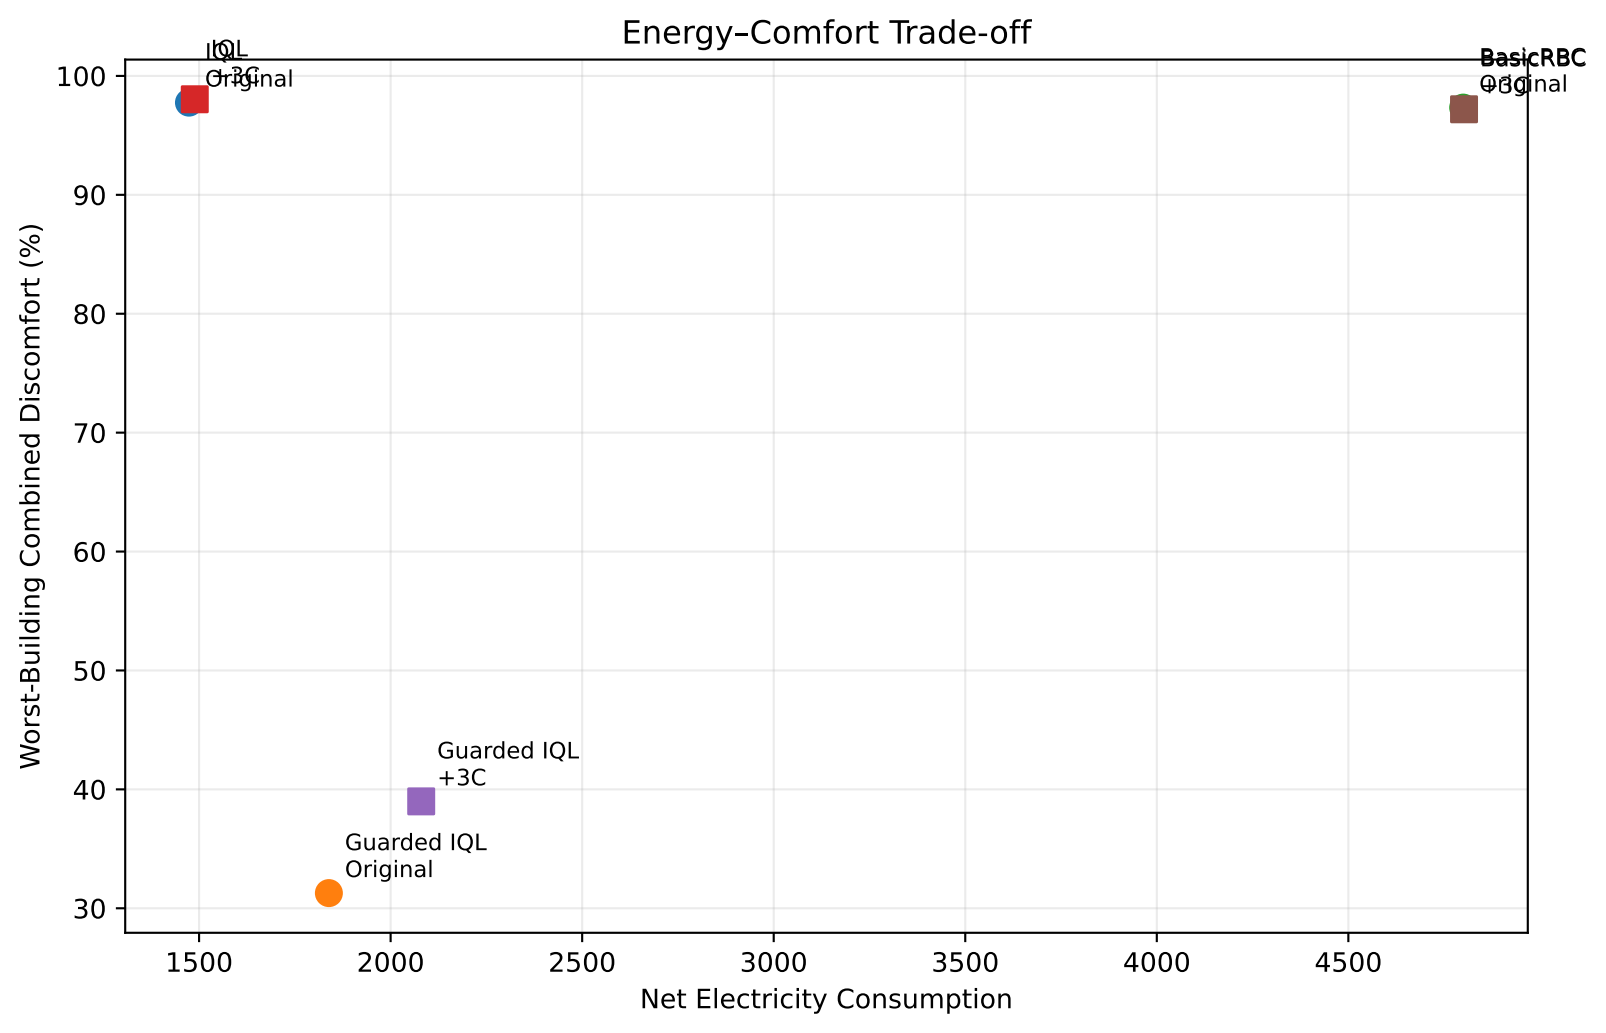
Energy–Comfort Trade-off
Worst-Building Combined Discomfort (%)
Net Electricity Consumption
100
90
80
70
60
50
40
30
1500
2000
2500
3000
3500
4000
4500
IQL
Original
IQL
+3C
BasicRBC
Original
BasicRBC
+3C
Guarded IQL
+3C
Guarded IQL
Original