PLAN

SCALE 1:500

0 — 25 m

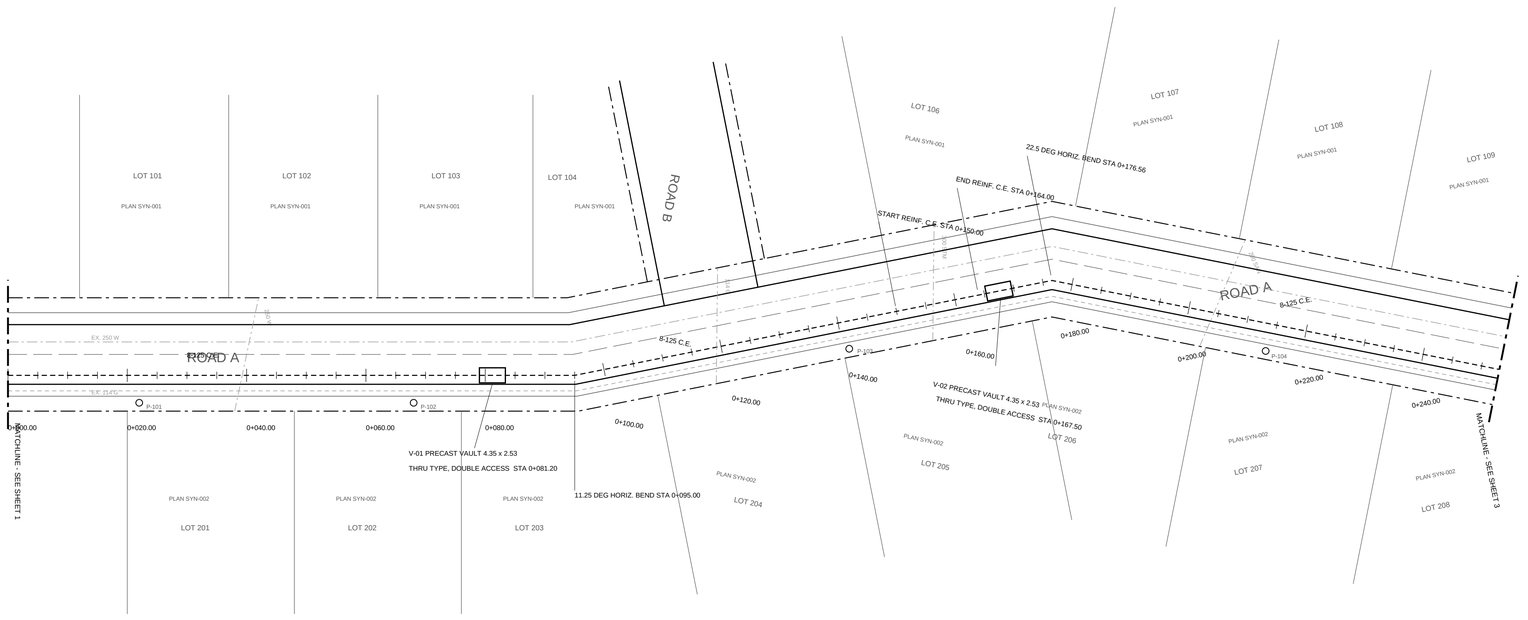

PROFILE

H 1:500 V 1:100

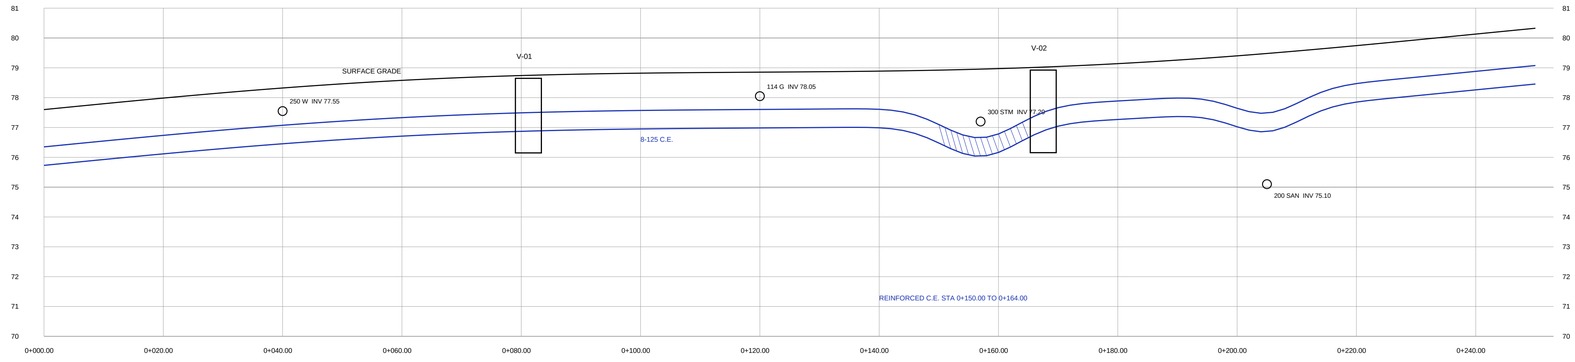

GENERAL NOTES

1. ALL DIMENSIONS IN METRES UNLESS NOTED. STATIONS ALONG DUCT CENTRELINE.
2. MIN. COVER 1.0 m TO TOP OF CONCRETE ENCASEMENT (C.E.).
3. MAINTAIN 0.9 m HORIZONTAL AND 0.3 m VERTICAL SEPARATION FROM OTHER UTILITIES.
4. REINFORCED C.E. REQUIRED WHERE DUCT PASSES BELOW A RIGID UTILITY.
5. STUB DUCTS 1.5 m FROM EACH VAULT WALL.
6. EXISTING UTILITIES SHOWN FOR REFERENCE ONLY. LOCATE BEFORE EXCAVATION.
7. RESTORE TRENCH SURFACE: TRENCH WIDTH PLUS 0.2 m EACH SIDE.

DUCT SCHEDULE

RUN	ID	FROM	TO	LENGTH m
RUN 1	S-M1	0+005.00	0+078.40	75.0
RUN 2	S-M2	0+084.00	0+150.00	66.0
RUN 3	S-RCE1	0+150.00	0+164.00	14.0
RUN 4	S-M3	0+171.00	0+246.00	75.0

LEGEND

- PROPOSED DUCT (C.E.)
- CURB
- PROPERTY LINE
- EX. WATER
- EX. GAS

SYNTHETIC TRAINING SHEET
NOT A REAL PROJECT. Every street, lot, station, elevation, structure and length on this sheet is invented. No owner, no site, no tender.

UNDERGROUND DUCT AND STRUCTURES

ROAD A STA 0+000 TO 0+253.03

PLAN AND PROFILE

DWG NO. SYN-U-0002 REV A