



TCN19-270, normalized during counting

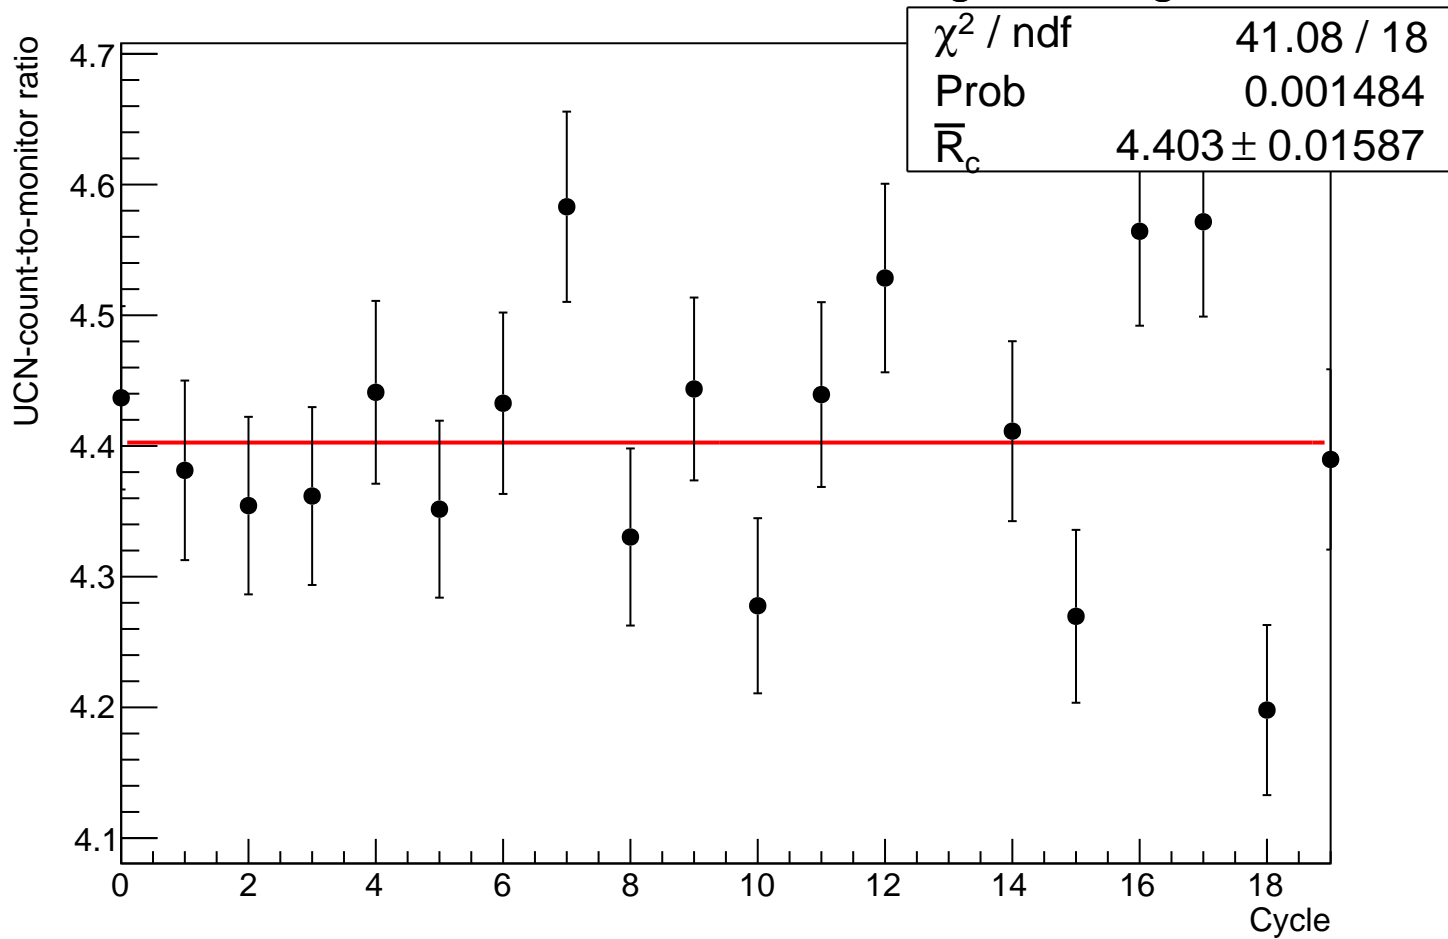


TCN19-270, normalized during irradiation

χ^2 / ndf 8.256 / 18
Prob 0.9746
 \overline{R}_i 2.911 ± 0.01383


UCN-count-to-monitor ratio

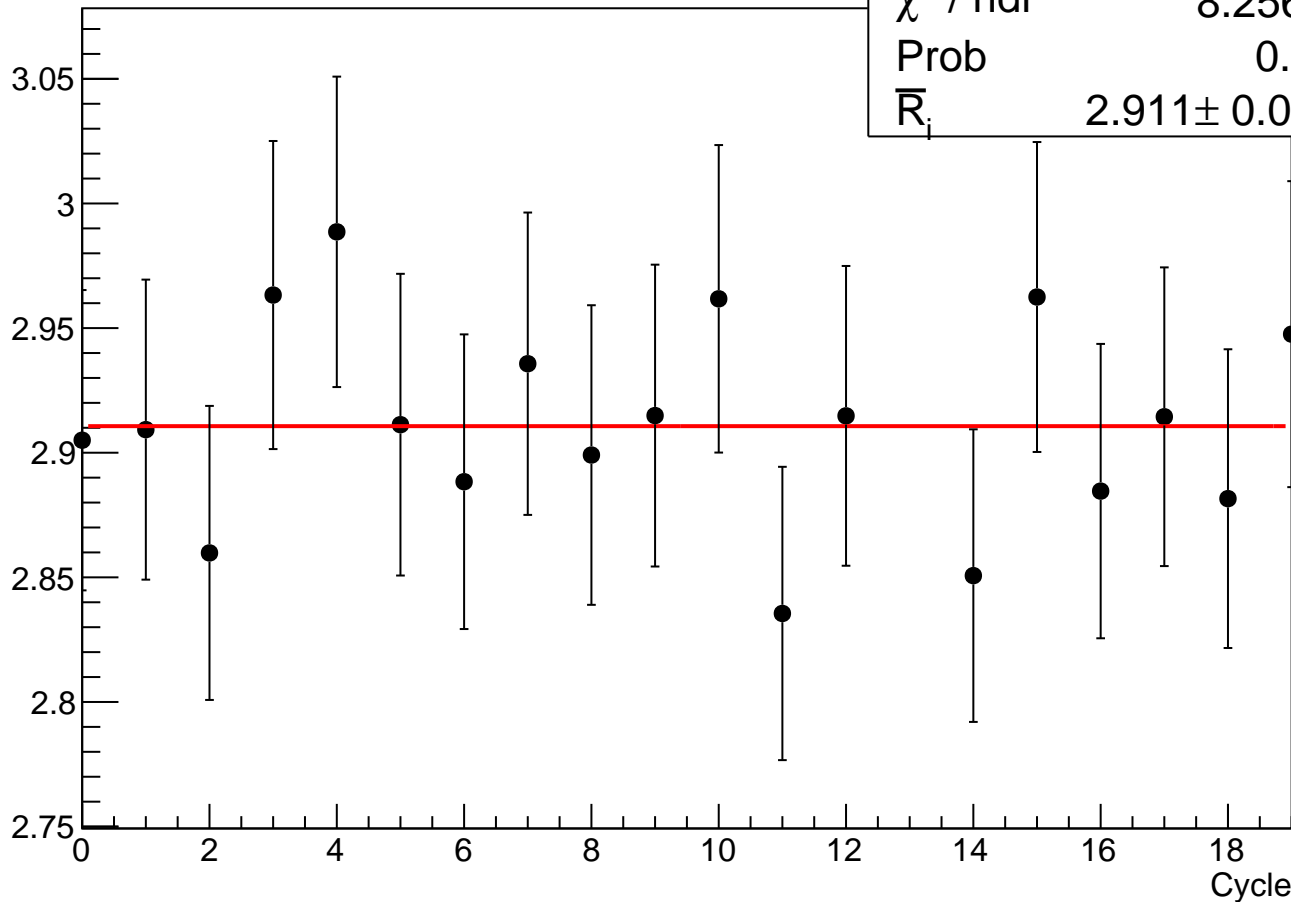


Graph

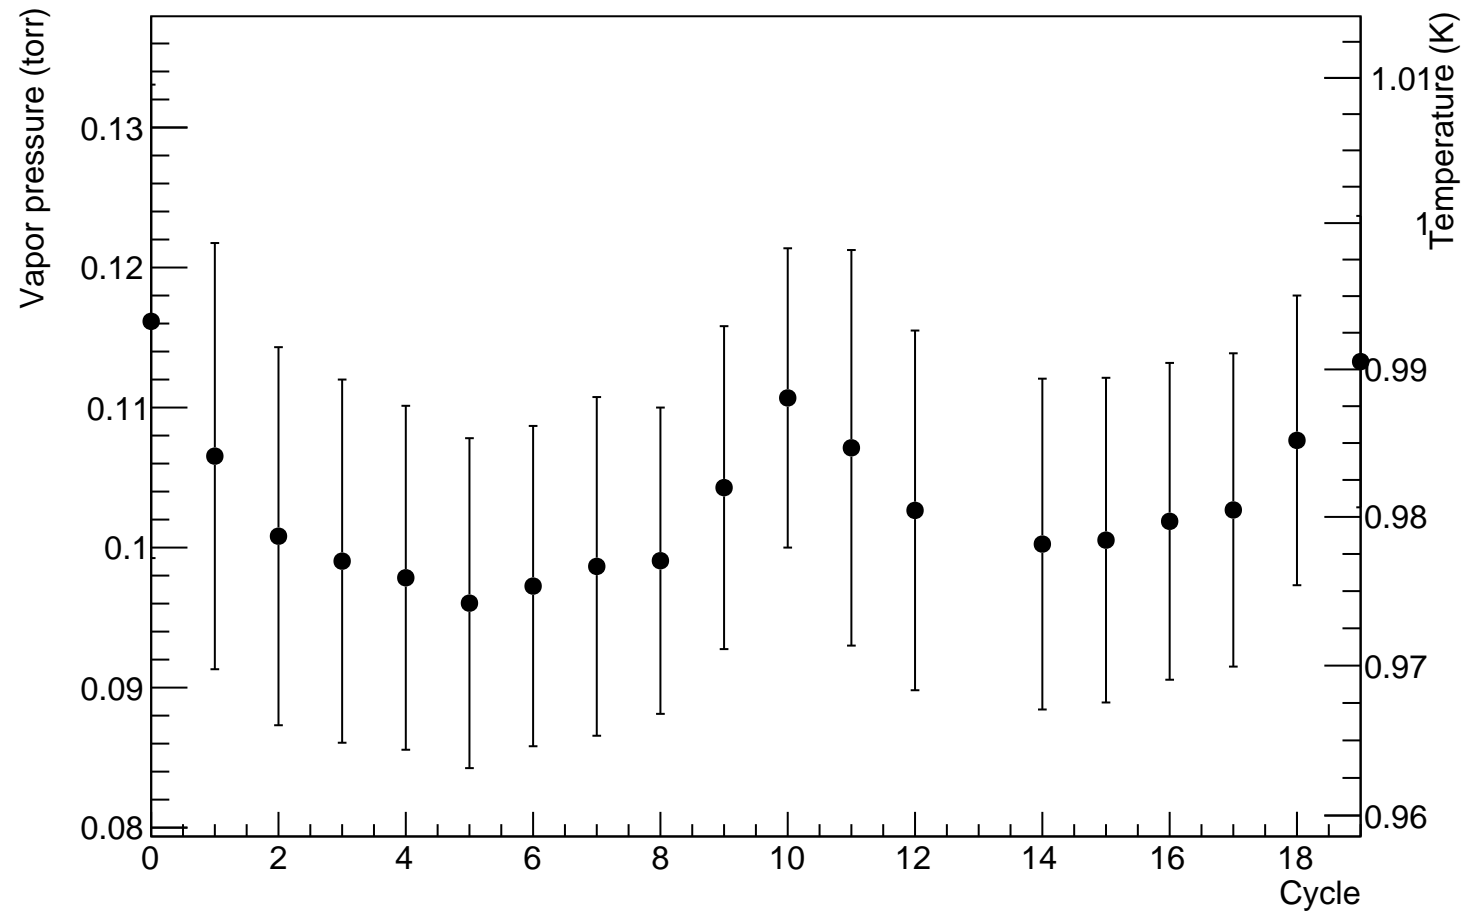


li6 background rate (1/s)

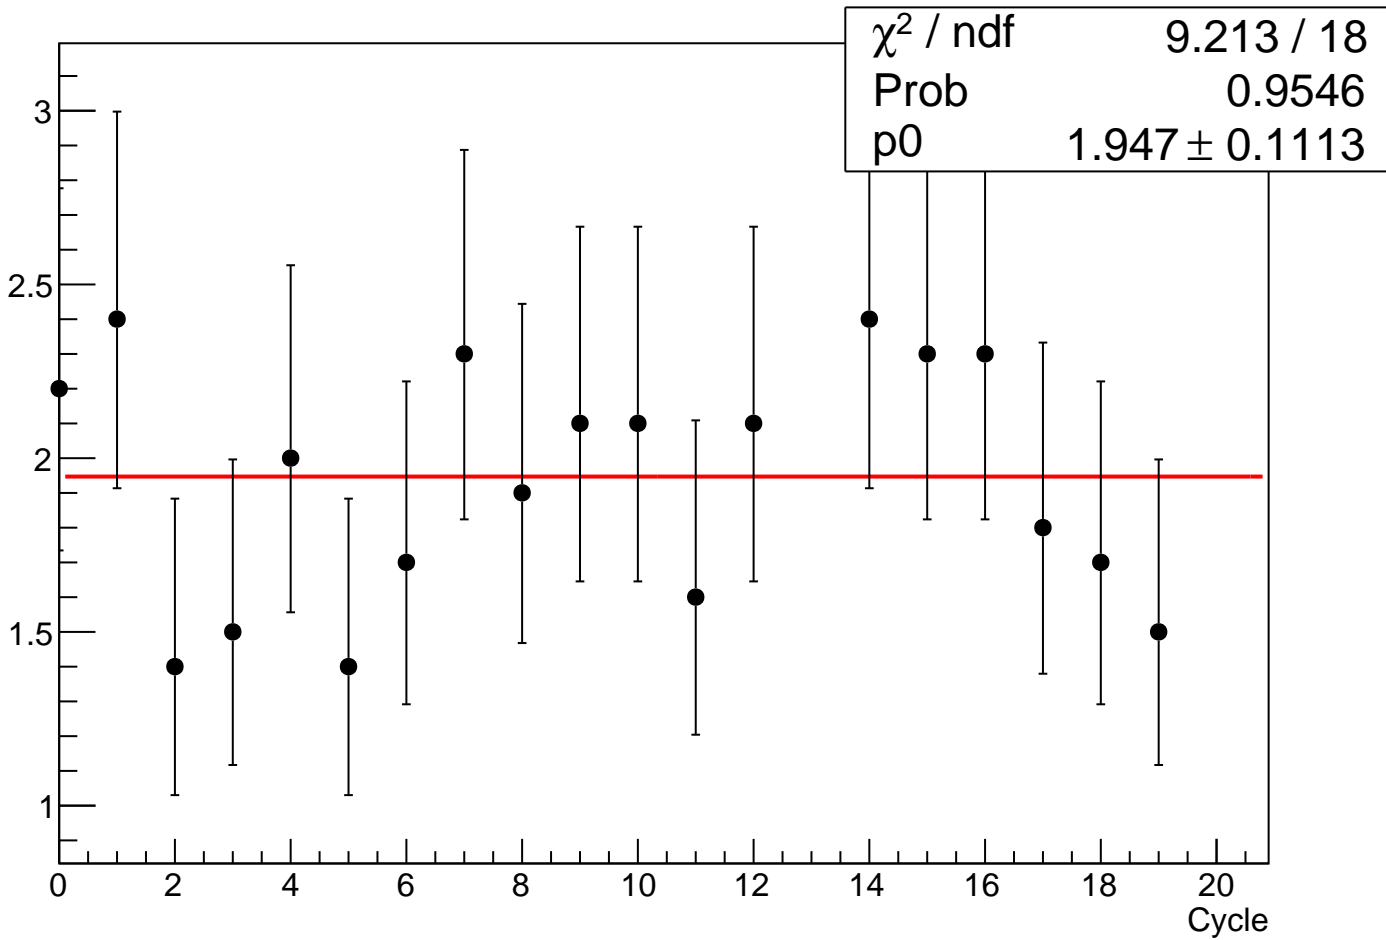


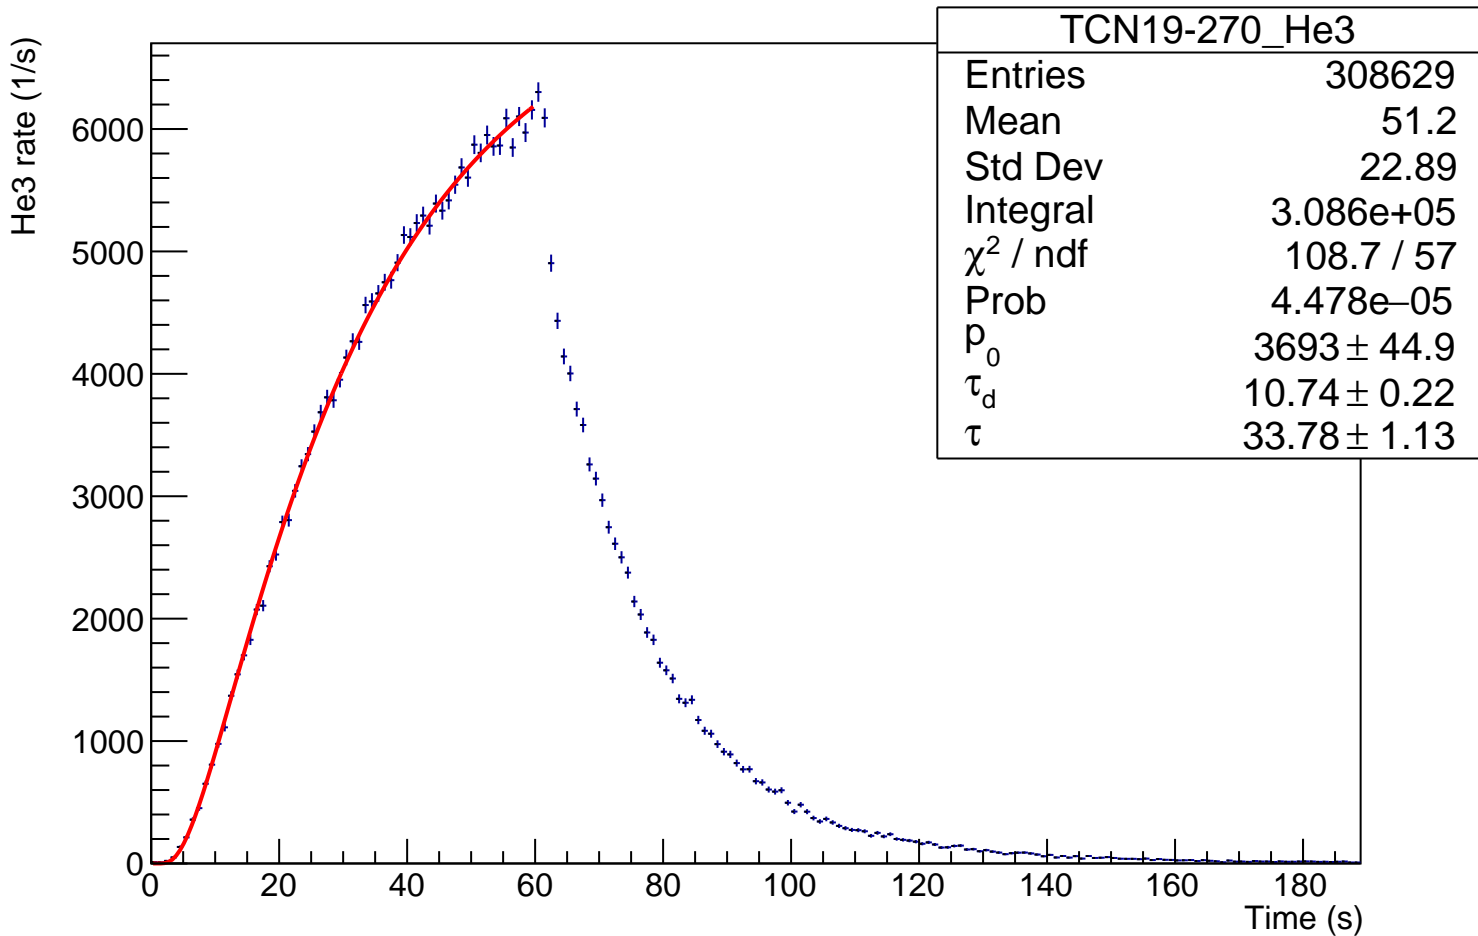

Li6 rate (1/0.05s)

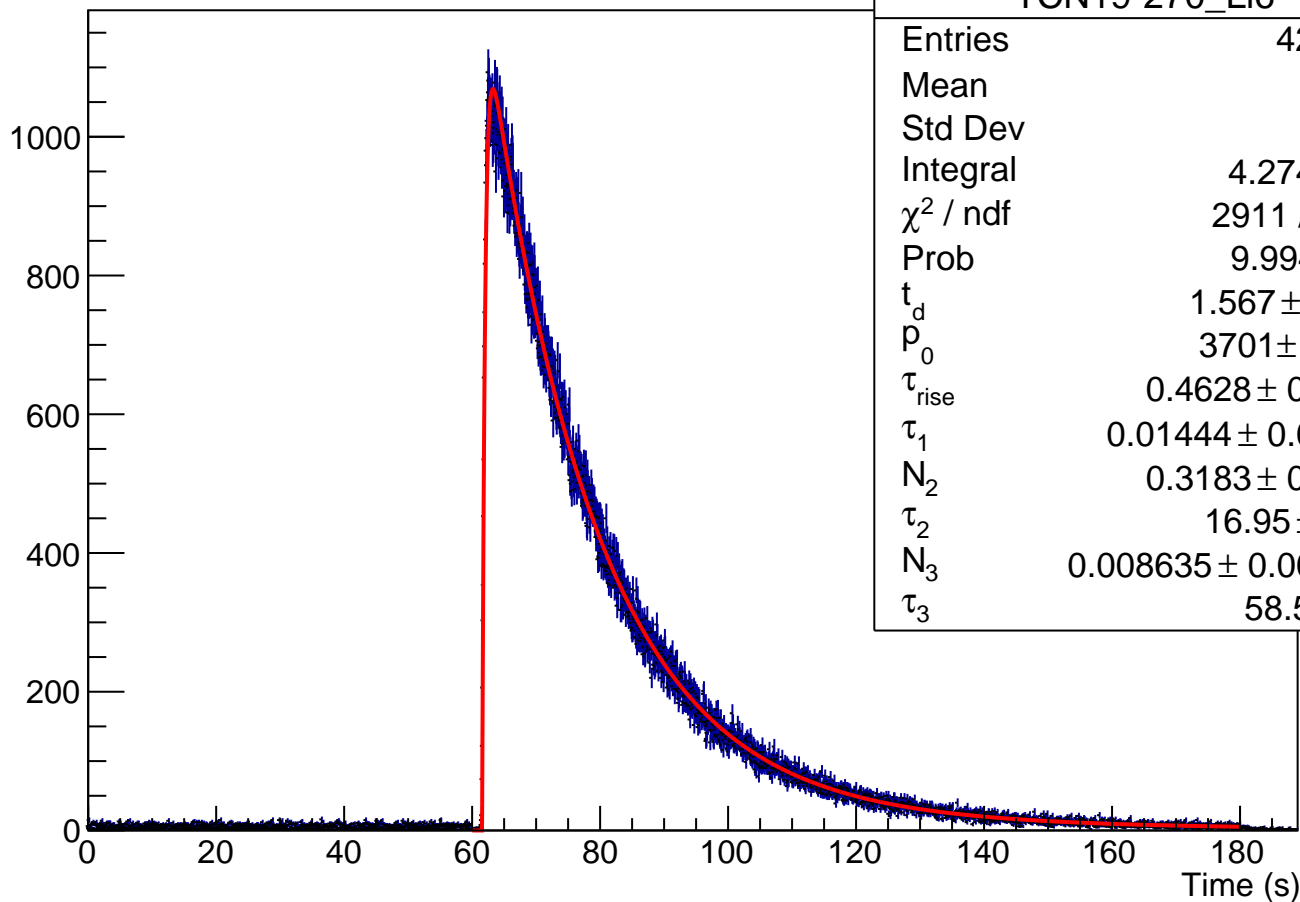


Li6 rate normalized during counting (1/0.05s)

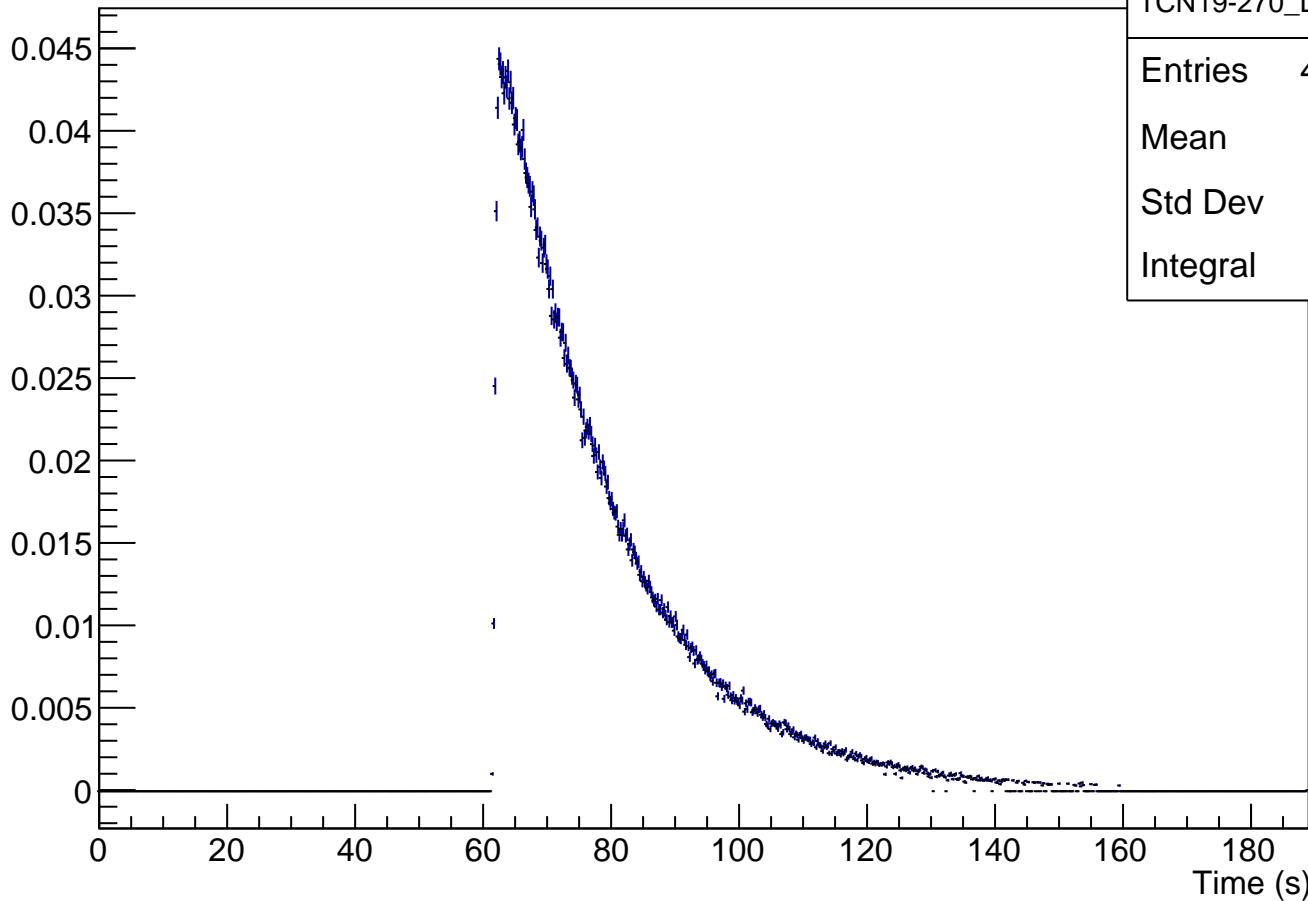

TCN19-270_Li6_norm	
Entries	407177
Mean	79.86
Std Dev	19.35
Integral	4.23

Li6 rate normalized during irradiation (1/0.05s)

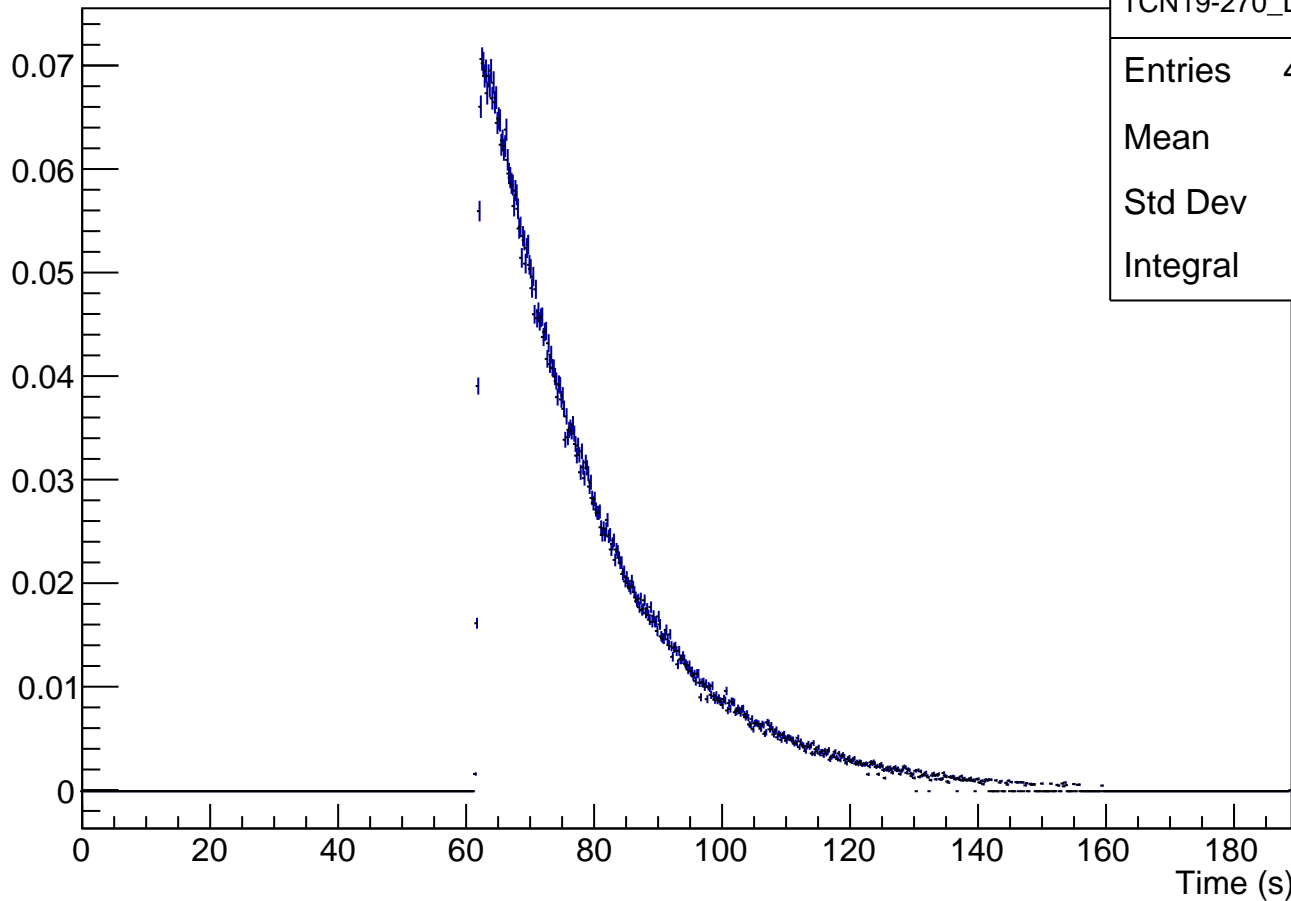


TCN19-270_Li6_norm


Entries 401729

Mean 79.86


Std Dev 19.35

Integral 6.737

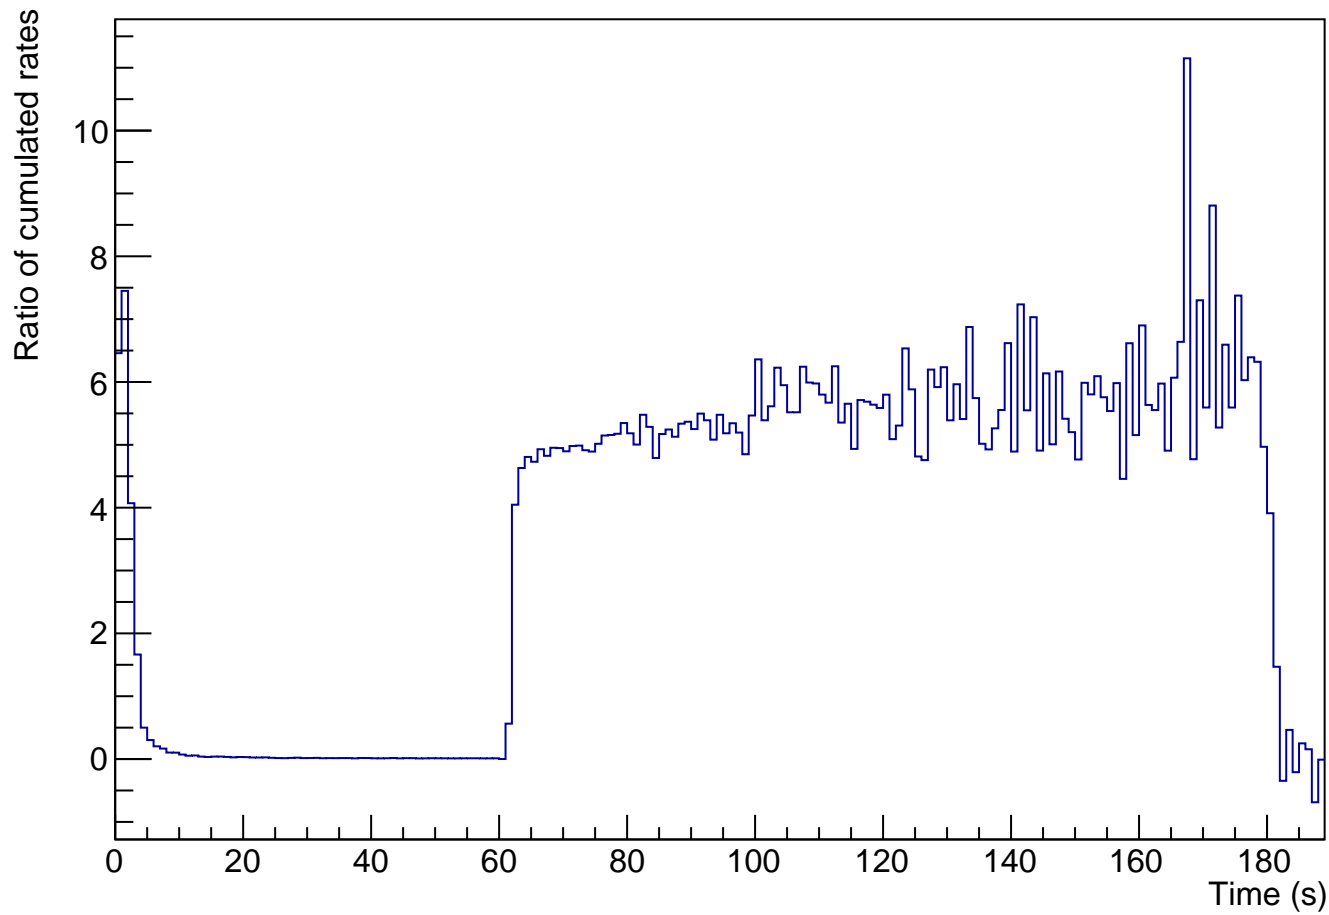

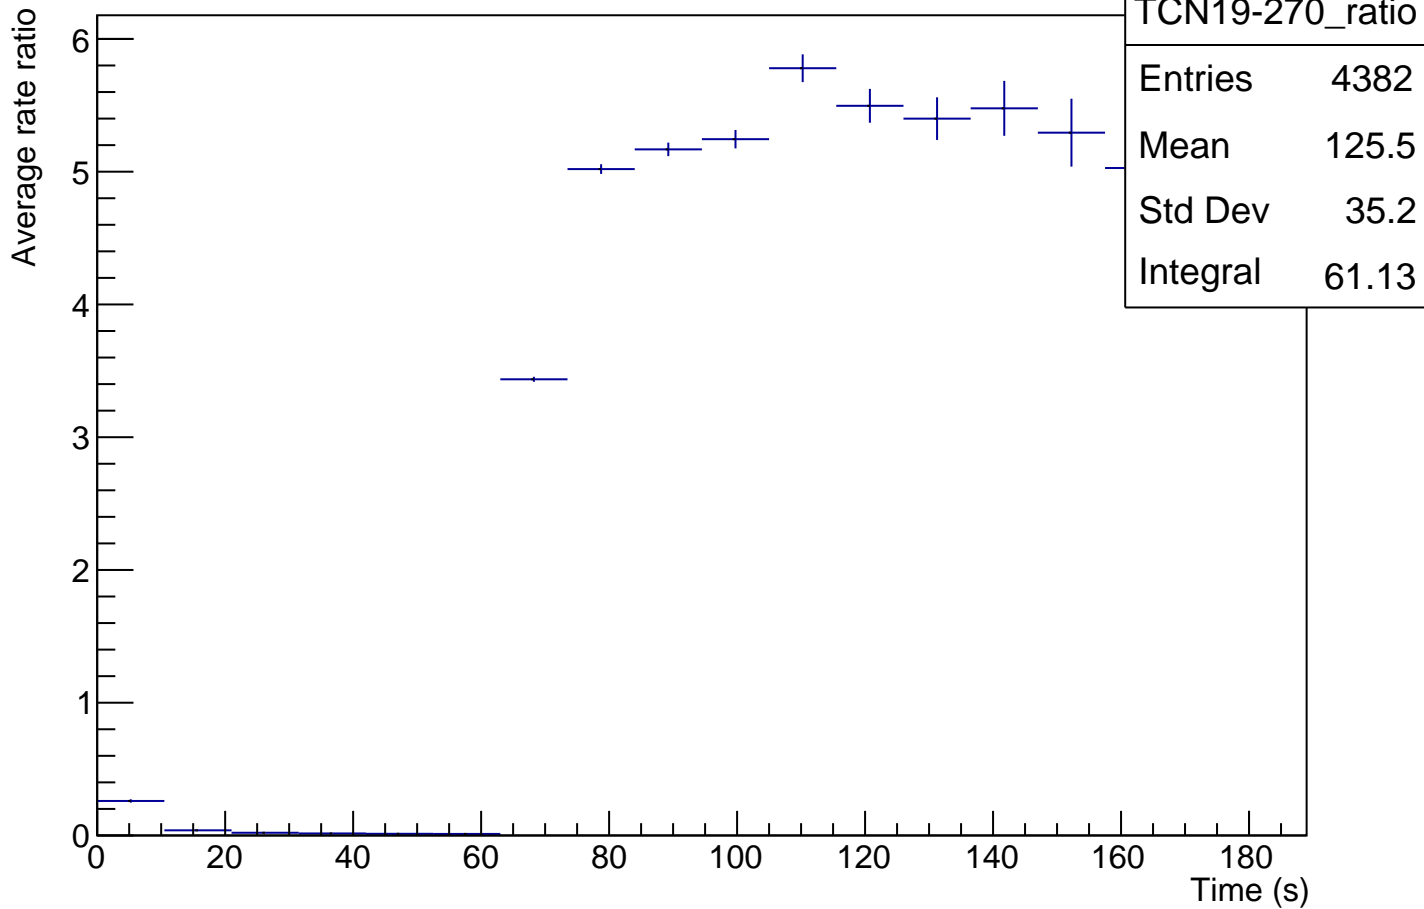

TCN19-270

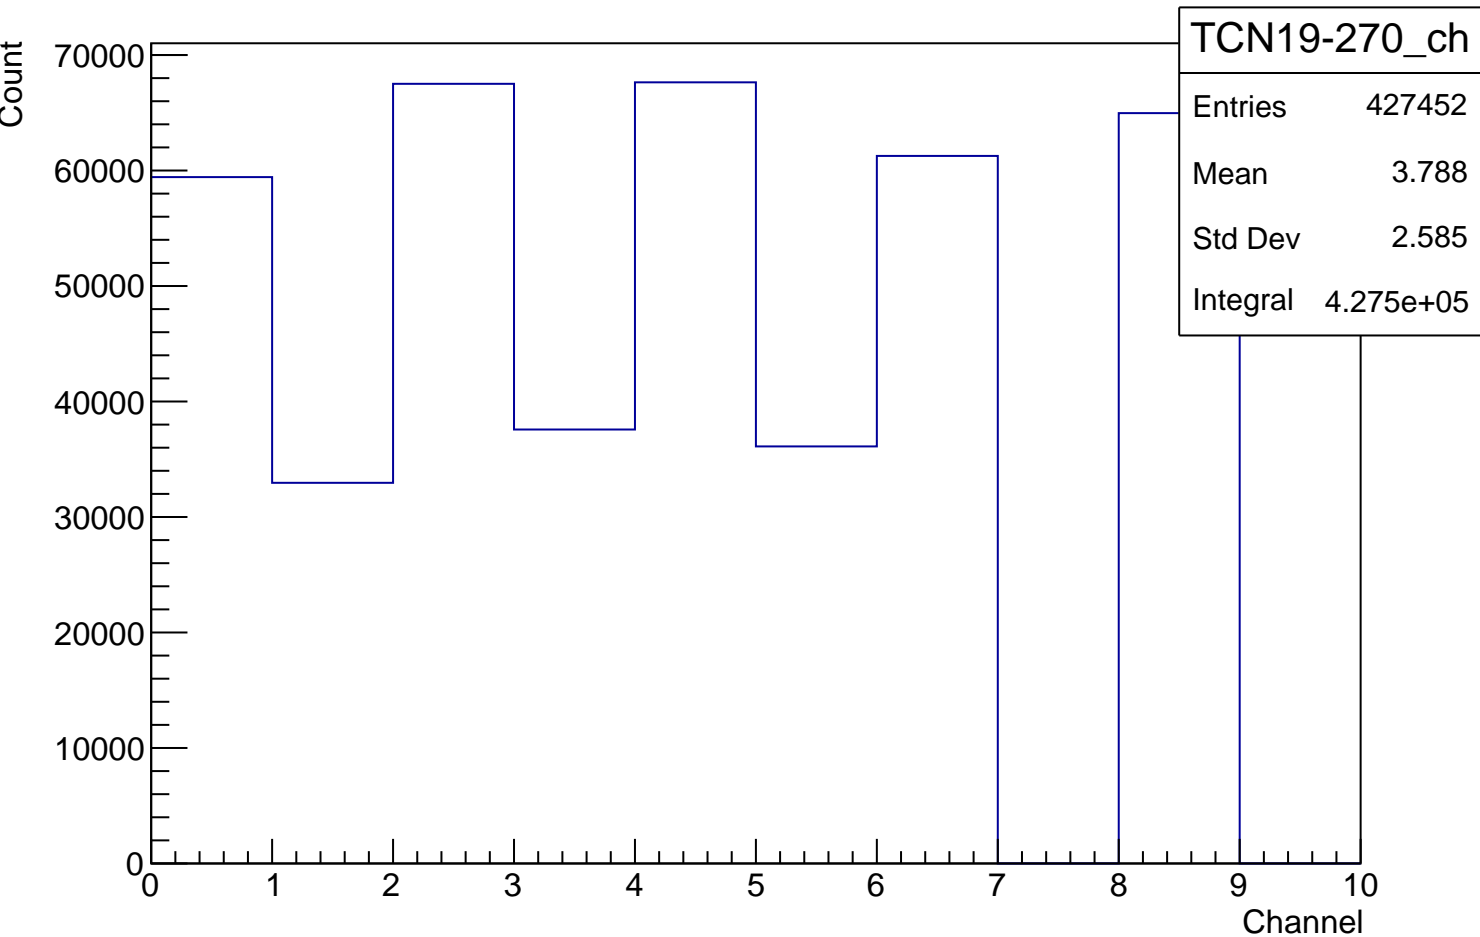

Li6 window

