



li6 background rate during irradiation (1/(s  $\mu$ A))

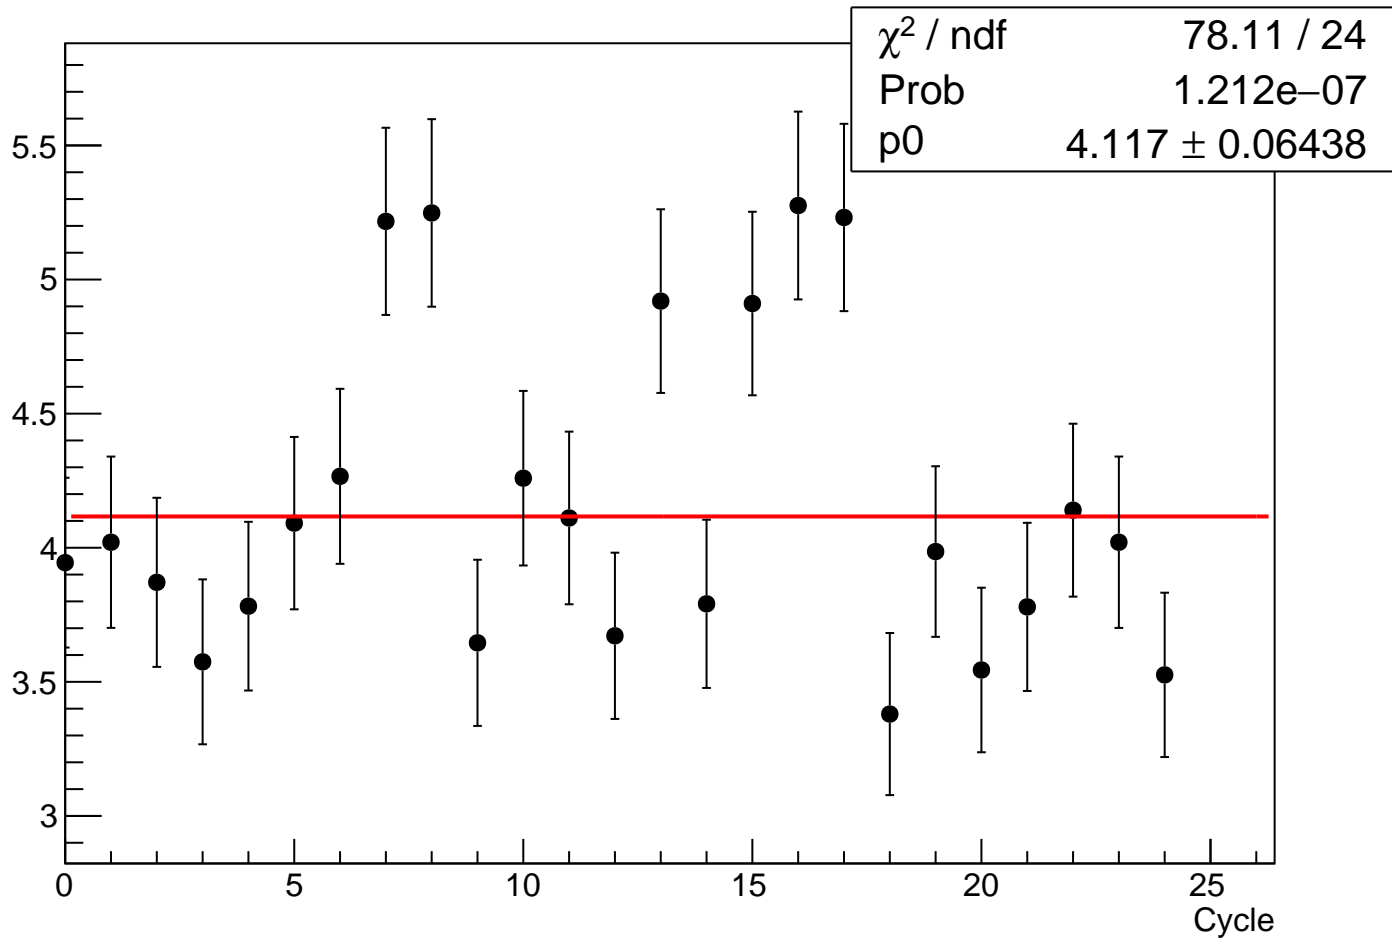


TCN19-260 (UGD22) (single exponential fit, with background subtracted, normalized to monitor detector, 0s excluded)


UCN-count-to-monitor ratio

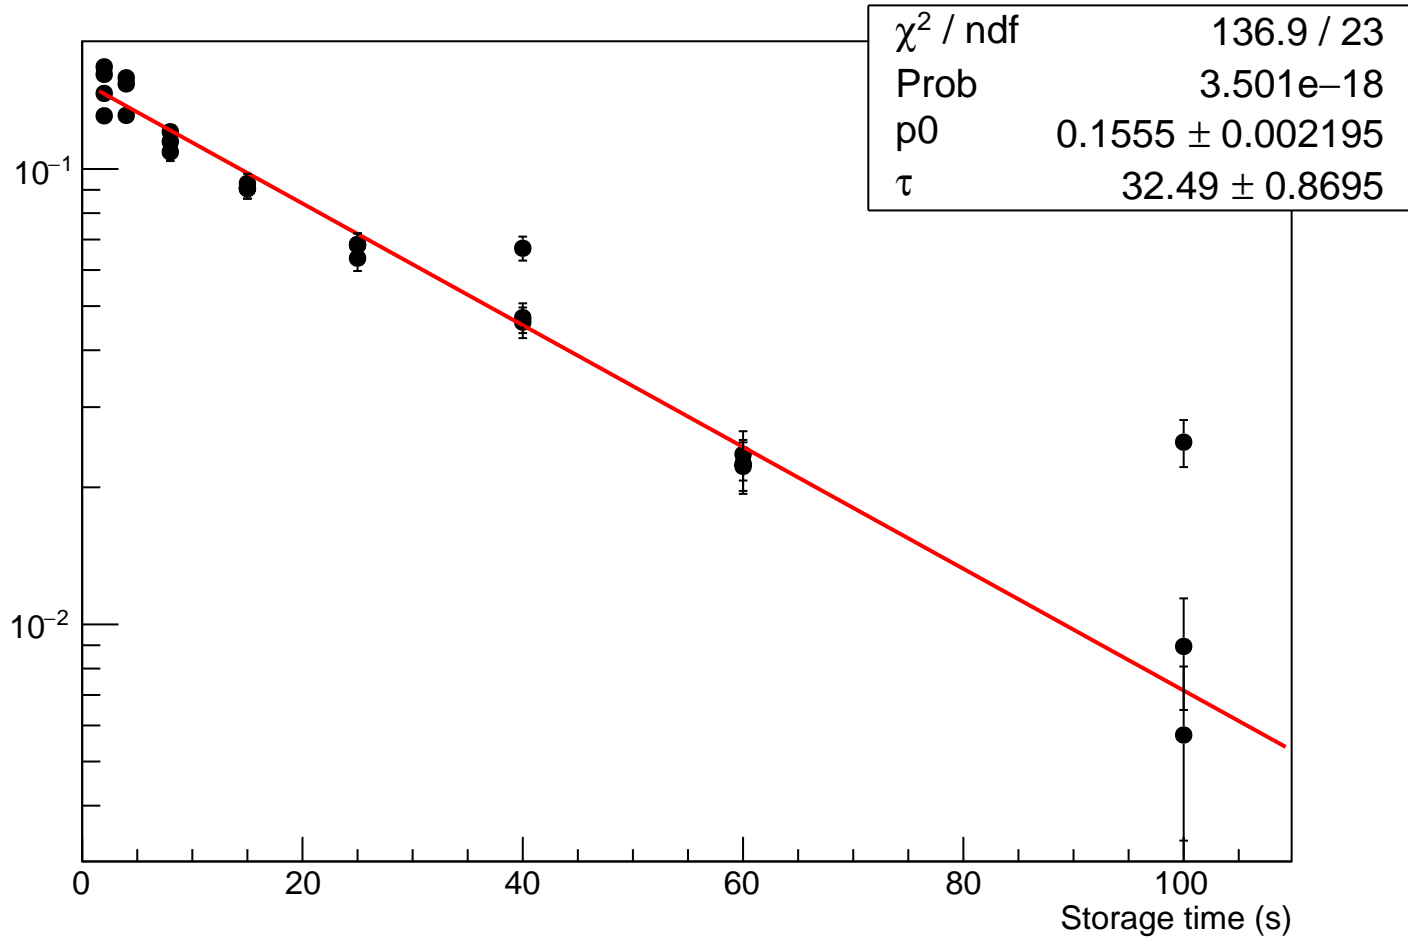


UCN-count-to-monitor ratio

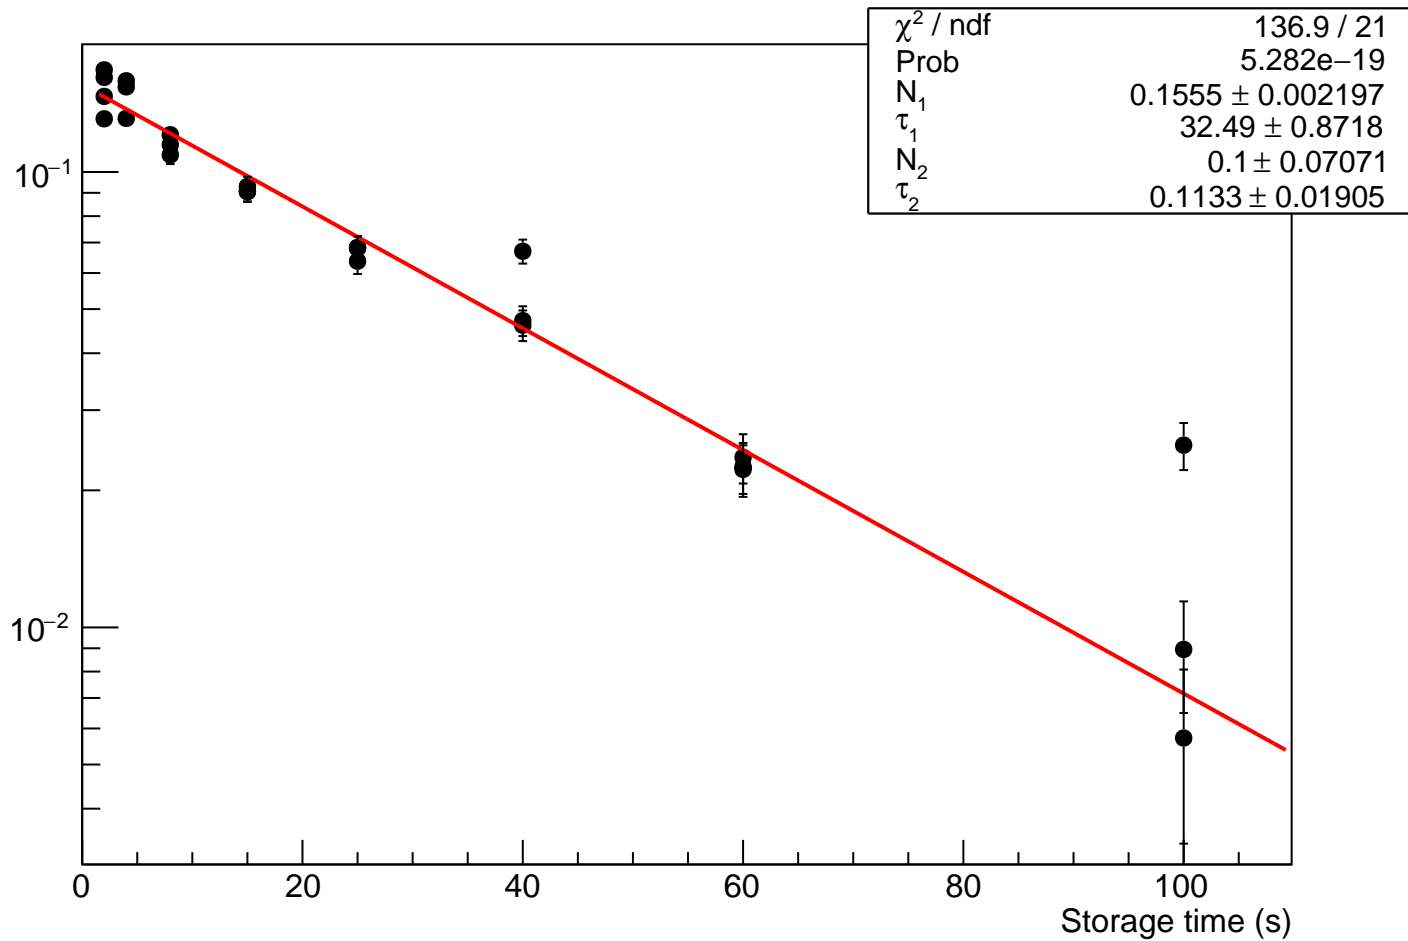


# Graph

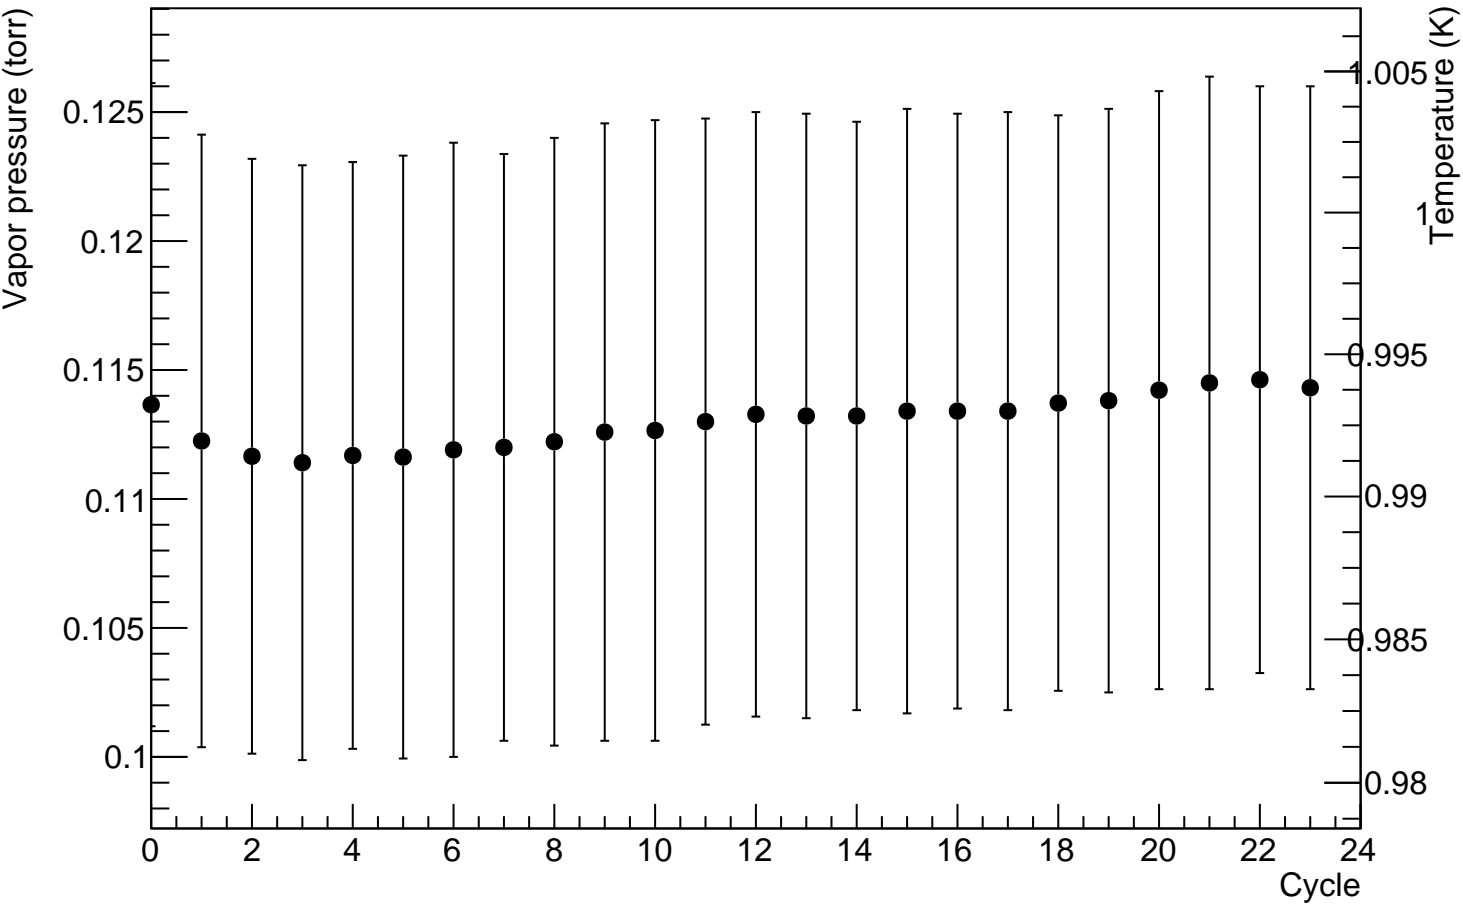


# TCN19-260 (UGD22) (He3 rate)

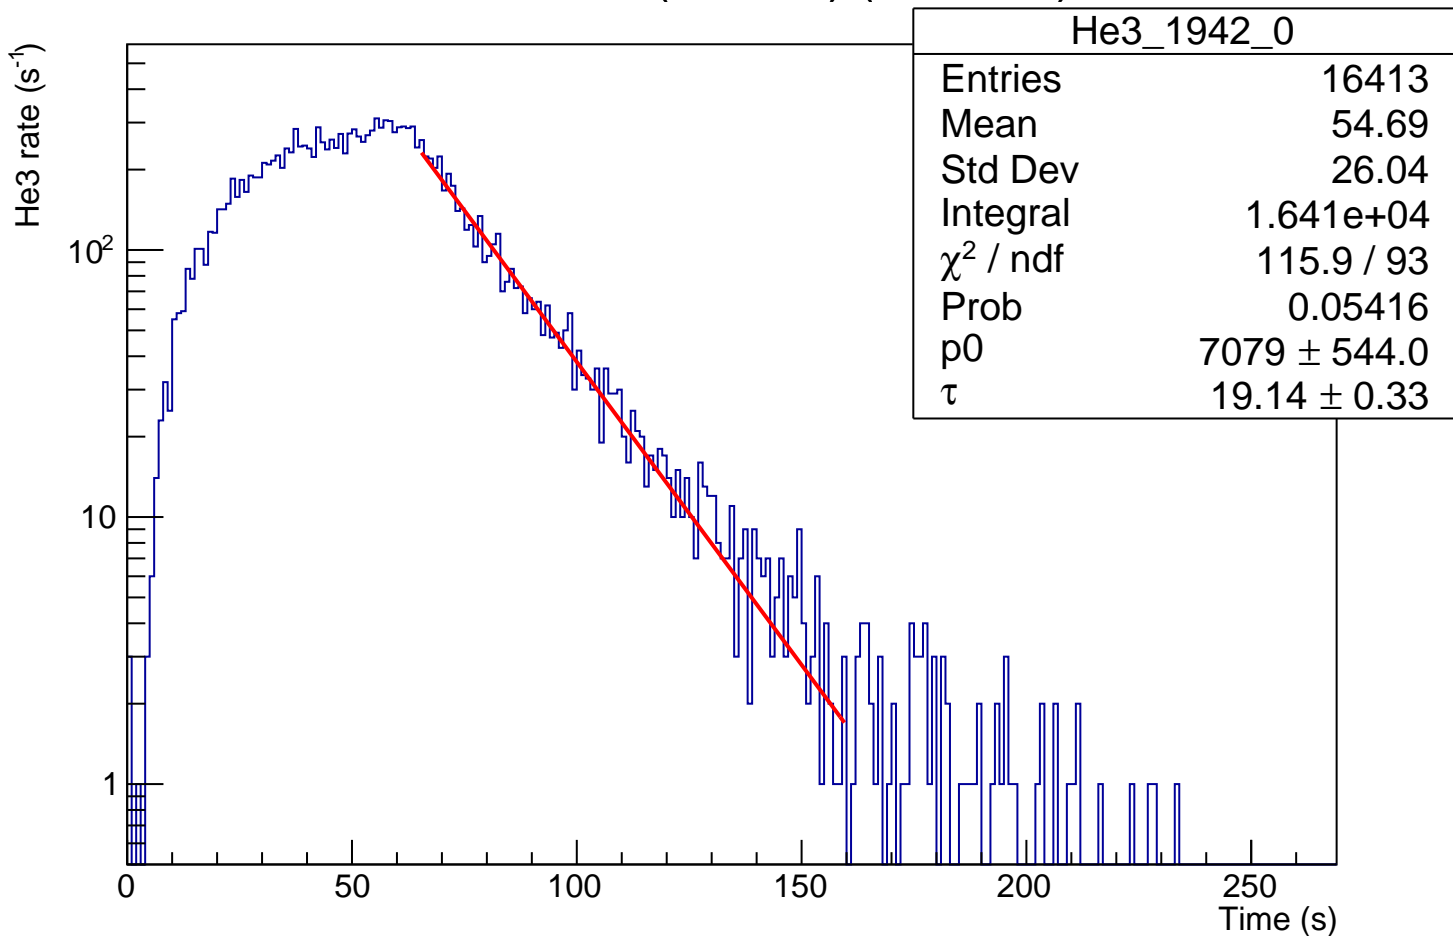

# TCN19-260 (UGD22) (He3 rate)

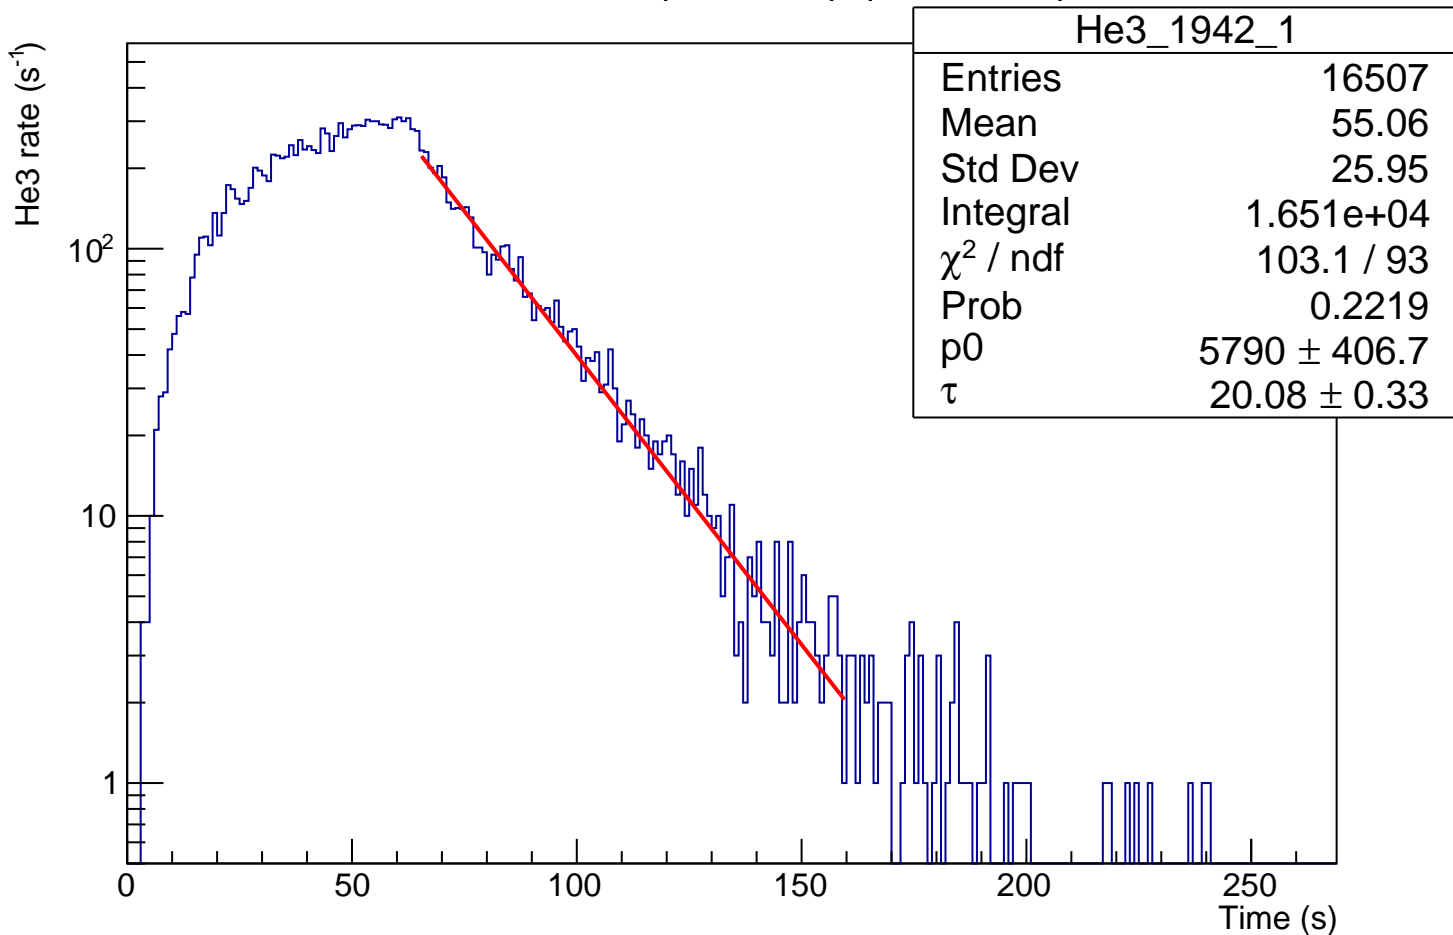


# TCN19-260 (UGD22) (He3 rate)

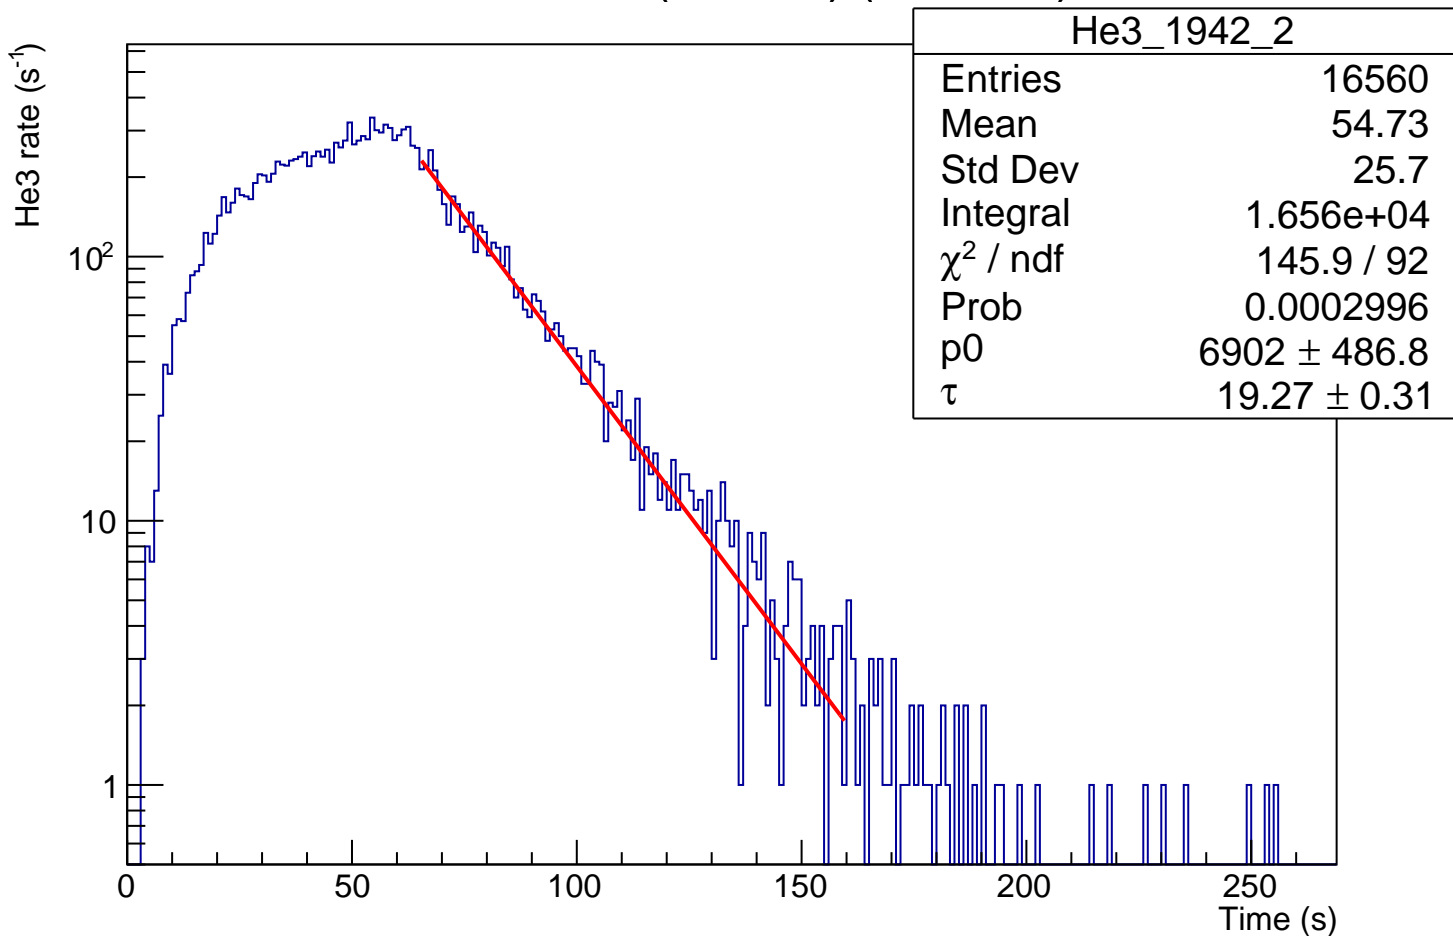





# TCN19-260 (UGD22) (He3 rate)

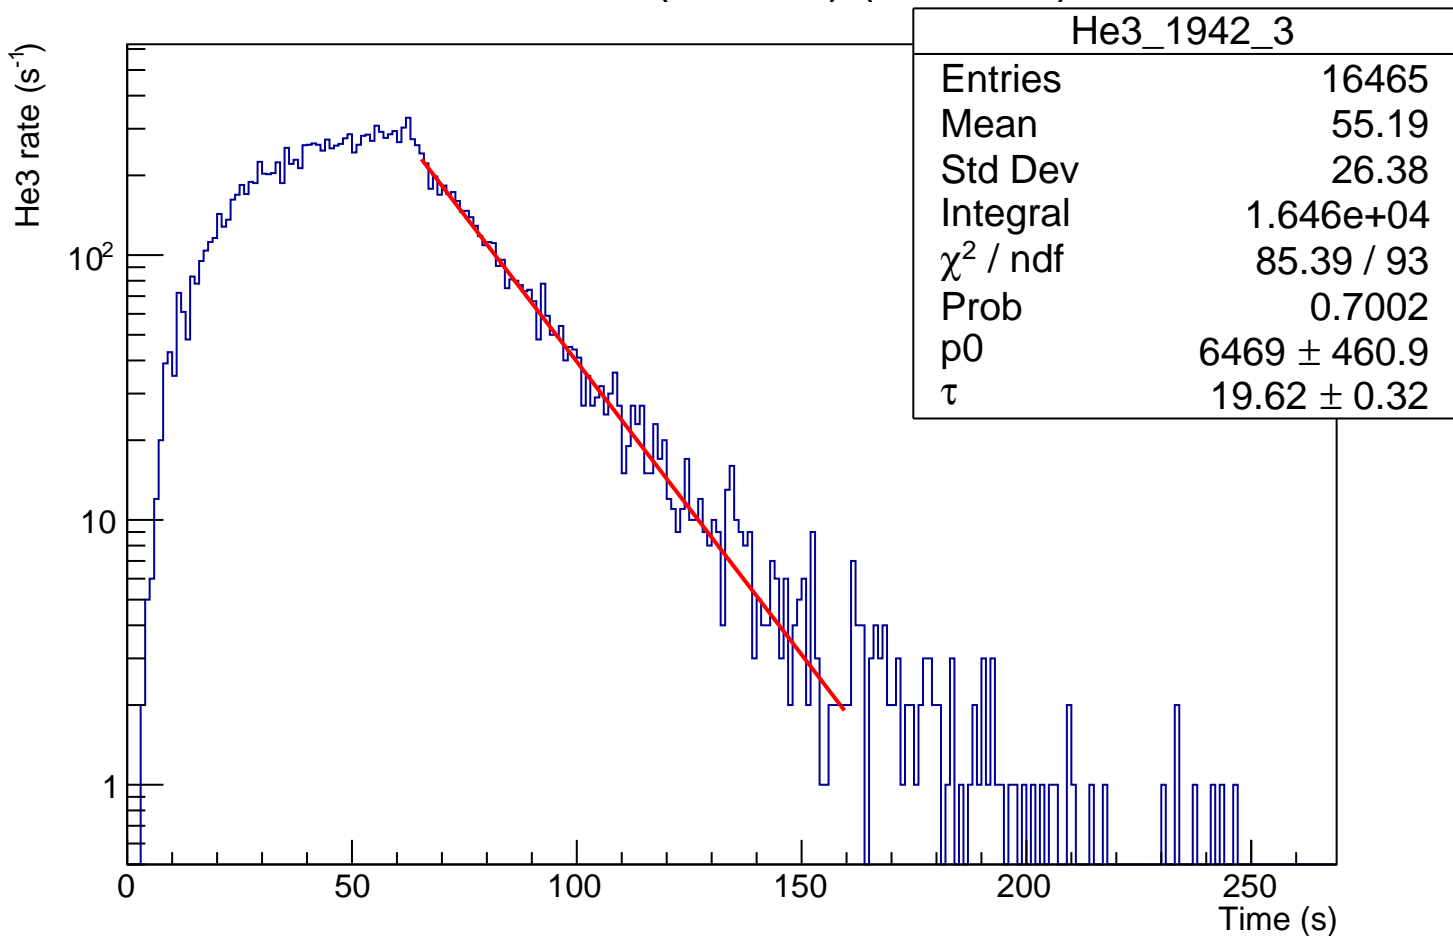


# TCN19-260 (UGD22) (He3 rate)

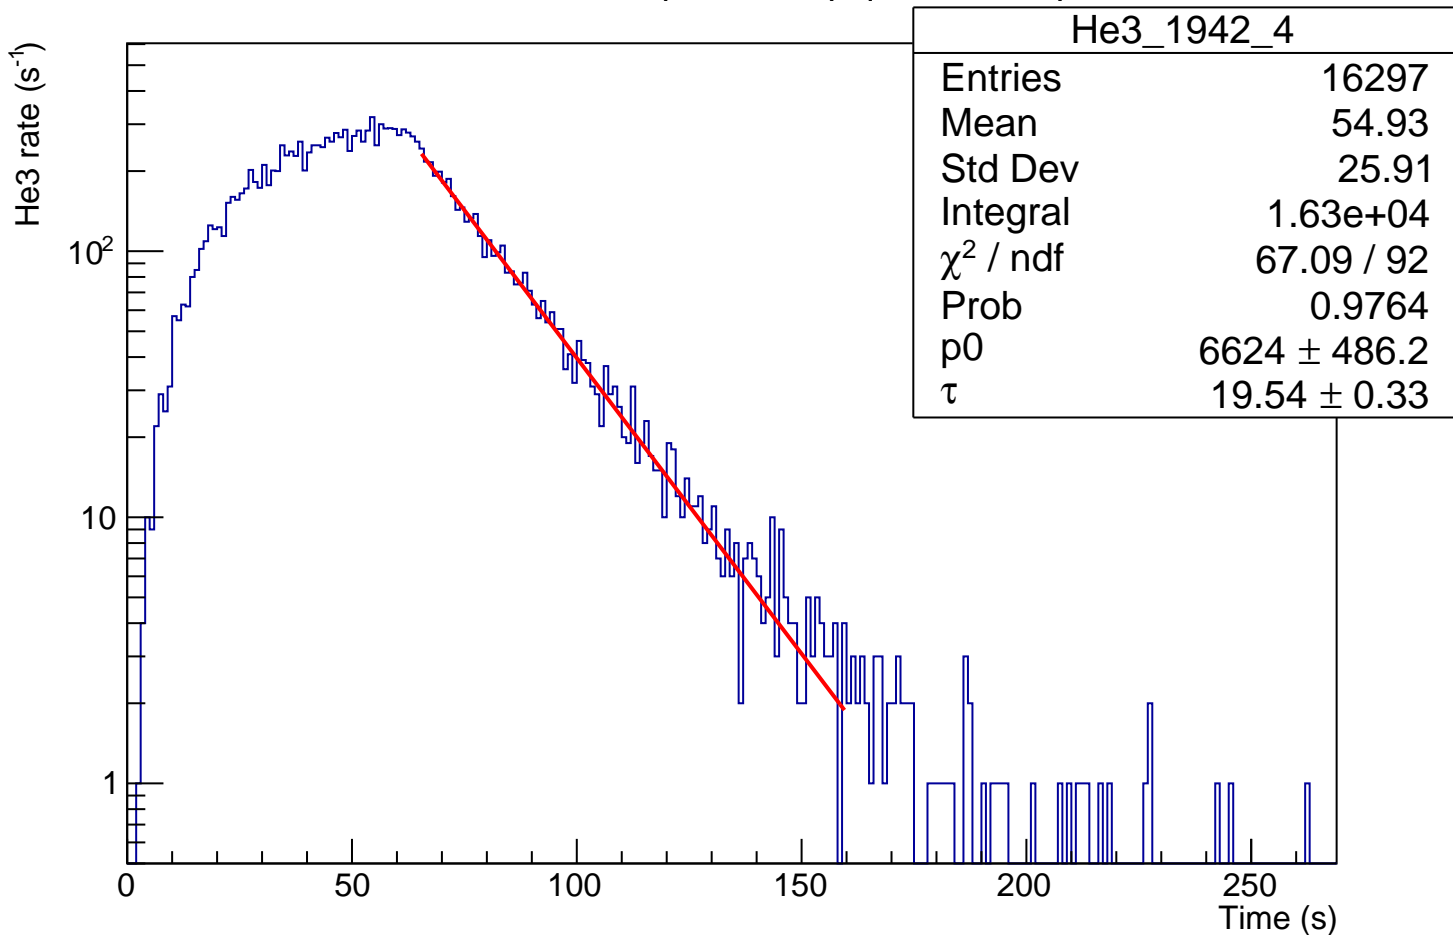


# TCN19-260 (UGD22) (He3 rate)

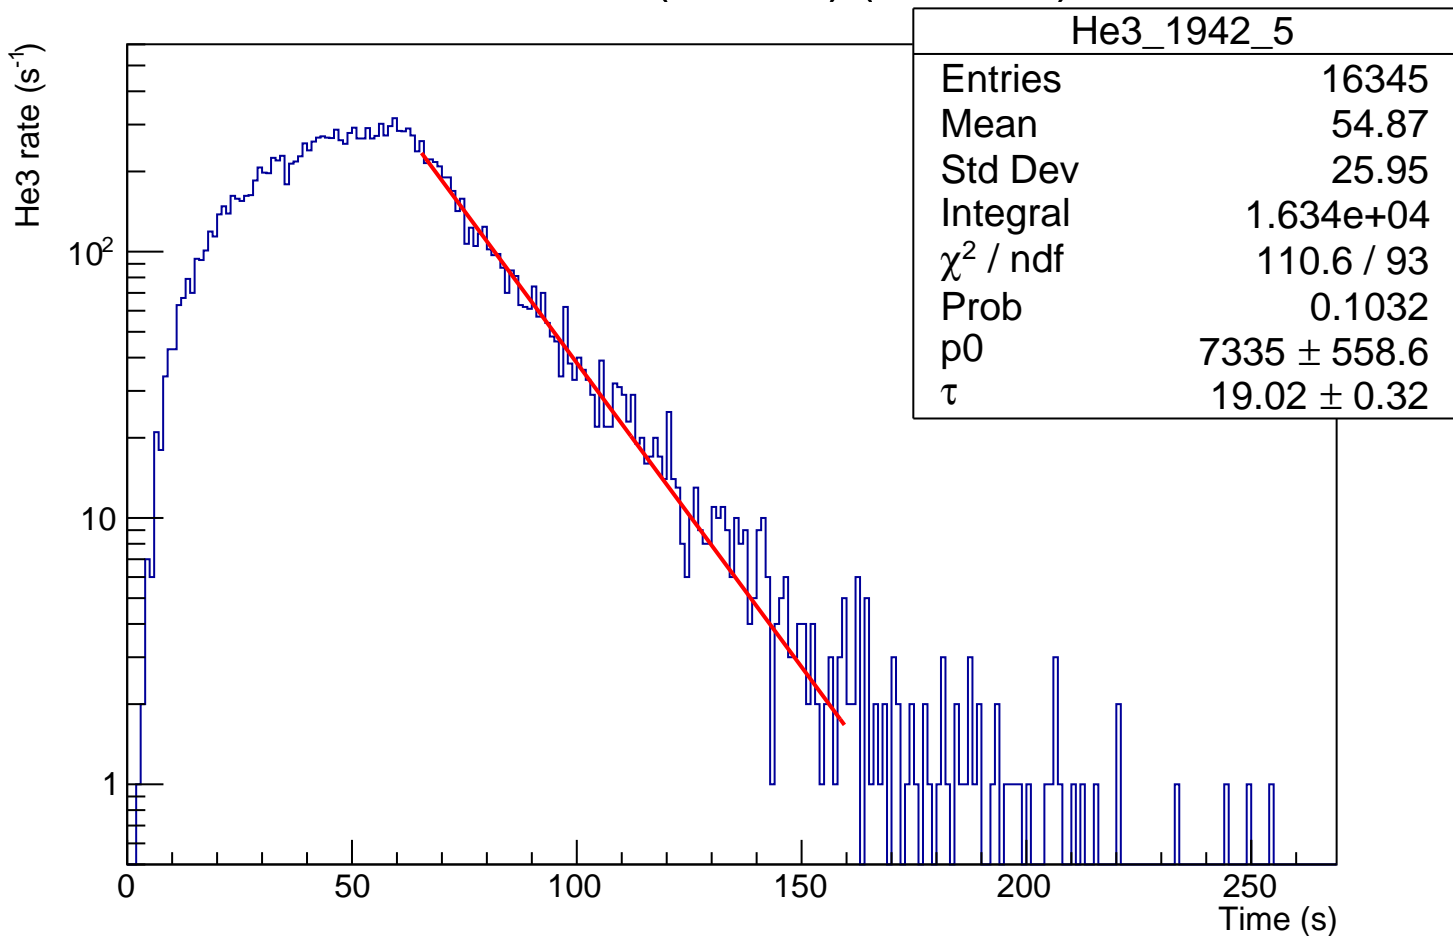


# TCN19-260 (UGD22) (He3 rate)

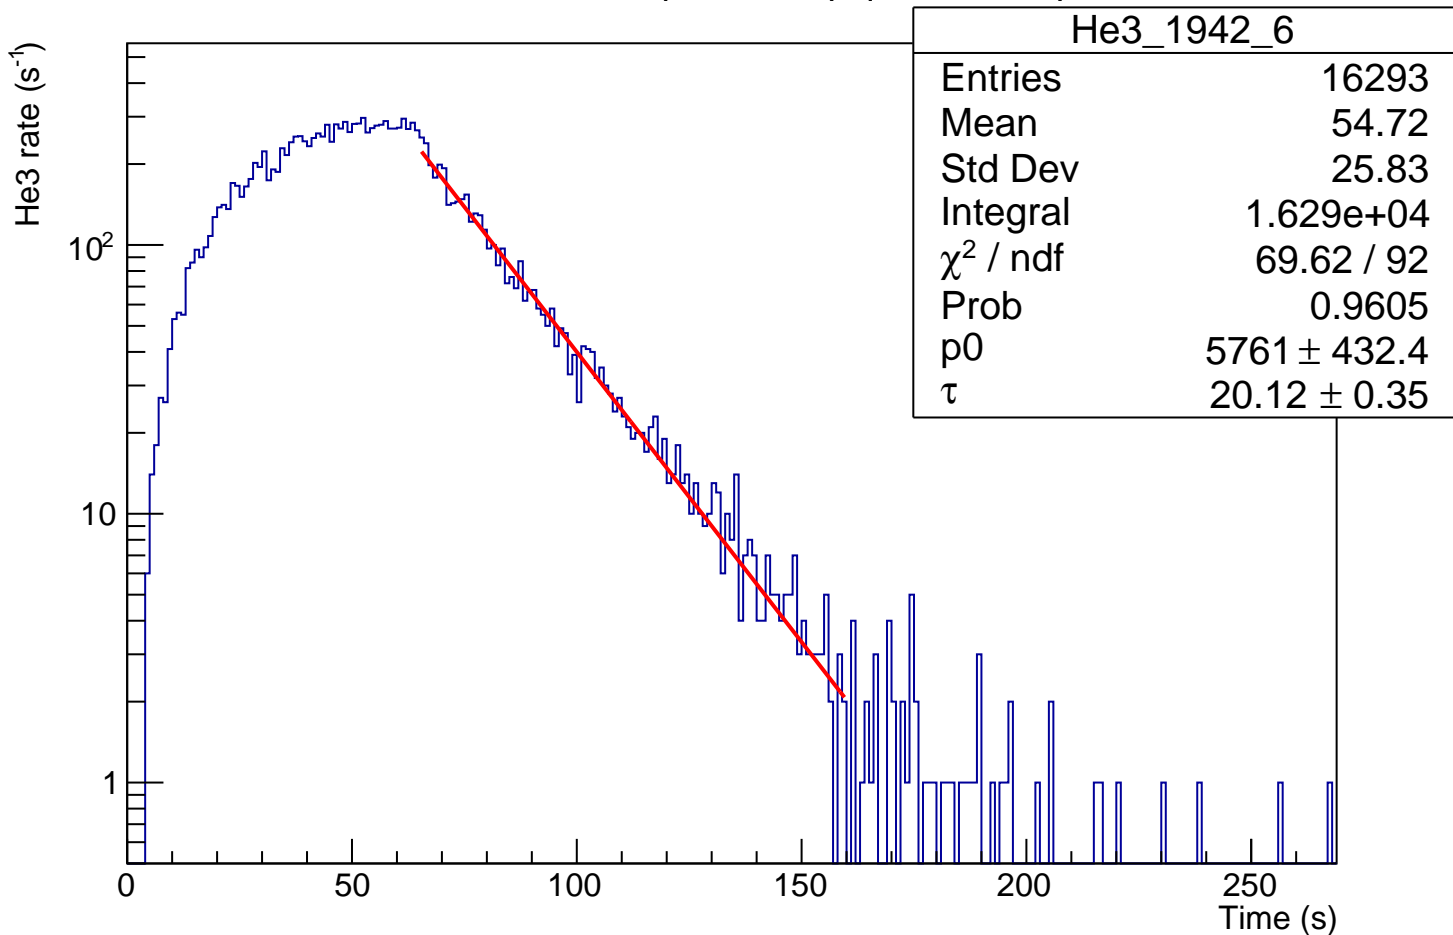


# TCN19-260 (UGD22) (He3 rate)

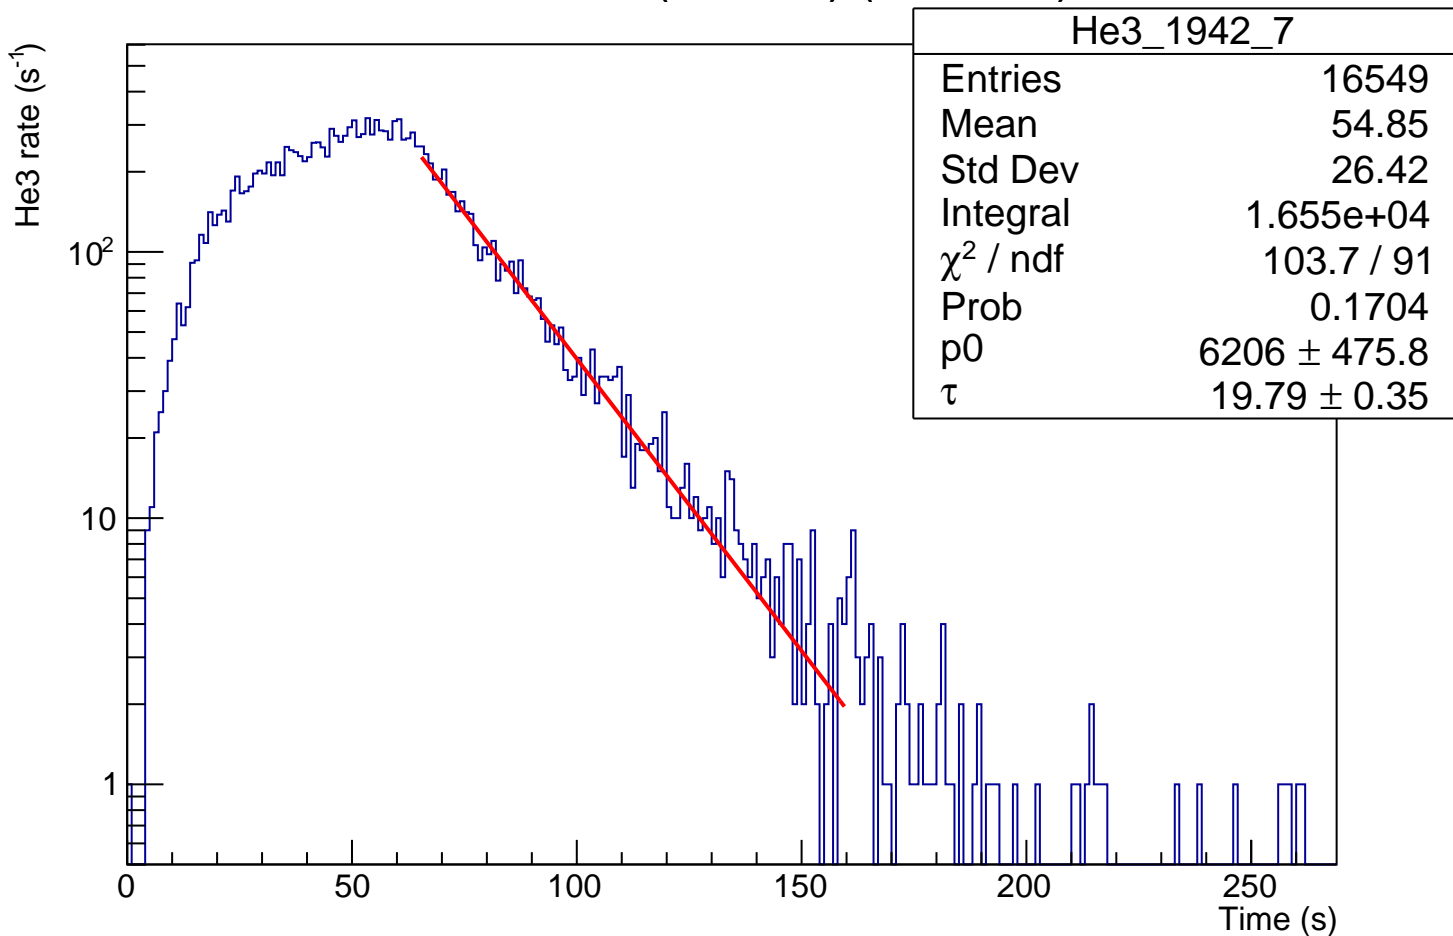


# TCN19-260 (UGD22) (He3 rate)

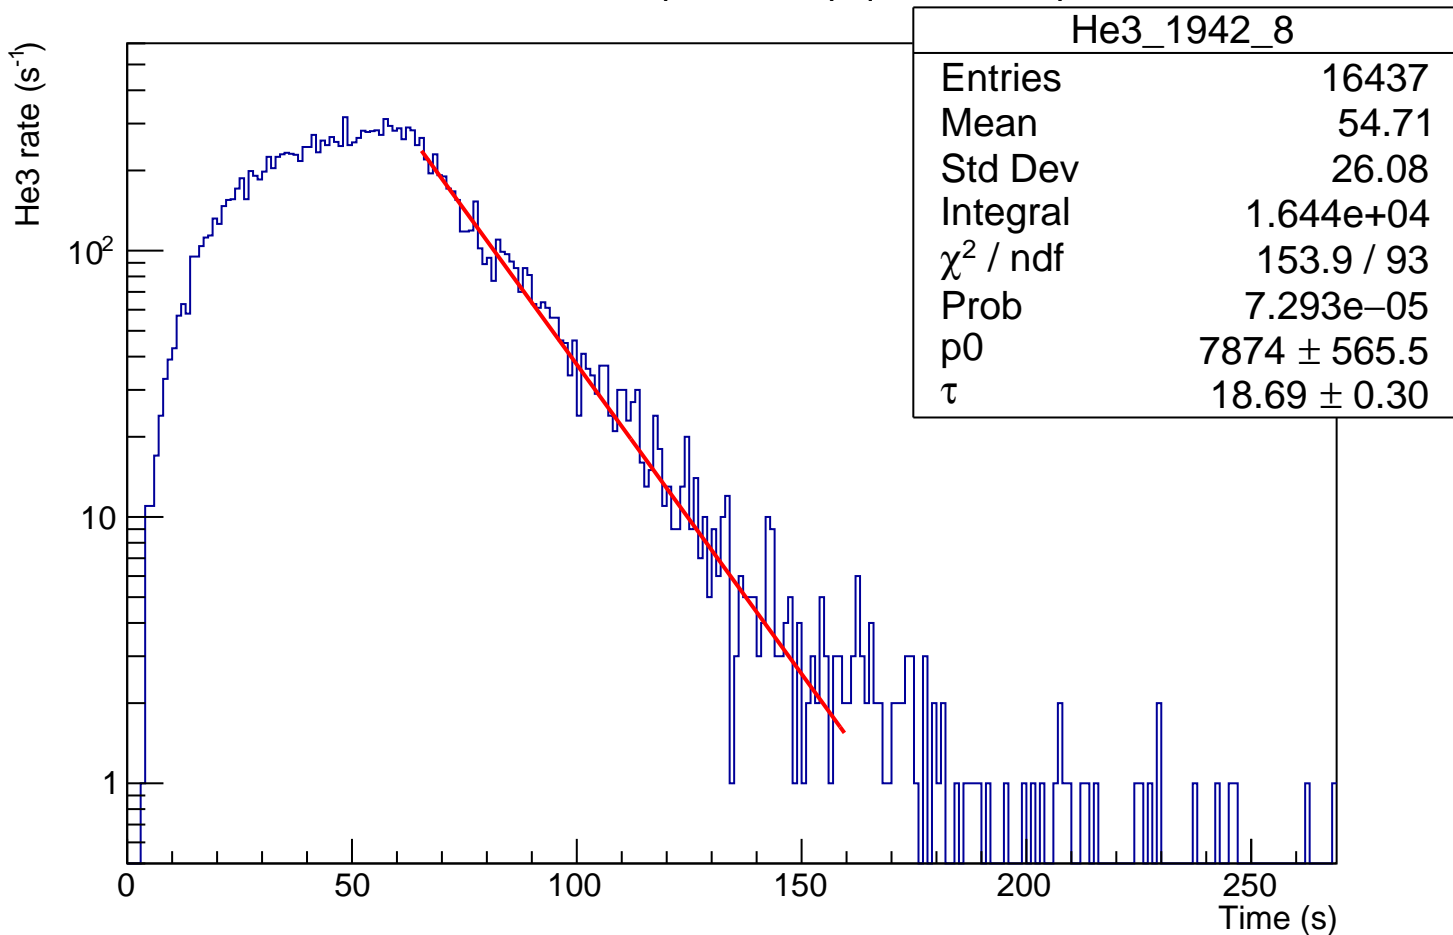

# TCN19-260 (UGD22) (He3 rate)

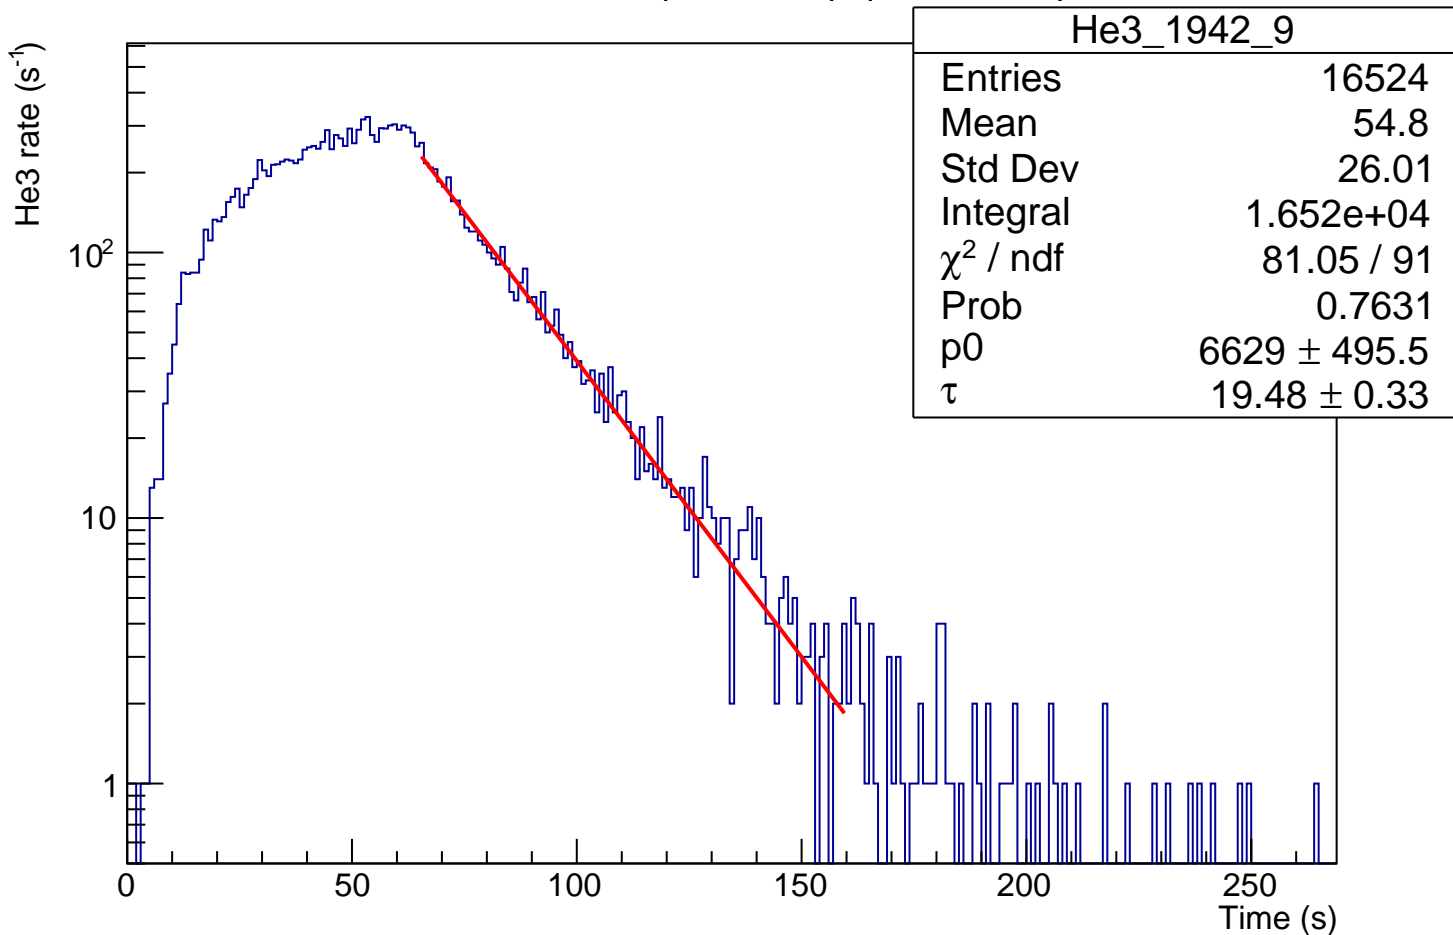


# TCN19-260 (UGD22) (He3 rate)

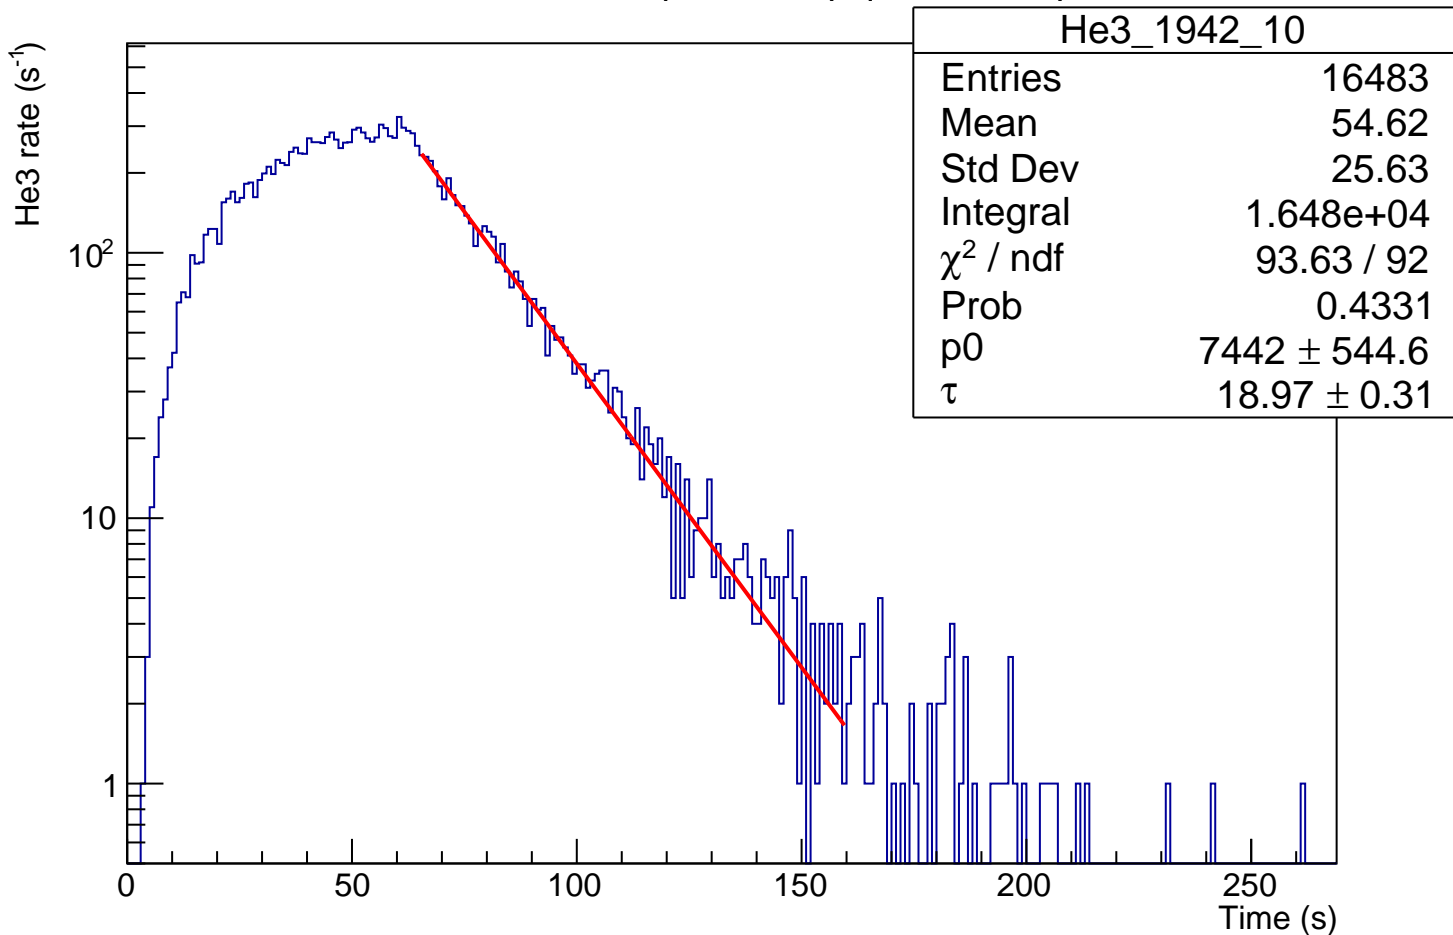





# TCN19-260 (UGD22) (He3 rate)

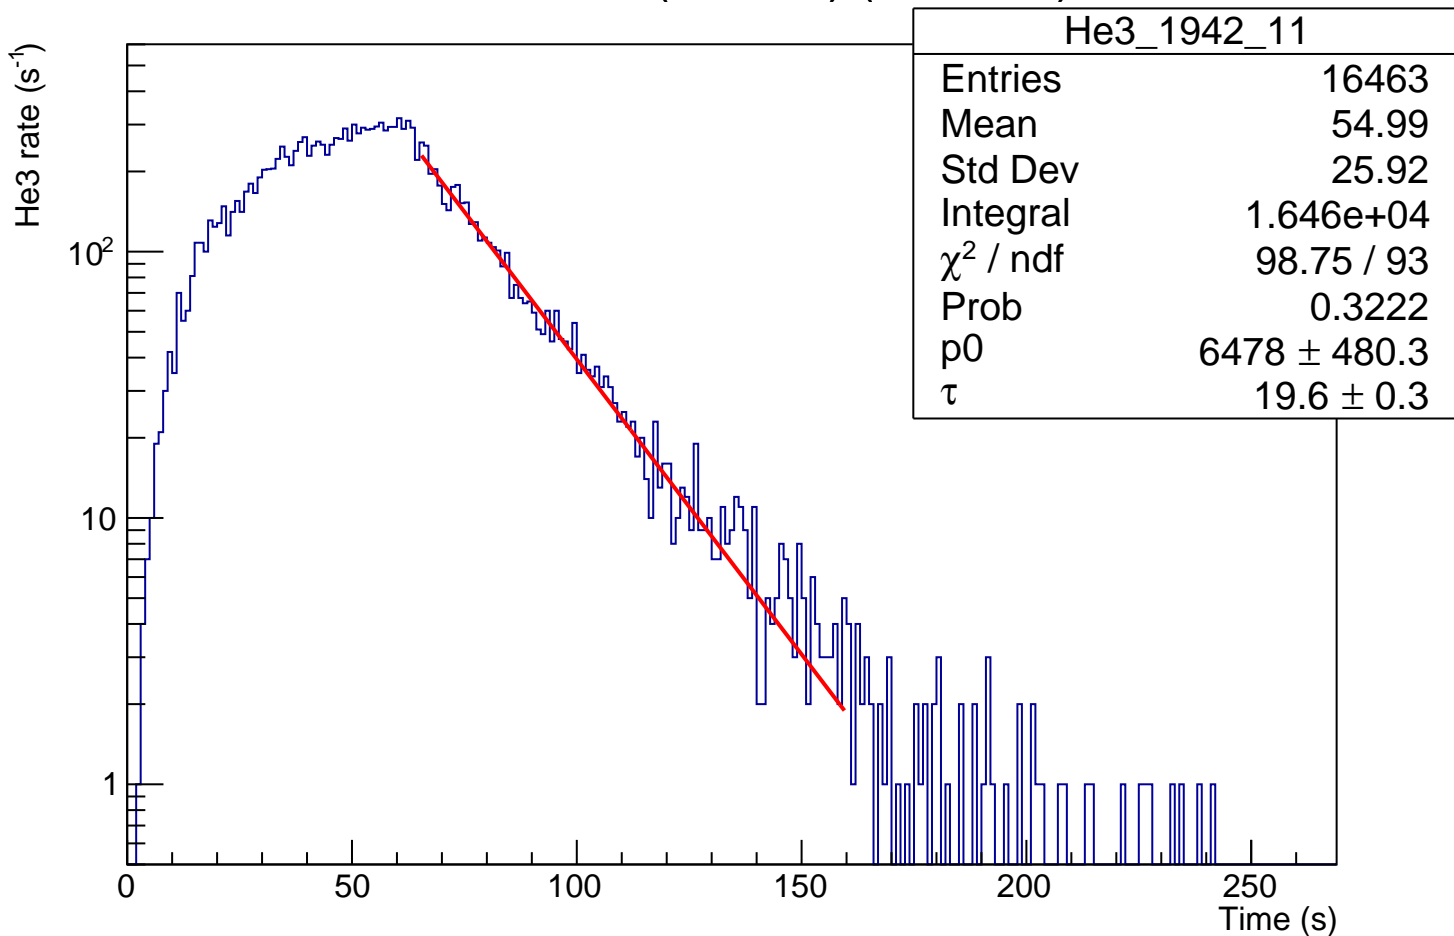


# TCN19-260 (UGD22) (He3 rate)

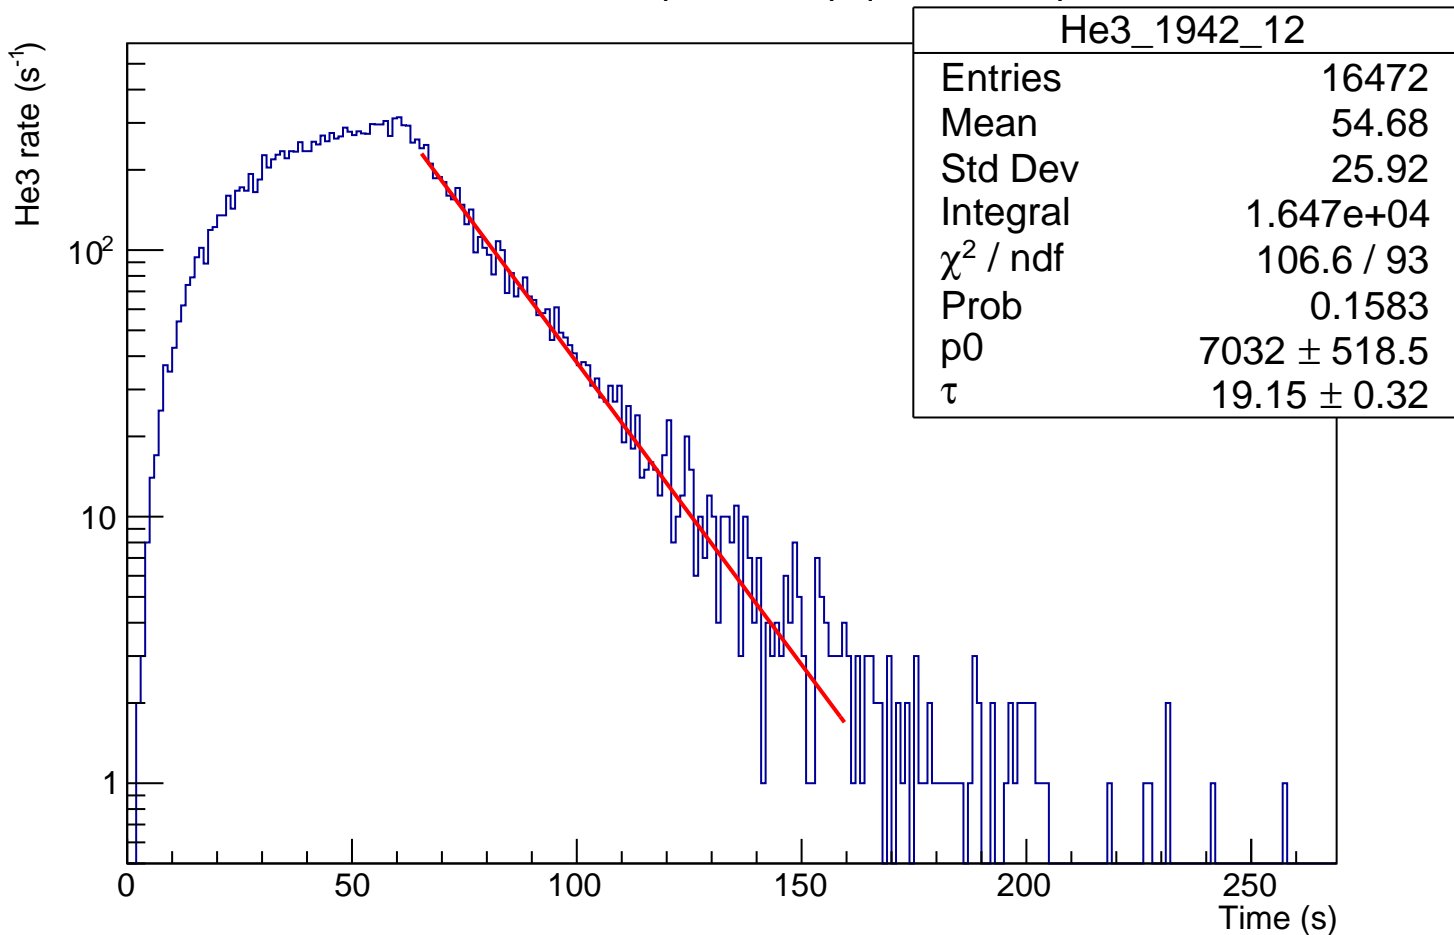


# TCN19-260 (UGD22) (He3 rate)

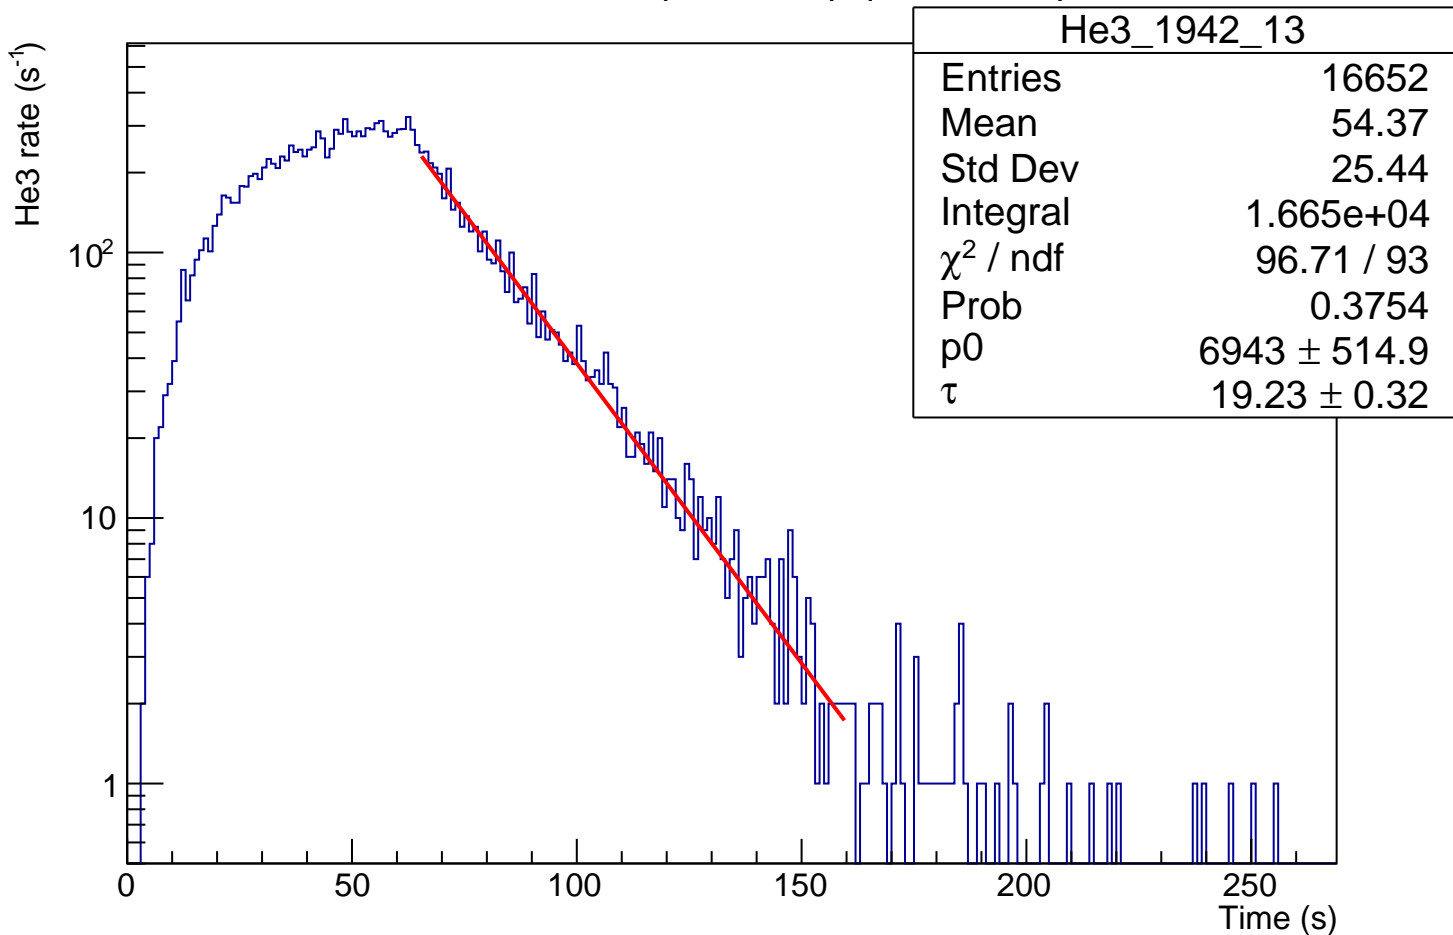


# TCN19-260 (UGD22) (He3 rate)

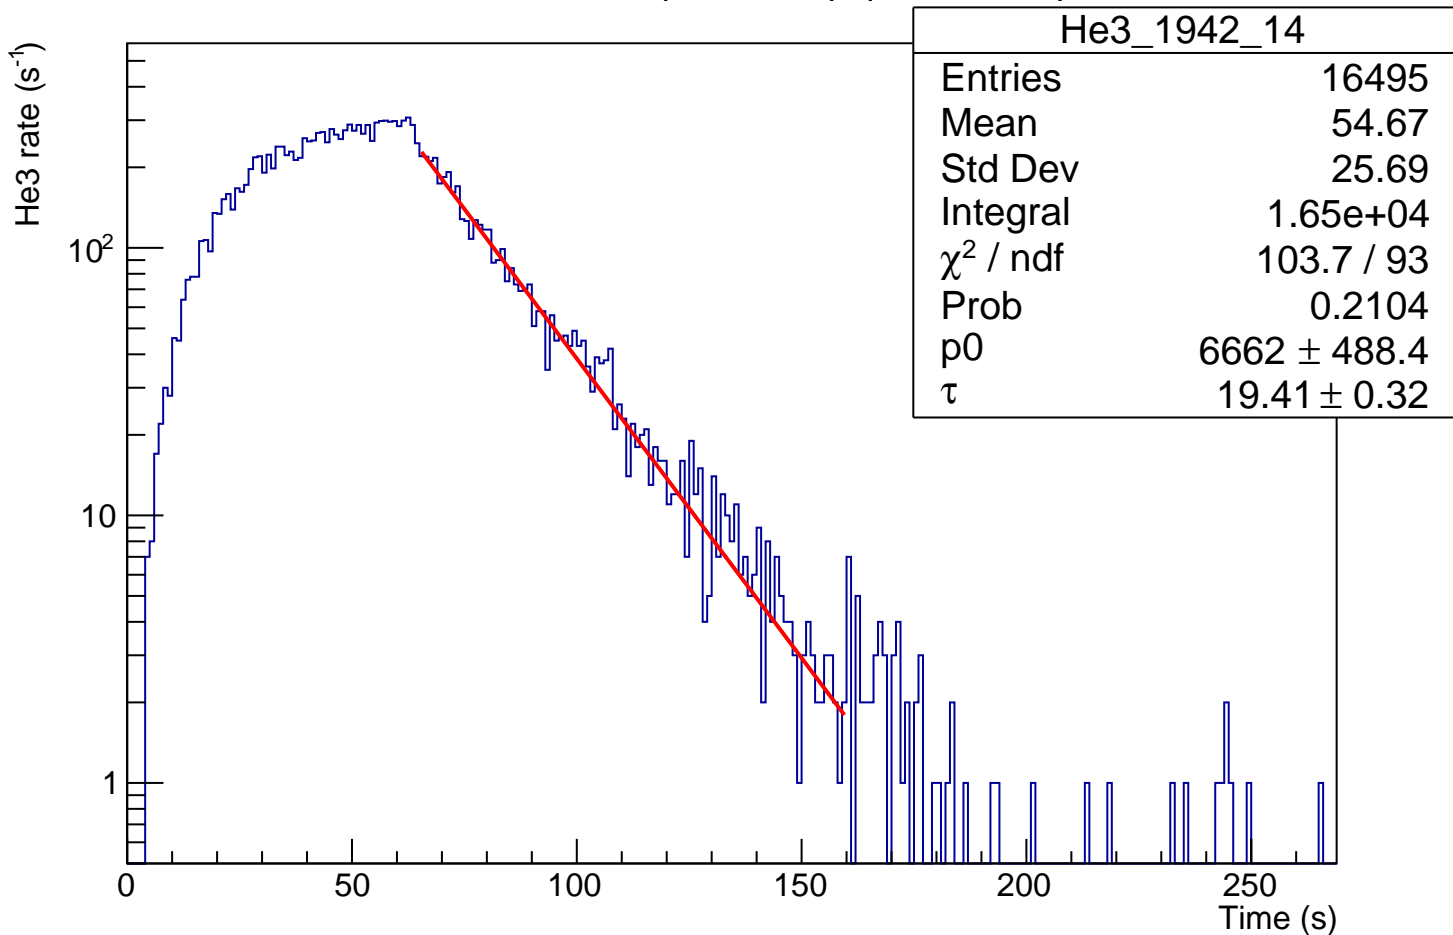


# TCN19-260 (UGD22) (He3 rate)

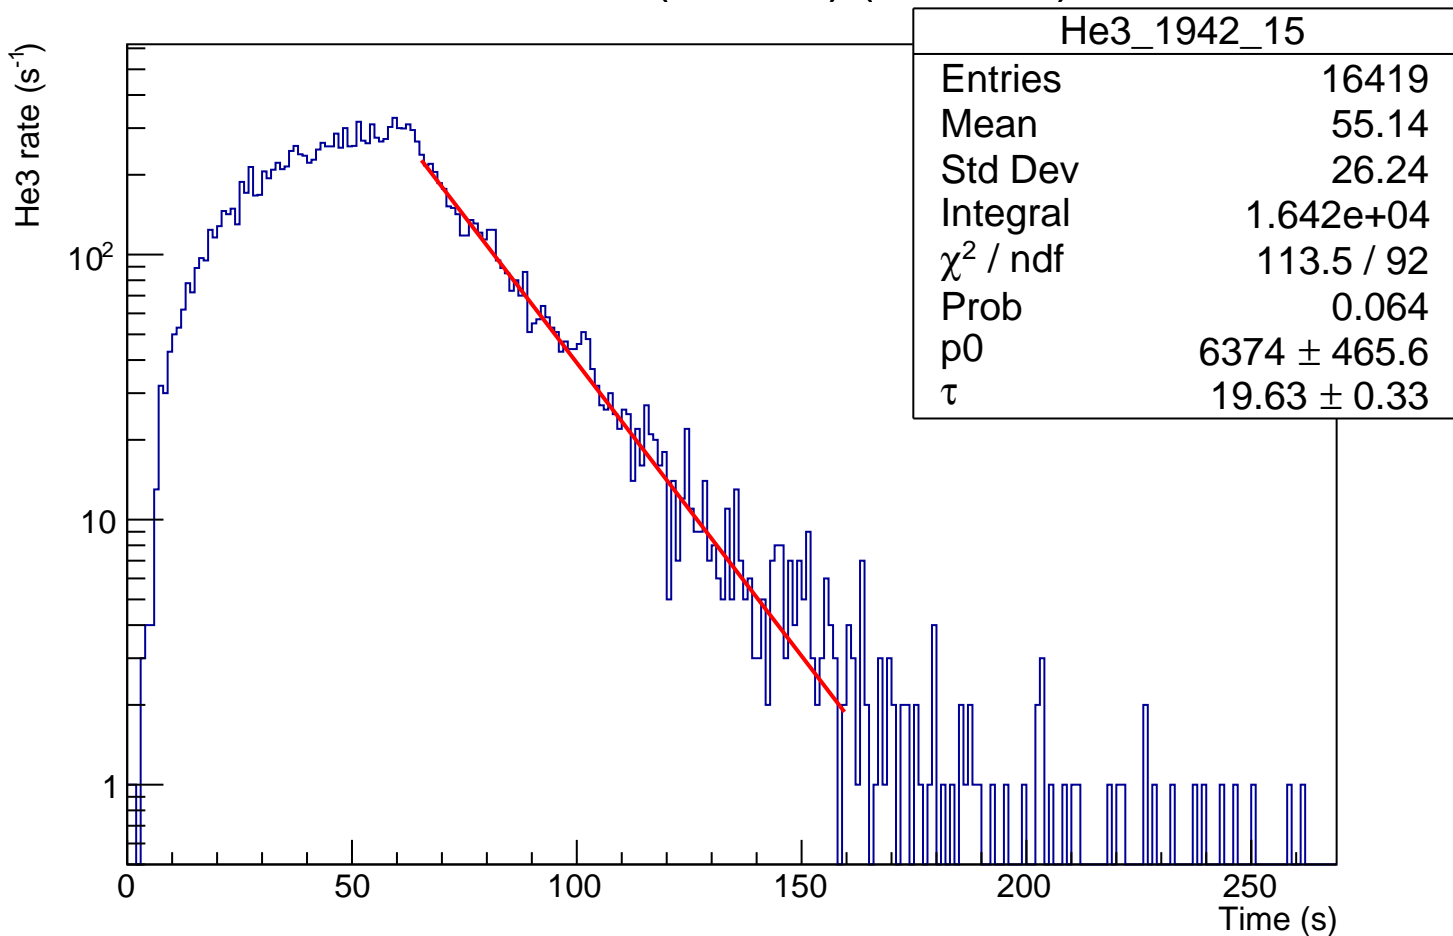


# TCN19-260 (UGD22) (He3 rate)

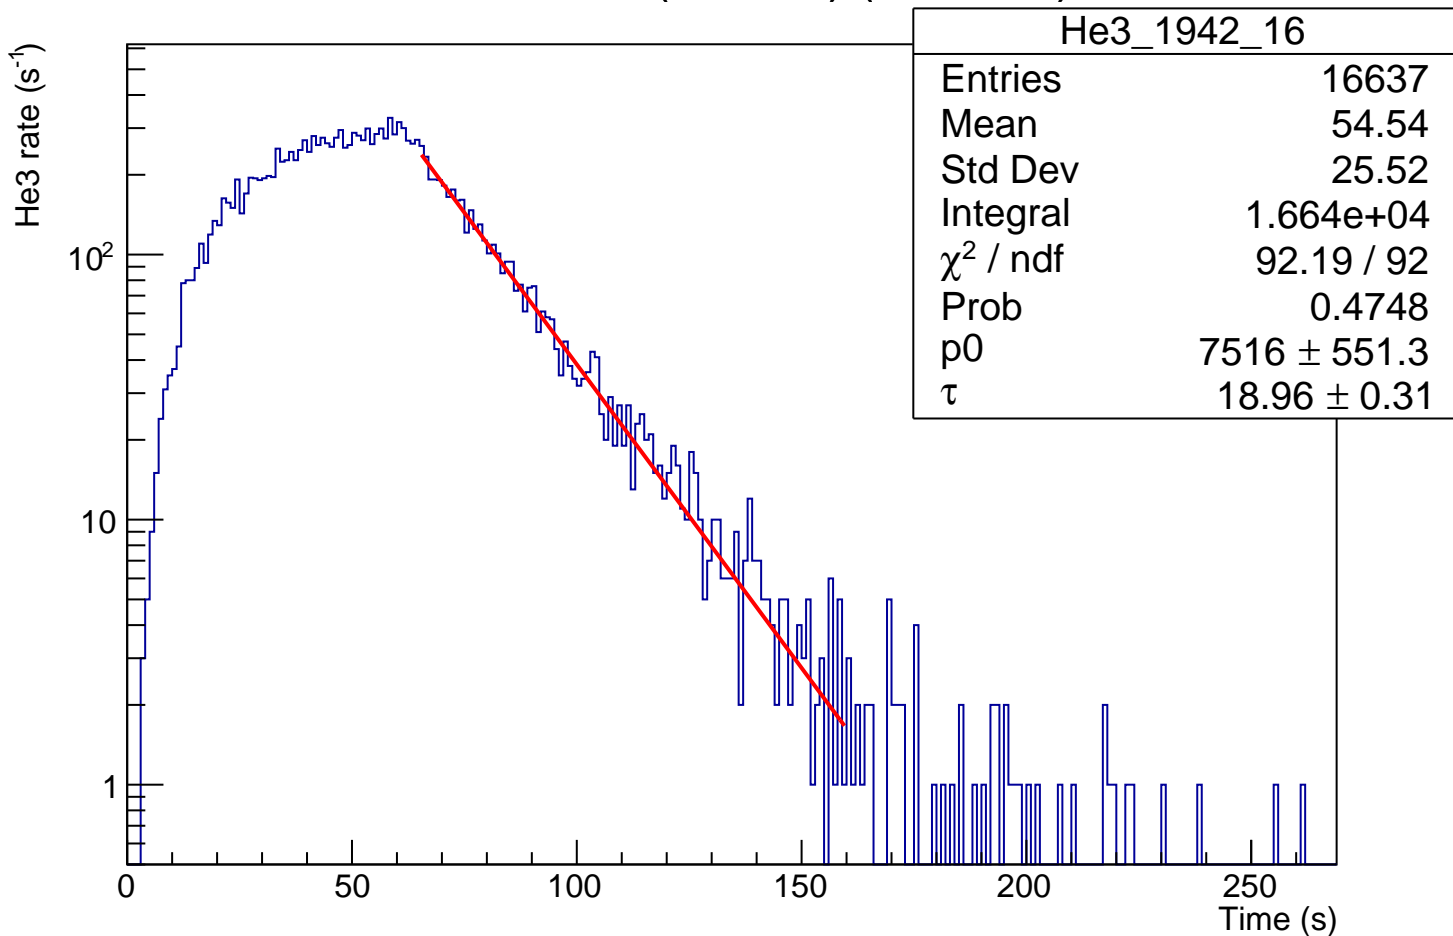

# TCN19-260 (UGD22) (He3 rate)

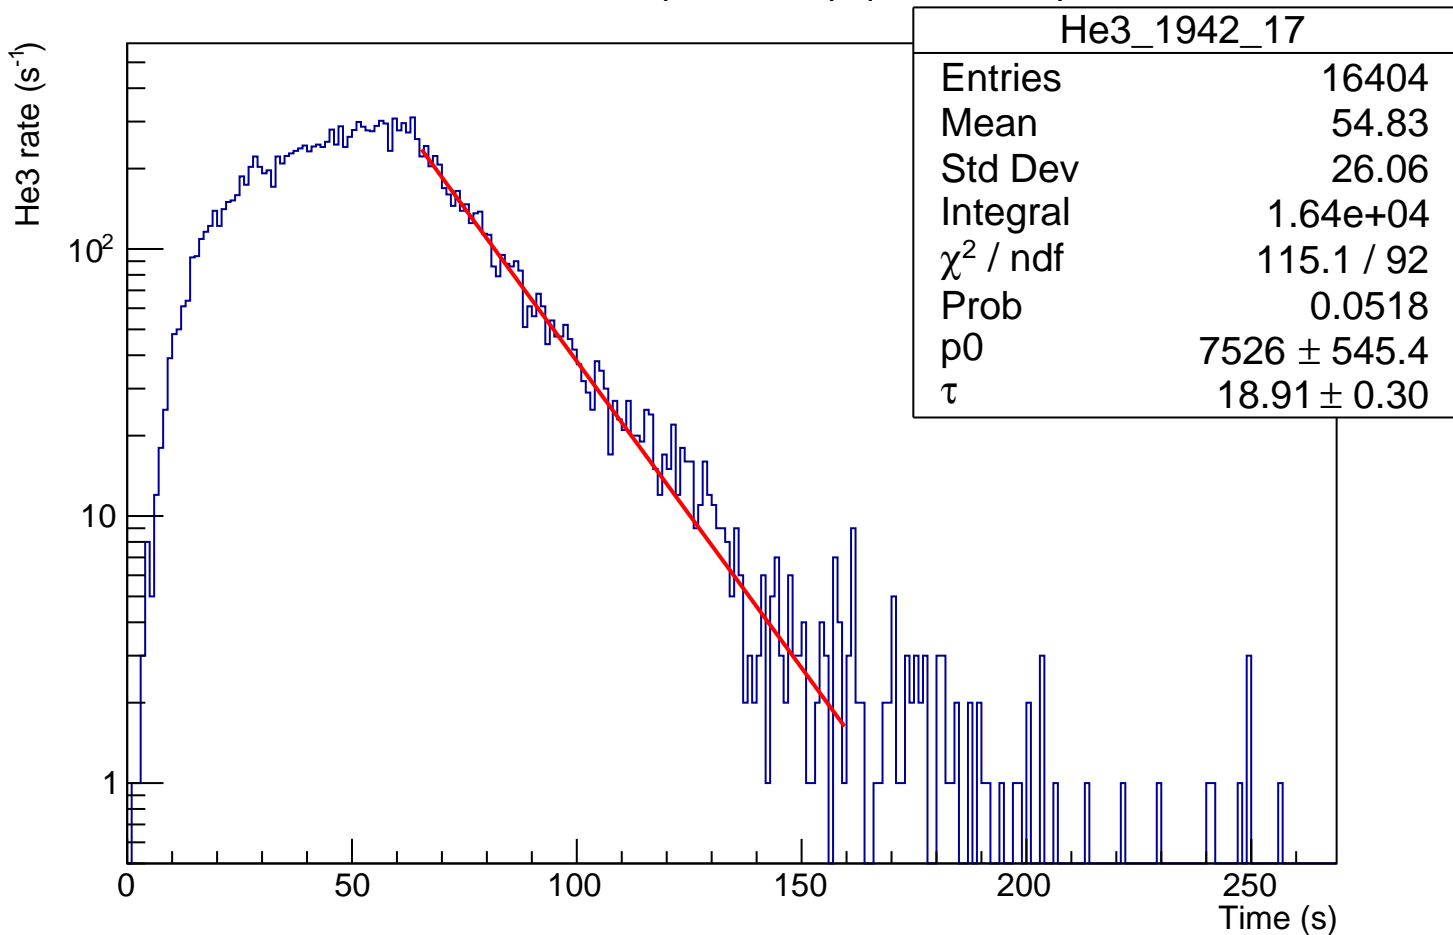


# TCN19-260 (UGD22) (He3 rate)

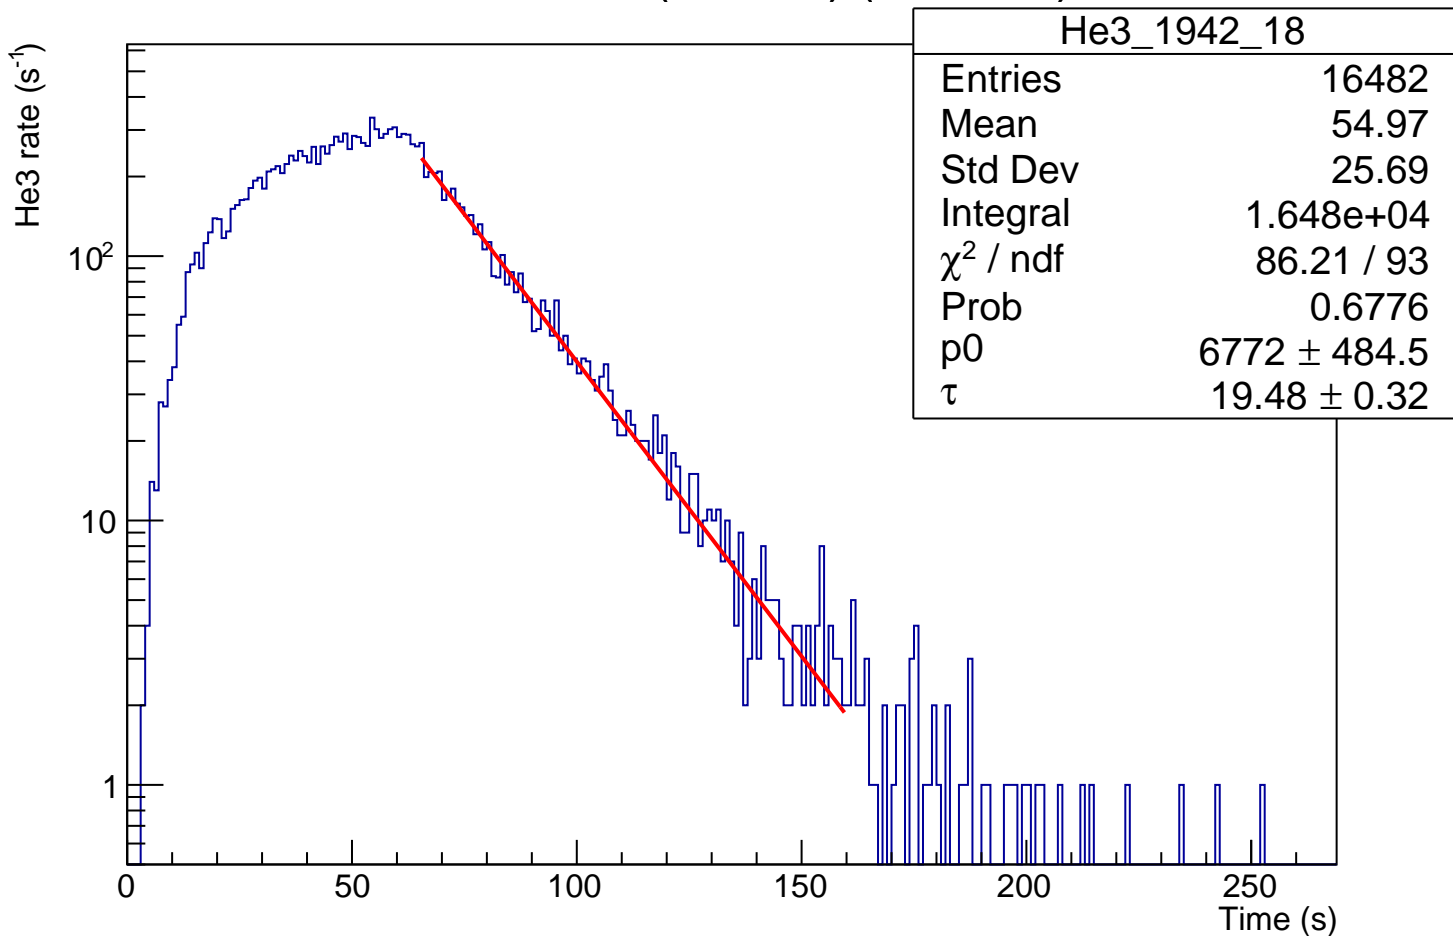





# TCN19-260 (UGD22) (He3 rate)

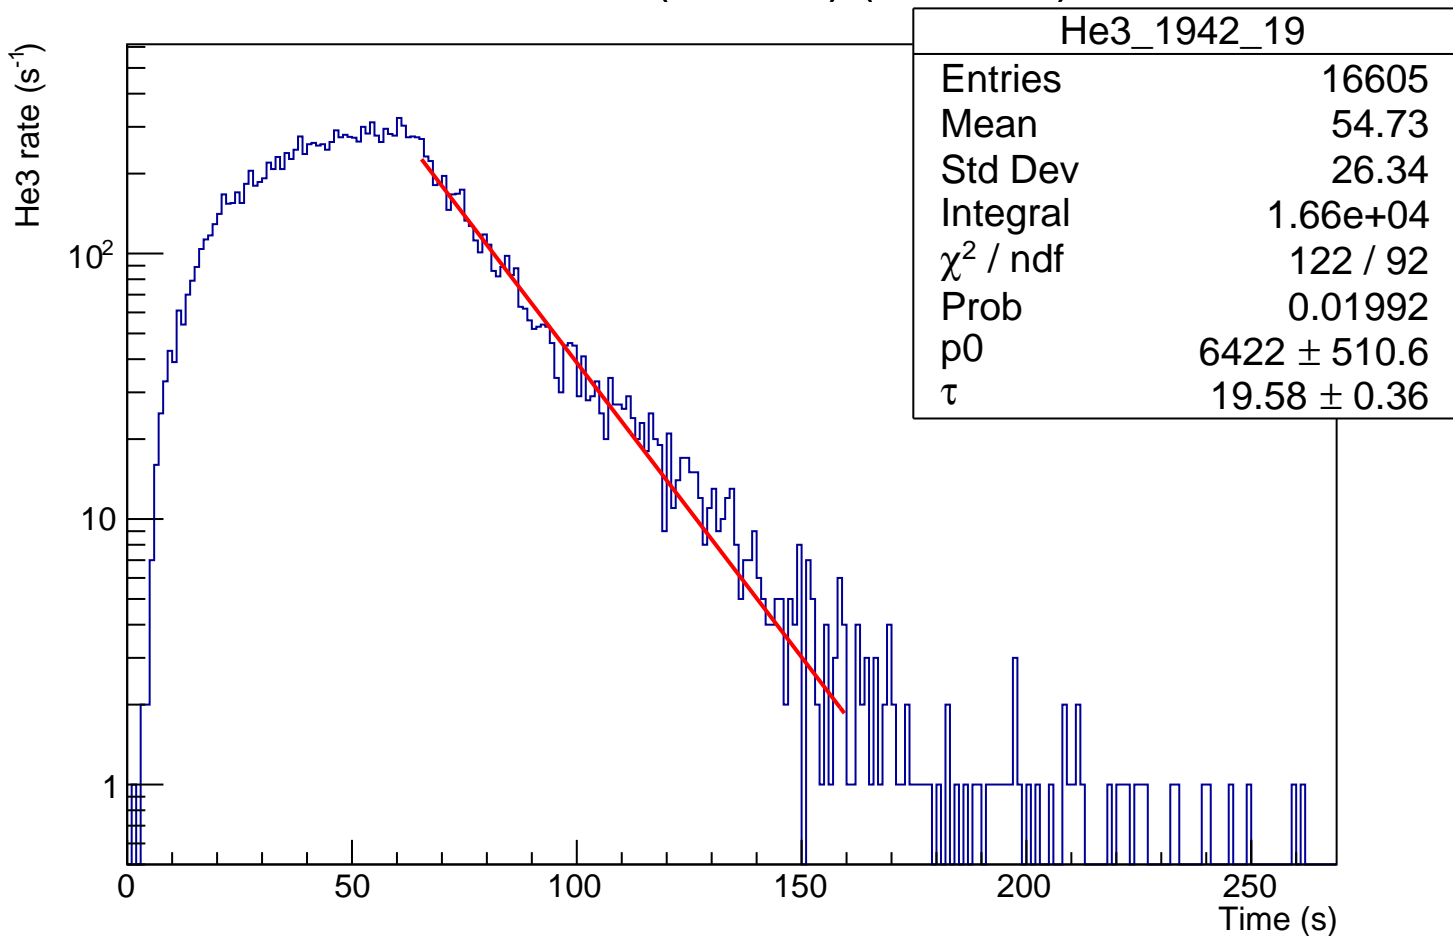


# TCN19-260 (UGD22) (He3 rate)

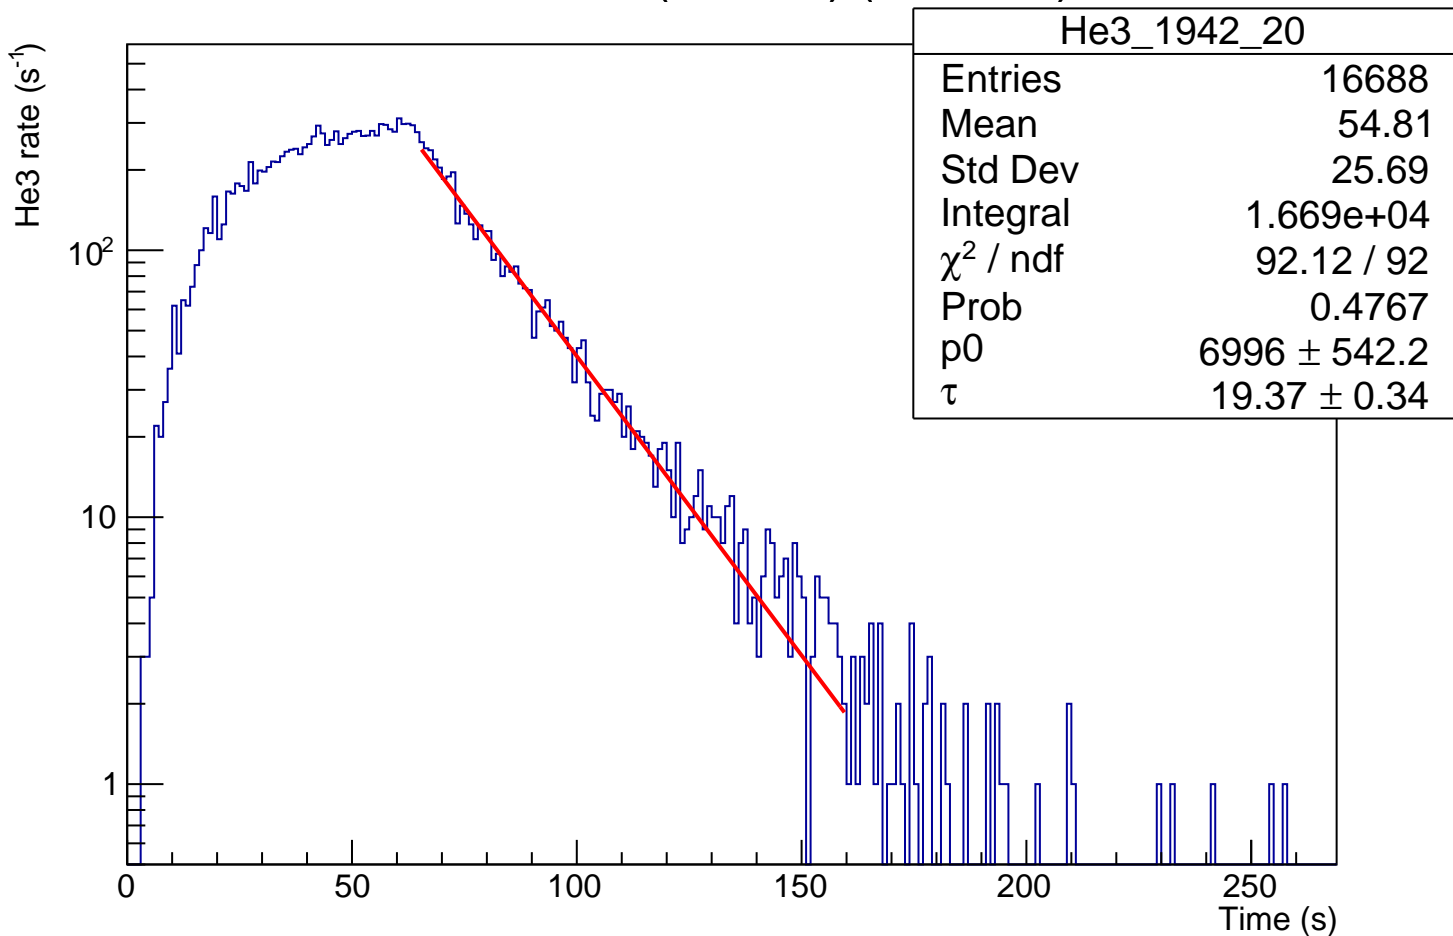


# TCN19-260 (UGD22) (He3 rate)

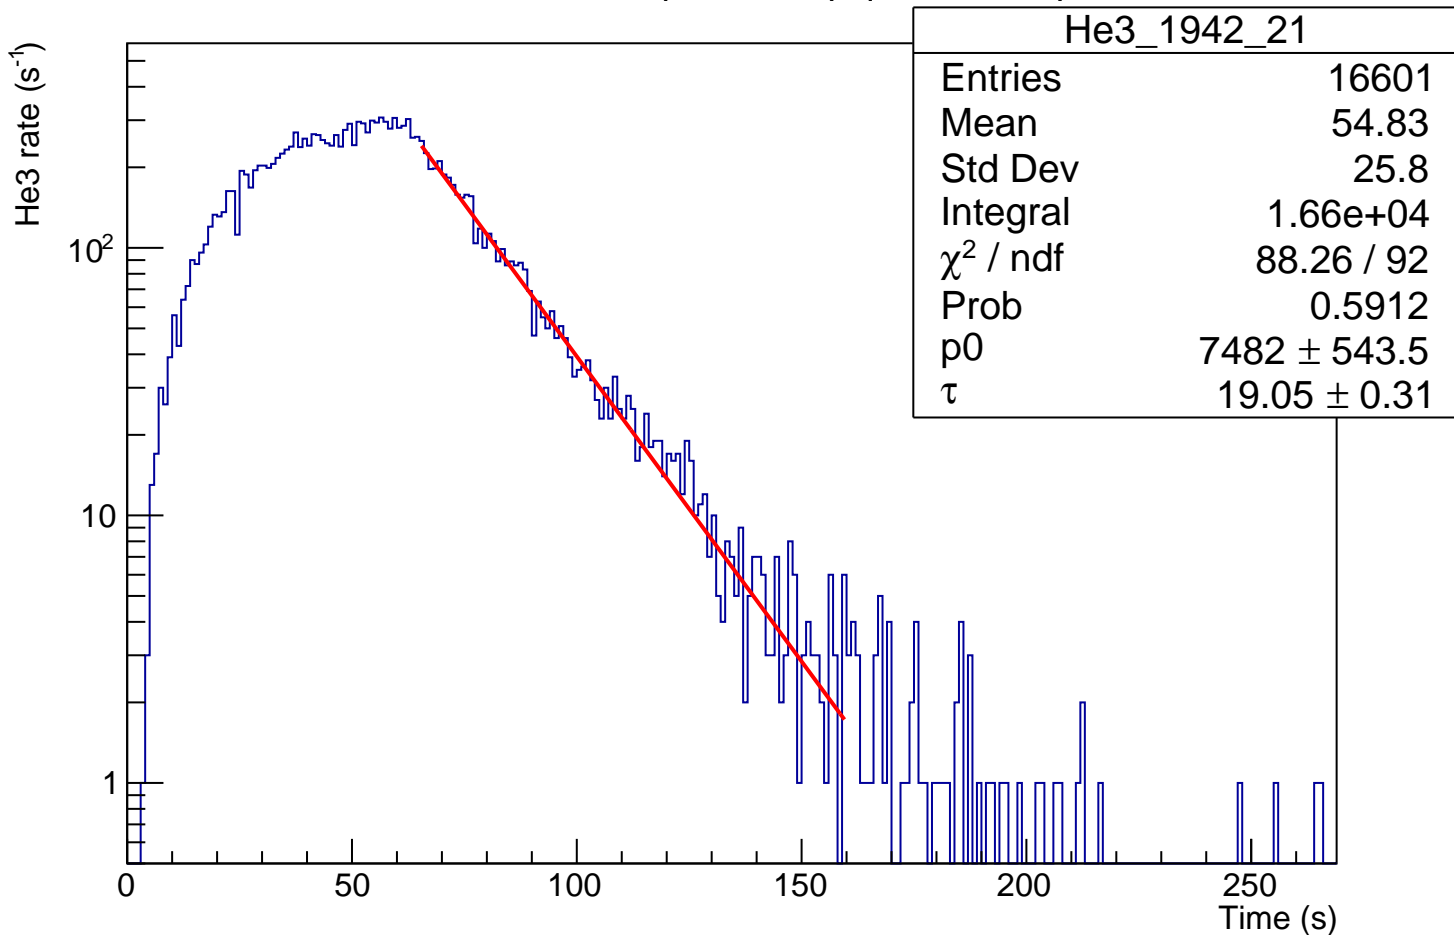


# TCN19-260 (UGD22) (He3 rate)

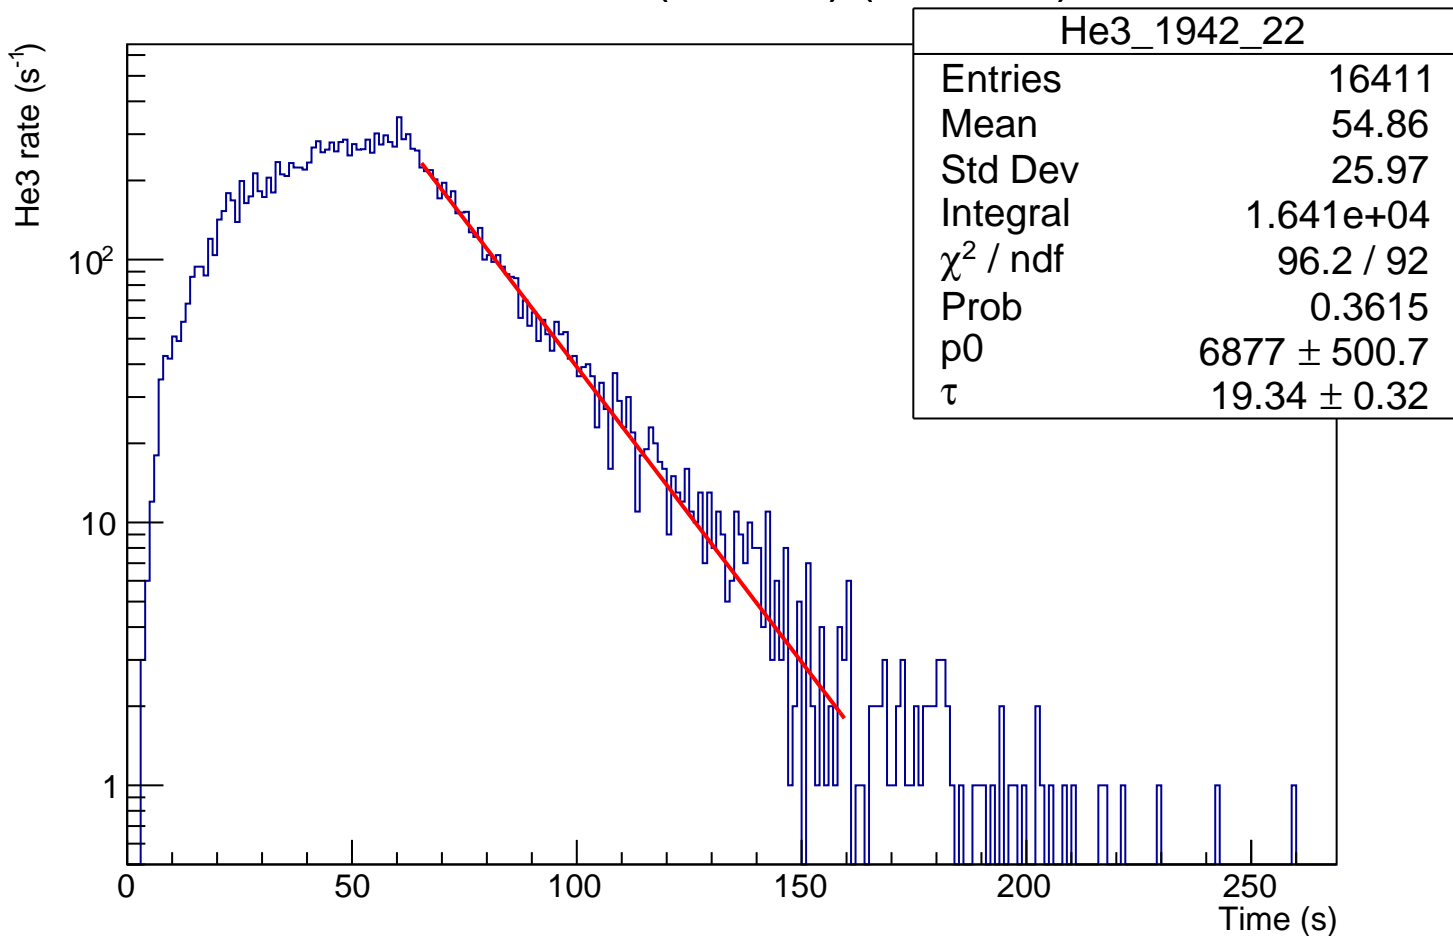


# TCN19-260 (UGD22) (He3 rate)

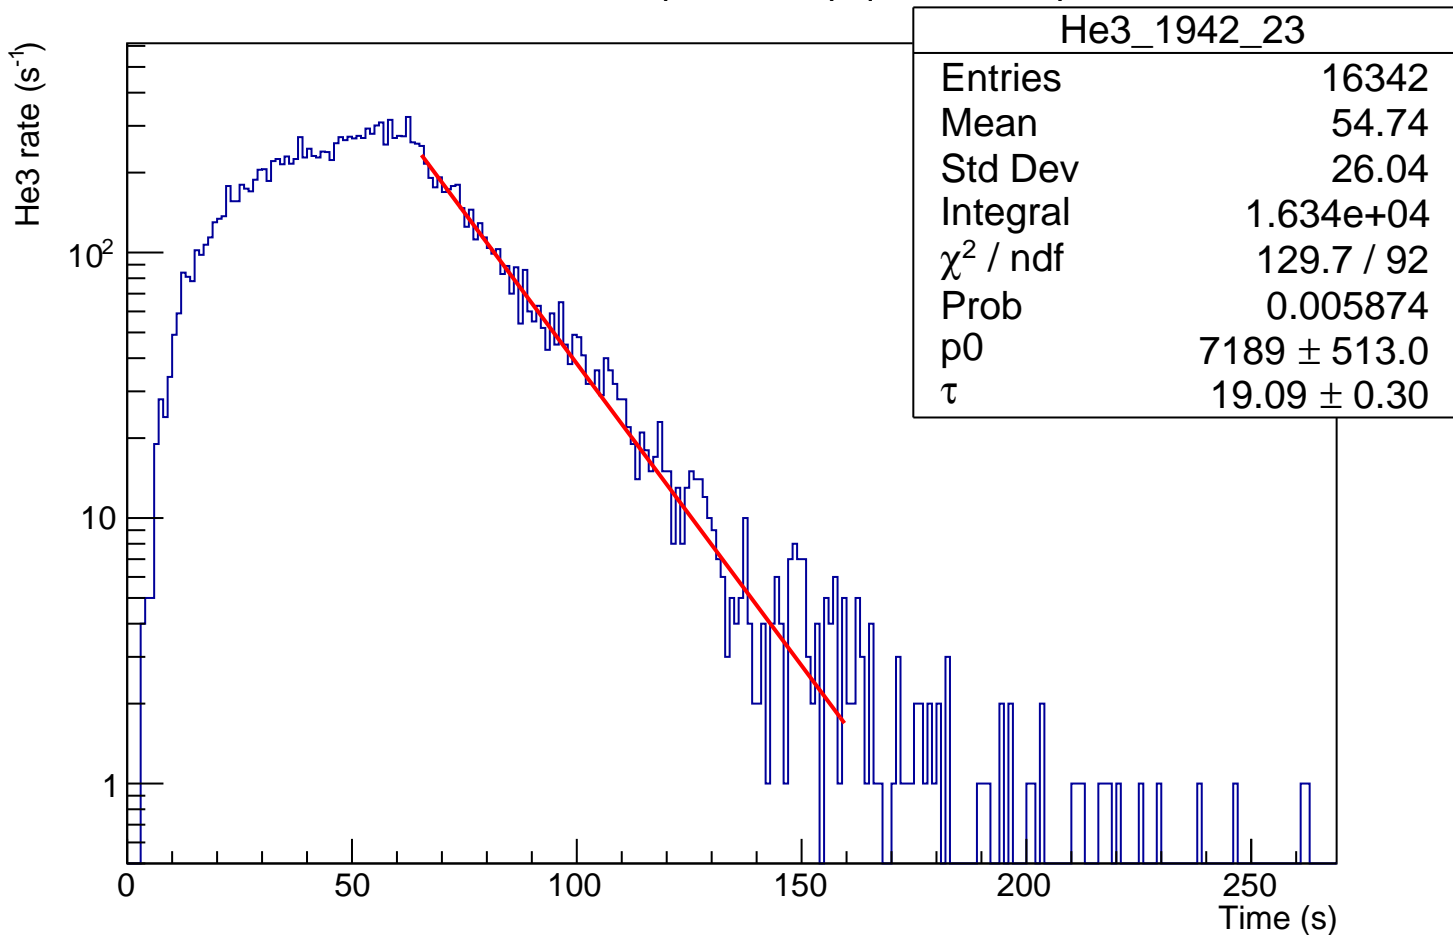

# TCN19-260 (UGD22) (He3 rate)

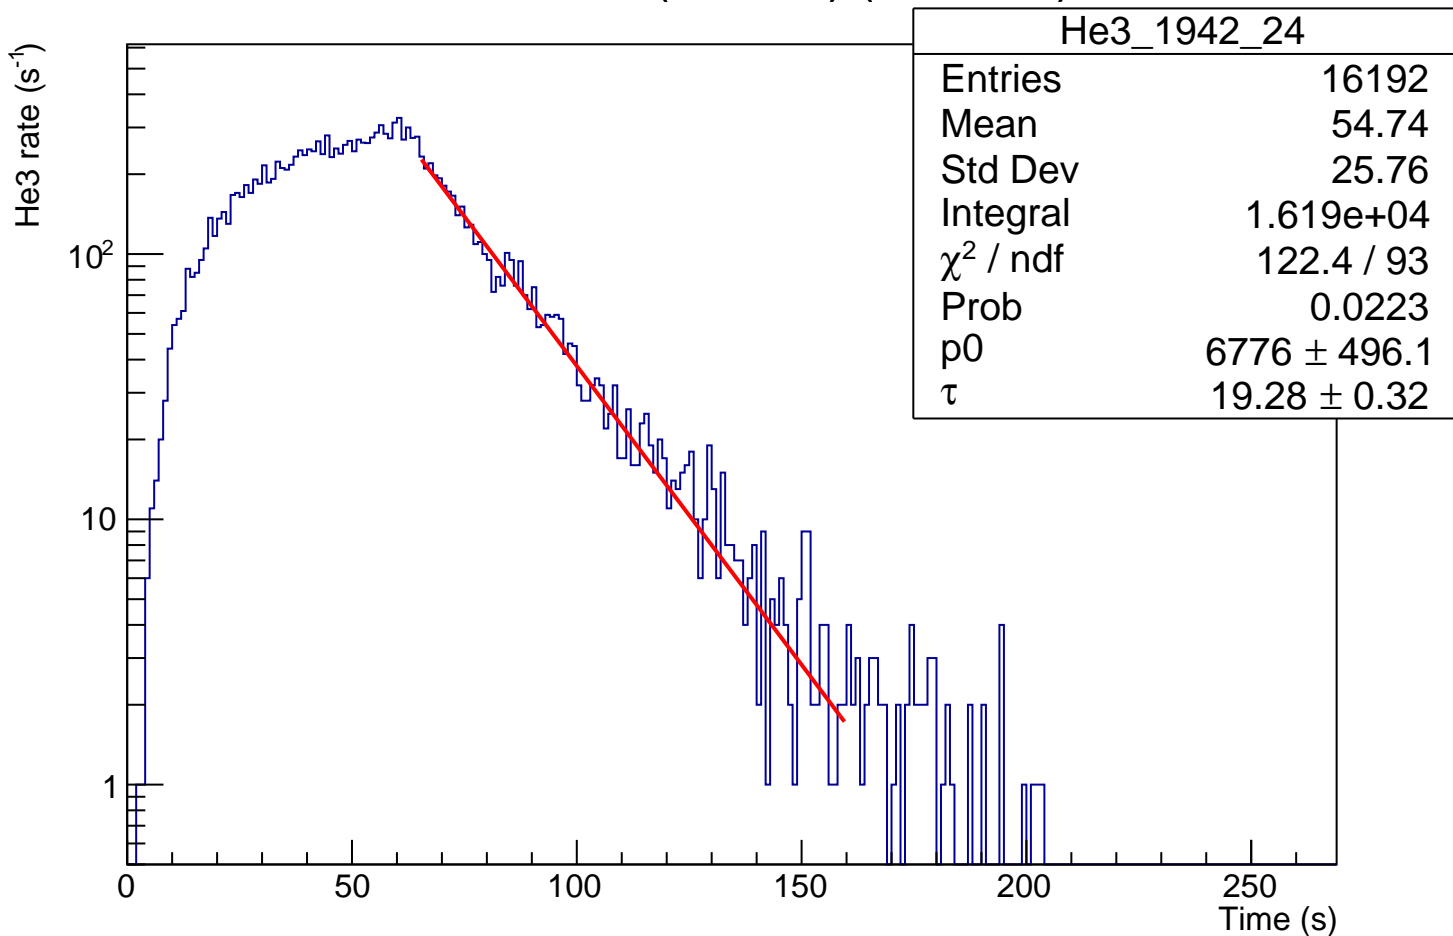

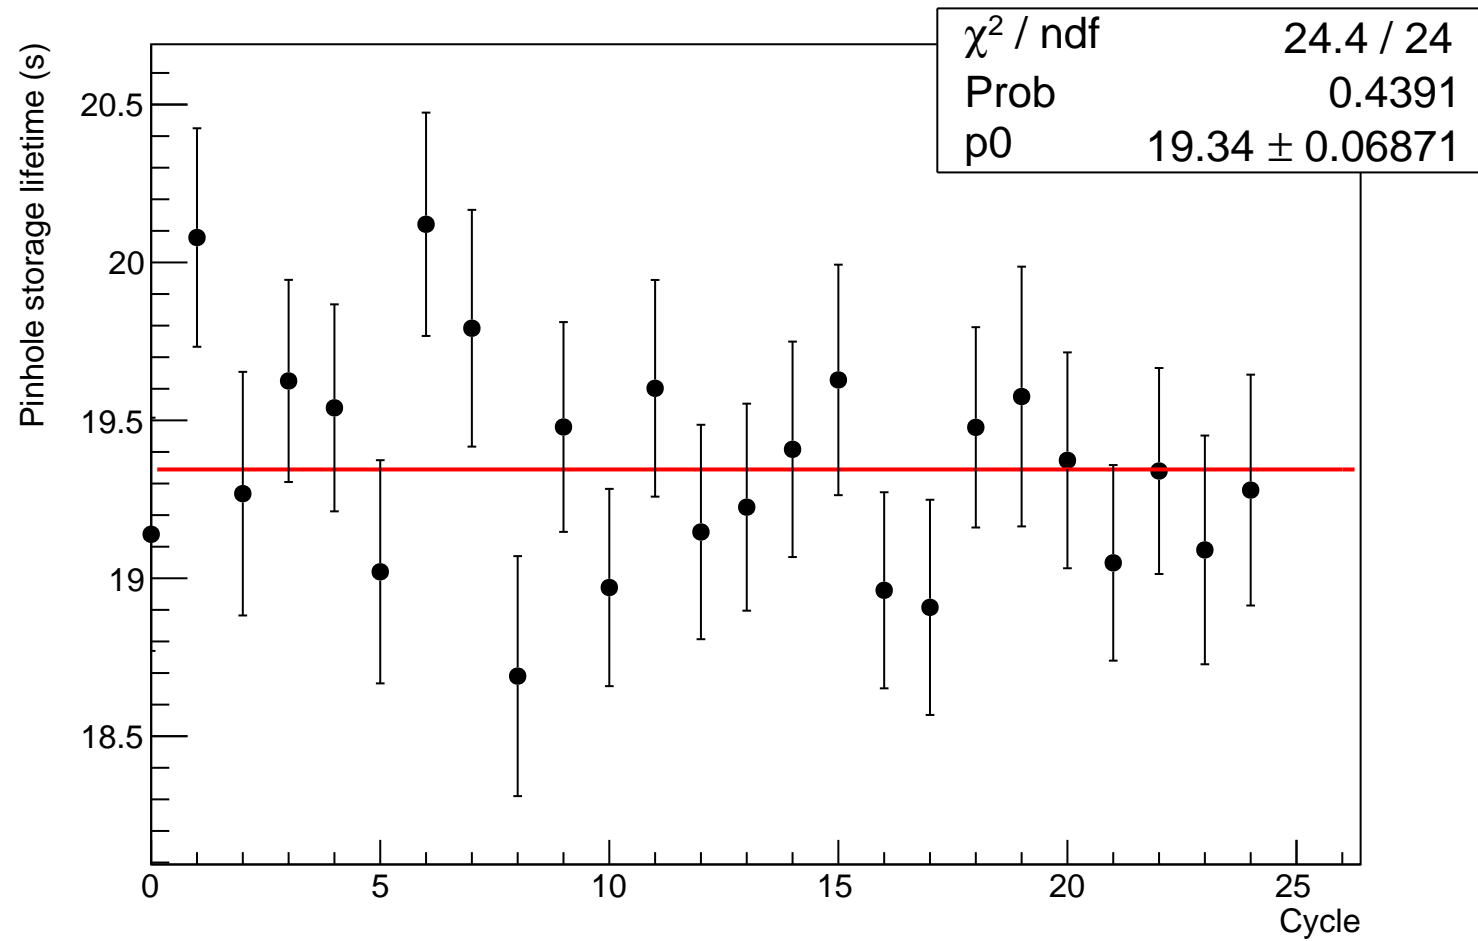

# TCN19-260 (UGD22)

