

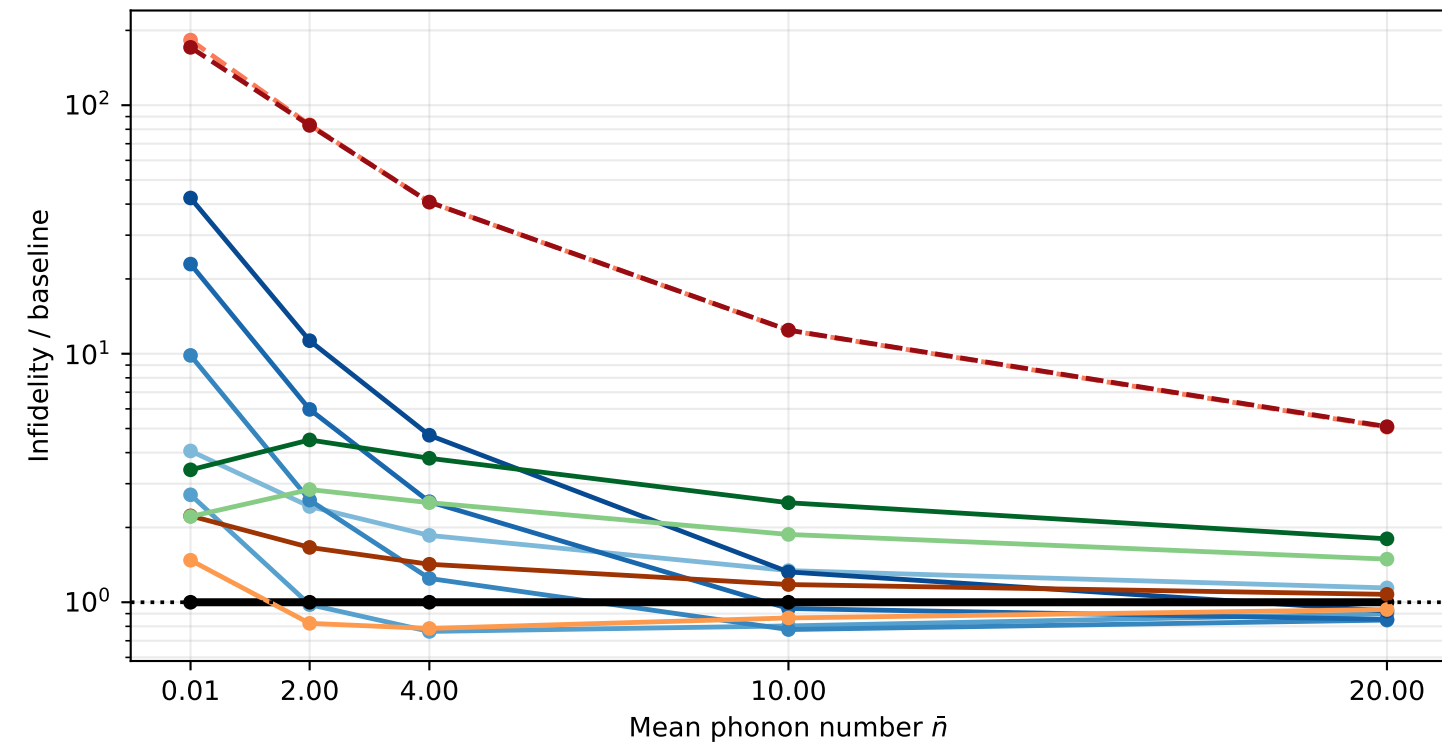
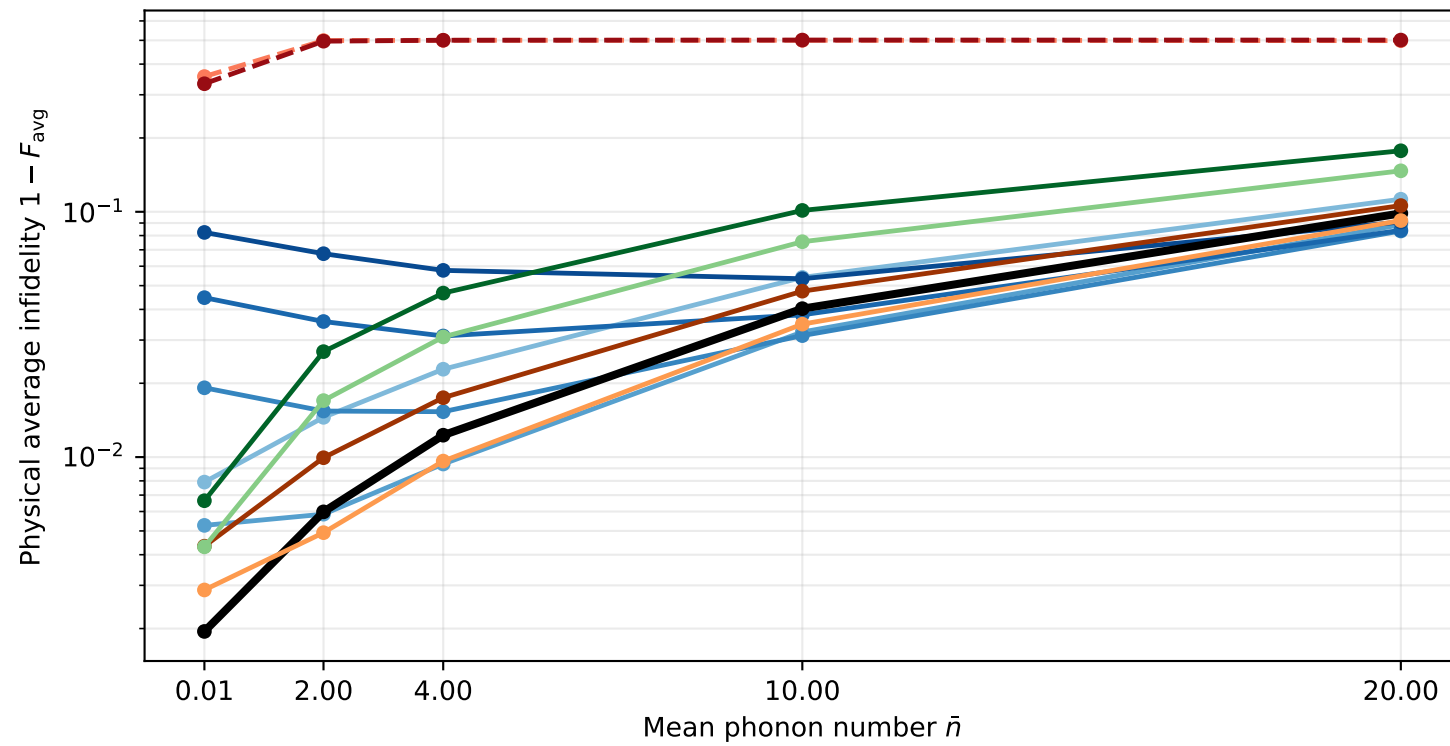


Physical-control screening: full-Hamiltonian QPT

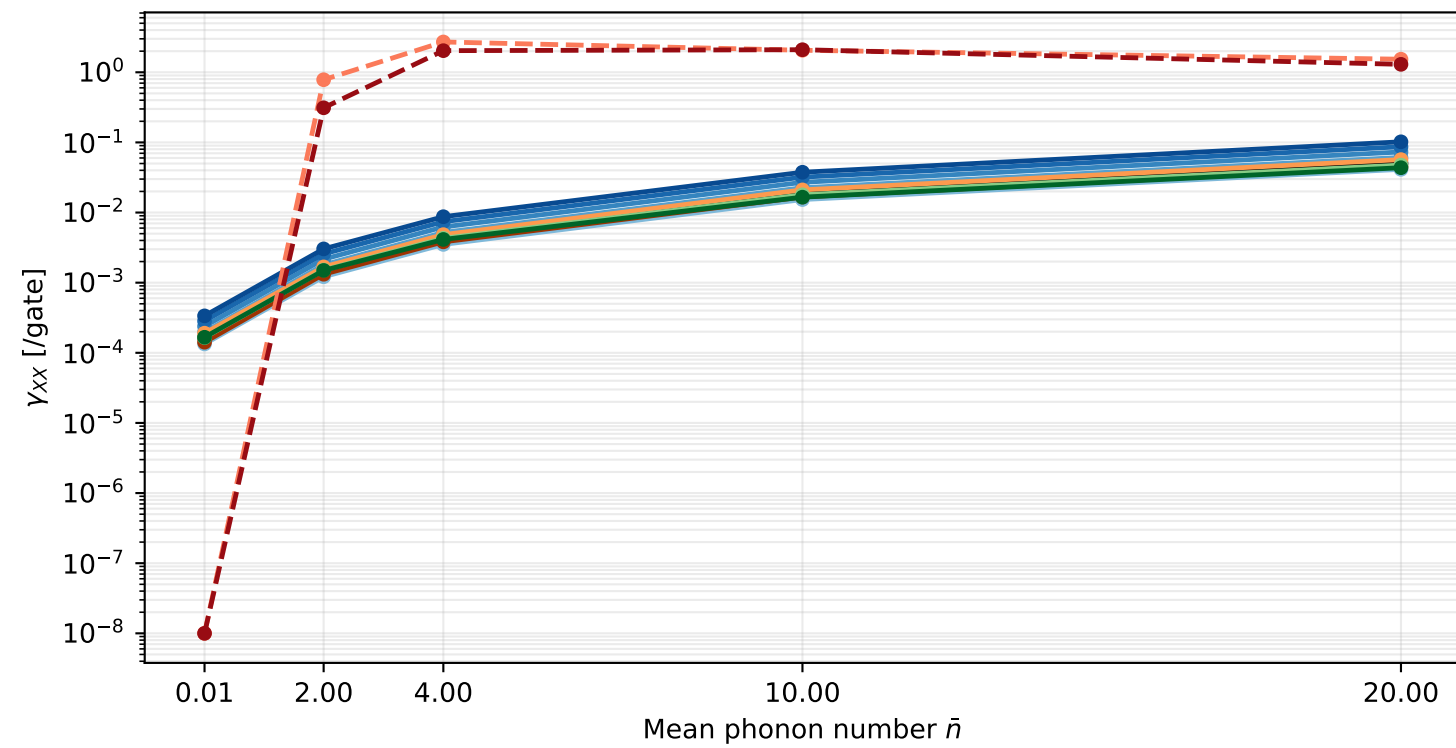

Dashed pulse curves use RMS-normalized, angle-uncalibrated pulses; their h_{XX} /gamma generator values are not a fair calibrated comparison.

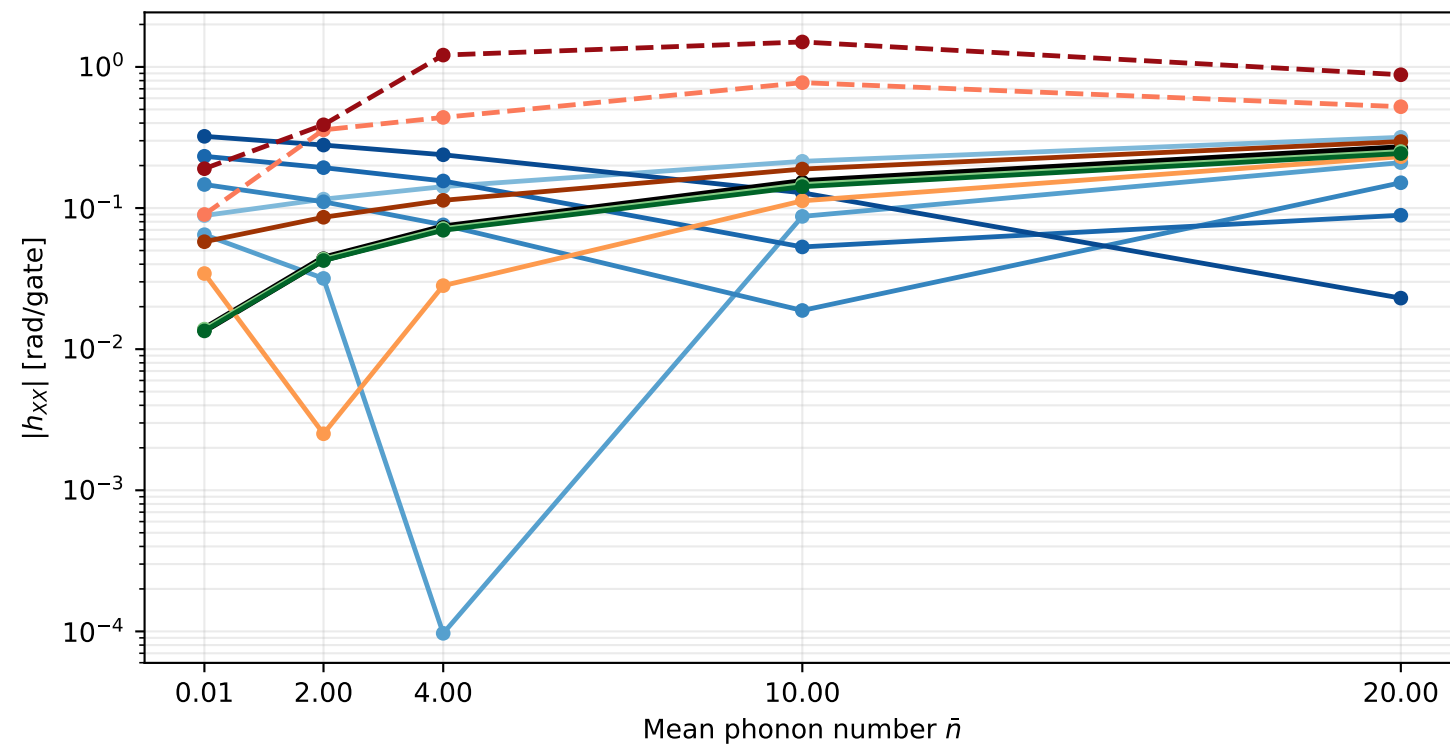