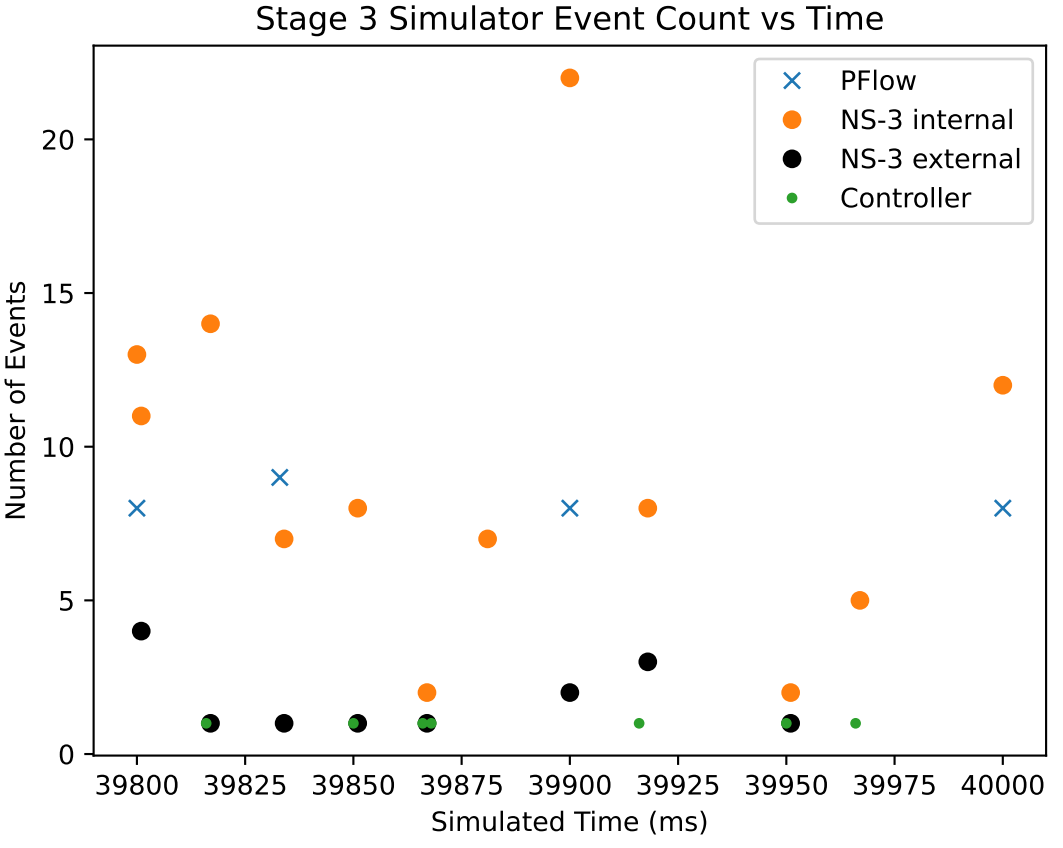
Stage 3 Simulator Event Count vs Time
PFlow
NS-3 internal
NS-3 external
Controller
Number of Events
0
5
10
15
20
39800
39825
39850
39875
39900
39925
39950
39975
40000
Simulated Time (ms)