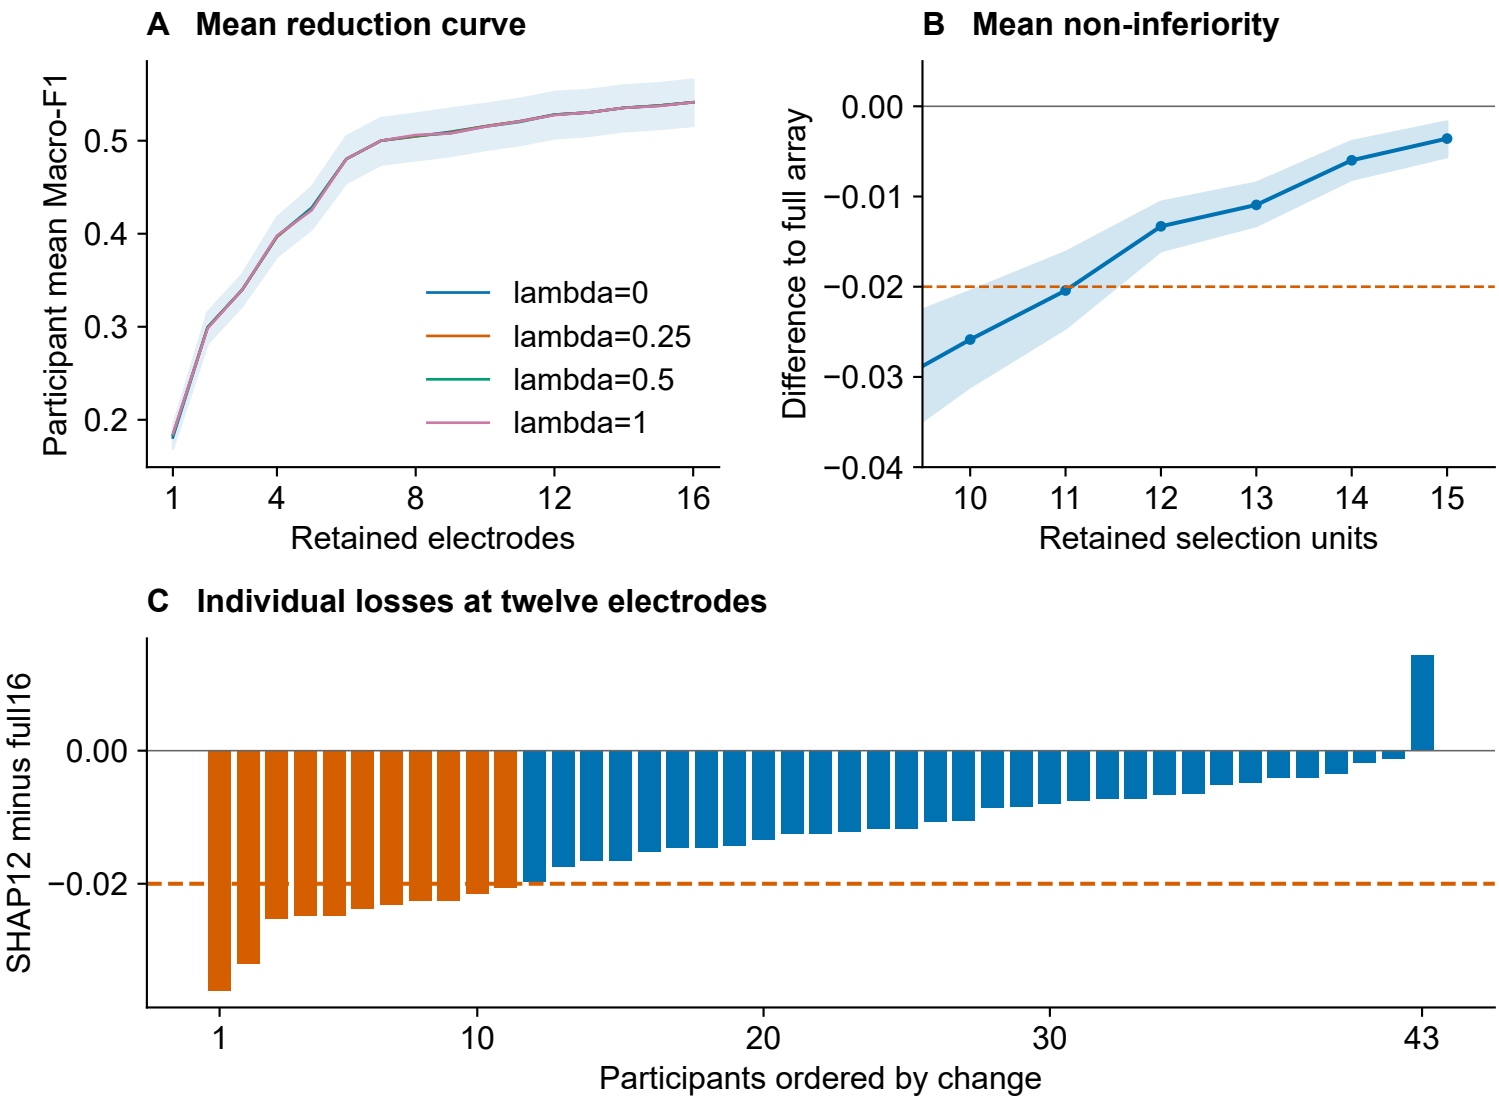
A Mean reduction curve
Participant mean Macro-F1
0.5
0.4
0.3
0.2
lambda=0
lambda=0.25
lambda=0.5
lambda=1
1
4
8
12
16
Retained electrodes
B Mean non-inferiority
Difference to full array
0.00
−0.01
−0.02
−0.03
−0.04
10
11
12
13
14
15
Retained selection units
C Individual losses at twelve electrodes
SHAP12 minus full16
0.00
−0.02
1
10
20
30
43
Participants ordered by change