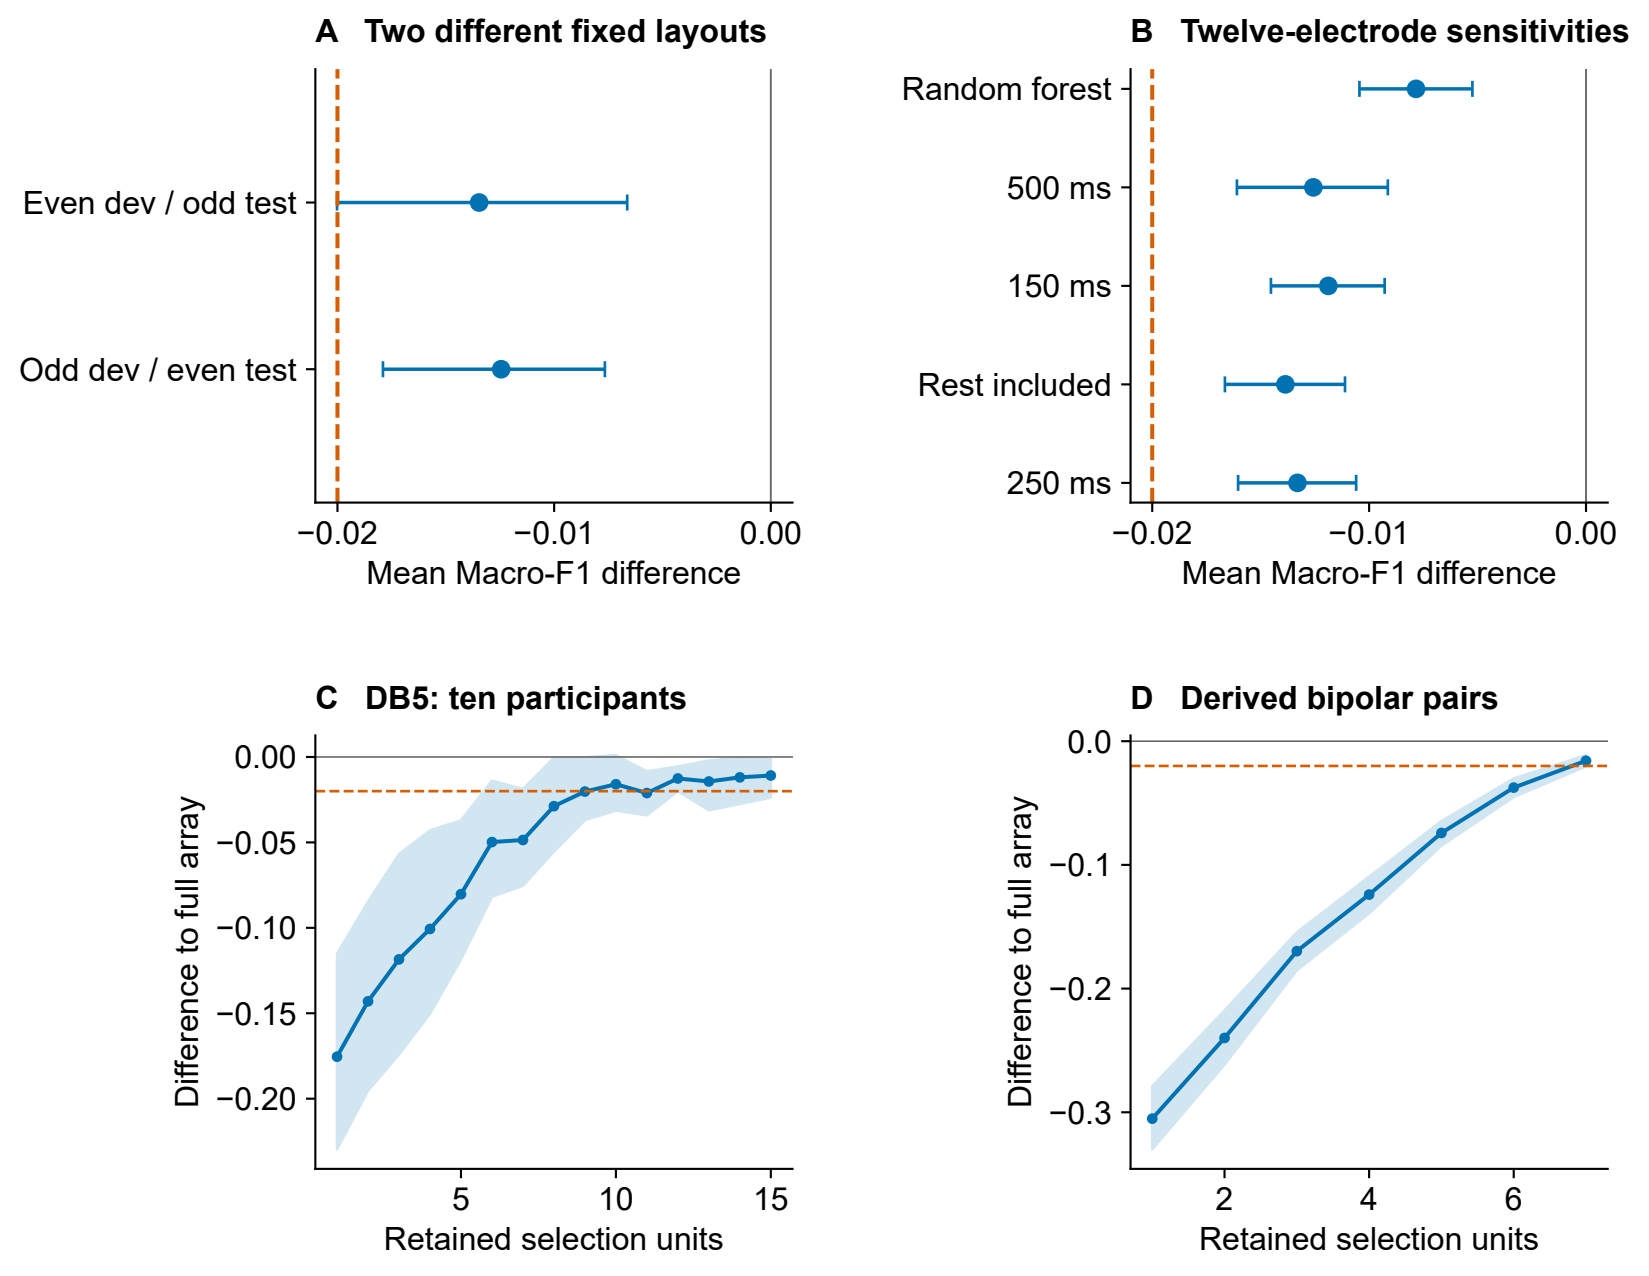
A Two different fixed layouts
Even dev / odd test
Odd dev / even test
−0.02
−0.01
0.00
Mean Macro-F1 difference
B Twelve-electrode sensitivities
Random forest
500 ms
150 ms
Rest included
250 ms
−0.02
−0.01
0.00
Mean Macro-F1 difference
C DB5: ten participants
Difference to full array
0.00
−0.05
−0.10
−0.15
−0.20
5
10
15
Retained selection units
D Derived bipolar pairs
Difference to full array
0.0
−0.1
−0.2
−0.3
2
4
6
Retained selection units