



National Load Despatch Centre
राष्ट्रीय भार प्रेषण केंद्र
POWER SYSTEM OPERATION CORPORATION LIMITED
पावर सिस्टम ऑपरेशन कारपोरेशन लिमिटेड
(Government of India Enterprise/ भारत सरकार का उद्यम)
B-9, QUTUB INSTITUTIONAL AREA, KATWARIA SARAI, NEW DELHI -110016
बी-9, कुतुब इन्स्टीट्यूशनल एरिया, कटवारिया सराये, न्यू दिल्ली-110016

Ref: POSOCO/NLDC/SO/Daily PSP Report

दिनांक: 21st August 2018

To,

1. कार्यकारी निदेशक, पू. क्षे. भा. प्रे. के., 14, गोल्फ क्लब रोड, कोलकाता - 700033
Executive Director, ERLDC, 14 Golf Club Road, Tollygunge, Kolkata, 700033
2. महाप्रबंधक, ऊ. क्षे. भा. प्रे. के., 18/ ए, शहीद जीत सिंह सनसनवाल मार्ग, नई दिल्ली - 110016
General Manager, NRLDC, 18-A, Shaheed Jeet Singh Marg, Katwaria Sarai, New Delhi - 110016
3. कार्यकारी निदेशक, प. क्षे. भा. प्रे. के., एफ3-, एम आई डी सी क्षेत्र, अंधेरी, मुंबई -400093
Executive Director, WRLDC, F-3, M.I.D.C. Area, Marol, Andheri (East), Mumbai-400093
4. कार्यकारी निदेशक, ऊ. पू. क्षे. भा. प्रे. के., डोंगतेह, लोअर नोंग्रह, लापलंग, शिलोंग - 793006
Executive Director, NERLDC, Dongteih, Lower Nongrah, Lapalang, Shillong - 793006, Meghalaya
5. महाप्रबंधक, द. क्षे. भा. प्रे. के., 29, रेस कोर्स क्रॉस रोड, बंगलुरु -560009
General Manager, SRLDC, 29, Race Course Cross Road, Bangalore-560009

Sub: Daily PSP Report for the date 20.08.2018.

महोदय/Dear Sir,

आई०ई०जी०सी०-2010 की धारा स.-5.5.1 के प्रावधान के अनुसार, दिनांक 20-अगस्त-2018 की अखिल भारतीय प्रणाली की दैनिक ग्रिड निष्पादन रिपोर्ट रा०भा०प्रे०के० की वेबसाइट पर उपलब्ध है ।

As per article 5.5.1 of the Indian Electricity Grid Code, the daily report pertaining power supply position of All India Power System for the date 20th August 2018, is available at the NLDC website.

धन्यवाद,

पॉवर सिस्टम ऑपरेशन कारपोरेशन लिमिटेड
राष्ट्रीय भार प्रेषण केंद्र, नई दिल्ली

Report for previous day

Date of Reporting

21-Aug-18

A. Maximum Demand

	NR	WR	SR	ER	NER	Total
Demand Met during Evening Peak hrs(MW) (at 2000 hrs; from RLDCs)	56157	43753	38744	20482	2674	161810
Peak Shortage (MW)	869	0	0	520	197	1586
Energy Met (MU)	1256	991	833	438	51	3569
Hydro Gen (MU)	352	19	171	104	21	667
Wind Gen (MU)	25	62	233	-----	-----	319
Solar Gen (MU)*	16.35	8.06	32.08	0.60	0.01	57
Energy Shortage (MU)	9.5	0.0	0.0	1.6	2.1	13.2
Maximum Demand Met during the day (MW) & time (from NLDC SCADA)	57641	45112	38259	21113	2653	162804
	22:30	10:40	19:00	20:31	19:04	19:54

B. Frequency Profile (%)

Region	FV1	<49.7	49.7-49.8	49.8-49.9	<49.9	49.9-50.05	> 50.05
All India	0.025	0.00	0.02	2.79	2.81	77.48	19.71

C. Power Supply Position in States

Region	States	Max. Demand Met during the day (MW)	Shortage during maximum Demand (MW)	Energy Met (MU)	Drawal Schedule (MU)	OD(+)/UD(-) (MU)	Max OD (MW)	Energy Shortage (MU)
NR	Punjab	10774	0	238.1	142.8	0.1	390	0.0
	Haryana	8956	0	189.6	145.6	1.2	641	0.0
	Rajasthan	10075	0	222.9	81.1	1.3	846	0.0
	Delhi	5752	0	117.6	100.4	-1.4	132	0.0
	UP	18067	0	370.7	185.4	1.2	863	0.0
	Uttarakhand	1960	0	41.1	21.3	0.2	243	0.0
	HP	1343	9	28.5	-1.4	3.3	131	0.1
	J&K	2153	538	41.9	19.4	-2.7	173	9.4
WR	Chandigarh	280	0	5.8	6.4	-0.6	22	0.0
	Chhattisgarh	3579	0	81.5	15.5	-1.4	389	0.0
	Gujarat	13490	0	294.1	74.9	1.0	470	0.0
	MP	7830	0	171.6	77.8	-0.5	473	0.0
	Maharashtra	18437	0	398.4	115.1	-1.3	566	0.0
	Goa	441	0	9.0	8.5	-0.1	72	0.0
	DD	332	0	7.3	6.6	0.7	85	0.0
	DNH	781	0	18.1	17.4	0.6	67	0.0
SR	Essar steel	561	0	11.0	10.7	0.3	293	0.0
	Andhra Pradesh	6884	0	158.5	3.5	2.1	433	0.0
	Telangana	6739	0	141.6	43.5	-1.8	402	0.0
	Karnataka	8333	0	166.6	25.1	0.1	405	0.0
	Kerala	2967	0	53.6	21.8	-0.8	263	0.0
	Tamil Nadu	14761	0	304.9	91.1	-0.4	442	0.0
	Pondy	364	0	7.7	7.7	-0.1	32	0.0
ER	Bihar	4813	0	92.5	91.1	-0.4	200	0.0
	DVC	2869	0	64.3	-29.3	2.3	220	1.0
	Jharkhand	1096	0	23.2	18.2	-1.2	80	0.0
	Odisha	4771	0	91.9	43.1	3.4	250	0.6
	West Bengal	8209	0	164.6	57.8	0.2	225	0.0
	Sikkim	85	0	1.0	1.3	-0.3	15	0.0
NER	Arunachal Pradesh	118	2	2.2	2.4	-0.2	25	0.0
	Assam	1709	151	33.2	28.0	0.9	188	2.0
	Manipur	181	1	2.2	2.3	-0.1	25	0.0
	Meghalaya	311	0	5.0	1.2	0.0	53	0.0
	Mizoram	81	1	1.4	1.1	0.0	17	0.0
	Nagaland	116	2	2.2	2.0	-0.2	35	0.0
	Tripura	282	3	4.8	4.5	-0.4	103	0.1

D. Transnational Exchanges (MU) - Import(+ve)/Export(-ve)

	Bhutan	Nepal	Bangladesh
Actual(MU)	32.2	-6.8	-15.3
Day peak (MW)	1749.4	-307.0	-667.7

E. Import/export By Regions(in MU) - Import(+ve)/Export(-ve); OD(+)/UD(-)

	NR	WR	SR	ER	NER	TOTAL
Schedule(MU)	292.5	-245.4	-16.2	-34.2	3.5	0.2
Actual(MU)	279.8	-238.3	-18.4	-28.7	1.1	-4.5
O/D/U/D(MU)	-12.7	7.1	-2.2	5.5	-2.4	-4.7

F. Generation Outage(MW)

	NR	WR	SR	ER	NER	Total
Central Sector	3800	15582	10512	1470	91	31456
State Sector	7240	16394	12703	5335	50	41721
Total	11040	31976	23215	6805	141	73177

G. Sourcewise generation (MU)

	NR	WR	SR	ER	NER	All India
Thermal (Coal & Lignite)	553	1059	339	383	7	2342
Hydro	352	24	171	104	21	672
Nuclear	27	27	24	0	0	79
Gas, Naptha & Diesel	17	41	23	0	26	106
RES (Wind, Solar, Biomass & Others)	54	102	303	1	0	460
Total	1003	1254	861	488	54	3659

Share of RES in total generation (%)	5.37	8.17	35.18	0.12	0.06	12.56
Share of Non-fossil fuel (Hydro, Nuclear and RES) in total generation (%)	43.23	12.25	57.86	21.49	38.55	33.09

H. Diversity Factor

All India Demand Diversity Factor	1.012
-----------------------------------	-------

Diversity factor = Sum of regional maximum demands / All India maximum demand

*Source: RLDCs for solar connected to ISTS; SLDCs for embedded solar. Limited visibility of embedded solar data.

INTER-REGIONAL EXCHANGES						Date of Reporting : 21-Aug-18		
								Import=(+ve) /Export =(-ve) for NET (MU)
Sl No	Voltage Level	Line Details	Circuit	Max Import (MW)	Max Export (MW)	Import (MU)	Export (MU)	NET (MU)
Import/Export of ER (With NR)								
1	765kV	GAYA-VARANASI	D/C	0	509	0.0	7.4	-7.4
2		SASARAM-FATEHPUR	S/C	358	14	4.3	0.0	4.3
3		GAYA-BALIA	S/C	0	355	0.0	6.6	-6.6
4		ALIPURDUAR-AGRA	-	0	787	0.0	18.8	-18.8
5	HVDC	PUSAULI B/B	S/C	0	398	0.0	7.0	-7.0
6		PUSAULI-VARANASI	S/C	1	297	0.0	0.0	0.0
7		PUSAULI -ALLAHABAD	S/C	0	412	0.0	0.0	0.0
8		MUZAFFARPUR-GORAKHPUR	D/C	0	669	0.0	10.5	-10.5
9	400 kV	PATNA-BALIA	Q/C	0	1121	0.0	20.1	-20.1
10		BIHARSHARIFF-BALIA	D/C	0	211	0.0	3.1	-3.1
11		MOTIHARI-GORAKHPUR	D/C	119	0	5.5	0.0	5.5
12		BIHARSHARIFF-VARANASI	D/C	25	0	0.3	0.0	0.3
13	220 kV	PUSAULI-SAHUPURI	S/C	0	176	0.0	3.6	-3.6
14	132 kV	SONE NAGAR-RIHAND	S/C	0	0	0.0	0.0	0.0
15		GARWAH-RIHAND	S/C	35	0	0.6	0.0	0.6
16		KARMANASA-SAHUPURI	S/C	0	0	0.0	0.0	0.0
17		KARMANASA-CHANDAUJI	S/C	0	0	0.0	0.0	0.0
ER-NR						10.6	77.0	-66.4
Import/Export of ER (With WR)								
18	765 kV	JHARSUGUDA-DHARAMJAIGARH S/C	D/C	912	12	13.5	0.0	13.5
19		NEW RANCHI-DHARAMJAIGARH	D/C	942	0	15.7	0.0	15.7
20	400 kV	JHARSUGUDA-RAIGARH	Q/C	981	0	18.6	0.0	18.6
21		RANCHI-SIPAT	D/C	425	0	6.8	0.0	6.8
22	220 kV	BUDHIPADAR-RAIGARH	S/C	129	11	1.1	0.0	1.1
23		BUDHIPADAR-KORBA	D/C	178	0	3.2	0.0	3.2
ER-WR						59.0	0.0	59.0
Import/Export of ER (With SR)								
24	765 kV	ANGUL-SRIKAKULAM	D/C	47.0	1180.8	0.0	10.5	-10.5
25	HVDC LINK	JEYPORE-GAZUWAKA B/B	D/C	0.0	367.7	0.0	8.7	-8.7
26		TALCHER-KOLAR BIPOLE	D/C	0.0	303.6	0.0	7.3	-7.3
27	400 kV	TALCHER-I/C	D/C	1005.1	0.0	0.0	17.6	-17.6
28	220 kV	BALIMELA-UPPER-SILERRU	S/C	0.0	0.0	0.0	0.0	0.0
ER-SR						0.0	26.5	-26.5
Import/Export of ER (With NER)								
29	400 kV	BINAGURI-BONGAIGAON	D/C	0	570	0.0	10.1	-10
30		ALIPURDUAR-BONGAIGAON	D/C	60	251	0.0	2.9	-3
31	220 kV	ALIPURDUAR-SALAKATI	D/C	0	127	0.0	2.4	-2
ER-NER						0.0	15.4	-15.4
Import/Export of NER (With NR)								
32	HVDC	BISWANATH CHARIALI-AGRA	-	0	700	0.0	16.8	-16.8
NER-NR						0.0	16.8	-16.8
Import/Export of WR (With NR)								
33	HVDC	CHAMPA-KURUKSHETRA	D/C	0	2004	0.0	43.6	-43.6
34		V'CHAL B/B	D/C	240	0	3.6	0.0	3.6
35		APL -MHG	D/C	0	1917	0.0	35.5	-35.5
36		GWALIOR-AGRA	D/C	0	1448	0.0	55.5	-55.5
37	765 kV	PHAGI-GWALIOR	D/C	0	1480	0.0	22.9	-22.9
38		JABALPUR-ORAI	D/C	0	708	0.0	25.9	-25.9
39		GWALIOR-ORAI	S/C	384	0	6.8	0.0	6.8
40		SATNA-ORAI	S/C	0	1851	0.0	40.8	-40.8
41	400 kV	ZERDA-KANKROLI	S/C	177	167	0.0	0.5	-0.5
42		ZERDA -BHINMAL	S/C	175	218	0.0	1.5	-1.5
43		V'CHAL -RIHAND	S/C	953	0	20.8	0.0	20.8
44		RAPP-SHUJALPUR	D/C	0	439	0	3	-3
45	220 kV	BADOD-KOTA	S/C	17	45	0.1	0.4	-0.3
46		BADOD-MORAK	S/C	5	69	0.0	0.9	-0.9
47		MEHGAON-AURAIYA	S/C	45	22	0.3	0.1	0.2
48		MALANPUR-AURAIYA	S/C	13	44	0.0	0.4	-0.4
49	132kV	GWALIOR-SAWAI MADHOPUR	S/C	0	0	0.0	0.0	0.0
WR-NR						31.6	231.3	-199.7
Import/Export of WR (With SR)								
50	HVDC LINK	BHADRAWATI B/B	-	0	309	0.0	2.6	-2.6
51		BARSUR-L.SILERU	-	0	0	0.0	0.0	0.0
52	765 kV	SOLAPUR-RAICHUR	D/C	1378	508	13.7	0.0	13.7
53		WARDHA-NIZAMABAD	D/C	464	1154	0.0	5.6	-5.6
54	400 kV	KOLHAPUR-KUDGI	D/C	970	0	16.2	0.0	16.2
55		KOLHAPUR-CHIKODI	D/C	0	0	0.0	0.0	0.0
56	220 kV	PONDA-AMBEWADI	S/C	1	0	0.0	0.0	0.0
57		XELDEM-AMBEWADI	S/C	0	106	0.0	1.9	-1.9
WR-SR						29.9	10.0	19.9
TRANSNATIONAL EXCHANGE								
58		BHUTAN						32.2
59		NEPAL						-6.8
60		BANGLADESH						-15.3


NATURAL CALAMITY- POWER SYSTEM CONDITION

Date: 21/08/2018 06.00 HRS

Date: 21/08/2018 06.00 HRS									
1	Generation Affected								
		Sl.No.	Generating Station	Installed Capacity (MW)	Capacity affected due to inundation (MW)	Capacity revived till now (MW)	Present affected capacity (MW)	Reason for outage	Remarks
	a	Due to transmission constraints							
		1	Idamalayar (2x37.5)	75	75	75	0	Line Constraints	Unit#1 revived at 23.50hrs on 19.08.18, Unit#2 revived at 00.39hrs on 20.08.18.
		Sub-Total		75	75	75	0		
	b	Due to power house inundation/tailrace water level high							
		1	Panniyar (2x16)	32	32	0	32	Land Sliding & water entered to control room.	outage since 23:49 hrs, 15.08.2018
		2	Neriamangalam (3x17.5 +25)	77.5	35	35	0	Partially affected (2X17.5)	Unit#1 switched off at 02:17 hrs 16.08.2018 ,due to cooling water outlet temperature high , unit #2 mechanical lockout at 00:27 hrs 16.08.2018. Neriya mangalam Extension Scheme (NES) synchronized back at 13.38 hrs 18.08.2018
		3	Lower Periyar (3x60)	180	180	0	180	Due to flooding	Outage since 14:19 hrs ,14.08.2017, EHT Feeders charged through backfeeding, machines not running yet.
		4	Poringal (4x8 +16)	48	48	0	48	Due to flooding	Outage since 05:49 hrs, 16.08.2018
		5	Sabarigiri (2x60 +4x55)	340	170	170	0	Partially affected (2X55 + 60)	five machines in service from 19.30hrs. 55 MW machine is out due to other reasons prior to flood and continued to be kept under outage.
		6	Kuthungal (3x7)	21	21	0	21	due to flooding	No generation & communication
		7	Maniyar (3x4)	12	12	0	12	due to flooding	No generation & communication
		8	Allungal (2x3.5)	7	7	0	7	due to flooding	Outage since 22:45 hrs, 14-8-2018
		9	Karikayam (3x3.5)	10.5	7	7	0	due to flooding.	No2& No3 were under outage due to block in penstock path due to mud. Both units are revived by 16:00Hrs on 20.08.18
		10	Urumi 1 & 2 (3x1.25 + 3x0.8)	6.15	6.15	3.75	2.4	Canal Blocked due to land slide	Urumi-2 under Shutdown. Urumi-1 normalized at 13:00Hrs on 20.08.2018
		11	Poozhithodu (3x1.6)	4.8	4.8	0	4.8	due to flooding	Outage since 22:05hrs, 8-8-2018
		12	Ranni-perinad (2x2)	4	4	0	4	due to flooding	Outage since 22:05hrs, 14-8-2018
		13	Chempukadavu (2.70+3.75)	6.45	6.45	0	6.45	due to flooding	Outage since 17:17hrs, 15-8-2018
14		MATTUPETTY (2)	2	2	0	2	due to flooding	Outage since 15.00hrs, 11-8-2018	
15		ADYANPARA (2x1.5 +0.5)	3.5	3.5	0	3.5	due to flooding	Outage since 14-08-2018	
		Sub-Total		754.9	538.9	215.75	323.15		
c.	Due to other reasons/Flood control								
	1	Pallivasal (3x7.5+3x5)	37.5	37.5	0	37.5	For flood control in Munnar Town	Outage since 12:23 hrs,14.08.2018	
		Sub-Total		37.5	37.5	0	37.5		
	Grand Total		867	651	291	361			
2	Transmission System Affected								
	a	Substation switched off due to inundation							
		Sl.No.	Substation Name	Reason for Outage				Remarks	
		1	110KV KURUMASSERY	WATER ENTERED TO CR				switched off at 17:26 hrs 15.08.2018-	
		2	110KV MALAYATTOOR	WATER ENTERED TO CR				All EHT feeders restored by 23.00hrs on 19.08.18	
		3	110KV EDATHUA	WATER ENTERED TO CR				switched off at 21:35 hrs 16.08.2018	
		4	110 KV KANDASANKADAV	WATER ENTERED TO CR				Restored by 9.45Hrs, 18-8-2018	
				WATER ENTERED TO CR				switched off at 04:32 hrs, 18.08.2018. 110kv feeder restored at 11:02hr on 20.8.18;Transformer#2-charged-13:39Hrs on 20.8.18;Transfrmr#1 charged at 16:41Hrs on 20.8.18	
		5	110KV PARAPPANANGAD	WATER ENTERED TO CR				switched off at 12:43 hrs,16-8-2018. restored by 16.15hrs on 19.08.18	
		6	110 KV EDAYAR	WATER ENTERED TO CR				switched off at 8:55 hrs, 16-8-2018	
		7	66 KV KCPL	WATER ENTERED TO CR				switched off at 10.35 Hrs, 17-8-2018	
		8	66 KV KUTTANAD	WATER ENTERED TO CR				switched off at 12.01 Hrs, 18-8-2018. Restored at 19:46Hrs on 19.08.2018	
		9	66 KV VAIGA THREADS	NON AVAILABILITY OF FEEDER				switched off at 12.01Hrs, 18-8-2018 & Restored by 12.50Hrs on 19.08.18	
		10	66KV KORATTY	WATER ENTERED TO CR				Trfr #1 charged at 17.09Hrs, trfr #2 charged at 17.16Hrs on 19.08.18	
		11	66KV MULAVUKAD	WATER ENTERED TO CR				switched off at 12.01Hrs, 15-8-2018. Restored at 16:39Hrs on 20.08.2018	
		12	33 KV VELLIKULANGARA	WATER ENTERED TO CR				Restored at 18.15 hrs on 19.08.18	
		13	33 KV KALLETUMKARA	WATER ENTERED TO CR				switched off at 12.44Hrs, 16-8-2018	
		14	33 KV VADAKEKARA	WATER ENTERED TO CR				Restored at 14.25 hrs on 19.08.18	
		15	33 KV VARAPUZHA	WATER ENTERED TO CR				switched off at 12.46 Hrs, 16-8-2018	
		16	33 KV ALANGAD	WATER ENTERED TO CR				Restored at 15.31hrs , 19-8-2018	
	17	33 KV THAKAZHI	WATER ENTERED TO CR						

b	EHT lines(66kV and above) s/off due to flood related issues			
	Sl.No.	Name of Transmission Line	Reason for Outage	Remarks
	1	220 KV Madakathra-Lower Periyar I&II	Lines switched off due to landsliding at Lower Periyar Substation	Restored at 14.28Hrs, 16-8-2018
	2	220 KV Brahmapuram-Lower Periyar I&II		Restored at 10:58hrs, 19-8-2018
	3	220 kv IDUKKI-LOWER PERIYAR I&II		Restored at 14.28hrs, 16-8-2018
	4	110KV PUNNAPRA - CHENGALA	FOR SAFETY CLEARANCE	switched off at 19:06 hrs 17.08.2018
	5	110KV PUNNAPRA - KODIMATHA	FOR SAFETY CLEARANCE	Switched off at 19:06 hrs 17.08.2018
	7	110KV CHENGANNUR- TRIKODITHANAM	FOR SAFETY CLEARANCE	Switched off at 13:04 hrs 16.08.2018 and restored at 15:10Hrs on 20.08.2018
	8	110KV CHENGANNUR- MALLAPPILLY	FOR SAFETY CLEARANCE	Switched off at 13:20 hrs 16.08.2018 and restored at 16:11Hrs on 20.8.2018
	9	110KV PUNNAPRA-EDATHUA #1,#2	FOR SAFETY CLEARANCE	Switched off at 21:35 hrs 16.08.2018
	10	110KV KALAMASSERY- EDAYAR#1,#2	DUE TO FLOODING	110KV Kalamassery Edayar #2 charged at IAC at 11:23 hrs 17.08.2018,Ckt#1 charged at 10.51Hrs on 19-8-2018
	11	110 KV KALAMASSERY-METRO #1,2	FOR SAFETY CLEARANCE	switched off at 7:12 hrs 16.08.2018
	12	110KV CHELARI-PARAPPANANGADI	FOR SAFETY CLEARANCE	Switched off at 04:32 hrs 18.08.2018 and restored on 20.08.18 at 11.02 hrs.
	13	110 KV ALUVA-CARBORANDAM-KALAMASSERY	DUE TO ACCESS FAILURE	TRIPPED DUE TO TREE FALL 15-8-2018
	14	110KVPORINGAL-CHALAKUDY1	DUE TO FLOODING	Switched off at 22:19hrs, 15-8-2018
	15	110KV PORINGAL-CHALAKUDY2	DUE TO FLOODING	Switched off at 5:50hrs, 16-8-2018 and restored at 12:49Hrs on 20.8.18
	16	110 KV CHALAKUDY-TRACTION	DUE TO FLOODING	Switched off at 15:07hrs, 16-8-2018
	17	110 KV KALAMASSERY-EDAPLLY	DUE TO FLOODING	Switched off at 17:14hrs, 16-8-2018 and restored on 20.08.18 at 08.36 hrs
	18	110 KV EDAYAR-NORTH PARAVUR 1&2	DUE TO FLOODING	Ckt#1 & 2 restored at 11.30Hrs &11.52Hrs respectively on 19-8-2018
	19	66 KV ALUVA-PALLIVASAL-1	DUE TO ACCESS FAILURE	TRIPPED DUE TO TREE FALL 15-8-2018, 16:53hrs
	20	66KV PALLOM - KUTTANAD	FOR SAFETY CLEARANCE	switched off at 11:08 hrs 17.08.2018
	21	66KV ALUVA - ANGAMALLY	DUE TO ACCESS FAILURE	switched off at 12:01 hrs, 18-8-2018. charged at 17.46hrs on 19.08.18
3	Failure of transmission Lines			
	1	Neriamangalam-Kuthungal Line	Tower Slanting	switched off on 14.08.2018


Kerala Demand Trend

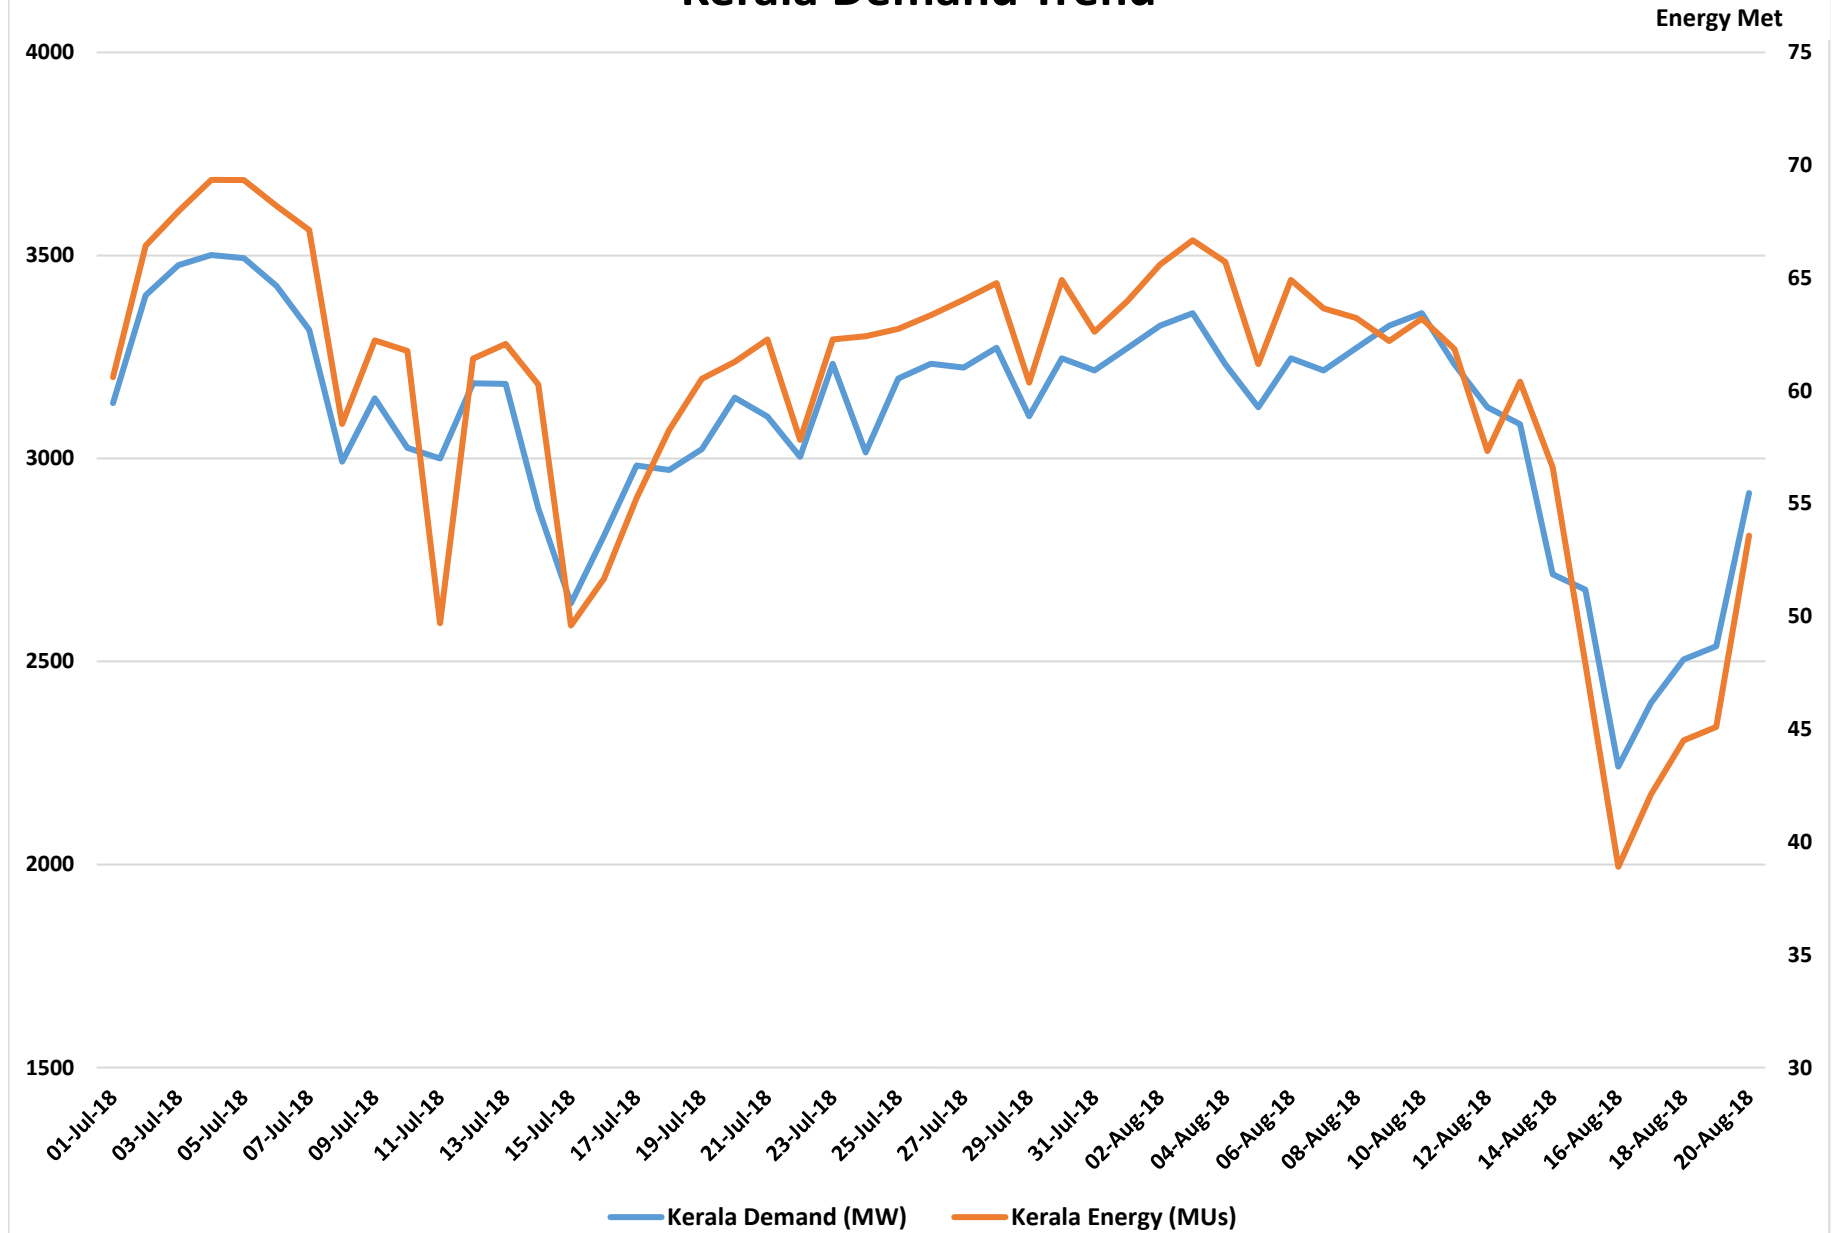

Kerala Hydro Generation


Ave. Hydro Gen.

Hydel Energy

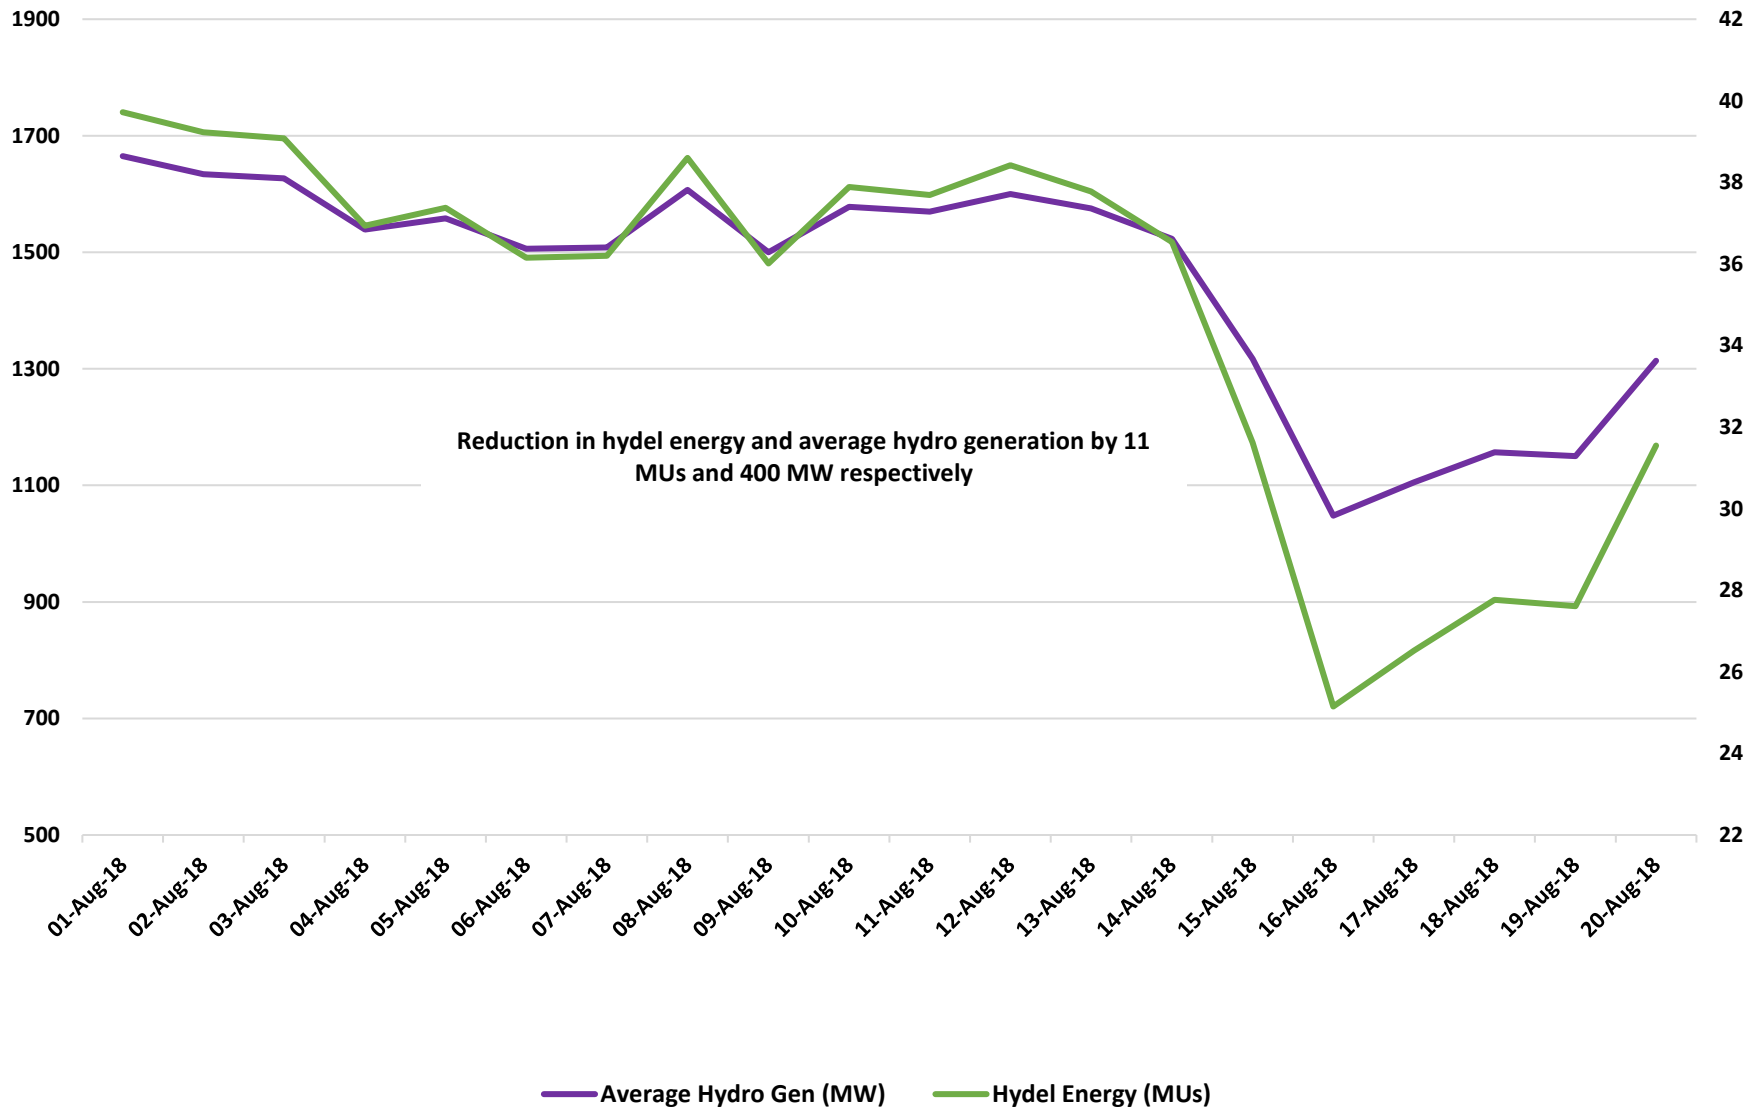

POWER MAP OF KERALA


AFFECTED GENERATING STATIONS

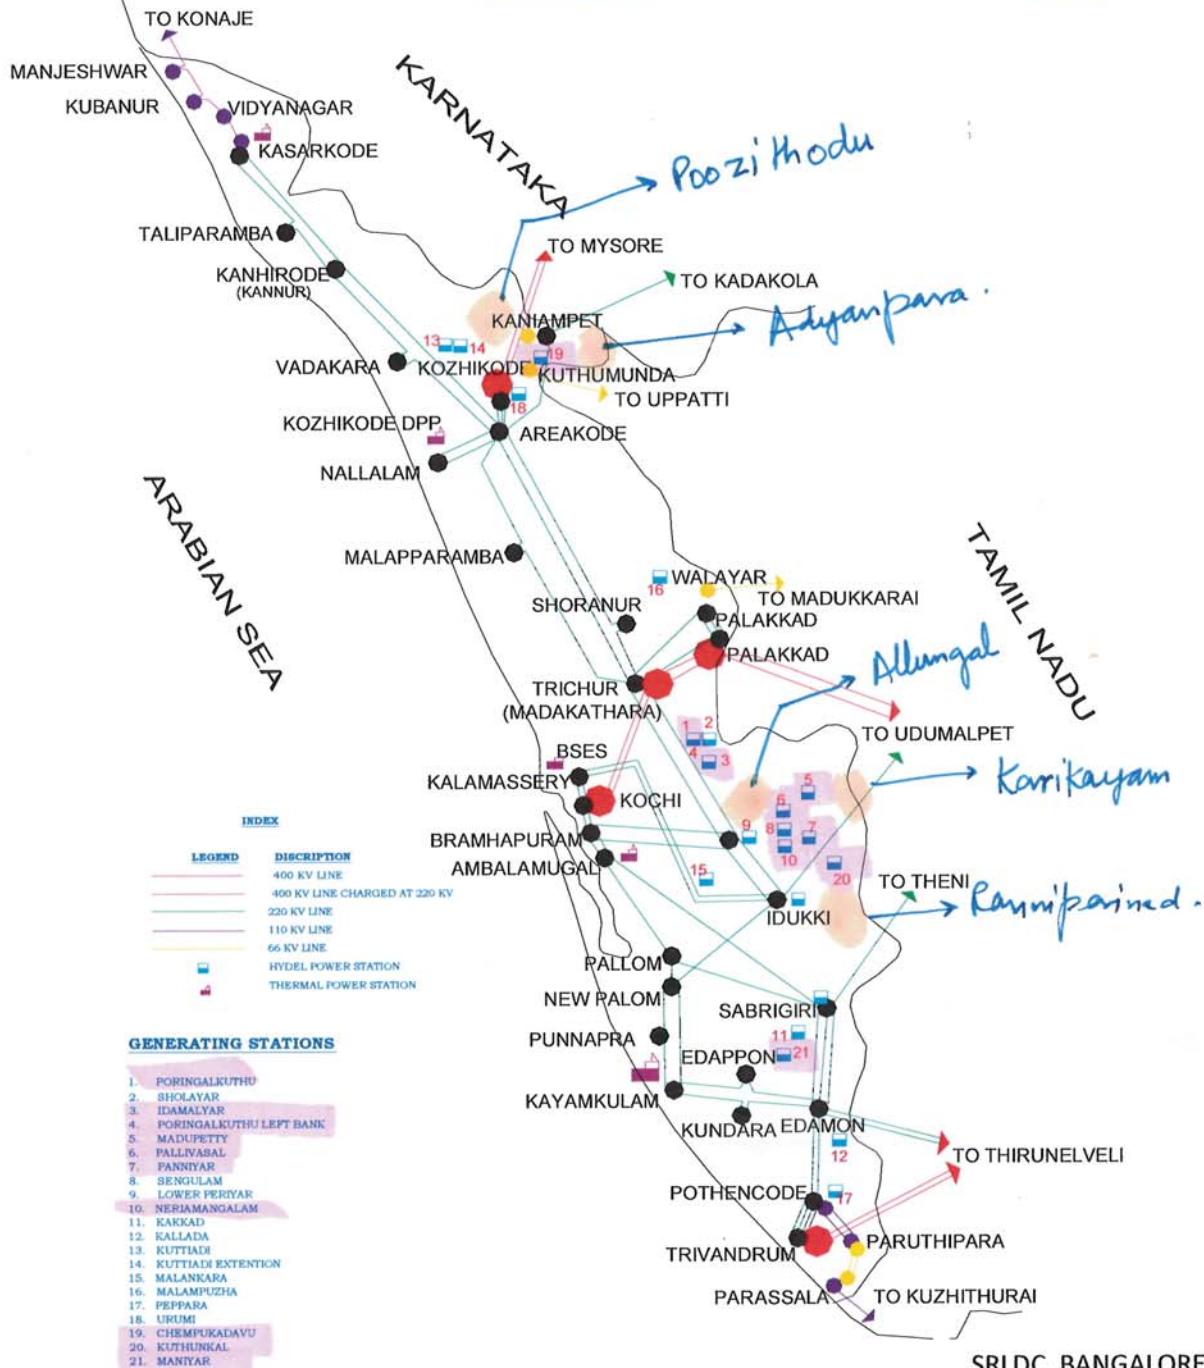

SRLDC, BANGALORE
June 2018

KERALA GRID AS ON 31.03.2011

 $\rightarrow 110 \text{ kV}$
 $\rightarrow 66/33 \text{ kV}$

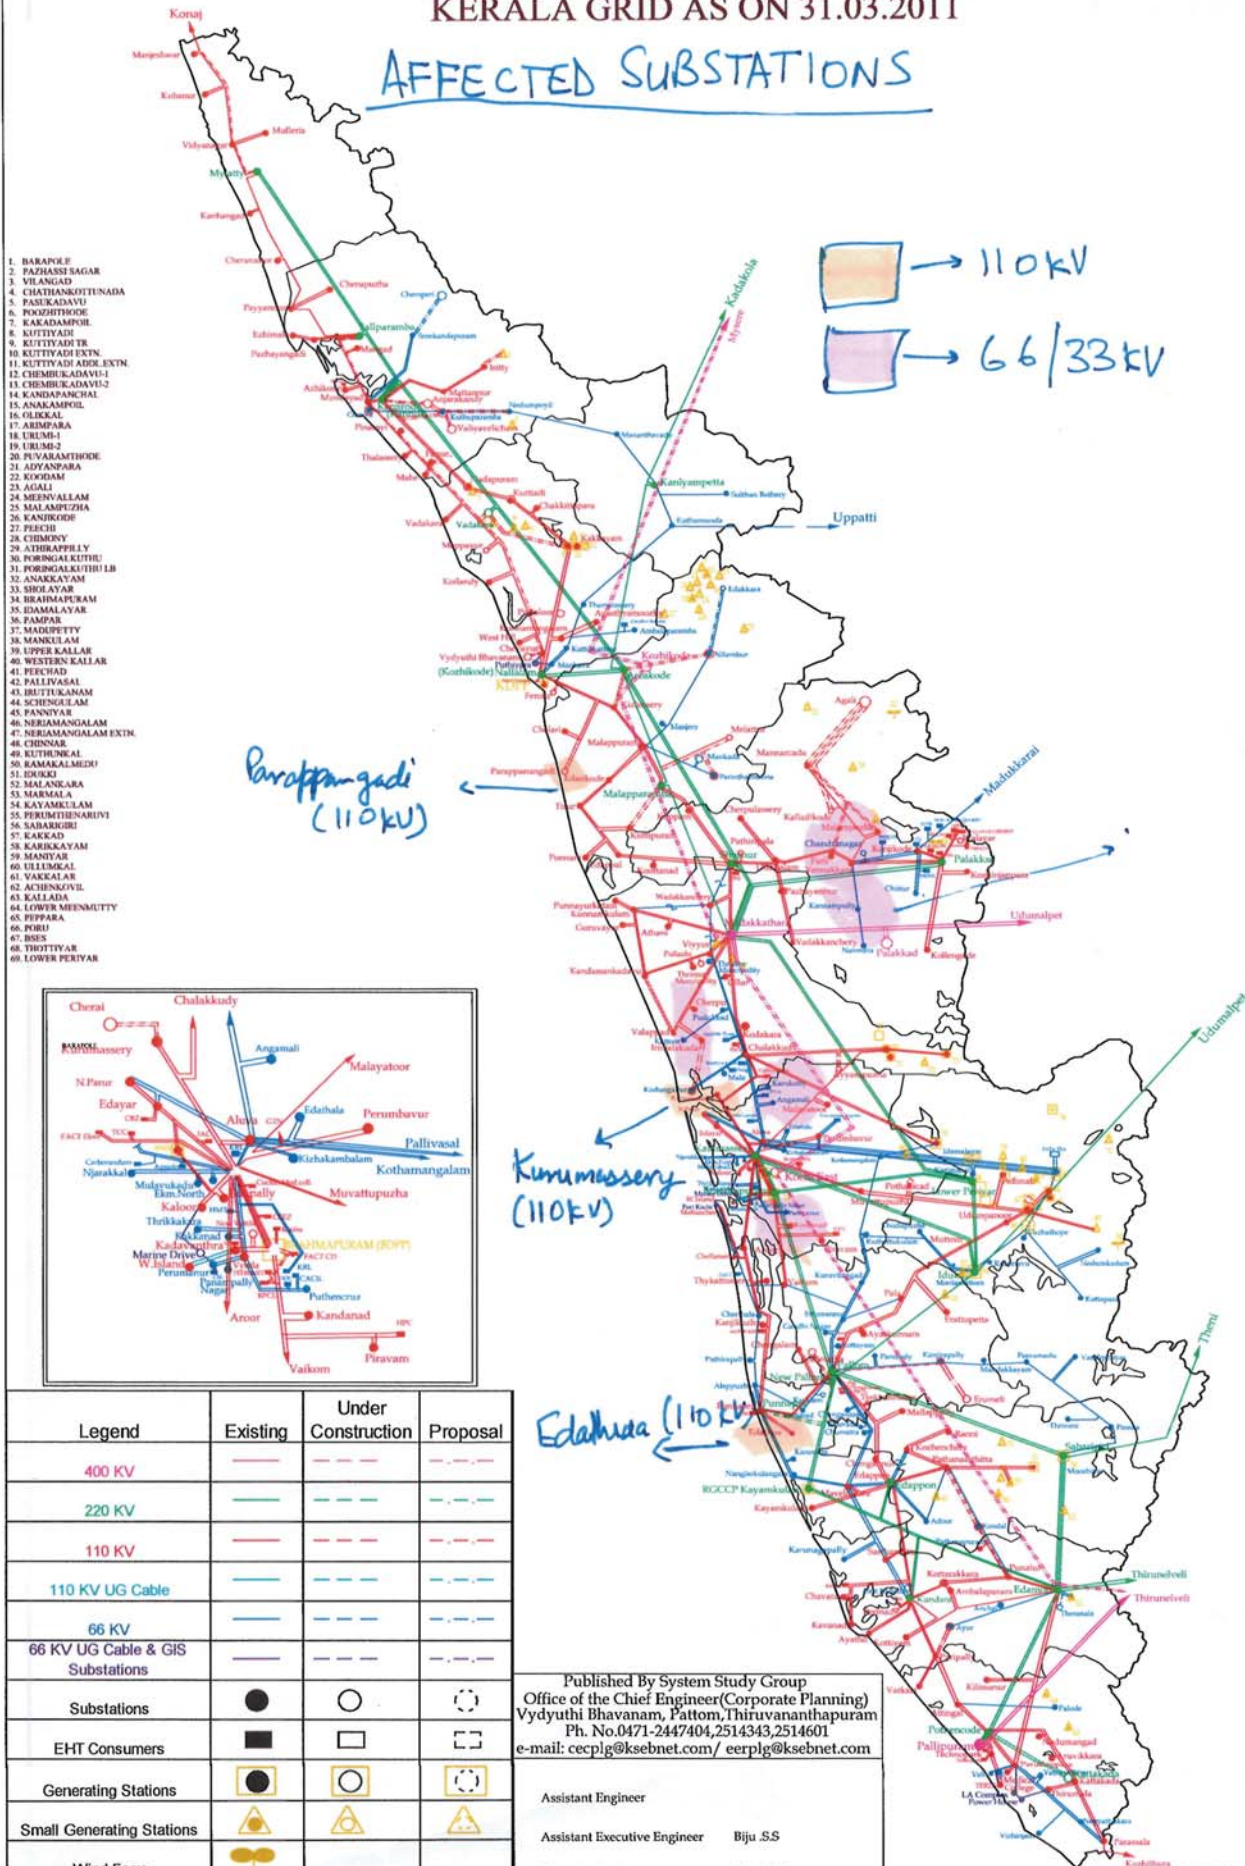

K. VALSAKUMARI
Chief Engineer
(Corporate Planning)