



National Load Despatch Centre
राष्ट्रीय भार प्रेषण केंद्र
POWER SYSTEM OPERATION CORPORATION LIMITED
पावर सिस्टम ऑपरेशन कारपोरेशन लिमिटेड
(Government of India Enterprise/ भारत सरकार का उद्यम)
B-9, QUTUB INSTITUTIONAL AREA, KATWARIA SARAI, NEW DELHI -110016
बी-9, कुतुब इन्स्टीट्यूशनल एरिया, कटवारिया सराये, न्यू दिल्ली-110016

Ref: POSOCO/NLDC/SO/Daily PSP Report

दिनांक: 18th August 2017

To,

1. कार्यकारी निदेशक, पू. क्षेत्र. भा. प्रे. के., 14, गोल्फ क्लब रोड, कोलकाता - 700033
Executive Director, ERLDC, 14 Golf Club Road, Tolleygunge, Kolkata, 700033
2. कार्यकारी निदेशक, ऊ. क्षेत्र. भा. प्रे. के., 18/ ए, शहीद जीत सिंह सनसनवाल मार्ग, नई दिल्ली - 110016
Executive Director, NRLDC, 18-A, Shaheed Jeet Singh Marg, Katwaria Sarai, New Delhi - 110016
3. कार्यकारी निदेशक, प. क्षेत्र. भा. प्रे. के., एफ3-, एम आई डी सी क्षेत्र, अंधेरी, मुंबई - 400093
Executive Director, WRLDC, F-3, M.I.D.C. Area, Marol, Andheri (East), Mumbai-400093
4. कार्यकारी निदेशक, ऊ. पू. क्षेत्र. भा. प्रे. के., डोंगतेह, लोअर नोंग्रह, लापलंग, शिलोंग - 793006
Executive Director, NERLDC, Dongteih, Lower Nongrah, Lapalang, Shillong - 793006, Meghalaya
5. महाप्रबंधक, द. क्षेत्र. भा. प्रे. के., 29, रेस कोर्स क्रॉस रोड, बंगलुरु - 560009
General Manager, SRLDC, 29, Race Course Cross Road, Bangalore-560009

Sub: Daily PSP Report for the date 17.08.2017.

महोदय/Dear Sir,

आई०ई०जी०सी०-2010 की धारा स.-5.5.1 के प्रावधान के अनुसार, दिनांक 16-अगस्त-2017 की अखिल भारतीय प्रणाली की दैनिक ग्रिड निष्पादन रिपोर्ट रा०भा०प्रे०के० की वेबसाइट पर उपलब्ध है

As per article 5.5.1 of the Indian Electricity Grid Code, the daily report pertaining power supply position of All India Power System for the date 17th August 2017, is available at the NLDC website.

धन्यवाद,



पावर सिस्टम ऑपरेशन कारपोरेशन लिमिटेड राष्ट्रीय भार प्रेषण केंद्र, नई दिल्ली

पिछले दिन के लिए प्रणाली प्रचालन रिपोर्ट

रिपोर्टिंग तिथि

18-Aug-17

क. अधिकतम मांग

	उत्तरी क्षेत्र	पश्चिमी क्षेत्र	दक्षिणी क्षेत्र	पूर्वी क्षेत्र	पूर्वोत्तर क्षेत्र	कुल
साध्यकालीन अधिकतम मांग आपूर्ति (मे०वा०)	55452	45148	37710	19531	2427	160269
साध्यकालीन अधिकतम कमी (मे०वा०)	2360	414	30	17	275	3096
ऊर्जा आपूर्ति (मि०यू०)	1288	1047	852	384	48	3618
पनोर्जन उत्पादन (मि०यू०)	371	19	44	83	29	544
पवन ऊर्जा (मि०यू०)	34	87	122	-----	-----	243
सौर ऊर्जा (मि०यू०)	3.49	13.12	21.40	1.05	0.02	39
अधिकतम मांग आपूर्ति (मे०वा०)	57502	46173	38360	19945	2686	160812

ख. आवृत्ति (प्रतिशत समय में)

क्षेत्र	एफ०वी०आई०	<49.7	49.7-49.8	49.8-49.9	<49.9	49.9-50.05	> 50.05
अखिल भारतीय	0.054	0.03	1.41	12.97	14.42	74.69	10.89

ग. राज्यों में विद्युत आपूर्ति स्थिति

क्षेत्र	राज्य	अधिकतम मांग आपूर्ति (मे०वा०)	अधिकतम कमी (मे०वा०)	ऊर्जा आपूर्ति (मि०यू०)	डॉवल शेड्यूल (मि०यू०)	ओवरडॉवल(+)/अंडरडॉवल(-) (मि०यू०)	अधिकतम ओवरडॉवल (मे०वा०)
उत्तरी क्षेत्र	पंजाब	10730	0	250	131	0.0	140
	हरियाणा	9294	300	202	127	1.0	222
	राजस्थान	9987	0	221	82	1.3	399
	दिल्ली	5993	16	122	96	-1.2	207
	उत्तर प्रदेश	17719	2555	376	182	3.9	901
	उत्तराखंड	1836	155	41	14	1.0	105
	हिमाचल प्रदेश	1340	0	29	0	3.0	303
	जम्मू कश्मीर	2025	506	41	15	0.4	125
	चंडीगढ़	330	0	6	7	-0.4	14
पश्चिमी क्षेत्र	छत्तीसगढ़	3683	0	82	26	1.0	268
	गुजरात	13724	0	303	58	0.5	402
	मध्य प्रदेश	8273	0	183	104	3.3	752
	महाराष्ट्र	20221	0	442	117	-0.3	485
	गोवा	409	0	9	9	-0.1	41
	डीडी	326	0	7	6	1.2	35
	डीएनएच	741	0	17	17	0.3	25
	एस्सार स्टील	230	0	3	1	2.0	145
	आन्ध्र प्रदेश	6688	0	154	37	1.8	598
दक्षिणी क्षेत्र	तेलंगाना	8358	0	177	90	-3.4	853
	कर्नाटक	8274	0	175	83	1.8	531
	केरला	3450	0	67	47	2.3	297
	तामिलनाडु	12531	0	273	84	-0.3	831
	पोंडी	338	0	7	7	-0.3	32
	बिहार	3979	0	72	68	1.2	250
पूर्वी क्षेत्र	डीवीसी	2781	0	63	-28	-0.3	200
	झारखंड	1238	0	22	16	-1.1	85
	ओडीसा	4107	0	80	26	-1.6	225
	पश्चिमी बंगाल	8191	0	145	50	3.2	250
	सिक्किम	97	0	1	2	-0.9	10
पूर्वोत्तर क्षेत्र	अरुणाचल प्रदेश	125	2	2	3	-1.0	6
	असम	1568	165	31	22	3.5	212
	मणिपुर	139	2	2	2	0.0	31
	मेघालय	264	0	4	-2	-0.3	27
	मिज़ोरम	73	0	1	1	-0.1	9
	नागालैंड	115	0	2	2	0.2	26
	त्रिपुरा	246	2	4	3	0.9	44

घ. अन्तर्राष्ट्रीय विनीमय (मि०यू०)

	भूटान	नेपाल	बांग्लादेश
Actual(MU)	37.1	-4.3	-14.7
Max MW	1538.9	-258.7	-646.0

ड. क्षेत्रों द्वारा आयात एवम् निर्यात (मि०यू०) - आयात(+ve)/निर्यात(-ve);ओवरडॉवल(+)/अंडरडॉवल(-) (मि०यू०)

	उत्तरी क्षेत्र	पश्चिमी क्षेत्र	दक्षिणी क्षेत्र	पूर्वी क्षेत्र	पूर्वोत्तर क्षेत्र	कुल
Schedule(MU)	216.7	-206.6	69.4	-71.9	-6.2	1.5
Actual(MU)	221.0	-216.7	63.4	-63.0	-4.8	-0.1
O/D/U/D(MU)	4.2	-10.1	-6.0	8.9	1.4	-1.6

च. अनुपलब्ध ऊर्जा उत्पादन (मे०वा०)

	उत्तरी क्षेत्र	पश्चिमी क्षेत्र	दक्षिणी क्षेत्र	पूर्वी क्षेत्र	पूर्वोत्तर क्षेत्र	कुल
केंद्रीय क्षेत्र	3942	16067	4510	1075	118	25713
राज्याय क्षेत्र	7765	16835	10544	6085	110	41339
कुल	11707	32902	15054	7160	228	67052

सचिव(ऊर्जा)/ विशेष सचिव(ऊर्जा)/अतिरिक्त सचिव(ऊर्जा)/संयुक्त सचिव(पारेषण)/(ओ एम)/निदेशक(ओ एम)/मुख्य अभियंता-के०वि०प्रा०(ग्रि०प्रा०)/मुख्य कार्यपालक अधिकारी(पोसोको)/सभी राज्यों के मुख्य सचिव/ऊर्जा सचिव



पावर सिस्टम ऑपरेशन कारपोरेशन लिमिटेड राष्ट्रीय भार प्रेषण केंद्र, नई दिल्ली

Report for previous day

Date of Reporting

18-Aug-17

A. Maximum Demand

	NR	WR	SR	ER	NER	Total
Demand Met during Evening Peak hrs(MW) (at 2000 hrs; from RLDCs)	55452	45148	37710	19531	2427	160269
Peak Shortage (MW)	2360	414	30	17	275	3096
Energy Met (MU)	1288	1047	852	384	48	3618
Hydro Gen(MU)	371	19	44	83	29	544
Wind Gen(MU)	34	87	122	-----	-----	243
Solar Gen (MU)*	3.49	13.12	21.40	1.05	0.02	39
Energy Shortage (MU)	12.1	0.0	0.0	0.1	1.7	13.9
Maximum Demand Met during the day (MW) (from NLDC SCADA)	57502	46173	38360	19945	2686	160812

B. Frequency Profile (%)

Region	FVI	<49.7	49.7-49.8	49.8-49.9	<49.9	49.9-50.05	> 50.05
All India	0.054	0.03	1.41	12.97	14.42	74.69	10.89

C. Power Supply Position in States

RegionRegion	States	Max. Demand Met during the day (MW)	Shortage during maximum Demand (MW)	Energy Met (MU)	Drawal Schedule (MU)	OD(+)/UD(-) (MU)	Max OD (MW)	Energy Shortage (MU)
NR	Punjab	10730	0	249.9	130.5	0.0	140	0.0
	Haryana	9294	300	202.0	126.9	1.0	222	0.5
	Rajasthan	9987	0	221.3	82.0	1.3	399	1.4
	Delhi	5993	16	121.5	95.9	-1.2	207	0.0
	UP	17719	2555	375.8	181.6	3.9	901	0.0
	Uttarakhand	1836	155	41.3	14.0	1.0	105	0.5
	HP	1340	0	28.5	-0.1	3.0	303	0.1
	J&K	2025	506	40.8	14.7	0.4	125	9.7
	Chandigarh	330	0	6.5	6.9	-0.4	14	0.0
	Chhattisgarh	3683	0	82.1	26.4	1.0	268	0.0
WR	Gujarat	13724	0	303.1	58.5	0.5	402	0.0
	MP	8273	0	183.2	104.1	3.3	752	0.0
	Maharashtra	20221	0	442.5	117.0	-0.3	485	0.0
	Goa	409	0	8.7	8.8	-0.1	41	0.0
	DD	326	0	7.4	6.2	1.2	35	0.0
	DNH	741	0	17.0	16.7	0.3	25	0.0
	Essar steel	230	0	3.2	1.2	2.0	145	0.0
	Andhra Pradesh	6688	0	154	37	1.8	598	0.0
SR	Telangana	8358	0	177	90	-3.4	853	0.0
	Karnataka	8274	0	175	83	1.8	531	0.0
	Kerala	3450	0	67	47	2.3	297	0.0
	Tamil Nadu	12531	0	273	84	-0.3	831	0.0
	Pondy	338	0	7	7	-0.3	32	0.0
	Bihar	3979	0	72.1	67.6	1.2	250	0.0
ER	DVC	2781	0	63.2	-27.7	-0.3	200	0.0
	Jharkhand	1238	0	22.4	15.8	-1.1	85	0.0
	Odisha	4107	0	79.6	26.1	-1.6	225	0.0
	West Bengal	8191	0	145.3	50.4	3.2	250	0.1
	Sikkim	97	0	1.1	2.0	-0.9	10	0.0
NER	Arunachal Pradesh	125	2	2.1	3.1	-1.0	6	0.1
	Assam	1568	165	30.8	22.4	3.5	212	1.5
	Manipur	139	2	2.2	2.2	0.0	31	0.0
	Meghalaya	264	0	4.5	-1.7	-0.3	27	0.0
	Mizoram	73	0	1.2	1.2	-0.1	9	0.0
	Nagaland	115	0	2.3	2.0	0.2	26	0.0
	Tripura	246	2	4.4	2.8	0.9	44	0.0

D. Transnational Exchanges (MU) - Import(+ve)/Export(-ve)

	Bhutan	Nepal	Bangladesh
Actual(MU)	37.1	-4.3	-14.7
Day peak (MW)	1538.9	-258.7	-646.0

E. Import/export By Regions(in MU) - Import(+ve)/Export(-ve); OD(+)/UD(-)

	NR	WR	SR	ER	NER	TOTAL
Schedule(MU)	216.7	-206.6	69.4	-71.9	-6.2	1.5
Actual(MU)	221.0	-216.7	63.4	-63.0	-4.8	-0.1
O/D/U/D(MU)	4.2	-10.1	-6.0	8.9	1.4	-1.6

F. Generation Outage(MW)

	NR	WR	SR	ER	NER	Total
Central Sector	3942	16067	4510	1075	118	25713
State Sector	7765	16835	10544	6085	110	41339
Total	11707	32902	15054	7160	228	67052

*Source: RLDCs for solar connected to ISTS; SLDCs for embedded solar. Limited visibility of embedded solar data.

सचिव(ऊर्जा)/संयुक्त सचिव(परिषद्)/(ओ एम)/मुख्य अभियंता-के०वि०प्रा०(ग्रि०प्रा०)/
मुख्य कार्यपालक अधिकारी(पोसोको) सभी राज्यों के मुख्य सचिव/ऊर्जा सचिव

महाप्रबंधक (रा० भा० प्र० के०)

All India Energy Balance for ISTS for 17-Aug-2017

	Schedule	Actual	Deviation
Northern Region			
Injection	459.4	457.4	-1.9
Drawal	648.0	655.0	7.0
Transnational	0.0	-0.5	-0.5
Western Region			
Injection	525.1	541.9	16.8
Drawal	340.6	346.8	6.2
Southern Region			
Injection	271.1	269.3	-1.8
Drawal	355.1	351.2	-3.9
Eastern Region			
Injection	217.0	222.3	5.3
Drawal	140.0	134.6	-5.3
Transnational	-9.5	-9.3	0.2
North Eastern Region			
Injection	39.7	40.8	1.1
Drawal	32.3	35.1	2.8
All India			
Injection, "A"	1512.3	1531.8	19.5
Drawal, "B"	1516.0	1522.7	6.8
Transnational, "C"	-9.5	-13.7	-4.2
Regional Losses (MU)			
NR	28.1	23.9	
WR	-22.1	-21.5	
SR	-14.6	-18.5	
ER	-4.3	5.7	
NER	1.2	0.9	
All India Loss			
Loss(MU), "D" = A-B+C	-13.1	-4.6	8.5
Loss(%), "E"= D/A	-0.87	-0.30	

* All figures in MU unless specified otherwise

Note: Injection is the sum of injection by each regional entity power stations.

Drawal is the sum of drawal by each regional entity drawal utility.

Northern Region Energy Balance for ISTS for 17-Aug-2017					
Sl. No.			Schedule	Actual	Deviation
A	States				
1	Punjab		130.5	130.5	0.0
2	Haryana		126.9	128.0	1.0
3	Rajasthan		82.0	83.2	1.3
4	Delhi		95.9	94.7	-1.2
5	UP		181.6	185.5	3.9
6	Uttarakhand		14.0	14.9	1.0
7	HP		-0.1	2.9	3.0
8	J & K		14.7	15.2	0.4
9	Chandigarh		6.868	6.453	-0.4
	Total Drawal		645.7	655.0	9.4
B	Regional Entities Generation				
1	Singrauli STPS	2000 MW	39.9	40.3	0.4
2	Rihand I STPS	1000 MW	11.1	11.0	0.0
3	Rihand II STPS	1000 MW	22.6	22.4	-0.2
4	Rihand III STPS	1000 MW	22.6	22.7	0.1
5	Dadri I STPS	840 MW	13.6	12.7	-0.9
6	Dadri II STPS	980 MW	21.5	20.6	-0.9
7	Unchahar I TPS	420 MW	9.1	8.2	-0.9
8	Unchahar II TPS	420 MW	9.1	8.4	-0.7
9	Unchahar III TPS	210 MW	4.5	4.1	-0.4
10	ISTPP (Jhajjar)	1500 MW	18.5	17.6	-0.9
11	Dadri GPS	830 MW	4.1	3.8	-0.3
12	Anta GPS	419 MW	0.0	0.0	0.0
13	Auraiya GPS	663 MW	0.0	0.0	0.0
14	Dadri Solar	5 MW	0.0	0.0	0.0
15	Unchahar Solar	10 MW	0.0	0.0	0.0
16	Singrauli Solar	15 MW	0.0	0.0	0.0
17	KHEP	800 MW	20.0	20.6	0.6
18	NAPS	440 MW	9.2	9.0	-0.2
19	RAPS- B	440 MW	9.5	9.0	-0.5
20	RAPS- C	440 MW	9.8	9.7	-0.1
21	Chamera I HPS	540 MW	12.8	12.9	0.1
22	Chamera II HPS	300 MW	7.2	7.2	0.0
23	Chamera III HPS	231 MW	5.2	5.3	0.0
24	Bairasuil HPS	180 MW	1.4	1.4	0.1
25	Salal-HPS	690 MW	16.1	16.1	0.0
26	Tanakpur-HPS	94 MW	2.2	2.3	0.1
27	Uri-I HPS	480 MW	9.0	9.5	0.4
28	Uri-II HPS	240 MW	5.0	5.2	0.2
29	Dhauliganga-HPS	280 MW	6.7	6.9	0.1
30	Dulhasti-HPS	390 MW	9.3	9.3	0.1
31	Sewa-II HPS	120 MW	1.4	1.4	0.0
32	Parbati 3	520 MW	3.9	4.0	0.1
33	NJ HEP	1500 MW	36.3	36.8	0.5
34	Rampur HEP	412 MW	10.0	10.2	0.3
35	Tehri HPS	1000 MW	19.8	20.2	0.4
36	Koteshwar HPS	400 MW	7.2	7.3	0.1
37	Bhakra HPS	1379 MW	22.3	22.3	0.0
38	Dehar HPS	990 MW	14.0	14.2	0.2
39	Pong HPS	396 MW	7.6	7.6	0.1
40	ALLAIN DUHANGAN HPS(IPP)	192 MW	3.1	3.1	0.0
41	KARCHAM WANGTOO HPS(IPP)	1000 MW	26.1	26.4	0.3
42	Malana Stg-II HPS	100 MW	2.5	2.7	0.2
43	Shree Cement TPS	300 MW	3.2	3.2	-0.1
44	Budhil HPS(IPP)	70 MW	1.8	1.8	0.0
	Total Generation	25236 MW	459.4	457.4	-1.9
C	Inter Regional Exchange		216.7	221.0	4.2
D	Trans-National Exchange		0.0	-0.5	
E	RRAS		2.4		
F	ISTS Loss (MU)		28.1	23.9	-4.2
	ISTS Loss (%)		4.16	3.52	

Western Region Energy Balance for ISTS for 17-Aug-2017					
Sl. No.			Schedule	Actual	Deviation
A	States				
1	Gujarat		58.5	58.9	0.5
2	Madhya Pradesh		104.1	107.4	3.3
3	Chattisgarh		26.4	27.4	1.0
4	Maharashtra		117.0	116.7	-0.3
5	Goa		8.8	8.7	-0.1
6	Daman & Diu		6.2	7.4	1.2
7	Dadra & Nagar Haveli		16.7	17.0	0.3
8	Essar Steel		1.2	3.2	2.0
	Total Drawal		338.9	346.8	7.9
B	Regional Entities Generation				
1	Korba-I&II	2100 MW	40.3	40.7	0.3
2	Korba-III	500 MW	11.2	11.0	-0.2
3	Vindhyachal-I	1260 MW	22.5	23.1	0.6
4	Vindhyachal-II	1000 MW	22.1	23.5	1.3
5	Vindhyachal-III	1000 MW	22.3	22.3	0.0
6	Vindhyachal-IV	1000 MW	11.1	11.4	0.3
7	Vindhyachal-V	500 MW	7.6	11.1	3.5
8	Sipat-I	1980 MW	44.9	45.1	0.1
9	Sipat-II	1000 MW	22.7	22.7	0.0
10	Mouda-I	1000 MW	17.2	19.2	2.0
11	Sasan	3960 MW	61.5	63.4	1.9
12	Mundra	4150 MW	75.7	74.9	-0.8
13	NSPCL	500 MW	10.2	10.9	0.7
14	Kakrapar	440 MW	0.0	0.0	0.0
15	Tarapur I	320 MW	3.6	3.4	-0.2
16	Tarapur-II	1080 MW	0.0	0.0	0.0
17	Kawas	656 MW	6.7	7.2	0.5
18	Gandhar	657 MW	8.9	8.6	-0.3
19	E-Bid RGPPL	1000 MW	12.1	11.4	-0.7
20	SSP	1450 MW	1.1	0.9	-0.2
21	Mouda-II	500 MW	0.0	9.0	9.0
22	Essar Mahan	600 MW	0.0	-0.1	-0.1
23	Vandana Vidyut	135 MW	0.0	0.0	0.0
24	Balco	1200 MW	-6.6	-6.5	0.1
25	JP Nigrie	1320 MW	29.6	29.8	0.2
26	Lanco	600 MW	8.0	8.2	0.1
27	KSK Mahnadi	1200 MW	12.9	12.9	0.0
28	Jindal Stg-1	1000 MW	13.5	13.4	-0.1
29	Jindal Stg-2	1800 MW	10.8	10.8	0.0
30	DCPP	540 MW	0.3	0.2	-0.1
31	Korba West	600 MW	0.0	0.0	0.0
32	DBPower	1200 MW	9.2	8.9	-0.3
33	EMCO	600 MW	6.5	6.3	-0.2
34	ACBIL+ Spectrum+MCPL	620 MW	8.9	8.6	-0.3
35	Dhariwal	300 MW	5.8	5.7	0.0
36	SKS	0 MW	0.0	0.0	0.0
37	RKM	720 MW	0.0	0.0	0.0
38	MB Power	1200 MW	13.8	13.3	-0.5
39	GMR Chhattisgarh	1370 MW	10.6	10.8	0.2
40	DGEN	1200 MW	0.0	0.0	0.0
41	Jhabua	600 MW	0.0	0.0	0.0
	Total Generation	42858 MW	525.1	541.9	16.8
C	Inter Regional Exchange		-206.6	-216.7	-10.1
D	RRAS		1.7		
F	ISTS loss (MU)		-22.1	-21.5	
	ISTS loss (%)		-4.20	-3.97	

Southern Region Energy Balance for ISTS for 17-Aug-2017					
Sl. No.			Schedule	Actual	Deviation
A	States				
1	Andhra Pradesh		37.4	39.2	1.8
2	Telangana		90.0	86.6	-3.4
3	Karnataka		83.3	85.1	1.8
4	Kerala		47.4	49.7	2.3
5	Tamil Nadu		84.0	83.7	-0.3
6	Pondicherry		7.2	6.9	-0.3
	Total Drawal		349.3	351.2	1.9
B	Regional Entities Generation				
1	Ramagundam,NTPC	2600 MW	58.1	57.3	-0.8
2	Neyveli TPS II	1470 MW	20.8	23.3	2.5
3	Neyveli TPS I (EXP)	420 MW	7.2	8.6	1.4
4	Madras APS	440 MW	8.5	8.8	0.3
5	Kaiga STGI	440 MW	9.6	9.6	0.0
6	Kaiga STG II	440 MW	9.9	9.9	0.0
7	Neyveli TPS II (EXP)	500 MW	1.9	0.0	-1.9
8	Talcher II, NTPC	2000 MW	33.8	33.9	0.1
9	Simhadri II, NTPC	1000 MW	17.4	18.5	1.1
10	Kudankulam	2000 MW	0.0	0.0	0.0
11	Vallur	1500 MW	15.2	15.9	0.6
12	NTPL	1000 MW	22.5	16.6	-6.0
13	LKPPL STG1	366 MW	0.0	0.0	0.0
14	LKPPL STG2	368 MW	0.0	0.0	0.0
15	Simhapuri	600 MW	0.0	0.0	0.0
16	Meenakshi	300 MW	5.9	5.4	-0.5
17	Coastal Energen	1200 MW	7.4	7.6	0.2
18	TPCIL	1320 MW	29.9	29.5	-0.3
19	IL&FS	1200 MW	0.0	0.0	0.0
20	SGPL (NCC)	660 MW	23.1	24.5	1.4
	Total Generation	19824 MW	271.1	269.3	-1.8
C	Inter Regional Exchange		69.4	63.4	-6.0
D	RRAS		5.8		
E	ISTS loss (MU)		-14.6	-18.5	
	ISTS loss (%)		-4.27	-5.57	

Eastern Region Energy Balance for ISTS for 17-Aug-2017					
Sl. No.			Schedule	Actual	Deviation
A	States				
1	Bihar		67.6	68.8	1.2
2	DVC		-27.7	-28.0	-0.3
3	Jharkhand		15.8	14.7	-1.1
4	Odisha		26.1	24.5	-1.6
5	West Bengal		50.4	53.6	3.2
6	Sikkim		2.0	1.1	-0.9
7	Total Drawal		134.2	134.6	0.4
B	Regional Entities Generation				
1	Farakka STPS - I & II	1600 MW	18.3	18.0	-0.3
2	Farakka STPS - III	500 MW	8.5	7.2	-1.3
3	Kahalgaon STPS - I	840 MW	17.3	16.9	-0.4
4	Kahalgaon STPS - II	1500 MW	32.6	32.2	-0.4
5	Barh STPS - I & II	1320 MW	27.5	26.5	-1.0
6	Talcher STPS - I	1000 MW	22.6	22.5	-0.1
7	Teesta	510 MW	-3.3	3.6	6.9
8	Rangit	60 MW	12.1	12.4	0.2
9	Kurichu	60 MW	1.4	1.4	0.0
10	Tala	1020 MW	1.4	1.9	0.4
11	Chukha	336 MW	25.4	25.2	-0.1
12	Dagachu	126 MW	7.0	7.6	0.7
13	MPL	1050 MW	0.0	0.0	0.0
14	APNRL	540 MW	22.9	24.3	1.4
15	GMR	1050 MW	6.0	6.7	0.7
16	JITPL	1200 MW	7.6	7.5	-0.1
17	Chuzachen HEP	110 MW	8.6	7.9	-0.8
18	Jorethang HEP	96 MW	2.4	2.5	0.1
19	Teesta-III	600 MW	-1.4	-2.1	-0.6
20	Talcher Solar	10 MW	0.0	0.0	0.0
	Total Generation	13528 MW	217.0	222.3	5.3
C	Inter Regional Exchange		-71.9	-72.7	-0.8
D	Trans-National Exchange		-9.5	-9.3	
E	RRAS		5.8		
F	ISTS loss (MU)		-4.3	5.7	
	ISTS loss (%)		-1.76	2.27	

North Eastern Region Energy Balance for ISTS for 17-Aug-2017					
Sl.No.			Schedule	Actual	Deviation
A	States				
1	Arunachal Pradesh		3.1	2.1	-1.0
2	Assam		22.4	25.9	3.5
3	Manipur		2.2	2.2	0.0
4	Meghalaya		-1.7	-2.0	-0.3
5	Mizoram		1.2	1.1	-0.1
6	Nagaland		2.0	2.1	0.2
7	Tripura		2.8	3.7	0.9
	Total Drawal		32.0	35.1	3.1
B	Regional Entities Generation				
1	Khandong+Kopili Stage-II	75 MW	1.5	1.5	0.0
2	Kopili	200 MW	4.6	4.7	0.1
3	Kathalguri	291 MW	3.6	3.8	0.2
4	Loktak	105 MW	2.4	2.4	0.0
5	AGTCCPP	130 MW	1.8	1.9	0.1
6	Doyang	75 MW	1.7	1.8	0.1
7	Ranganadi	405 MW	8.7	8.8	0.1
8	Palatana	726 MW	11.1	11.2	0.1
9	BgTPP	250 MW	4.3	4.6	0.3
	Total Generation	2257 MW	39.7	40.8	1.1
C	Inter Regional Exchange		-6.2	-4.8	1.3
D	RRAS		0.3		
E	ISTS loss (MU)		1.2	0.9	
	ISTS loss (%)		3.02	2.11	

(C). GENERATION LOSS DUE TO LESS REQUISITION /HIGH COST

Date of Reporting:18.08.2017

	Station Name	Fuel Type	Installed Capacity (MW)	UNITS		Average Declared Capacity	Average Schedule	Less Requisition
				S/D	Fuel Shortage			
NR	ANTA	GAS	419			0	0	0
		RLNG				0	0	0
		LF				392	0	392
		Total				392	0	392
	AURAIYA	GAS	663			0	0	0
		RLNG				0	0	0
		LF				614	0	614
		Total				614	0	614
	DADRI	GAS	830			171	170	2
		RLNG				0	0	0
		LF				587	0	587
		Total				758	170	589
	NR TOTAL		1912			1764	170	1594
WR	KAWAS	GAS	656			224	217	7
		NAPM				118	56	62
		LF				0	0	0
		RLNG				301	6	295
		Total		0	0	644	280	364
	GANDHAR	GAS	657			259	268	-9
		NAPM				61	95	-34
		RLNG				295	6	289
		Total		0	0	615	369	246
	RGPPL	GAS	1967			0	0	0
		RLNG				0	0	0
		RLNG-IR				540	504	36
		Total		0	0	540	504	36
	WR TOTAL		3280	0	0	1799	1154	645

Note:-

Report of loss of generation in respect of ISGS stations of WR and NR due to less requisition/high cost.

पॉवर सिस्टम ऑपरेशन कार्पोरेशन लिमिटेड

(भारत सरकार का उद्यम)

उत्तरी क्षेत्रीय भार प्रेषण केंद्र

CIN: U40105DL2009GOI188682

Power Supply Position in Northern Region for 17.08.2017

Date of Reporting : 18.08.2017



I. Regional Availability/Demand:

Evening Peak (20:00 Hrs) MW				Off Peak (03:00 Hrs) MW				Day Energy (Net MU)	
Demand Met	Shortage	Requirement	Freq* (Hz)	Demand Met	Shortage	Requirement	Freq* (Hz)	Demand Met	Shortage
55452	2360	57812	49.97	54306	932	55238	50.02	1287.66	12.13

* Half hourly two 15 minutes block-one block each before and after the designated time) average frequency

II. A. State's Load Demands (At States periphery) in MUs:

State	State's Control Area Generation (Net MU)				Drawal Schedule (Net MU)	Actual Drawal (Net MU)	UI (Net MU)	Consumption (Net MU)	Shortages * (MU)
	Thermal	Hydro	Renewable/others \$	Total					
Punjab	96.09	23.08	0.23	119.41	130.53	130.54	0.00	249.94	0.00
Haryana	73.23	0.78	0.00	74.02	126.93	127.95	1.02	201.97	0.50
Rajasthan	100.82	0.12	37.16	138.09	81.99	83.24	1.25	221.33	1.36
Delhi	26.82		0.00	26.82	95.93	94.72	-1.21	121.54	0.00
UP	166.56	23.75	0.00	190.31	181.63	185.52	3.89	375.83	0.00
Uttarakhand		19.01	7.34	26.35	13.97	14.94	0.98	41.29	0.48
HP		17.54	8.06	25.59	-0.06	2.94	3.01	28.54	0.10
J & K		25.60	0.00	25.60	14.74	15.17	0.43	40.77	9.69
Chandigarh				0.00	6.87	6.45	-0.42	6.45	0.00
Total	463.53	109.87	52.78	626.18	652.52	661.48	8.95	1287.66	12.13

* Shortage furnished by the respective constituent \$ Others include UP Co-generation and JK Diesel

II. B. State's Demand Met in MWs:

State	Evening Peak (20:00 Hrs) MW				Off Peak (03:00 Hrs) MW				Maximum Demand Met (MW) and Time(Hrs)	
	Demand Met	Shortage	UI	STOA/PX transaction	Demand Met	Shortage	UI	STOA/PX transaction	Maximum Demand Met (MW) and Time(Hrs)	Shortage (MW)
Punjab	10605	0	-77	1428	10336	0	-58	1688	10730	15
Haryana	8869	413	-5	985	8763	0	-73	1609	9294	21
Rajasthan	8796	0	-206	167	9812	0	67	273	9987	2
Delhi	5151	0	-96	480	5157	0	207	643	5993	24
UP	16686	1295	-110	1723	15999	700	-224	1648	17719	22
Uttarakhand	1836	155	96	-267	1650	0	43	-376	1836	20
HP	1230	0	259	-1775	1046	0	71	-1642	1340	16
J&K	1990	498	41	-746	1315	232	-2	-1233	2025	21
Chandigarh	289	0	-35	-15	228	0	-12	0	330	15
Total	55452	2360	-133	1980	54306	932	19	2611	57264	22

* STOA figures are at sellers boundary & PX figures are at regional boundary. # figures may not be at simultaneous hour.

Diversity is 1.03

III. Regional Entities :

Station/ Constituent	Inst. Capacity (Effective) MW	Declared Capacity(MW)	Peak MW (Gross)	Off Peak MW (Gross)	Energy (Net MU)	Average Sentout(MW)	Schedule Net MU	UI [OG(+ve), UG: (-ve)]	
								Net MU	Net MU
A. NTPC	Singrauli STPS (5*200+2*500)	2000	1671	1855	1837	40.33	1680	39.90	0.43
	Rihand I STPS (2*500)	1000	461	509	486	11.04	460	11.07	-0.03
	Rihand II STPS (2*500)	1000	943	979	988	22.38	932	22.59	-0.21
	Rihand III STPS (2*500)	1000	943	1002	989	22.67	944	22.59	0.07
	Dadri I STPS (4*210)	840	769	577	577	12.67	528	13.61	-0.94
	Dadri II STPS (2*490)	980	929	936	939	20.61	859	21.53	-0.92
	Unchahar I TPS (2*210)	420	383	408	392	8.25	344	9.15	-0.90
	Unchahar II TPS (2*210)	420	383	373	364	8.38	349	9.06	-0.68
	Unchahar III TPS (1*210)	210	192	193	181	4.15	173	4.55	-0.40
	Unchahar IV TPS(1*500)	500		0	0	0.00	0	0.00	0.00
	ISTPP (Jhajjhar) (3*500)	1500	777	968	746	17.62	734	18.54	-0.92
	Dadri GPS (4*130, 19+2*154.51)	830	758	180	135	3.79	158	4.07	-0.28
	Anta GPS (3*88.71+1*153.2)	419	392	0	0	0.00	0	0.00	0.00
	Auraiya GPS (4*111.19+2*109.30)	663	614	0	0	0.00	0	0.00	0.00
	Dadri Solar(5)	5	1	0	0	0.02	1	0.02	0.00
	Unchahar Solar(10)	10	1	0	0	0.04	2	0.03	0.00
	Singrauli Solar(15)	15	1	0	0	0.02	1	0.03	-0.01
	KHEP(4*200)	800	835	870	865	20.62	859	20.04	0.57
	Sub Total (A)	12612	10052	8850	8499	193	8024	197	-4.21
B. NPC	NAPS (2*220)	440	382	408	420	8.97	374	9.17	-0.19
	RAPS- B (2*220)	440	400	422	409	8.95	373	9.48	-0.52
	RAPS- C (2*220)	440	410	447	452	9.70	404	9.84	-0.14
	Sub Total (B)	1320	1192	1277	1281	27.62	1151	28.48	-0.86
	Chamera I HPS (3*180)	540	535	543	538	12.92	538	12.83	0.09
C. NHPC	Chamera II HPS (3*100)	300	300	305	304	7.23	301	7.20	0.03
	Chamera III HPS (3*77)	231	230	232	234	5.26	219	5.22	0.04
	Bairasuli HPS(3*60)	180	82	182	122	1.42	59	1.35	0.07
	Salal-HPS (6*115)	690	672	684	670	16.12	672	16.12	0.00
	Tanakpur-HPS (3*31.4)	94	91	93	96	2.26	94	2.18	0.09
	Uri-I HPS (4*120)	480	376	480	380	9.47	395	9.02	0.45
	Uri-II HPS (4*60)	240	206	207	204	5.17	216	4.98	0.19
	Dhauliganga-HPS (4*70)	280	281	285	280	6.87	286	6.74	0.14
	Dulhasti-HPS (3*130)	390	387	399	394	9.33	389	9.28	0.05
	Sewa-II HPS (3*40)	120	101	126	118	1.38	57	1.35	0.03
	Parbati 3 (4*130)	520	514	521	129	4.01	167	3.95	0.06
	Sub Total (C)	4065	3773	4057	3469	81	3393	80	1.22
	NJPC (6*250)	1500	1513	1608	1529	36.82	1534	36.31	0.51
	Rampur HEP (6*68.67)	412	416	436	437	10.24	427	9.98	0.27
	Sub Total (D)	1912	1929	2044	1966	47.07	1961	46.29	0.77
E. THDC	Tehri HPS (4*250)	1000	926	1024	771	20.22	843	19.83	0.39
	Koteshwar HPS (4*100)	400	301	399	272	7.29	304	7.22	0.07
	Sub Total (E)	1400	1227	1423	1043	27.51	1146	27.05	0.46
F. BBMB	Bhakra HPS (2*108+3*126+5*157)	1379	931	1342	772	22.31	930	22.33	-0.02
	Dehar HPS (6*165)	990	582	825	560	14.21	592	13.98	0.23
	Pong HPS (6*66)	396	315	330	330	7.61	317	7.56	0.06
	Sub Total (F)	2765	1828	2497	1662	44.13	1839	43.87	0.26
G. IPP(s)/JV(s)	ALLAIN DUHANGAN HPS(IPP) (2*96)	192	0	191	92	3.07	128	3.07	0.00
	KARCHAM WANGTOO HPS(IPP) (4*250)	1000	0	1100	1100	26.40	1100	26.08	0.32
	Malana Stg-II HPS (2*50)	100	0	113	113	2.65	111	2.50	0.15
	Shree Cement TPS (2*150)	300	0	146	146	3.17	132	3.23	-0.06
	Budhil HPS(IPP) (2*35)	70	0	76	76	1.81	75	1.79	0.01
	Sub Total (G)	1662	0	1626	1527	37.10	1546	36.68	0.42
	Sub Total (H)	25737	20000	21774	19447	457.44	19060	459.38	-1.93

H. Total Regional Entities (A-G)									
I. State Entities	Station	Effective Installed Capacity (MW)	Peak MW	Off Peak MW	Energy(MU)	Average(Sento ut MW)			
Punjab	Guru Gobind Singh TPS (Ropar) (6*210)	1260	615	470	11.78	491			
	Guru Nanak Dev TPS(Bhatinda) (2*110+2*120)	460	227	190	4.59	191			
	Guru Hargobind Singh TPS(L.mbt) (2*210+2*250)	920	251	215	5.02	209			
	Goindwal(GVK) (2*270)	540	0	246	4.20	175			
	Rajpura (2*700)	1400	1320	1320	31.68	1320			
	Talwandi Saboo (3*660)	1980	1700	1700	38.82	1618			

	Thermal (Total)		6560	4113	4141	96.09	4004	
	Total Hydro		1000	1112	927	23.08	962	
	Wind Power		0	0	0	0.00	0	
	Biomass		288	0	0	0.15	6	
	Solar		560	0	0	0.08	3	
	Renewable(Total)		848	0	0	0.23	10	
	Total Punjab		8408	5225	5068	119.41	4975	
	Haryana	Panipat TPS (2*210+2*250)		920	730	592	16.00	667
		DCRTPP (Yamuna nagar) (2*300)		600	517	469	11.96	498
		Faridabad GPS (NTPC)(2*137.75+1*156)		432	0	0	0.00	0
RGTPP (khedar) (IPP) (2*600)		1200	1116	1062	25.06	1044		
Magnum Diesel (IPP)		25	0	0	0.00	0		
Jhajjar(CLP) (2*660)		1320	1172	735	20.21	842		
Thermal (Total)		4497	3535	2858	73.23	3051		
Total Hydro		62	33	33	0.78	33		
Wind Power		0	0	0	0.00	0		
Biomass		40	0	0	0.00	0		
Solar		0	0	0	0.00	0		
Renewable(Total)		40	0	0	0.00	0		
Total Haryana		4599	3568	2891	74.02	3084		
Rajasthan	kota TPS (2*110+2*195+3*210)		1240	524	452	11.57	482	
	suratgarh TPS (6*250)		1500	217	175	4.46	186	
	Chabra TPS (4*250)		1000	461	437	10.23	426	
	Chabra TPS (1*660)		660	0	0	0.00	0	
	Dholpur GPS (3*110)		330	0	0	0.00	0	
	Ramgarh GPS(1*37.5 + 1*35.5 +2*37.5 +1*110 +1*50)		271	177	176	4.41	184	
	RAPS A (NPC) (1*100+1*200)		300	166	168	4.15	173	
	Barsingsar (NLC) (2*125)		250	109	111	2.39	100	
	Giral LTPS (2*125)		250	0	0	0.00	0	
	Rajwest LTPS (IPP) (8*135)		1080	765	518	15.41	642	
	VS LIGNITE LTPS (IPP) (1*135)		135	0	0	0.00	0	
	Kalisindh Thermal(2*600)		1200	1028	1023	21.99	916	
	Kawai(Adani) (2*660)		1320	1186	1115	26.20	1092	
	Thermal (Total)		9536	4633	4175	100.82	4201	
	Total Hydro		550	31	0	0.12	5	
	Wind power		4017	680	2081	34.06	1419	
	Biomass		99	14	14	0.33	14	
	Solar		1295	0	0	2.78	116	
	Renewable/Others (Total)		5411	694	2095	37.16	1548	
Total Rajasthan		15497	5358	6270	138.09	5754		
UP	Anpara TPS (3*210+2*500)		1630	1133	1152	28.42	1184	
	Obra TPS (2*50+2*94+5*200)		1194	461	516	10.69	445	
	Paricha TPS (2*110+2*220+2*250)		1160	705	662	16.21	675	
	Panki TPS (2*105)		210	0	0	0.00	0	
	Harduaganj TPS (1*60+1*105+2*250)		665	444	447	10.71	446	
	Tanda TPS (NTPC) (4*110)		440	388	390	8.99	375	
	Roza TPS (IPP) (4*300)		1200	553	528	13.11	546	
	Anpara-C (IPP) (2*600)		1200	1103	1018	25.17	1049	
	Bajaj Energy Pvt.Ltd(IPP) TPS (10*45)		450	0	0	0.00	0	
	Anpara-D(2*500)		1000	901	446	17.71	738	
	Lalitpur TPS(3*660)		1980	1242	761	21.07	878	
	Bara(2*660)		1320	606	603	14.47	603	
	Thermal (Total)		12449	7536	6523	166.56	6940	
	Vishnuparyag HPS (IPP)(4*110)		440	395	440	9.48	395	
	Alaknanada(4*82.5)		330	341	339	8.20	342	
	Other Hydro		527	300	275	6.07	253	
	Cogeneration		981	0	0	0.00	0	
	Wind Power		0	0	0	0.00	0	
	Biomass		26	0	0	0.00	0	
	Solar		102	0	0	0.00	0	
	Renewable(Total)		128	0	0	0.00	0	
	Total UP		14855	8572	7577	190.31	7930	
Uttarakhand	Other Hydro		1250	776	846	19.01	792	
	Total Gas		225	279	286	6.78	283	
	Wind Power		0	0	0	0.00	0	
	Biomass		127	0	0	0.00	0	
	Solar		100	0	0	0.56	23	
	Small Hydro (< 25 MW)		180	0	0	0.00	0	
	Renewable(Total)		407	0	0	0.56	23	
	Total Uttarakhand		1882	1055	1132	26.35	1098	
Delhi	Rajghat TPS (2*67.5)		135	0	0	0.00	0	
	Delhi Gas Turbine (6x30 + 3x34)		282	75	76	1.74	73	
	Pragati Gas Turbine (2x104+ 1x122)		330	260	259	6.41	267	
	Rithala GPS (3*36)		95	0	0	0.00	0	
	Bawana GPS (4*216+2*253)		1370	549	428	11.57	482	
	Badarpur TPS (NTPC) (3*95+2*210)		705	332	323	7.10	296	
	Thermal (Total)		2917	1216	1087	26.82	1117	
	Wind Power		0	0	0	0.00	0	
	Biomass		16	0	0	0.00	0	
	Solar		2	0	0	0.00	0	
	Renewable(Total)		18	0	0	0.00	0	
	Total Delhi		2935	1216	1087	26.82	1117	
HP	Baspa HPS (IPP) (3*100)		300	330	330	7.87	328	
	Malana HPS (IPP) (2*43)		86	104	106	2.49	104	
	Other Hydro (>25MW)		372	295	344	7.17	299	
	Wind Power		0	0	0	0.00	0	
	Biomass		0	0	0	0.00	0	
	Solar		0	0	0	0.00	0	
	Small Hydro (< 25 MW)		486	343	343	8.06	336	
	Renewable(Total)		486	343	343	8.06	336	
	Total HP		1244	1072	1122	25.59	1066	
	J & K	Baglihar HPS (IPP) (3*150+3*150)		900	883	886	20.79	866
Other Hydro/IPP(including 98 MW Small Hydro)		308	200	200	4.81	201		
Gas/Diesel/Others		190	0	0	0.00	0		
Wind Power		0	0	0	0.00	0		
Biomass		0	0	0	0.00	0		
Solar		0	0	0	0.00	0		
Small Hydro (< 25 MW)Included in Other Hydro Above		98	0	0	0.00	0		
Renewable(Total)		98	0	0	0.00	0		
Total J & K		1398	1083	1086	26	1067		
Total State Control Area Generation		50818	27149	26232	626.18	26091		
J. Net Inter Regional Exchange [Import (+ve)/Export (-ve)]			9396	10031	220.97	9207		
Total Regional Availability(Gross)		76555	58319	55710	1304.60	54358		

IV. Total Hydro Generation:					
Regional Entities Hydro	12234	12295	10310	252.88	10537
State Control Area Hydro	7243	5422	5354	117.93	5219
Total Regional Hydro	19477	17716	15664	370.81	15756

V. Total Renewable Generation:					
Regional Entities Renewable	30	0	0	0.08	3
State Control Area Renewable	7436	1037	2438	46.00	1917
Total Regional Renewable	7466	1037	2438	46.08	1920

VI(A). Inter Regional Exchange [Import (+ve)/Export (-ve)] [Linkwise]							
Element	Peak(20:00 Hrs)	Off Peak(03:00 Hrs)	Maximum Interchange (MW)		Energy (MU)		Net Energy MU
	MW	MW	Import	Export	Import	Export	
Vindhychal(HVDC B/B)	-400	-200	250	400	0.46	7.42	-6.96
765 KV Gwalior-Agra (D/C)	2394	2135	2855	0	51.08	0.00	51.08
400 KV Zerda-Kankroli	-4	-6	133	149	0.00	0.45	-0.45
400 KV Zerda-Bhinmal	78	-32	171	163	0.21	0.00	0.21
220 KV Auraiya-Malanpur	-42	-33	0	52	0.00	0.55	-0.55
220 KV Badod-Kota/Morak	53	89	135	0	1.91	0.00	1.91
Mundra-Mohindergarh(HVDC Bipole)	2502	2498	2505	0	49.92	0.00	49.92
400 KV RAPPC-Sujalpur	334	75	356	0	4.99	0.00	4.99
400 KV Vindhyachal-Rihand	0	0	0	0	0.00	0.00	0.00
765 kv Phagi-Gwalior (D/C)	674	836	1005	0	20.43	0.00	20.43
+/- 800 kV HVDC Champa-Kurushetra	1500	1500	1500	0	25.97	0	25.97
Sub Total WR	7089	6862			154.97	8.42	146.55
400 kV Sasaram - Varanasi	171	156	171	0	3.72	0.00	3.72
400 kV Sasaram - Allahabad	16	33	61	0	0.91	0.00	0.91
400 KV MZP- GKP (D/C)	364	474	744	0	12.52	0.00	12.52
400 KV Patna-Balia(D/C) X 2	768	925	1000	0	20.95	0.00	20.95
400 KV B'Sharif-Balia (D/C)	185	244	370	0	6.39	0.00	6.39
765 KV Gaya-Balia	331	268	422	0	7.17	0.00	7.17
765 KV Gaya-Varanasi (D/C)	172	273	482	0	7.98	0.00	7.98
220 KV Pusauli-Sahupuri	124	114	129	0	2.39	0.00	2.39
132 KV K'nasa-Sahupuri	-26	-22	0	28	0.00	0.84	-0.84
132 KV Son Ngr-Rihand	-27	-24	0	35	0.00	0.61	-0.61
132 KV Garhwa-Rihand	0	0	0	0	0.00	0.00	0.00
765 KV Sasaram - Fatehpur	-191	-95	118	201	0.00	0.61	-0.61
400 KV Barh -GKP (D/C)	-210	-156	0	200	0.00	3.30	-3.30
400 kV B'Sharif - Varanasi (D/C)	130	-21	130	158	0.00	0.83	-0.83
+/- 800 KV HVDC Alipurduar-Agra	0	0	0	0	0.00	0.00	0.00
Sub Total ER	1807	2169			62.01	6.20	55.82
+/- 800 KV HVDC BiswanathChariali-Agra	500	1000	1150	0.00	18.61	0.00	18.61
Sub Total NER	500	1000			18.61	0.00	18.61
Total IR Exch	9396	10031			235.59	14.62	220.97

ISGS/LT Schedule (MU)			Bilateral Schedule (MU)		Power Exchange Shdl (MU)		Wheeling (MU)	
ER	Bhutan	Total	Through ER	Through WR	Through ER	Through WR	Through ER	Through WR
45.96	3.75	49.70	18.21	14.42	-7.14	-4.87	0.00	0.00

Total IR Schedule (MU)			Total IR Actual (MU)			Net IR UI (MU)		
Through ER	Through WR Inclds Mndra	Total	Through ER(including NER)	Through WR	Total	Through ER (including NER)	Through WR	Total
60.76	155.98	216.74	74.43	146.55	220.97	13.66	-9.43	4.23

VI(C). Inter National Exchange with Nepal [Import (+ve)/Export (-ve)] [Linkwise]							
Element	Peak(20:00 Hrs)	Off Peak(03:00 Hrs)	Maximum Interchange (MW)		Energy (MU)		Net Energy MU
	MW	MW	Import	Export	Import	Export	
132 KV Tanakpur - Mahendarnagar	-26	0	0	30	0	0	-0.48

VII. Frequency Profile <----- % of Time Frequency ----->									
<49.2	<49.7	<49.8	<49.9	<50.0	49.9-50.05	50.05-50.10	50.10-50.20	>50.20	>50.50
0.00	0.03	1.44	14.42	59.39	74.69	9.50	1.92	0.00	0.00

<----- Frequency (Hz) ----->				Average Frequency	Frequency Variation	Std. Dev.	Frequency in 15 Min Block		Freq Dev Index (% of Time)
Maximum		Minimum					MAX	MIN	
Freq	Time	Freq	Time	Hz	Index		(Hz)	(Hz)	
50.16	18.03	49.69	19.24	49.98	0.054	0.069	50.06	49.76	25.31

VIII(A). Voltage profile 400 kV										
Station	Voltage Level (kV)	Maximum		Minimum		Voltage (in % of Time)				Voltage Deviation
		Voltage(KV)	Time	Voltage (KV)	Time	<380 kV	<390 kV	>420 kV	>430 kV	
Rihand	400	407	2:00	400	19:16	0.0	0.0	0.0	0.0	0.0
Gorakhpur	400	410	2:00	383	19:17	0.0	1.3	0.0	0.0	0.0
Bareilly(PG)400kV	400	414	2:02	387	19:20	0.0	0.9	0.0	0.0	0.0
Kanpur	400	415	1:59	396	19:21	0.0	0.0	0.0	0.0	0.0
Dadri	400	410	5:02	390	14:42	0.0	0.0	0.0	0.0	0.0
Ballabgarh	400	410	5:06	386	14:51	0.0	5.6	0.0	0.0	0.0
Bawana	400	407	5:17	387	14:51	0.0	3.7	0.0	0.0	0.0
Bassi	400	420	18:04	393	22:10	0.0	0.0	0.0	0.0	0.0
Hissar	400	404	5:03	388	19:21	0.0	0.9	0.0	0.0	0.0
Moga	400	404	5:05	390	19:19	0.0	0.0	0.0	0.0	0.0
Abdullapur	400	405	5:17	387	19:21	0.0	1.8	0.0	0.0	0.0
Nalagarh	400	410	5:20	394	14:52	0.0	0.0	0.0	0.0	0.0
Kishenpur	400	409	4:53	398	19:22	0.0	0.0	0.0	0.0	0.0
Wagoora	400	407	2:00	384	19:48	0.0	26.2	0.0	0.0	0.0
Amritsar	400	407	5:05	394	12:31	0.0	0.0	0.0	0.0	0.0
Kashipur	400	0	0:00	0	0:00	0.0	0.0	0.0	0.0	0.0
Hamirpur	400	407	5:20	394	12:37	0.0	0.0	0.0	0.0	0.0
Rishikesh	400	0	0:00	0	0:00	0.0	0.0	0.0	0.0	0.0

III(B). Voltage profile 765 kV										
Station	Voltage Level (kV)	Maximum		Minimum		Voltage (in % of Time)				Voltage Deviate
		Voltage(KV)	Time	Voltage (KV)	Time	<728 kV	<742 kV	>800 kV	>820 kV	
Fatehpur	765	786	1:59	740	19:21	0.0	0.7	0.0	0.0	0.0
Balia	765	789	2:01	741	19:21	0.0	0.1	0.0	0.0	0.0
Moga	765	0	0:00	0	0:00	0.0	0.0	0.0	0.0	0.0
Agra	765	791	2:01	750	22:13	0.0	0.0	0.0	0.0	0.0
Bhiwani	765	788	5:00	759	22:08	0.0	0.0	0.0	0.0	0.0

Unnao	765	772	2:02	734	19:22	0.0	2.1	0.0	0.0	0.0
Lucknow	765	795	2:02	740	19:17	0.0	1.1	0.0	0.0	0.0
Meerut	765	795	5:06	753	14:10	0.0	0.0	0.0	0.0	0.0
Jhatikara	765	789	5:05	752	22:11	0.0	0.0	0.0	0.0	0.0
Bareilly 765 kV	765	799	2:02	741	19:21	0.0	0.1	0.0	0.0	0.0
Anta	765	795	5:11	764	22:13	0.0	0.0	0.0	0.0	0.0
Phagi	765	793	18:00	759	22:12	0.0	0.0	0.0	0.0	0.0

Note : "0" in Max / Min Col -> Telemetry Outage

IX. Reservoir Parameters:

Name of Reservoir	Parameters		Present Parameters		Last Year		Last day	
	FRL (m)	MDDL (m)	Level (m)	Energy (MU)	Level (m)	Energy (MU)	Inflow (m ³ /s)	Usage (m ³ /s)
Bhakra	513.59	445.62	505.86	1352.81	496.88	971.87	979.00	685.47
Pong	426.72	384.05	420.02	889.22	414.69	668.52	525.22	439.05
Tehri	829.79	740.04	808.30	769.13	809.80	798.36	435.48	477.00
Koteshwar	612.50	598.50	610.68	4.69	610.42	4.69	477.00	480.85
Chamera-I	760.00	748.75	755.17	0.00	0.00	0.00	282.18	350.79
Rihand	268.22	252.98	0.00	0.00	0.00	0.00	0.00	0.00
RPS	352.80	343.81	0.00	0.00	0.00	0.00	0.00	0.00
Jawahar Sagar	298.70	295.78	0.00	0.00	0.00	0.00	0.00	0.00
RSD	527.91	487.91	522.36	11.11	518.26	5.20	338.45	450.07

* NA: Not Available

X(A). Short-Term Open Access Details:

State	Off- Peak Hours (03:00 Hrs)			Peak Hours (20:00 Hrs)			Day Energy (MU)		
	Bilateral (MW)	IEX (MW)	PXIL (MW)	Bilateral (MW)	IEX (MW)	PXIL (MW)	Bilateral (MU)	IEX / PXIL (MU)	Total (MU)
Punjab	1688	0	0	1428	0	0	40.26	0.10	40.36
Delhi	654	-11	0	678	-198	0	17.42	-2.20	15.22
Haryana	1416	193	0	948	37	0	20.98	3.59	24.56
HP	-1343	-299	0	-1409	-366	0	-28.93	-7.98	-36.91
J&K	-740	-492	0	-740	-5	0	-17.77	-5.79	-23.56
CHD	0	0	0	0	-15	0	0.00	-0.20	-0.20
Rajasthan	-59	332	0	-59	226	0	-1.41	7.00	5.59
UP	1097	550	0	1426	297	0	14.31	8.08	22.39
Uttarakhand	-204	-172	0	-277	10	0	-5.37	-2.08	-7.45
Total	2510	101	0	1995	-15	0	39.49	0.51	40.00

X(B). Short-Term Open Access Details:

State	Bilateral (MW)		IEX (MW)		PXIL (MW)	
	Maximum	Minimum	Maximum	Minimum	Maximum	Minimum
Punjab	1821	1428	47	0	0	0
Delhi	1138	520	171	-336	0	0
Haryana	1416	689	217	-271	0	0
HP	-1026	-1637	-270	-391	0	0
J&K	-740	-740	-5	-498	0	0
CHD	0	0	0	-35	0	0
Rajasthan	-59	-59	341	-177	0	0
UP	1475	97	1021	-69	0	0
Uttarakhand	-188	-277	118	-180	0	0

XI. System Reliability Indices(Violation of TTC and ATC):

(i)%age of times N-1 Criteria was violated in the inter - regional corridors

WR	0.00%
ER	0.00%
Simultaneous	0.00%

(ii)%age of times ATC violated on the inter-regional corridors

WR	0.00%
ER	0.00%
Simultaneous	0.00%

(iii)%age of times Angular Difference on Important Buses was beyond permissible limits(40 deg.)

Rihand - Dadri	0.00%
----------------	-------

XII. Zero Crossing Violations

State	No. of violations(Maximum 8 in a day)	Maximum number of continuous blocks without sign change
Punjab	1	15
Haryana	0	12
Rajasthan	2	18
Delhi	4	33
UP	1	15
Uttarakhand	2	17
HP	3	33
J & K	2	16
Chandigarh	3	19

XIII.System Constraints:

XIV. Grid Disturbance / Any Other Significant Event:

XV. Weather Conditions For 17.08.2017 :

XVI. Synchronisation of new generating units :

XVII. Synchronisation of new 220 / 400 / 765 KV lines and energising of bus / substation :

- 1. 315MVA ICT-2 at 400kV GSS Chittorgarh first time charged on no-load at 1315Hrs of 17.08.17.
- 2. 50MVA ICT-2 at 400kV GSS Bhadla first time charged on no-load at 1330Hrs of 17.08.17.

XVIII. Tripping of lines in pooling stations :

XIX. Complete generation loss in a generating station :

Note: Data(regarding drawal,generation, shortage , inter-regional flows and reservoir levels)of the constituents filled in the report are as per last furnished data by the respective state/constituent to NRLDC.

Report for : 17.08.2017

पारी प्रभारी अभियंता / SHIFT CHARGE ENGINEER



पश्चिम क्षेत्रीय भार प्रेषण केंद्र, मुंबई/ Western Regional Load Despatch Centre, Mumbai

रिपोर्ट तिथि / Date of Reporting

18-08-2017

पश्चिम क्षेत्रीय बिड की दैनिक उर्जा उपलब्धता रिपोर्ट / Power Supply Position in Western Region for

17-08-2017

1. पश्चिम क्षेत्र में उर्जा उपलब्धता एवं मांग / Regional Availability / Requirement of Western Region]

समय 20:00 बजे/ 20:00 hrs			रात्री 03:00 बजे /03:00 hrs			दैनिक उर्जा / Day Energy		अंतर-क्षेत्रीय आयात-निर्यात /Inter-regional Exchange		
उपलब्धता / Demand Met (MW)	अभाव / Shortage (MW)	मांग/ Requirement (MW)	उपलब्धता / Demand Met (MW)	अभाव / Shortage (MW)	मांग/ Requirement (MW)	उपलब्धता/ Demand Met (MU)	अभाव/ Shortage (MU)	सैद्ध्युल Schedule (MU)	वास्तविक/ Actual (MU)	विवरण/ Deviation (MU)
45148	414	45562	40075	0	40075	1047	0.0	-206.6	-216.7	-10.1

2. फ्रिक्वेन्सी प्रोफाइल / Frequency Profile

तात्कालिक/ Instantaneous			फ्रिक्वेन्सी प्रसरण सूचकांक / Frequency Variation Index	प्रतिशत समय फ्रिक्वेन्सी / % of time frequency						
अधिकतम / Maximum (Hz) / Time	न्यूनतम (Hz)/ Time	औसत / Average (Hz)		f < 49.2 Hz	f < 49.7 Hz	f < 49.9 Hz	f < 50.0 Hz	49.9 < f < 50.05	f > 50.05 Hz	f ≥ 50.1 Hz
50.16	49.69	49.98	0.054	0.00	0.03	14.42	59.39	74.69	10.89	1.92
18:03	19:24									
Percentage of Time Frequency Remained outside IEGC Band						25.3%	Percentage			
Nos of hours frequency remained outside IEGC Band						6.1	Hours			

3. राज्य अथवा क्षेत्र में उर्जा उत्पादन, बिड से आयात एवं अभाव / Generation, Drawal and Shortage in State or Control Area

राज्य / क्षेत्र State/Area	शुद्ध उत्पादन/ Net Generation (MU)					बिड से शुद्ध आयात/ Net Drawal from Grid (MU)			व्यय/ Consumption (in MU)	अभाव/ Shortage* (in MU)
	तापीय/ Thermal	जलीय/ Hydro	पवन/ Wind	सौर-अन्य / Solar-Others	कुल/ Total	सैद्ध्युल Schedule	वास्तविक/ Actual	अव्यय/ अग्रिम / (Deviation)		
गुजरात / Gujarat	189.2	2.5	47.1	5.3	244.1	58.5	58.9	0.5	303.1	0.0
मध्य प्रदेश/ Madhya Pradesh	50.3	2.9	17.2	5.5	75.8	104.1	107.4	3.3	183.2	0.0
छत्तीसगढ़/ Chattisgarh	52.2	2.4	0.0	0.2	54.7	26.4	27.4	1.0	82.1	0.0
महाराष्ट्र/ Maharashtra	291.2	9.7	22.7	2.2	325.7	117.0	116.7	-0.3	442.5	0.0
गोवा/ Goa	0.0	0.0	0.0	0.0	0.0	8.8	8.7	-0.1	8.7	0.0
दमन-द्यू/ Daman & Diu	0.0	0.0	0.0	0.0	0.0	6.2	7.4	1.2	7.4	0.0
दादरा नगर हवेली/ Dadra & Nagar Haveli	0.0	0.0	0.0	0.0	0.0	16.7	17.0	0.29	17.0	0.0
एस्सर स्टील/ Essar Steel	0.0	0.0	0.0	0.0	0.0	1.2	3.2	2.0	3.2	0.0
पश्चिम क्षेत्रीय / Western Regional	582.9	17.4	87.0	13.1	700.4	338.9	346.8	7.9	1047.1	0.0

Note: Shortage as reported by respective entities

Deviation=STOA/PX: [OD/Import: +ve], [UD/Export: -ve]

4. राज्य अथवा क्षेत्र में उर्जा कुल उपलब्धता / State's Demand Met

राज्य / क्षेत्र State/Area	समय 20:00 बजे/ 20:00 hrs		रात्री 03:00 बजे /03:00 hrs		दैनिक बिड/ Day Peak			विवरण/ Deviation in 15-minute time block		
	उपलब्धता / Demand Met (MW)	अभाव / Shortage (MW)	उपलब्धता / Demand Met (MW)	अभाव / Shortage (MW)	उपलब्धता Max Demand Met / बजे Time (MW)	Time	अभाव / Shortage (MW)	औसत/ Average (MW)	अधिकतम/ Maximum (MW)	न्यूनतम/ Minimum (MW)
गुजरात / Gujarat	13093	0	11318	0	13724	24.00	0	-51	402	-905
मध्य प्रदेश/ Madhya Pradesh	8273	29	7279	0	8273	8.00	0	132	752	-1354
छत्तीसगढ़/ Chattisgarh	3604	315	3713	0	3683	19.00	0	-39	268	-257
महाराष्ट्र/ Maharashtra	18630	65	16300	0	20221	13.00	0	-55	485	-1610
गोवा/ Goa	375	1	291	0	409	11.00	0	-13	41	-110
दमन-द्यू/ Daman & Diu	306	1	286	0	326	16.00	0	21	35	-3
दादरा नगर हवेली/ Dadra & Nagar Haveli	724	3	700	0	741	15.00	0	-19	25	-184
एस्सर स्टील/ Essar Steel	143	1	189	0	230	24.00	0	6	145	-93
पश्चिम क्षेत्रीय / Western Regional	45148	414	40075	0	43447	16-08-2017 12:18:00		-511	1947	-1581

5. क्षेत्रीय इकाई उत्पादन केंद्र में उत्पादन स्थिति / Regional Entity-Generators (CGS/UMPP)

स्टेशन/ Station	संस्थापित क्षमता/ Installed Capacity	घोषित क्षमता/ ON Bar Declared Capability (Maximum)	वास्तविक उत्पादन/ Actual Generation (Ex-bus)		औसत/ Day Average	दैनिक उत्पादन / Day Generation (Ex-bus)			विवरण/ Deviation in 15-minute time block	
			शिखर समय / Peak hour(Avg 15 min)	Off-Peak hour (Avg 15 min)		सैद्ध्युल Schedule	वास्तविक/ Actual	विवरण/ Deviation	अधिकतम/ Maximum	न्यूनतम/ Minimum
कोरबा / Korba-II	2100	1800	1650	1804	1695	40.3	40.7	0.3	30	-511
कोरबा / Korba-II	500	465	462	468	460	11.2	11.0	-0.2	23	-20
विन्ध्यवास / Vindhyachal-I	1260	945	986	923	962	22.5	23.1	0.6	144	-276
विन्ध्यवास / Vindhyachal-II	1000	935	1026	828	977	22.1	23.5	1.3	124	-240
विन्ध्यवास / Vindhyachal-III	1000	943	933	821	928	22.3	22.3	0.0	82	-256
विन्ध्यवास / Vindhyachal-IV	1000	471	488	476	477	11.1	11.4	0.3	108	-145
विन्ध्यवास / Vindhyachal-V	500	628	484	474	472	11.1	11.3	0.3	124	-191
सीपत / Sipat-I	1980	1867	1893	1900	1879	44.9	45.1	0.1	50	-589
सीपत / Sipat-II	1000	943	955	948	946	22.7	22.7	0.0	28	-308
मौदा-I / Mouda-I	1000	944	865	864	799	17.2	19.2	2.0	408	-116
मौदा-II/Mouda-II	660	0	533	592	373	0.0	9.0	9.0	660	0
सानन / Sasan	3960	3000	3078	2473	2640	61.5	63.4	1.9	165	-702
मुंदरा / Mundra	4150	3728	3361	2781	3122	75.7	74.9	-0.8	56	-905
एन एस पी सी एल / NSPCL	500	455	462	454	455	10.2	10.9	0.7	183	-155
ककरापूर/Kakrapar	440	0	-2	-3	-2	0.0	0.0	0.0	-2	-3
तरापुर / Tarapur-I	320	148	140	140	140	3.6	3.4	-0.2	-7	-58
तरापुर / Tarapur-II	1080	0	0	0	0	0.0	0.0	0.0	0	0
कवास / Kawas	656	330	320	324	300	6.7	7.2	0.5	99	-87
गणेशपुर / Ganeshpur	657	426	398	344	358	8.9	8.6	-0.3	27	-112
ई-गोली /RGPL-IR	1000	540	516	464	475	12.1	11.4	-0.7	12	-190
सरदार सरोवर पीजेनट / SSP	1450	76	70	12	37	1.1	0.9	-0.2	34	-40
कुल / Total	26213	18644	18618	17086	17494	405.2	419.8	14.6		

Note: Source SCADA

6. क्षेत्रीय इकाई उत्पादन केंद्र में उत्पादन स्थिति / Regional Entity-Generators (IPP)

स्टेशन/ Station	संस्थापित क्षमता/ Installed Capacity	वास्तविक उत्पादन/ Actual Generation (Ex-bus)			दैनिक उत्पादन / Day Generation (Ex-bus)			विवरण/ Deviation in 15-minute time block	
		शिखर समय / Peak hour(Avg 15 min)	Off-Peak hour (Avg 15 min)	औसत/ Day Average	सैद्ध्युल Schedule	वास्तविक/ Actual	विवरण/ Deviation	अधिकतम/ Maximum	न्यूनतम/ Minimum
		(MW)	(MW)	(MW)	(MU)	(MU)	(MU)	(MW)	(MW)
एस्सर महान/ Essar Mahan	600	-3	-4	-3	0.0	-0.1	-0.1	-2	-5
वन्दना विद्युत / Vandana Vidyut	135	0	0	0	0.0	0.0	0.0	0	0
बालको/ Balco	1200	-68	-343	-269	-6.6	-6.5	0.1	-125	-708

जे पी नीगरी/ JP Nigrie	1320	1235	1246	1241	29.6	29.8	0.2	17	-166
लंको /Lanco	600	467	333	341	8.0	8.2	0.1	22	-98
के एस के / KSK Mahnadi	1200	536	540	538	12.9	12.9	0.0	10	-177
जिंदल/Jindal Sig-1	1000	640	600	560	13.5	13.4	-0.1	42	-56
जिंदल/Jindal Sig-2	1800	459	453	454	10.8	10.8	0.0	-125	-22
की सी पी सी / DCPP	540	11	7	7	0.3	0.2	-0.1	11	-42
कोरबा वेस्ट / Korba West	600	0	0	0	0.0	0.0	0.0	0	0
डी बी पावर/ DBPower	1200	364	339	370	9.2	8.9	-0.3	30	-146
जीएमआर वरदा / GMR WARORA	600	275	247	263	6.5	6.3	-0.2	7	-91
ACBL+ Spectrum+MCPL	620	358	362	358	8.9	8.6	-0.3	-1	-77
धारीवाल/ Dharawal	300	273	217	239	5.8	5.7	0.0	7	-90
एसकेएल / SKS	0	0	0	0	0.0	0.0	0.0	0	0
आरकेएम / RKM	720	320	320	321	7.7	7.7	0.0	5	282
रानी बिट्टूर / MB Power	1200	560	556	554	13.8	13.3	-0.5	-330	24
डीजेन/ DGEN	1200	-2	-2	-2	0.0	0.0	0.0	-2	-4
आरकेएम / RKM	630	323	320	317	7.7	7.6	-0.1	5	-113
झुबुआ/ Jhabua	600	0	0	0	0.0	0.0	0.0	0	0
टीआरएन एनजी/ TRN Energy	600	199	187	190	4.6	4.6	0.0	11	-64
जीएमआर चतलीसगढ़ GMR Chhattisgarh	1370	-3	-3	-2	0.0	-0.1	-0.1	-2	-3
शुद्ध / Total	19405	6131	5525	5634	143.3	142.2	-1.1		

Note: Source: SCADA

7. अंतर क्षेत्रीय विनिमय / Inter regional Exchange

क्षेत्र / Region		सैड्यूल/ Schedule (MU)	वास्तविक/ Actual (MU)	अधिकतम/ Maximum (MW)
उत्तरी क्षेत्र/ Northern Region	आयात / Import	5.9	8.4	765
	निर्यात / Export	161.7	153.6	8944
	शुद्ध / Net	-155.8	-145.2	
पूर्वी क्षेत्र / Eastern Region	आयात / Import	40.0	0.6	-171
	निर्यात / Export	45.1	26.0	1847
	शुद्ध / Net	-5.1	-25.4	
दक्षिणी क्षेत्र/ Southern Region	आयात / Import	2.5	4.7	464
	निर्यात / Export	48.2	50.8	2250
	शुद्ध / Net	-45.7	-46.1	
पश्चिम क्षेत्रीय / WR Region	आयात / Import	48.4	13.7	1058
	निर्यात / Export	255.0	230.4	13041
	शुद्ध / Net	-206.6	-216.7	

Note : [Import: +ve], [Export: -ve]

8. वोल्टेज प्रोफाइल / Voltage Profile- 765 kV

उपकेंद्र/ Station	अधिकतम/ Maximum (Instantaneous)		न्यूनतम/ Minimum (Instantaneous)		प्रतिशत समय विभिन्न/ % time voltage			Nos of Hours Voltage remained Outside IEGC Range(VDI)
	केवी / kV	समय/Time	केवी / kV	समय/Time	< 728 kV	IEGC Band (A)	> 800 kV	
सीपात/Sipat	769	18:05:00	760	12:19:00	0	100	0	0.0
सिचनी/Seoni	788	18:06:00	767	11:21:00	0	100	0	0.0
वर्धा/Wardha	794	20:06:00	771	11:22:00	0	100	0	0.0
बीना/Bina	789	18:03:00	759	22:08:00	0	100	0	0.0
इंदौर/Indore	783	4:41:00	758	11:20:00	0	100	0	0.0
सासन/Sasan	768	4:03:00	0	17:45:00	61	39	0	14.6
सतना/Satna	778	18:05:00	752	22:09:00	0	100	0	0.0
तमना/Tamnar	795	6:02:00	787	11:10:10	0	100	0	0.0
कोटरा/Kotra	796	4:15:00	787	11:20:00	0	100	0	0.0
वाडोदरा / Vadodara	780	18:05:00	765	22:25:00	0	100	0	0.0
दुर्ग/Durg	788	0:00:00	779	7:11:00	0	100	0	0.0

9. वोल्टेज प्रोफाइल / Voltage Profile-400 kV

उपकेंद्र/ Station	अधिकतम/ Maximum (Instantaneous)		न्यूनतम/ Minimum (Instantaneous)		प्रतिशत समय विभिन्न/ % time voltage			Nos of Hours Voltage remained Outside IEGC Range(VDI)
	केवी / kV	समय/Time	केवी / kV	समय/Time	<380 kV	IEGC Band (A)	> 420 kV	
भोपाल / Bhopal	415	4:18	402	11:19	0	100	0	0.0
खन्दा / Khandwa	421	18:04	410	11:19	0	98	2	0.6
इटहरी / Itarsi	410	4:02	399	11:10	0	100	0	0.0
दमोह / Damoh	418	21:21	409	14:48	0	100	0	0.0
नागदा / Nagda	420	4:41	407	11:11	0	100	0	0.0

रायपुर / Raipur	417	1:46	411	11:10	0	100	0	0.0
रायगढ़ / Raigarh	422.54	4:38	417	11:22	0	100	0	0.0

वर्धा / Wardha	423	19:57	415	11:05	0	52	48	11.4
धुले / Dhule	433	20:05	405	15:29	0	65	35	8.4
पार्ली / Parli	427	2:00	399	11:20	0	84	16	3.7
बोईसर / Boisar	426	3:33	392	11:10	0	74	26	6.2

असोज / Asoj	418	4:04	402	11:47	0	100	0	0.0
देहगम / Dehgam	432	4:05	0	1:43	0	27	73	17.6
कासर / Kasor	424	3:33	412	11:48	0	75	25	6.0
जैतपुर / Jetpur	416	4:02	403	23:08	0	100	0	0.0
अमरेली / Amreli	421	3:15	410	23:12	0	100	0	0.0
वापी / Vapi	428	3:33	395	11:10	0	74	26	6.2

कला/ KALA	425	3:13	392	11:05	0	80	20	4.9
मागराजड़ा / Maganwara	428	3:33	393	11:05	0	74	26	6.2
हजीरा / Hazira	424	3:23	400	11:20	0	95	5	1.2

10.अनुवर्ती अनुमति / STOA (Bilateral & PX)

CONSTITUENTS	STOA Schedule		20:00 hrs Approval		03:00 hrs Approval	
	BILATERAL	PX	BILATERAL	PX	BILATERAL	PX
	(MUS)	(MUS)	(MW)	(MW)	(MW)	(MW)
गुजरात / Gujarat	-2.5	-13.0	-44	-937	-304	-598
मध्य प्रदेश/ Madhya Pradesh	-14.3	-1.3	-664	-47	-1037	28
छत्तीसगढ़/ Chhattisgarh	9.9	0.5	308	0	455	0
महाराष्ट्र/ Maharashtra	5.5	5.1	195	-138	-161	29
गोवा/ Goa	1.0	1.7	20	122	-4	70
दमन और दीव/ Daman & Diu	0.0	0.9	0	41	0	38
दादरा नगर हवेली/ Dadra & Nagar Haveli	2.3	0.0	96	0	97	0
एस्सार स्टील/ Essar Steel	0.8	0.5	146	32	0	7

State Generators

स्टेशन/ Station	संस्थापित क्षमता/ Installed Capacity	वास्तविक उत्पादन/ Actual Generation (Ex-bus)			चिखन/ Day Peak in 15-minute time block		Day Energy (MU)
		चिखन समय / Peak hour(Avg 15 min)	ऑफ-पीक समय / Off-Peak hour (Avg 15 min)	औसत/ Day Average	अधिकतम/ Maximum	समय/ Time	
	Effective MW	(MW)	(MW)	(MW)	(MW)	hh:mm	MU
Chhattisgarh							
Bango HY	120	103	72	85	103	(16:15-16:30)	2.0
DSPM	500	465	471	424	471	(03:00-03:15)	10.2

Korba (E)	440	235	237	234	247	(01:15-01:30)	5.6
Korba(W)	1340	32	42	29	61	(09:15-09:30)	0.7
Marwa	1000	628	578	590	634	(22:30-22:45)	14.2
SOLAR	76	0	0	11	44	(12:30-12:45)	0.2
WIND	0						0.0
Gujarat							
UKAI (HYDRO)	300	1	0.176	20	78	(07:15-07:30)	0.5
KADANA HY	240	58	58	63	114	(09:45-10:00)	6.9
Vadinar	1200	7	311	81	390	(00:15-00:30)	1.9
ALTPS	250	146	146	146	146	(00:00-00:15)	3.5
GIPCL	305	0	0	0	0	(17:15-17:30)	0.0
GSEC	156.1	-3	-3	-3	-3	(14:30-14:45)	-0.1
SLPP	500	323	218	287	335	(08:30-08:45)	6.9
UNO SUGEN	361	300	241	282	356	(11:45-12:00)	6.9
ADANI	4620	3073	2434	2804	3292	(23:45-24:00)	67.3
DGBP	215	81	2	47	82	(12:15-12:30)	1.1
GTPS	870	321	163	303	421	(23:45-24:00)	7.3
KLTPS	290	181	54	133	196	(23:30-23:45)	3.2
STPS	740	187	51	152	192	(12:45-13:00)	3.7
UKAI (TH)	1350	322	158	297	408	(23:45-24:00)	7.1
WTPS	1470	0	0	0	0	(00:00-00:15)	0.0
SUGN TOTAL	1147.5	1031	563	757	1032	(20:15-20:30)	18.2
UTRAN-2	375	1	1	1	1	(00:15-00:30)	0.0
SOLAR	1262	2	1	202	668	(13:00-13:15)	5.3
WIND	5405	2501	1682	1877	2887	(17:45-18:00)	47.1
Madhya Pradesh							
BARGI HYDRO	90	1	1	1	0	(02:45-03:00)	0.0
SILPARA HY	30	0	0	0	0	(05:45-06:00)	0.0
GANDHI SAGAR HY	125	1	1	1	1	(00:15-00:30)	0.0
TONS HY	315	300	0	106	313	(19:00-19:15)	2.5
ISP HY	1000	330	0	24	330	(19:45-20:00)	0.6
OMKARESWAR HY	520	116	0	11	116	(20:45-21:00)	0.3
RAJGHAT HY	45	0	0	0	0	(00:00-00:15)	0.0
AMARKANTAK	450	212	211	208	217	(11:15-11:30)	5.0
SATPURA (SARNI)	1330	357	533	430	538	(07:30-07:45)	10.3
SGTPS (SANJAY GANDHI)	1340	951	766	811	1014	(22:45-23:00)	19.5
JP BINA	500	226	161	173	228	(20:45-21:00)	4.2
SINGHA JI	1200	527	522	532	532	(22:00-22:15)	12.5
SOLAR	976	0	1	223	725	(12:15-12:30)	5.5
WIND	2428	749	990	798	1103	(23:30-23:45)	17.2
Maharashtra							
KOYNA 1&2 HY	600	40	40	64	530	(11:30-11:45)	1.5
KOYNA 3 HY	320	157	0	39	160	(20:15-20:30)	0.9
KOYNA-4 HY	1000	-3	-5	28	247	(12:45-13:00)	0.7
GHATGARH HY	250	0	0	0	0	(00:00-00:15)	0.0
BHIRA PSS HY	150	164	0	96	164	(14:00-14:15)	2.3
TATA BHIRA HY	150	151	2	78	153	(11:30-11:45)	1.9
TATA KHOPOLI HY	72	24	0	14	24	(12:30-12:45)	0.3
BHIVPURI HY	75	58	0	3	69	(20:00-20:15)	0.1
DHARIWAL	300	146	146	146	146	(00:15-00:30)	3.5
IB AMRAVATI	1350	995	697	805	995	(19:45-20:00)	19.3
IEPL BELA	270	0	0	0	0	(00:00-00:15)	0.0
BHUSAWAL	1420	172	693	594	858	(12:00-12:15)	14.3
CHANDRAPUR	2340	2453	2056	2350	2520	(07:45-08:00)	56.4
DHANU	500	476	355	385	480	(15:15-15:30)	9.2
KHAPARKHEDA	1340	832	743	799	980	(22:00-22:15)	19.2
KORADI	1950	1001	885	968	1101	(21:15-21:30)	23.2
NASIK	630	187	150	158	191	(20:15-20:30)	3.8
PARAS	500	424	358	408	453	(15:45-16:00)	9.8
PARLI	1130	426	84	263	454	(23:30-23:45)	6.3
TOMBAY	1580	815	685	702	856	(14:45-15:00)	16.8
JAIGAD (JSW)	1200	569	458	536	570	(20:15-20:30)	12.9
URAN	675	332	414	376	421	(05:00-05:15)	9.0
APML TIRODA	3300	1748	1311	1461	1756	(19:30-19:45)	35.1
SOLAR	383	-1	0	41	140	(11:15-11:30)	2.2
WIND	4769	737	561	592	1679	(01:45-02:00)	22.7

11. No of Zero crossing of UI of States

State	CHATTISGARH	DD	DNH	GOA	GUJARAT	MADHYAPRADSH	MAHARASHTRA
* No of Zero Crossing of UI	17	73	72	74	75	80	73

* Calculated based on 15-minute average sample data from SCADA.

POWER SYSTEM OPERATION CORPORATION LIMITED.



SOUTHERN REGIONAL LOAD DESPATCH CENTRE

DAILY OPERATION REPORT

POWER SUPPLY POSITION IN SOUTHERN REGION FOR 17-AUG-2017

DATE OF REPORTING : 18-AUG-2017 AT 06:00HRS

1. REGIONAL AVAILABILITY

EVENING PEAK (19:00HRS)			NIGHT OFF-PEAK (03:00HRS)*			DAY ENERGY (MU)	
AVAILABILITY (MW)*	SHORTAGE (MW)#	FREQUENCY (Hz)	AVAILABILITY (MW)*	SHORTAGE (MW)#	FREQUENCY (Hz)	MET	SHORTAGE #
38060	26	49.98	31771	--	50.01	852.29	2.10

* MW Availability indicated above includes SR ISTS Loss.

#Shortage is calculated at 50 Hz which is the sum of Load Shedding and Frequency Correction at 50 Hz.

2 A. STATE DEMAND (ENERGY - MU)

STATE	THERMAL	HYDRO	GAS/NAPTH A/ DIESEL	WIND	SOLAR	OTHERS	NET SCH (FROM GRID)	DRAWAL (FROM GRID)	AVAILABILITY	DEMAND MET	SHORTAGE #
AP	67.67	6.13	8.84	24.16	5.60	1.94	37.41	39.21	151.75	153.55	0.40
TELANGANA	78.16	0.00	0.00	0.31	6.12	5.76	89.99	86.59	180.34	176.94	0.43
KAR	43.16	16.36	0.00	19.67	3.35	7.04	83.27	85.08	172.85	174.66	0.47
KERALA	0.00	16.92	0.00	0.44	0.16	0.14	47.45	49.78	65.11	67.44	0.17
TN	72.35	4.20	8.17	77.70	6.12	20.49	84.01	83.75	273.04	272.78	0.61
PONDY	0.00	0.00	0.00	0.00	0.00	0.00	7.21	6.92	7.21	6.92	0.02
TOTAL	261.34	43.61	17.01	122.28	21.35	35.37	349.34	351.33	850.30	852.29	2.10

The accuracy of shortage computation depends on timely load shedding details furnished in the web directly by constituents

2 B. STATE DEMAND (MW) & ENERGY FORECAST (MU)

STATE	19:00 HRS PEAK		03:00 HRS OFF-PEAK		DAY PEAK			DAY ENERGY (MU)	
	DEMAND MET	SHORTAGE #	DEMAND MET	SHORTAGE #	DEMAND MET	TIME	SHORTAGE#	FORECAST	DEVIATION FROM FORECAST (ACTUAL + LS - FORECAST)
AP	6619	5	6097	0	6688	12:00:00		155.00	-1.45
TELANGANA	7433	6	6661	0	8358	13:00:00		175.00	1.94
KAR	7949	6	6347	0	8274	11:00	7	170.00	4.66
KER	3414	3	2283	0	3450	19:00	17	65.81	1.63
TN	11961	10	9799	0	12531	20:00	5	280.53	-7.75
PONDY	334	0	234	0	338	19:00	1	7.40	-0.48
SR ISTS LOSS	350	--	350	--	--	--	--	--	--
SR	38060	26	31771		38359	19:28	26	853.74	-1.45

3. GENERATION :

STATION	INSTALLED CAPACITY(MW)	19:00HRS PEAK MW	03:00HRS OFF-PEAK MW	DAY PEAK		DAY ENERGY (MU)	AVG MW
				MW	HRS		
ANDHRA PRADESH							
Vijayawada TPS (6x210+1x500)	1760	1199	1024	1208	07:11	26.85	1119
Rayalaseema TPS (5x210)	1050	911	713	948	17:53	17.69	737
Krishnapatnam TPP (2*800)	1600	651	542	663	19:34	12.48	520
Hinduja (1*520)	1040	535	617	652	03:50	10.65	444
Total Thermal	5450	3296	2896	--	--	67.67	2820
Srisaillam RB (7x110)	770	--	--	--	--	--	--
Lower Sileru (4x115)	460	171	--	401	16:57	3.54	147
Upper Sileru (4x60)	240	143	6	148	20:30	1.27	53
Other Hydro	278	57	45	--	--	1.32	55
Total Hydro	1748	371	51	--	--	6.13	255
Vijjeswaram Gas (2x33+1x34+1x112.5+1x59.5)	272	186	187	187	03:00	4.58	191
Reliance Energy Ltd.(1x140+1x80)	220	--	--	--	--	--	--
Jegrupadu (2x45.8+1x48.9+1x75.5)	216	175	144	187	23:24	4.26	178
Spectrum (1x46.8+2x46.1+1x68.88)	208	--	--	--	--	--	--
LANCO (2*115+1*125)	351	--	--	--	--	--	--
Vemegiri 1x233+1x137)	370	--	--	--	--	--	--
Jegrupadu Ext.	220	--	--	--	--	--	--
Konaseema (1x145+1x140+1x165)	450	--	--	--	--	--	--
Gauthami (2x145+1x174)	464	--	--	--	--	--	--
GMR(BRG) (1x237)	237	--	--	--	--	--	--
Other Gas/Naptha/Diesel	27	--	--	--	--	--	--
Total Gas/Naptha/Diesel	3035	361	331	--	--	8.84	369
Wind	2013	210	1320	1320	03:00	24.16	1007
Solar	980	--	--	--	--	5.60	234
Others	424	149	125	149	19:00	1.94	81
Total AP	13650	4387	4723	--	--	114.34	4766

STATION	INSTALLED CAPACITY(MW)	19:00HRS PEAK MW	03:00HRS OFF-PEAK MW	DAY PEAK		DAY ENERGY (MU)	AVG MW
				MW	HRS		
TELANGANA							
Kothagundam TPS (4x60+4x120+2x250+1x500)	1720	1192	1100	1274	12:36	29.99	1250
Kaktiya TPS (1x500+1x600)	1100	1025	1040	1066	18:07	20.75	865
Ramagundan B (1x62.5)	63	--	--	--	--	--	--
Singareni (2x600)	1200	1202	1220	1254	11:42	27.42	1143
Total Thermal	4083	3419	3360	--	--	78.16	3258
N'Sagar (1x110+7x100.8)	816	--	--	--	--	--	--
Srisailem LB (Gen) (6x150)	900	--	--	--	--	--	--
Srisailem LB (Pump)	900	--	--	--	--	--	--
Other Hydro	636	--	--	--	--	--	--
Total Hydro	2352	--	--	--	--	--	--
Wind	100	--	--	--	--	0.31	13
Solar	1322	--	--	--	--	6.12	255
Others	211	191	75	191	19:00	5.76	240
Total TG	8068	3610	3435	--	--	90.35	3766
KARNATAKA							
Raichur TPS (7x210+1x250)	1720	1361	1346	1397	14:20	33.04	1377
Bellary TPS (2x500+1x700)	1700	325	414	549	15:05	9.14	381
UPCL(IPP) (2x600)	1200	--	--	--	--	--	--
Jindal (2x130+4x300)	1460	270	32	270	19:00	0.98	41
YTPS (1x800)	800	--	--	--	--	--	--
Total Thermal	6880	1956	1792	--	--	43.16	1799
Sharavathi (10x103.5)	1035	517	147	704	19:43	5.47	228
Nagjheri (1x135+5x150)	885	597	120	678	19:46	3.65	152
Varahi (4x115)	460	227	23	232	20:15	2.91	121
Other Hydro	1992	828	231	--	--	4.33	180
Total Hydro	4372	2169	521	--	--	16.36	681
Yelehanka Diesel (6x21.32)	128	--	--	--	--	--	--
Other Gas/Naptha/Diesel	118	--	--	--	--	--	--
Total Gas/Naptha/Diesel	246	--	--	--	--	--	--
Wind	3245	1332	640	1404	19:42	19.67	819
Solar	342	--	--	--	--	3.35	139
Others	1041	74	74	74	19:00	7.04	293
Total KAR	16126	5531	3027	--	--	89.58	3731
KERALA							
Iddukki (6x130)	780	151	65	376	06:42	2.81	117
Sabarigiri (1x60+4x55))	280	105	24	230	19:21	2.90	121
Lower Periyar (3x60)	180	168	95	170	18:50	2.17	90
Other Hydro	751	415	224	--	--	9.04	377
Total Hydro	1991	839	408	--	--	16.92	705
Kayamkulam (2x116.6+1x126.38)	360	--	--	--	--	--	--
Reliance Energy (3x40.5+1x35.5)	157	--	--	--	--	--	--
Brahmapuram DPP (5x21.32))	107	--	--	--	--	--	--
Kozhikode DPP (8x16)	128	--	--	--	--	--	--
Other Gas/Naptha/Diesel	22	--	--	--	--	--	--
Total Gas/Naptha/Diesel	774	--	--	--	--	--	--
Wind	35	--	--	--	--	0.44	18
Solar	13	--	--	--	--	0.16	7
Others	20	--	--	--	--	0.14	6
Total KER	2833	839	408	--	--	17.66	736

TAMILNADU							
Ennore TPS (2x60+3x110)	450	--	--	--	--	--	--
North Chennai TPS (3x210)	630	193	193	193	01:58	11.70	488
Tutucorin TPS (5x210)	1050	626	626	626	01:52	9.66	403
Mettur TPS (4x210+1x600)	1440	1110	1110	1110	01:52	28.15	1173
Neyveli-I (IPP) (6x50+3x100)	600	348	405	423	09:21	7.84	327
ST-CMS (1x250)	250	149	149	149	01:52	4.08	170
NCTPS STAGE-II (2x600)	1200	423	457	542	08:21	10.92	455
Other Thermal	--	--	--	--	--	--	--
Total TN Thermal	5620	2849	2940	--	--	72.35	3016
Kadamparai (G) (4x100)	400	--	219	219	03:00	0.08	3
Kadamparai (P)	400	--	--	--	--	4.24	176
Other Hydro	1824	235	131	--	--	4.12	172
Total TN Hydro	2224	235	350	--	--	4.20	175
Basin Bridge (4x30)	120	--	--	--	--	--	--
Kovilkalappal (1x70+1x37.88)	108	37	36	41	14:33	0.92	38
Kuttalam (1x64+1x37)	101	52	52	52	00:22	1.08	45
Valattur(Stg 1&2) (2x60+1x35+1x32)	187	89	15	90	23:26	3.73	155
Samalpatty (7x15.1)	106	--	--	--	--	--	--
P P Nallur (1x330.5)	331	--	--	--	--	--	--
Madurai Power CL (1x106)	106	--	--	--	--	--	--
GMR Vasavi (4x49)	196	--	--	--	--	--	--
Other Gas/Naptha/Diesel	166	770	770	770	19:00	2.44	102
Total Gas/Naptha/Diesel	1421	948	873	--	--	8.17	340
Wind	7598	3862	2896	4174	17:54	77.70	3237
Solar	1590	--	--	--	--	6.12	255
Others	806	56	68	68	03:00	20.49	854
Total TN	19259	7950	7127	--	--	189.03	7877
STATION	INSTALLED CAPACITY(MW)	19:00HRS PEAK MW	03:00HRS OFF-PEAK MW	DAY PEAK		DAY ENERGY (MU)	AVG MW
				MW	HRS		
CENTRAL SECTOR (ISGS)							
Ramagundam,NTPC (3x200+4x500)	2600	2345	2295	2458	21:41	57.26	2386
Neyveli TPS II (7x210)	1470	1041	777	1081	12:14	23.28	970
Neyveli TPS I (EXP) (2x210)	420	358	358	358	00:00	8.56	357
Madras APS (2x220)	440	344	374	393	13:03	8.78	366
Kaiga STGI (2x220)	440	376	374	385	09:48	9.63	401
Kaiga STG II (2x220)	440	414	414	414	19:00	9.92	413
Neyveli TPS II (EXP) (2x250)	500	--	--	--	--	--	--
Talcher II, NTPC (4x500)	2000	1398	1394	1427	16:44	33.92	1413
Simhadri II, NTPC (2x500)	1000	954	524	966	19:33	18.51	771
Kudankulam (2x1000)	2000	--	--	--	--	--	--
NTPC Kudgi (2x800)	1600	--	--	--	--	10.04	418
Simhadri I, NTPC (2x500)	1000	914	914	914	00:00	15.40	642
Total ISGS	13910	8144	7424	--	--	195.30	8137
JOINT VENTURE							
Vallur (3x500)	1500	959	959	959	00:00	15.85	660
NTPL (2x500)	1000	924	519	955	20:07	16.56	690
Total JV	2500	1883	1478	--	--	32.41	1350
IPP UNDER OPEN ACCESS							
LKPPL STG2 (1x233+1x133)	366	--	--	--	--	--	--
LKPPL STG3 (1x241.3+1x126.7)	732	--	--	--	--	--	--
SIMHAPURI (2x150)	600	--	--	--	--	--	--
MEENAKSHI (2x150)	300	244	198	274	17:32	5.39	225
COSTAL ENERGEN (2x600)	1200	304	304	304	19:00	7.58	316
TPCIL (2x660)	1320	1273	1140	1290	00:42	29.53	1231
IL&FS (2x600)	1200	--	--	--	--	--	--
SGPL (2x660)	1320	650	361	662	15:03	24.49	1020
Total IPP	7038	2471	2003	--	--	66.99	2792

Total State Thermal	29071	13991	12991	--	--	328.33	13685
Total ISGS Thermal	13090	8893	7740	--	--	199.38	8307
Total Thermal	42161	22884	20731	--	--	527.71	21992
Total Hydro	12687	3614	1330	--	--	43.61	1816
*Total Gas/Naptha/Diesel	5476	1309	1204	--	--	17.01	709
Total Nuclear	3320	1134	1162	--	--	28.33	1180
Total Wind	12991	5404	4856	--	--	122.28	5094
Total Solar	4247	--	--	--	--	21.35	890
Total Others	2502	470	342	--	--	35.37	1474
Inter-regional (Except Talcher II)	--	631	542	--	--	94.96	3957
Grand Total	83384	35446	30167	--	--	852.29	35512

* Total Gas/ naptha/Diesel includes pondy Karaikal Power Plant of 32.5 MW

4 A. INTER-REGIONAL EXCHANGES & HVDC - PHYSICAL FLOWS [IMPORT(+)/EXPORT(-)]

ELEMENT	19:00 HRS PEAK MW	03:00 HRS OFF-PEAK MW	MAX INTER-CHANGE (MW)				ENERGY (MU)
			IMPORT	TIME	EXPORT	TIME	
Bhadrawati B2B	485	391	--	--	--	--	13.020
Gazuwaka B2B	552	553	581	17:21	--	--	12.814
Talcher-Kolar	992	992	1802	07:40	--	--	27.796
Talcher Stage II I/C	-406	-403	--	--	--	--	-6.120
Raichur-Solapur I & II	795	758	1595	05:31	--	--	16.621
Upper Sileru-Balimela	--	--	--	--	--	--	0.000
CHIKODI-KOHLAPUR	0	0	--	--	--	--	0.000
KUDUGI-KOHLAPUR	478	78	522	19:46	--	--	-4.440
SRIKAKULAM-ANGUL	269	376	--	--	--	--	10.370
NIZAMABAD-WARDHA	792	756	102	19:00	--	--	21.175

4 B. INTER-REGIONAL EXCHANGES - SCHEDULES, WHEELING, UI & TALCHER AC I/C

ISGS Schedule		Bilaterals of SR constituents		Power Exchange		Wheeling through SR		Diversion of SR power		IR Schedule		Net UI		Inter-Regional	
Talcher Stage II to SR	ER ISGS	Through ER	Through WR	Through ER	Through WR	ER to SR	WR to SR	Through ER	Through WR	ER to SR	WR to SR	ER to SR	WR to SR	Schedule (Total)	Flow (Total)
30.435	0.861	-1.245	-2.128	23.259	0.000	0.000	0.000	0.000	0.000	23.719	45.690	-6.655	0.686	69.408	63.440

5. FREQUENCY PROFILE

% OF TIME										
RANGE	<48.8 Hz	<49.0 Hz	<49.2 Hz	<49.5 Hz	<49.7 Hz	<49.9 Hz	49.9 Hz To 50.05 Hz	>50 Hz	>50.05 Hz	
%	0.0	0.0	0.0	0.0	0.0	14.4	74.7	40.6	10.9	

Instantenous Maximum		Instantenous Minimum		Block Maximum		Block Minimum		Day Avg	Frequency Variation Index	Std. Var.
Hz	TIME	Hz	TIME	Hz	TIME	Hz	TIME	Hz		
50.16	18:03:10	49.69	19:24:30	50.07	12:15	49.75	19:30	49.98	0.054	0.069

6. SHORT TERM OPEN ACCESS TRANSACTION

WHEELING			BILATERAL			
NAME OF THE TRANSACTION	ER END	WR END	NAME OF THE TRANSACTION	MU	PEAK (MW)	OFF-PEAK (MW)
			APPCC-BSPHCL(MANIKARAN)(154.5MW)(SR-ER)	3.708	154.500	154.500
			APPCC-TATADELHI(GMRETL)(49MW)(SR-WR)	0.931	49.000	49.000
			APPCC-PSEB(NVVN)(50MW)(SR-ER)	0.950	50.000	50.000
			APPCC-PSEB(ARPPCPL)(34.33MW)(SR-ER)	0.610	34.330	34.330
			APPCC-TATADELHI(GMRETL)(80MW)(SR-ER)	1.120	80.000	80.000
			APPCC-GOAWR(NVVN)(60MW)(SR-WR)	1.280	60.000	60.000
			ITCWIND-ITCLTDI3L(ITCLTDWIND)(2.74MW)(SR-SR)	0.049	2.740	2.740
			BMMCEMENT-SAGARCEM(SAGARCEMNT)(13.5MW)(SR-SR)	0.268	13.500	13.500
			ITCWIND-ITCPSPD(ITCLTDWIND)(8MW)(SR-SR)	0.192	8.000	8.000
			ITCWIND-ITCLTDBIAL(ITCLTDWIND)(2.74MW)(SR-SR)	0.055	2.740	2.740
			APTRANSCO TOTAL EXPORT	9.163		
			SITAPURPOW-ZUARICEMEN(SITAPURLTD)(15.85MW)(SR-SR)	0.380	15.850	15.850
			PENNACEM-PENNABOYYA(PENNACPP)(10MW)(SR-SR)	0.180	10.000	10.000
			PENNACEM-PENNATALAR(PENNACPP)(5.5MW)(SR-SR)	0.132	5.500	5.500
			MYHOMEIND-JAYAJOTHI(MYHOME)(12MW)(SR-SR)	0.288	12.000	12.000
			SGPLNLR-APPCC(GMRETL)(350.21MW)(SR-SR)	8.104	350.210	350.210
			DALCEMTN-DALCEMAP(MANIKARAN)(8.3MW)(SR-SR)	0.154	8.300	8.300
			APTRANSCO TOTAL IMPORT	9.238		
			SITAPURPOW-ZUARICEMEN(SITAPURLTD)(15.85MW)(SR-SR)	0.380	15.850	15.850
			PENNACEM-PENNABOYYA(PENNACPP)(10MW)(SR-SR)	0.180	10.000	10.000
			PENNACEM-PENNATALAR(PENNACPP)(5.5MW)(SR-SR)	0.132	5.500	5.500
			MYHOMEIND-JAYAJOTHI(MYHOME)(12MW)(SR-SR)	0.288	12.000	12.000
			MYHOMEIND-MYHOMETGU(MYHOME)(5.4MW)(SR-SR)	0.056	5.400	5.400
			TGTRANSCO TOTAL EXPORT	1.036		
			MEENAKSHI-TSSPDCL(IEIX)(44MW)(SR-SR)	0.044	44.000	44.000
			SGPLNLR-TSSPDCL(IEIX)(300MW)(SR-SR)	0.300	300.000	300.000
			APNRL-U#1&2-TGPCC(PTC)(10.7MW)(ER-SR)	0.107	10.700	10.700
			Dikchu-TGPCC(PTC)(0MW)(ER-SR)	0.000	0.000	0.000
			JNSTPP-TGPCC(PTC)(13.69MW)(ER-SR)	0.137	13.690	13.690
			APNRL-U#1&2-TGPCC(PTC)(28.36MW)(ER-SR)	0.284	28.360	28.360
			JNSTPP-TGPCC(PTC)(36.31MW)(ER-SR)	0.363	36.310	36.310
			Dikchu-TGPCC(PTC)(0MW)(ER-SR)	0.000	0.000	0.000
			KARCHWANG-TGPCC(ISWPTC)(225MW)(ER-SR)	2.250	225.000	225.000
			JNSTPP-TGPCC(PTC)(50MW)(ER-SR)	0.200	50.000	50.000
			TUL3-TGPCC(PTC)(0MW)(ER-SR)	0.000	0.000	0.000
			HP-Govt-TGPCC(PTC)(25MW)(ER-SR)	0.100	25.000	25.000
			SUGEN_GUVNL-TELANGANA(SUGEN)(202MW)(ER-SR)	0.808	202.000	202.000
			DVC-TSSPDCL(IEIX)(142MW)(ER-SR)	0.326	142.000	142.000
			BMMCEMENT-SAGARCEM(SAGARCEMNT)(13.5MW)(SR-SR)	0.268	13.500	13.500
			ITCWIND-ITCPSPD(ITCLTDWIND)(8MW)(SR-SR)	0.192	8.000	8.000
			SGPLNLR-TSSPDCL(SGPLNLR)(440.72MW)(SR-SR)	4.407	440.720	440.720
			SGPLNLR-TSSPDCL(SGPLNLR)(288.75MW)(SR-SR)	0.866	288.750	0.000
			MEENAKSHI-TSSPDCL(IEIX)(220MW)(SR-SR)	5.280	220.000	220.000
			TGTRANSCO TOTAL IMPORT	15.932		
			KPTCL TOTAL EXPORT	0.000		
			ITCWIND-ITCLTDI3L(ITCLTDWIND)(2.74MW)(SR-SR)	0.049	2.740	2.740
			ITCWIND-ITCLTDBIAL(ITCLTDWIND)(2.74MW)(SR-SR)	0.055	2.740	2.740
			KPTCL TOTAL IMPORT	0.104		
			KSEB TOTAL EXPORT	0.000		
			CHUZHACHEN-KSEB(ARPPCPL)(90MW)(ER-SR)	1.694	90.000	90.000
			KSEB TOTAL IMPORT	1.694		
			TNEB-WBSEDCL(IEIX)(200MW)(SR-ER)	0.200	200.000	0.000
			TNEB-MPPMCL(IEIX)(100MW)(SR-WR)	0.100	100.000	0.000
			DALCEMTN-DALCEMAP(MANIKARAN)(8.3MW)(SR-SR)	0.154	8.300	8.300
			TNEB TOTAL EXPORT	0.454		
			NSPCL-SAILSLM(SAILSSP)(13.5MW)(ER-SR)	0.324	13.500	13.500
			APLMUNDRA1-TNEB(ADANI)(21.19MW)(WR-SR)	0.403	21.190	21.190
			MYHOMEIND-MYHOMETGU(MYHOME)(5.4MW)(SR-SR)	0.056	5.400	5.400
			SGPLNLR-TANGEDCO(GMRETL)(351.56MW)(SR-SR)	8.437	351.560	351.560
			THERMPOWER-TANGEDCO(GMRETL)(67.7MW)(SR-SR)	1.625	67.700	67.700
			TNEB TOTAL IMPORT	10.845		
			GOA TOTAL EXPORT	0.000		
			GOA TOTAL IMPORT	0.000		
			LKPPL TOTAL EXPORT	0.000		

7. VOLTAGE LEVEL AT CRITICAL SUB STATION

SUBSTATION	% OF TIME (Minute Wise)				400 KV (Hourly)				220 KV / 230 KV (Hourly)			
	<380 KV	<390 KV	>420 KV	>430 KV	MAXIMUM		MINIMUM		MAXIMUM		MINIMUM	
					KV	TIME	KV	TIME	KV	TIME	KV	TIME
HYDERABAD	0.00	0.00	5.00	0.00	421	0201	402	1042	236	0144	224	0144
GOOTY	0.00	0.00	35.21	0.00	427	0202	408	0938	238	0300	228	0940
VIJAYWADA	0.00	0.00	23.47	0.00	424	0300	407	1239	235	0200	228	1845
KOLAR	0.00	0.00	9.10	0.00	423	0201	394	0923	231	0201	214	0938
BANGALORE	0.00	8.96	0.00	0.00	418	0201	387	0938	225	1136	218	1136
HIRIYUR	0.00	0.00	23.19	0.00	425	0202	405	1103	235	2158	222	1019
CHENNAI	0.00	0.00	10.63	0.00	422	0300	406	1106	228	0359	218	0940
TRICHY	0.21	0.21	0.00	0.00	419	0202	391	1910	210	0158	210	0158
TRIVENDRAM	0.00	0.00	0.00	0.00	421	0402	391	1656	232	0359	215	1551
KAIGA	0.00	0.00	0.00	0.00	420	1802	402	1102	220	0157	220	0157
KUDANKULAM	0.00	0.00	0.00	0.00	419	2354	399	1914	236	2353	223	1914

8. MAJOR RESERVOIR PARTICULARS

RESERVOIR	DESIGNED			PRESENT		LAST YEAR		LAST DAY		MONTH	
	MDDL (Mts)	FRL (Mts)	Energy (MU)	Level (Mts)	Energy (MU)	Level (Mts)	Energy (MU)	Inflow (Mus)	Usage (Mus)	Prog. Inflow (Mus)	Prog. Usage (Mus)
JALAPUT	818.39	838.40	534	830.96	256	834.21	361	3.74	2.80	27.07	26.79
SRISAILAM	243.84	270.70	1392	237.59	0	266.70	740	0.00	0.00	0.00	0.00
N.SAGAR	149.30	179.90	1398	152.49	0	156.82	43	0.00	0.00	2.28	0.00
LINGANAMAKKI	522.73	554.50	4557	544.10	1910	545.68	2218	12.05	6.65	347.59	120.60
SUPA	495.00	564.00	3159	544.10	1591	542.51	1495	3.79	3.80	125.22	120.41
IDUKKI	694.94	732.43	2148	710.25	664	715.78	975	5.71	2.51	200.56	48.03
KAKKI	908.30	981.45	916	954.39	268	969.27	531	0.65	1.37	105.04	31.02
NILAGIRIS	--	--	1504	--	571	--	679	4.21	1.46	75.93	32.84
TOTAL	--	--	15608	--	5260	--	7042	30.15	18.59	883.69	379.69

Note: The Reservoirs data are of previous day and Cumulative figures for the month is upto previous day

9. DETAILS OF OVER DRAWAL OVER A DAY WHEN FREQUENCY < 49.9 HZ

CONSTITUENTS	AP	TG	KARNATAKA	KERALA	TAMILNADU	PONDY
AVERAGE MW (F<49.9)	208.24	81.80	150.57	83.13	206.22	12.34
OD MU'S (F<49.9)	0.26	0.18	0.19	0.27	0.21	0.04
OD NO OF BLOCK(F<49.9)	5	9	5	13	4	12

GENERATOR	NLCII	NLCEXPI	RSTP	SEPL	LANCO	MEPL
AVERAGE MW (F<49.9)	0.00	0.00	0.00	0.00	0.00	0.00
Under Injection MU'S (F<49.9)	0.00	0.00	0.00	0.00	0.00	0.00
Under Injection NO OF BLOCK(F<49.9)	0	0	0	0	0	0

10. SIGNIFICANT EVENTS (IF ANY) :

11. SYSTEM CONSTRAINTS (IF ANY) :

12. WEATHER CONDITIONS:

पावर सिस्टम ऑपरेशन निगम लिमिटेड
पूर्वी क्षेत्रीय भार प्रेषण केंद्र



DAILY OPERATION REPORT OF EASTERN REGION

Power Supply Position For

17-Aug-17

Date of Reporting:

18-Aug-17

1. Regional Availability/Demand:

Evening Peak (19:00 Hrs) MW				Off Peak (14:00 Hrs) MW				Day Energy(Net MU)	
Demand Met	Shortage(-)/Surplus(+)	Requirement	Freq (Hz)	Demand Met	Shortage/Surplus	Requirement	Freq (Hz)	Demand Met	Shortage
19531	-17	19548	49.85	15486	0	15486	49.97	384	-0.05

2. A.State's Load Deals (At State Periphery) in MUs:

State	State's Control Area Generation (Net MU)					Drawal Schd.	Actual Drawal	UI	Availability	Requirement	Consumption	Shortage
	Thermal	Hydro	Others / Renewable	Total	Units under reserve S/D	(Net MU)	(Net MU)	(Net MU)	(Net MU)	(Net MU)	(Net MU)	(Net MU)
Bihar	3.38	0.00	0.00	3.38	0.00	67.59	68.77	1.18	78.89	70.97	72.15	0.00
DVC	88.20	3.02	0.00	91.22	0.00	-27.73	-28.04	-0.30	63.78	63.48	63.18	0.00
Jharkhand	4.22	2.57	0.92	7.71	0.00	15.83	14.72	-1.11	23.78	23.54	22.42	0.00
Odisha	17.77	19.87	17.44	55.09	0.00	26.06	24.50	-1.56	78.53	81.15	79.59	0.00
West Bengal	72.71	3.93	15.12	91.76	0.00	50.43	53.59	3.16	144.05	142.19	145.35	-0.05
Sikkim	0.00	0.00	0.00	0.00	0.00	2.03	1.11	-0.93	2.36	2.03	1.11	0.00
Region	186.28	29.39	33.48	249.15	0.00	134.21	134.64	0.43	391.40	383.36	383.80	-0.05

2. B.State's Demand Met in MWs:

State	Evening Peak (19:00 hrs) MW		Off Peak (14:00 hrs) MW		Day peak			Day Energy(Net MU)	
	Demand Met	Shortage(-)/Surplus(+)	Demand Met	Shortage(-)/Surplus(+)	Demand Peak	Time	Shortage(-)/Surplus(+)	ForeCast (LGBR)	Deviation[For ecast(LGBR)-Consumption]
Bihar	3653	0	2783	0	3979	19:47	0	75.00	2.86
DVC	2604	0	2264	0	2781	20:36	0	54.47	-8.71
Jharkhand	1058	0	800	0	1238	18:59	0	25.67	3.24
Odisha	3941	0	2991	0	4107	19:55	0	85.57	5.98
West Bengal	8191	-17	6609	0	8191	18:00	0	158.20	12.85
Sikkim	84	0	39	0	97	18:55	0	1.10	-0.01
Region	19531	-17	15486	0	19972	19:57	0	400.00	16

3.A. Regional Entities Generations:

Station/ Constituents	Inst.Capacity (MW)	19:00 Hrs Peak MW	14:00 Hrs Off Peak MW	Day Peak		Day Energy		AVG. MW
	(MW)	Peak MW	Off Peak MW	MW	Hrs	SCHD (MU)	ACT (MU)	
NTPC	Farakka STPS - I & II(3*200+2*500)	1600	801	757	958	06:14	18.33	749
	Farakka STPS - III(500)	500	344	272	389	21:50	8.49	299
	Kahalgaon STPS - II(4*210)	840	723	674	780	00:22	17.33	705
	Kahalgaon STPS - III(3*500)	1500	1381	1288	1454	23:33	32.59	1342
	Barh STPS - I & II (2*660)	1320	1194	1082	1235	01:10	27.48	1105
	Nabinagar (1*250)	250	152	151	174	13:00	3.29	150
	Talcher STPS - II(2*500)	1000	916	919	948	23:05	22.60	939
	Talcher STPS - III(4*500)	2000	1401	1407	1430	16:44	33.72	1405
Sub Total Thermal		7010	5510	5143		130.11	126.95	
NHPC	Teesta(3*170)	510	518	515	519	17:39	12.13	516
	Rangit(3*20)	60	59	59	59	12:15	1.39	59
	Sub Total Hydro	570	577	574		13.52	13.80	
BHUTAN	Kurichu(4*15)	60	22	22	22	00:00	1.44	77
	Tala(6*170)	1020	1030	1067	1085	07:34	25.39	1052
	Chukha(4*84)	336	303	296	332	14:37	6.98	318
	Dagachu(2*63)	126					7.64	0
	Sub Total Hydro	1542	1355	1385		33.82	34.75	1448
IPP	MPL(2*525)	1050	1007	1004	1027	00:03	22.95	1013
	APNRL(270*2)	540	245	250	410	21:37	6.03	281
	GMR(3*350)	1050	332	332	339	19:48	7.65	313
	JITPL(2*600)	1200	426	330	505	19:50	8.61	327
	Sub Total IPP Thermal	3840	1252	1254		45.23	46.42	1934
	Chuzachen HEP(2*55)	110	104	104	105	00:00	2.37	103
	Teesta - III (6*200)	1200	0	0	0	00:00	0.00	0
	Dikchu (2*48)	96	0	0	0	00:00	0.00	0
	Jorethang HEP(2*48)	96	100	101	102	12:21	2.20	96
	Sub Total IPP Hydro	1502	204	205		4.57	4.77	199
Solar	Talcher NTPC Solar	10					0.02	1
INFIRM	Nabinagar Infirm	250					0.00	0
Total Regional Entities		14464	8898	8561		227.24	226.71	

3.B. State Entities Generation:

Station/ Constituents	Inst.Capacity (MW)	19:00 Hrs Peak MW	14:00 Hrs Off Peak MW	Day Peak		Day Energy (MU)	AVG. MW
	(MW)	Peak MW	Off Peak MW	MW	Hrs	(MU)	
BIHAR	Baruni TPS(2*110)	220	0	0	00:00	0.00	0
	Muzaffarpur TPS(2*110)	220	0	0	00:00	0.00	0
	KBUNL Stg 2 (2 * 195)	390				3.38	
	Thermal (Total)	830	0	0	-	3.38	
	Hydro (Total)	45	0	0		0.00	
	Solar Generation					0.93	
	Others/Sugar Mill	14	0	0	00:00	0.00	
	Total BIHAR	888	0	0		4.31	
JHARKHAND	Patratu TPS(4*50+2*100+4*110)	840	0	0	00:00	0.00	0
	Tenughat TPS(2*110)	420	177	170	181	22:27	4.22
	Thermal (Total)	1260	177	171		4.22	176
	Suberrekha (2*65)	130	80	82	83	14:55	2.57
	Hydro (Total)	130	80	82	83	14:55	2.57
	CPP IMPORT		0	0	00:00	0.92	38
	Total JHARKHAND	1390	257	252		7.71	

	Station/	Inst.Capacity	19:00 Hrs	14:00 Hrs	Day Peak		Day Energy	AVG. MW
	Constituents	(MW)	Peak MW	Off Peak MW	MW	Hrs	(MU)	
DVC	Chandrapura TPS(3*140+2*250)	920	376	376	394	23:44	11.56	482
	Bokaro'B TPS(3*210)	630	0	0	0	06:02	0.00	0
	Bokaro A (2*500)	1000					9.75	406
	Waria TPS(140+210)	350	0	0	0	00:00	0.00	0
	Mejia TPS(4*210+2*250)	1340	723	694	808	21:01	18.76	782
	Mejia'B TPS(2*500)	1000	376	384	414	05:21	9.61	401
	Durgapur STPS (2*500)	1000	437	453	490	00:59	11.09	462
	Koderma TPS(500*2)	1000	719	730	755	14:15	18.06	753
	Raghunathpur TPS	600	390	398	440	20:08	9.35	390
	Thermal (Total)	7840	3020	3035			88.20	
	Maithon(2*20+23.2)	63	40	40	40	19:21	1.46	61
	Panchet(2*40)	80	61	58	62	17:26	1.46	61
	Tilaiya(2*2)	4	0	0	0	00:00	0.10	4
	Hydro (Total)	147	101	98			3.02	
	Renewable/Others							
	Total DVC	7987	3121	3132			91.22	
ODISHA	Talcher TPS(4*62.5+2*110)	470	425	425	437	01:19	10.21	426
	JB Valley TPS(2*110)	420	315	337	340	13:15	7.56	315
	Thermal (Total)	890	740	762			17.77	
	Burla(2*49.5+3*37.5+2*32)	276	103	103	105	11:16	2.12	88
	Chipilima(3*24)	72	45	45	47	08:22	1.03	43
	Ballimela(2*75+6*60)	510	280	41	351	19:33	4.58	191
	Rengali(5*50)	250	190	190	203	05:06	4.68	195
	Upper Kolab(4*80)	320	120	0	156	18:39	1.95	81
	Indravati(4*150)	600	455	0	580	18:47	4.76	198
	Machkund Share	57	32	32	32	01:48	0.77	32
	Hydro (Total)	2085	1224	411			19.87	
	Total CPPGR Import	5173	783	745	1067	13:55	17.35	723
	Solar Generation	0	0	0			0.10	4
	Renewable /Other							
	Total Odisha	2975	1964	1173			55.09	
WEST BENGAL	Santalidih TPS(2*250)	500	250	249	255	21:41	5.97	249
	Bandel TPS(4*82.5+210)	540	243	202	249	19:35	5.31	221
	Kolaghat TPS(6*210)	1260	479	504	504	00:00	11.91	496
	Bakreswar TPS(5*210)	1050	539	539	539	00:00	12.93	539
	DPL TPS(3*75+110+300)	635	231	220	236	17:33	5.32	222
	SAGARDIGHI TPS(2*300+1*500)	1100	763	746	802	18:07	16.86	703
	Thermal (Total)	5085	2504	2459			52.99	
	Purulia PSP(G)(4*225)	900	380	1	459	19:16	2.65	111
	Purulia PSP(P)		0	-3	0	00:00	-3.81	-159
	Jaldhaka(3*9+2*4)	35	25	25	25	00:00	0.60	25
	Ramam(4*12.5)	50	0	0	0	00:00	0.00	0
	TLDP III & IV(4*40 + 4*40)	320	5	6	7	23:49	0.13	6
	Tista(9*7.5)	68	22	22	23	10:50	0.54	22
	Hydro (Total)	1373	432	52			3.93	164
	Total CPPWB Import	631	660	667	686	19:54	15.12	630
	Renewable/Others							
	Total WEST BENGAL	6458	2937	2511			72.04	3002
CESC	Budge-Budge TPS(3*250)	750	762	767	779	13:25	18.20	758
	Southern TPS(2*67.5)	135	149	76	152	19:53	1.52	63
	Thermal (Total)	885	911	844			19.72	822
	Renewable/Others							
	Total CESC	885	911	844			19.72	822
Total ISGS & IPP Thermal		10850	6763	6396			173.36	7223
Total State Thermal		16790	7353	7271			186.28	7762
Total CPP Import		5804	1442	1412			33.38	1391
Total ISGS & IPP Hydro		3614	2136	2164			53	2222
Total State Hydro		3779	1837	642			29.39	1225
Total Renewable/Others		14	0	0			1.05	44
Net Inter Regional Exchange [Import(+ve)/Export(-ve)]			3165	4601			-72.66	4028
Regional Total (Gross)		40837	22695	22486	0	0	404.13	23850

* 765 KV Volatge Range

4.A. INTER-REGIONAL EXCHANGES (Import=(+ve) /Export =(-ve))

Sl No	Element	19:00 Hrs Peak	14:00 Hrs Off Peak	Maximum Interchange (MW)		Import in MU	Export in MU	NET
		MW	MW	Import (MW)±	Export (MW)±			
Import/Export NR from ER								
1	765 KV GAYA-VARANASI D/C	101	230	0	277	0.00	-7.53	-7.53
2	765 KV SASARAM-FATEHPUR	-106	80	0	128	0.54	0.00	0.54
3	765 KV GAYA-BALIA	226	319	0	430	0.00	-6.44	-6.44
4	HVDC LINK PUSAULI B/B	194	192	0	196	0.00	-4.81	-4.81
5	HVDC LINK ALIPURDUAR AGRA POLE 3	0	0	0	0	0.00	0.00	0.00
6	HVDC LINK ALIPURDUAR AGRA POLE 4	0	0	0	0	0.00	0.00	0.00
7	400 KV PUSAULI-SARNATH	158	133	0	175	0.00	0.00	0.00
8	400 KV PUSAULI-ALLAHABAD	28	53	0	60	0.00	0.00	0.00
9	400 KV MUZAFFARPUR-GORAKHPUR	291	596	0	751	0.00	-13.41	-13.41
10	400 KV PATNA-BALIA	711	901	0	1021	0.00	-21.02	-21.02
11	400 KV BIHARSHARIFF-BALIA	56	262	0	331	0.00	-6.47	-6.47
12	400 KV MOTIHARI - GORAKHPUR D/C	-154	-145	0	0	0.00	-3.24	-3.24
13	400 KV BIHARSHARIFF - VARANASI D/C			0	110	0.00	-0.90	-0.90
14	220 KV PUSAULI-SAHUPURI	112	96	0	136	0.00	-2.39	-2.39
15	132 KV SONE NAGAR-RIHAND	0	0	0	0	0.00	0.00	0.00
16	132 KV GARWAH-RIHAND	0	0	0	0	0.32	0.00	0.32
17	132 KV KARMANASA-SAHUPURI	0	0	0	0	0.00	0.00	0.00
18	132 KV KARMANASA-CHANDAULI					0.00	0.00	0.00
Sub Total NR		1366	2767	0	3213	1	-66	-65.35
Import/Export WR from ER								
1	765 KV JHARSUGUDA-DHARMAJAYAGARH D/C	-288	-275	0	0	6.18	0.00	6.18
2	765 KV RANCHI-DHARMAJAYAGARH S/C	-356	-211	0	54	6.76	0.00	6.76
3	400 KV ROURKELA - RAIGARH (SEL LILO BYPASS)	-74	-59	0	14	1.46	0.00	1.46
4	400 KV JHARSUGUDA-RAIGARH I	-34	-51	0	12	1.15	0.00	1.15
5	400 KV JHARSUGUDA-RAIGARH II	0	0	0	0	1.14	0.00	1.14
6	400 KV STERLITE-RAIGARH -II	55	47	0	131	0.00	-0.27	-0.27
7	400 KV RANCHI-SIPAT D/C	-249	-210	0	0	3.67	0.00	3.67
8	220 KV BUDHIPADAR-RAIGARH S/C	11	49	0	91	0.00	-0.54	-0.54
9	220 KV BUDHIPADAR-KORBA D/C	-174	-154	0	0	3.68	0.00	3.68
Sub Total WR		-1144	-915	0	0	24	-1	23.23
Import/Export SR from ER								
1	765 KV ANGUL SHRIKAKULAM D/C					0.00	-10.51	-10.51
2	GAZUWAKA B/B	289	288	0	291	0.00	-13.15	-13.15
3	TALCHER-KOLAR BIPOLE	1012	1411	0	1808	0.00	-27.80	-27.80
4	TALCHER STG - II I/C	213	321	0	427	5.92	0.00	6
5	220 KV BALIMELA-UPPER-SILERRU S/C	-1	-1	0	0	0.00	0.00	0.00
Sub Total SR		631	991	0	1491	5.92	-23.65	-17.73
Import/Export NER from ER								
1	400 KV BINAGURI-BONGAIGAON D/C	809	255	0	1124	0.00	-4.91	-4.91
2	400 KV ALIPURDUAR-BONGAIGAON D/C	642	216	0	879	0.00	-6.04	-6.04
3	220 KV ALIPURDUAR-SALAKATI D/C					0.00	0.00	0.00
4	132 KV GEYLEGPHU - SALAKATI					0.00	-1.37	-1.37
5	132 KV DEOTHANG - RANGIA					0.00	-0.49	-0.49
Sub Total NER		882	315	0	1214	0	-13	-12.80
TOTAL IR EXCHANGE		3165	4601	0	5560	31	-103	-72.66

4.B. Inter Regional Schedule & Actual Exchange (Import=(+ve) /Export =(-ve)) in MU

	ISGS/(LT+MT) Schedule	BILT Schedule	PX Schedule	Total IR Schedule	Total IR Actual	NET IR UI
ER-NR	-48.69	-17.84	7.14	-59.38	-65.35	-5.97
ER-WR	-41.46	8.62	22.04	-10.80	23.23	34.02
ER-SR	14.35	1.25	-23.26	-7.66	-17.73	-10.07
ER-NER	-3.90	3.65	6.23	5.98	-12.80	-18.78
TOTAL	-79.70	-4.32	12.16	-71.86	-72.66	-0.80

5. Transnational Exchange (Import=(+ve) /Export =(-ve))

	Scheduled Energy Exchange(In MU)	Actual Energy Exchange (In MU)	Day Peak (MW)	Day Min (MW)	Day Average (MW)	Nepal Exchange	Energy Exchange (In MU)	Day Peak (MW)	Day Min (MW)	Day Average (MW)
Bhutan	33.82	34.75	1428		1448	Bihar	-1.79	-110	0	-74
Nepal*	-1.44	-3.84	-229	0	-160	132 kV Mzf - Dhalkebar	-2.05	-119	0	-85
Bangladesh	-11.69	-11.64	-488	0	-485	* Actual Energy of Nepal is inclusive of Bihar and 132 kV Muzaffarpur - Dhalkebar				

6. Frequency Profile

RANGE(Hz)	<49.2	<49.7	<49.8	<49.9	49.9 - 50.05	50.05 - 50.1	>50.05	>50.2
%	0.00	0.03	1.41	14.42	74.69	9.50	10.89	0.00

<-----Frequency (Hz)----->

Maximum		Minimum		Average Frequency	Freq Variation Index	Standard deviation	Freq. in 15 mnt blk		Freq. Dev Index (% of Time)
Freq	Time	Freq	Time				Max.	Min.	
50.16	18:03	49.69	19:24	49.98	0.05	0.07	50.06	49.75	25.31

7. Voltage Profile

Station	Maximum		Minimum		Voltage (in %)			Voltage Dev. Index (%of Time)
	Voltage (KV)	Time	Voltage (KV)	Time	<380/728 KV	380<=420KV 728<=800KV	>420/800 KV	
Ranchi New	794	02:02	773	20:24	0.00	100.00	0.00	0.00
Jamshedpur	429	06:02	419	20:22	0.00	4.17	95.83	95.83
Muzaffarpur	406	23:59	384	20:17	0.00	100.00	0.00	0.00
Bihar Sariff	412	02:03	396	20:17	0.00	100.00	0.00	0.00
Binaguri	413	02:04	399	20:19	0.00	100.00	0.00	0.00
Jeerat	417	06:02	386	20:21	0.00	100.00	0.00	0.00
Rourkela	416	05:02	409	20:21	0.00	100.00	0.00	0.00
Jeypore	415	23:55	392	12:03	0.00	100.00	0.00	0.00
Koderma	418	01:58	407	20:17	0.00	100.00	0.00	0.00
Maithon	416	05:03	408	20:28	0.00	100.00	0.00	0.00
Teesta	408	23:56	396	20:11	0.00	100.00	0.00	0.00
Rango	406	23:54	394	20:11	0.00	100.00	0.00	0.00

8. System Reliability Indices (Violation of TTC and ATC)

(i) % age of times N-1 Criteria was violated in the inter - regional corridors

ER-NR & NER (Kahalgaon-Banka) (500mW)	0.00%
W3-ER (MPL-Maithon) (550mW)	0.00%

(i) % age of times ATC violated on the inter-regional corridors

	EXPORT	IMPORT
NR	0.00%	0.00%
SR	0.00%	0.00%
NER	0.00%	0.00%
WR	0.00%	0.00%

(ii) % age of times Angular Difference on Important Buses was beyond permissible limits (30 degree)

Rourkela-Jamshedpur	0.00%
---------------------	-------

9. Significant events (If any):

10.System Constraints (If any)

11. Weather Condition:

Shift In Charge

पॉवर सिस्टम ऑपरेशन कार्पोरेशन लिमिटेड

(पावरग्रिड की पूर्ण स्वामित्व प्राप्त सहायक कंपनी)

उत्तर-पूर्वी क्षेत्रीय भार प्रेषण केंद्र



Power Supply Position in North-Eastern Region for 17-Aug-17
Date of Reporting 18-Aug-17

I. Regional Availability/Demand:

Evening Peak (20:00 Hrs) MW				Off Peak (03:00 Hrs) MW				Day Energy (Net MU)	
Demand Met	Shortage	Requirement	Freq* (Hz)	Demand Met	Shortage	Requirement	Freq* (Hz)	Demand Met	Shortage
2427	275	2702	49.97	1728	11	1739	50.05	47.56	1.67

* Half hourly (two 15 minutes block-one block before and after the designated time) average frequency

II. A. State's Load Details (At States periphery) in MUs:

UI [OD:(+ve), UD: (-ve)]

State	State's Control Area Generation (Net MU)					Drawal Schedule (Net MU)	Actual Drawal (Net MU)	UI (Net MU)	Consumption (Net MU)	Shortages *
	Thermal	Hydro	Solar	Wind	Total					
ARUNACHAL PRADESH	0.00	0.00	0.00	0.00	0.00	3.10	2.12	-0.98	2.12	0.05
ASSAM	2.46	2.47	0.02	0.00	4.95	22.37	25.85	3.48	30.80	1.46
MANIPUR	0.00	0.00	0.00	0.00	0.00	2.18	2.16	-0.02	2.16	0.05
MEGHALAYA	0.00	6.53	0.00	0.00	6.53	-1.65	-2.00	-0.35	4.46	0.00
MIZORAM	0.00	0.09	0.00	0.00	0.09	1.21	1.14	-0.07	1.23	0.04
NAGALAND	0.00	0.20	0.00	0.00	0.20	1.97	2.14	0.17	2.34	0.04
TRIPURA	3.75	0.10	0.02	0.00	3.87	2.81	3.66	0.85	4.44	0.03
Total	6.21	9.39	0.04	0.00	15.64	31.99	35.08	3.09	47.56	1.67

* Shortage furnished by the respective constituent. # Tripura Demand excludes Bangladesh Dr

3.09 MU

II. B. State's Demand Met in MWs:

UI/OA/PX [OD/import: (+ve), UD/Export: (-ve)]

State	Evening Peak (20:00 Hrs) MW				Off Peak (03:00 Hrs) MW				# Max(hourly) Demand Met of Day (MW)	Time
	Demand Met	Shortage	UI	STOA/PX transaction	Demand Met	Shortage	UI	STOA/PX transaction		
ARUNACHAL PRADESH	124	3	-22	0	83	0	-5	0	125	19:28
ASSAM	1471	262	19	318	1191	0	70	13	1568	19:04
MANIPUR	139	2	2	-22	59	0	-10	-79	139	18:40
MEGHALAYA	264	0	-36	-202	150	0	-32	-168	264	19:49
MIZORAM	72	1	-6	-26	26	0	-5	-56	73	18:23
NAGALAND	114	1	9	0	52	0	-16	-18	115	18:39
TRIPURA	244	5	37	0	167	11	44	-96	246	18:46
Total	2427	275	3	68	1728	11	46	-404	2532	19:20

* STOA figures are at sellers boundary & PX figures are at regional boundary.

III. Regional Entities :

UI [OG:(+ve), UG: (-ve)]

	Station/ Constituent	Inst. Capacity	Declared	Peak MW (At 20:00 Hrs)	Off Peak MW (At 03:00 Hrs)	Energy	Average	Schedule	UI
		(Effective) MW	Capacity(MW)	(Gross)	(Gross)	(Net MU)	MW	Net MU	Net MU
A. NEEPCO	KHANDONG (2x25)	50	43	44	44	1.06	44	1.03	0.03
	KOPII STAGE-II (Khandong) (1x25)	25	20	19	20	0.49	20	0.48	0.01
	KOPII (4x50)	200	191	191	191	4.69	195	4.58	0.10
	AGBPP (Kathalguri)- (GT+ST) (6x33.5 + 3x30)	291	160	161	161	3.84	160	3.62	0.22
	AGTCCPP (RC NAGAR) (4x21+2x25)	135	82	74	71	1.89	79	1.80	0.09
	DOYANG (3x25)	75	72	71	71	1.78	74	1.71	0.07
	RANGANADI (3x135)	405	401	401	401	8.80	367	8.69	0.11
B. NHPC	Sub Total (A)	1181	968	961	959	22.55	940	21.91	0.64
	LOKTAK (3x35)	105	104	105	102	2.42	101	2.39	0.03
	Sub Total (B)	105	104	105	102	2.42	101	2.39	0.03
C. OTPCL	PALATANA CAPP (2X363.3)	726.6	462	461	461	11.24	469	11.10	0.15
	Sub Total (C)	726.6	462	461	461	11.24	469	11.10	0.15
D.NTPC	BgTTP	250	228	232	158	4.62	192	4.33	0.29
	Sub Total (D)	250	228	232	158	4.62	192	4.33	0.29
E. Total Regional Entities (A-D)		2263	1762	1759	1680	40.83	1701	39.72	1.11

E. State Entities	Station	Effective Installed Capacity (MW)	Peak MW	Off Peak MW	Energy(MU)	Average(Sentout MW)
ARUNACHAL PRADESH	Thermal (Total)	0	0	0.00	0.00	0
	Total Hydro	0	0	0.00	0.00	0
	Total Micro Hydel	0	0	0.00	0.00	0
	Total Diesel	0	0	0.00	0.00	0
	Total Solar	0.000	0	0.00	0.00	0
	Total Wind	0	0	0.00	0.00	0
	Total Arunachal Pradesh	0	0	0.00	0.00	0
ASSAM	LTPS(Thermal) (4x15+3x20+1x37.2)	157.2	81	81.83	1.79	75
	NTPS(Thermal) (20+21+21+11+24+ 22)	120	36	29.00	0.67	28
	Adamtilla(Thermal) (3*3) + CTPS(2*30)	69	0	0.00	0.00	0
	Baskandi(Thermal) (3*3.5+1*5)	15.5	0	0.00	0.00	0
	KLHEP(Hydro) (2*50)	100	102	101.12	2.39	99
	Mini Hydel(Champabati + Myntreng =4+3)	7	4	2.72	0.08	3
	Thermal (Total)	361	117	110.83	2.46	103
	Total Hydro	107	106	103.84	2.47	103
	Total Solar(Suryataap Solar)	5	0	0.00	0.02	1
	Total Wind	0	0	0.00	0.00	0
	Total Assam	473	223	214.67	4.95	206
MANIPUR	Thermal (Total)	0	0	0.00	0.00	0
	Total Hydro	0	0	0.00	0.00	0
	Total Micro Hydel	0.0	0	0.00	0.00	0
	Total Diesel	0.00	0	0.00	0.00	0
	Total Solar	0	0	0.00	0.00	0
	Total Wind	0	0	0.00	0.00	0
	Total Manipur	0	0	0.00	0.00	0
MEGHALAYA	UMIUM ST-I (4*9)	36	36	36.30	0.87	36
	UMIUM ST-II (2*10)	20	17	16.65	0.43	18
	UMIUM ST-III (2*30)	60	25	0.00	0.37	15
	UMIUM ST-IV (2*30)	60	60	59.54	1.38	58
	UMTRU (4*2.8)+ New UMTRU(2*20)	51.2	20	21.00	0.48	20
	SONAPANI (1*1.5)	1.5	1	0.00	0.02	1
	MLHEP (3*42)	126	126	126.00	2.98	124
	Private Generator	0	50	0.00	0.00	0
	Total Hydro	355	284	259.49	6.53	272
	Thermal (Total)	107	0	0.00	0.00	0
	Total Solar	0	0	0.00	0.00	0
	Total Wind	0	0	0.00	0.00	0
	Total Meghalaya	462	284	259.49	6.53	272
	BAIRABI (4X5.73)	22.92	0	0.00	0.00	0
MIZORAM	Total Hydro (Serlui B+Mini Hydro)	29.85	0	0.00	0.09	4
	Total Diesel	22.9	0	0.00	0.00	0
	Total Solar	0.00	0	0.00	0.00	0
	Total Wind	0	0	0.00	0.00	0
	Total Mizoram	76	0	0.00	0.09	4
NAGALAND	LIKHMRO + Dulumroi (3*8+1.5)	26	20	0.00	0.20	8
	Total Hydro	26	20	0.00	0.20	8
	Total Solar	0	0	0.00	0.00	0
	Total Wind	0	0	0.00	0.00	0
	Total Nagaland	26	20	0.00	0.20	8
TRIPURA	ROKHIA(Thermal) (6x8+3x21)	111	52	52.00	1.25	52
	BARAMJURA(Thermal) (1x7+2x5+2*21)	59.0	21	21.00	0.50	21
	Monarchak(Thermal)	101.0	74	94.20	2.00	83
	Gumati(Hydro) (3*5)	15	4	4.00	0.10	4
	Thermal (Total)	271	147	167.20	3.75	156
	Total Hydro	15	4	4.00	0.10	4
	Total Diesel	0	0	0.00	0.00	0
	Total Solar(Monarchak 5)	5	0	0.00	0.02	1
	Total Wind	0	0	0.00	0.00	0
	Total Tripura(including Monarchak)	291	151	171.20	3.87	161
Total State Control Area Generation		1328	678	645.36	15.64	652
Total State control area generation (excluding hydro)		772.1	263.71	278.03	6.23	260
Total regional entirties generation (excluding hydro)		1403	696	693	21.59	707
Total Regional generation (excluding Hydro)		2175	960	971	27.83	967
IV. Total Hydro Generation:						
Regional Entities Hydro		860	831	829	19.24	802
State Control Area Hydro		533	414	367	9.39	391
Total Regional Hydro		1393	1245	1196	28.62	1193
Infirm Generation in the Region						
Total Generation availability in the Region		3567	2205	2167	56.4	2159.7

V(A). Inter Regional Exchange [Import (-ve)/Export (+ve)] [Linkwise]

Element	Peak(20:00 Hrs) MW	Off Peak(03:00 Hrs) MW	Maximum Interchange (MW)		Energy (MU)		Net Energy
			Import	Export	Import	Export	
400 kV Binaquri-Bongaigaon I	-180	-115	-248	0	-2.61	0.00	-2.61
400 kV Binaquri-Bongaigaon II	-178	-113	-247	0	-2.62	0.00	-2.62
400 kV Alipurduar-Bongaigaon I	-218	-150	-302	0	-3.44	0.00	-3.44
400 kV Alipurduar-Bongaigaon II	-214	-149	-298	0	-3.45	0.00	-3.45
220 kV Alipurduar-Salakati I	0	0	0	0	0.00	0.00	0.00
220 kV Alipurduar-Salakati II	1	1	0	1	0.00	0.00	0.00
132 kV Rangia-Deothang / Salakati-Gelephu (India-	-45	-58	-62	0	-2.35	0.00	-2.35
+/- 800 KV Biswanath charali - Agra	700	1002	0	1150	0.00	19.32	19.32
Total IR Exch	-134	418	-1157	1151	-14.48	19.32	4.84

V(B). Inter Regional Schedule & Actual Exchanges [Import (+ve)/Export (-ve)] [Corridor wise]

ISGS/IT Schedule (MU)		Bilateral Schedule (MU)		Power Exchange Shdl (MU)		Wheeling (MU)	
ER	Total	Through ER		Through ER		Through ER	
	0.00		0.00		0.00		
Total IR Schedule (MU)		Total IR Actual (MU)		Net IR UI (MU)			
Through ER	Total	Through ER	Total	Through ER	Total		

6.17									
-----> % of Time Frequency ----->									
<49.2	<49.7	<49.8	<49.9	<50.0	49.9-50.05	50.05-50.10	50.10-50.20	>50.20	>50.50
0.00	0.03	1.44	14.42	63.75	74.69	9.50	1.92	0.00	0.00
-----> Frequency (Hz) ----->									
Maximum		Minimum		Average	Frequency	Std. Dev.	Frequency in 15 Min Block		
Freq	Time	Freq	Time	Hz	Variation		MAX	MIN	
50.16	6:03:10 PM	49.69	7:24:30 PM	49.98	0.054	0.069	50.064	(Hz)	49.754

VII. Voltage profile 400 kV

Station	Voltage Level (kV)	Maximum		Minimum		Voltage (in % of Time)			
		Voltage(KV)	Time	Voltage(KV)	Time	<380 kV	<390 kV	>420 kV	>430 kV
Bongaigaon	400	409	20:09	395	19:03	0.0	0.0	0.0	0.0
Ballipara	400	420	20:03	400	19:07	0.0	0.0	0.0	0.0
Misa	400	422	20:05	401	19:10	0.0	0.0	1.8	0.0

VIII. Voltage profile 220 kV

Station	Voltage Level (kV)	Maximum		Minimum		Voltage (in % of Time)			
		Voltage(KV)	Time	Voltage(KV)	Time	<198 kV	<208 kV	>235 kV	>245 kV
Salakati	220	223	2:02	213	19:18	0.0	0.0	0.0	0.0
Dimapur	220	221	1:50	210	18:15	0.0	0.0	0.0	0.0
Mariani	220	235	20:16	225	18:12	0.0	0.0	0.0	0.0
Misa	220	225	20:02	214	18:18	0.0	0.0	0.0	0.0

IX. Voltage profile 132 kV

Station	Voltage Level (kV)	Maximum		Minimum		Voltage (in % of Time)			
		Voltage(KV)	Time	Voltage(KV)	Time	<110 kV	<120 kV	>135 kV	>145 kV
Jiribam	132	136	23:54	129	19:18	0.0	0.0	33.3	0.0
Hallong	132	135	2:17	133	19:18	0.0	0.0	0.0	0.0
Kahilipara	132	132	2:17	130	20:18	0.0	0.0	0.0	0.0
Aizawl	132	128	23:54	121	15:32	0.0	0.0	0.0	0.0
Kumarghat	132	133	5:05	125	19:18	0.0	0.0	0.0	0.0
Imphal	132	137	2:01	128	19:18	0.0	0.0	34.2	0.0
Khliehriat	132	136	2:04	131	19:18	0.0	0.0	28.8	0.0
Badarpur	132	137	23:54	131	19:11	0.0	0.0	57.5	0.0
Nirjuli	132	136	20:16	130	20:27	0.0	0.0	39.1	0.0

X. Reservoir Parameters:

Name of Reservoir	Parameters		Present Parameters		Last Year		Last day	
	FRL (m)	MDDL (m)	Level (m)	Energy (MU)	Level (m)	Energy (MU)	Inflow (m3/s)	Usage (m3/s)
Khandong	719.30	704.26	720.50	27.61	714.35	14.49	N/A	N/A
Kopili	609.60	597.24	609.41	98.20	609.47	98.20		
Loktak	769.00	767.95	769.16	250.00	769.23	250.00		
Umiam	979.88	958.45	976.79	33.69	976.27	31.26		
Gumti	93.55	83.60	93.30	29.17	91.80	22.58		
Doyang	333.00	306.00	323.35	33.00	324.10	36.10		
Ranganadi	567.00	560.00	564.53	N/A	563.77	N/A		

* N/A: Not Available

XI. System Constraints:

NIL

XII. Grid Disturbance / Any Other Significant Event:

NIL

XIV. Synchronisation of new generating units :

NIL

XV. Synchronisation of new 132/220 / 400 / 765 KV lines and energising of bus / substation :

NIL

XVI. Tripping of lines in pooling stations :

NIL

XVII. Complete generation loss in a generating station :

NIL

Report for :


पारी प्रभारी अभियंता / SHIFT CHARGE ENGINEER

POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI



BAWANA:Frequency

National Grid Frequency Profile for 17-Aug-2017

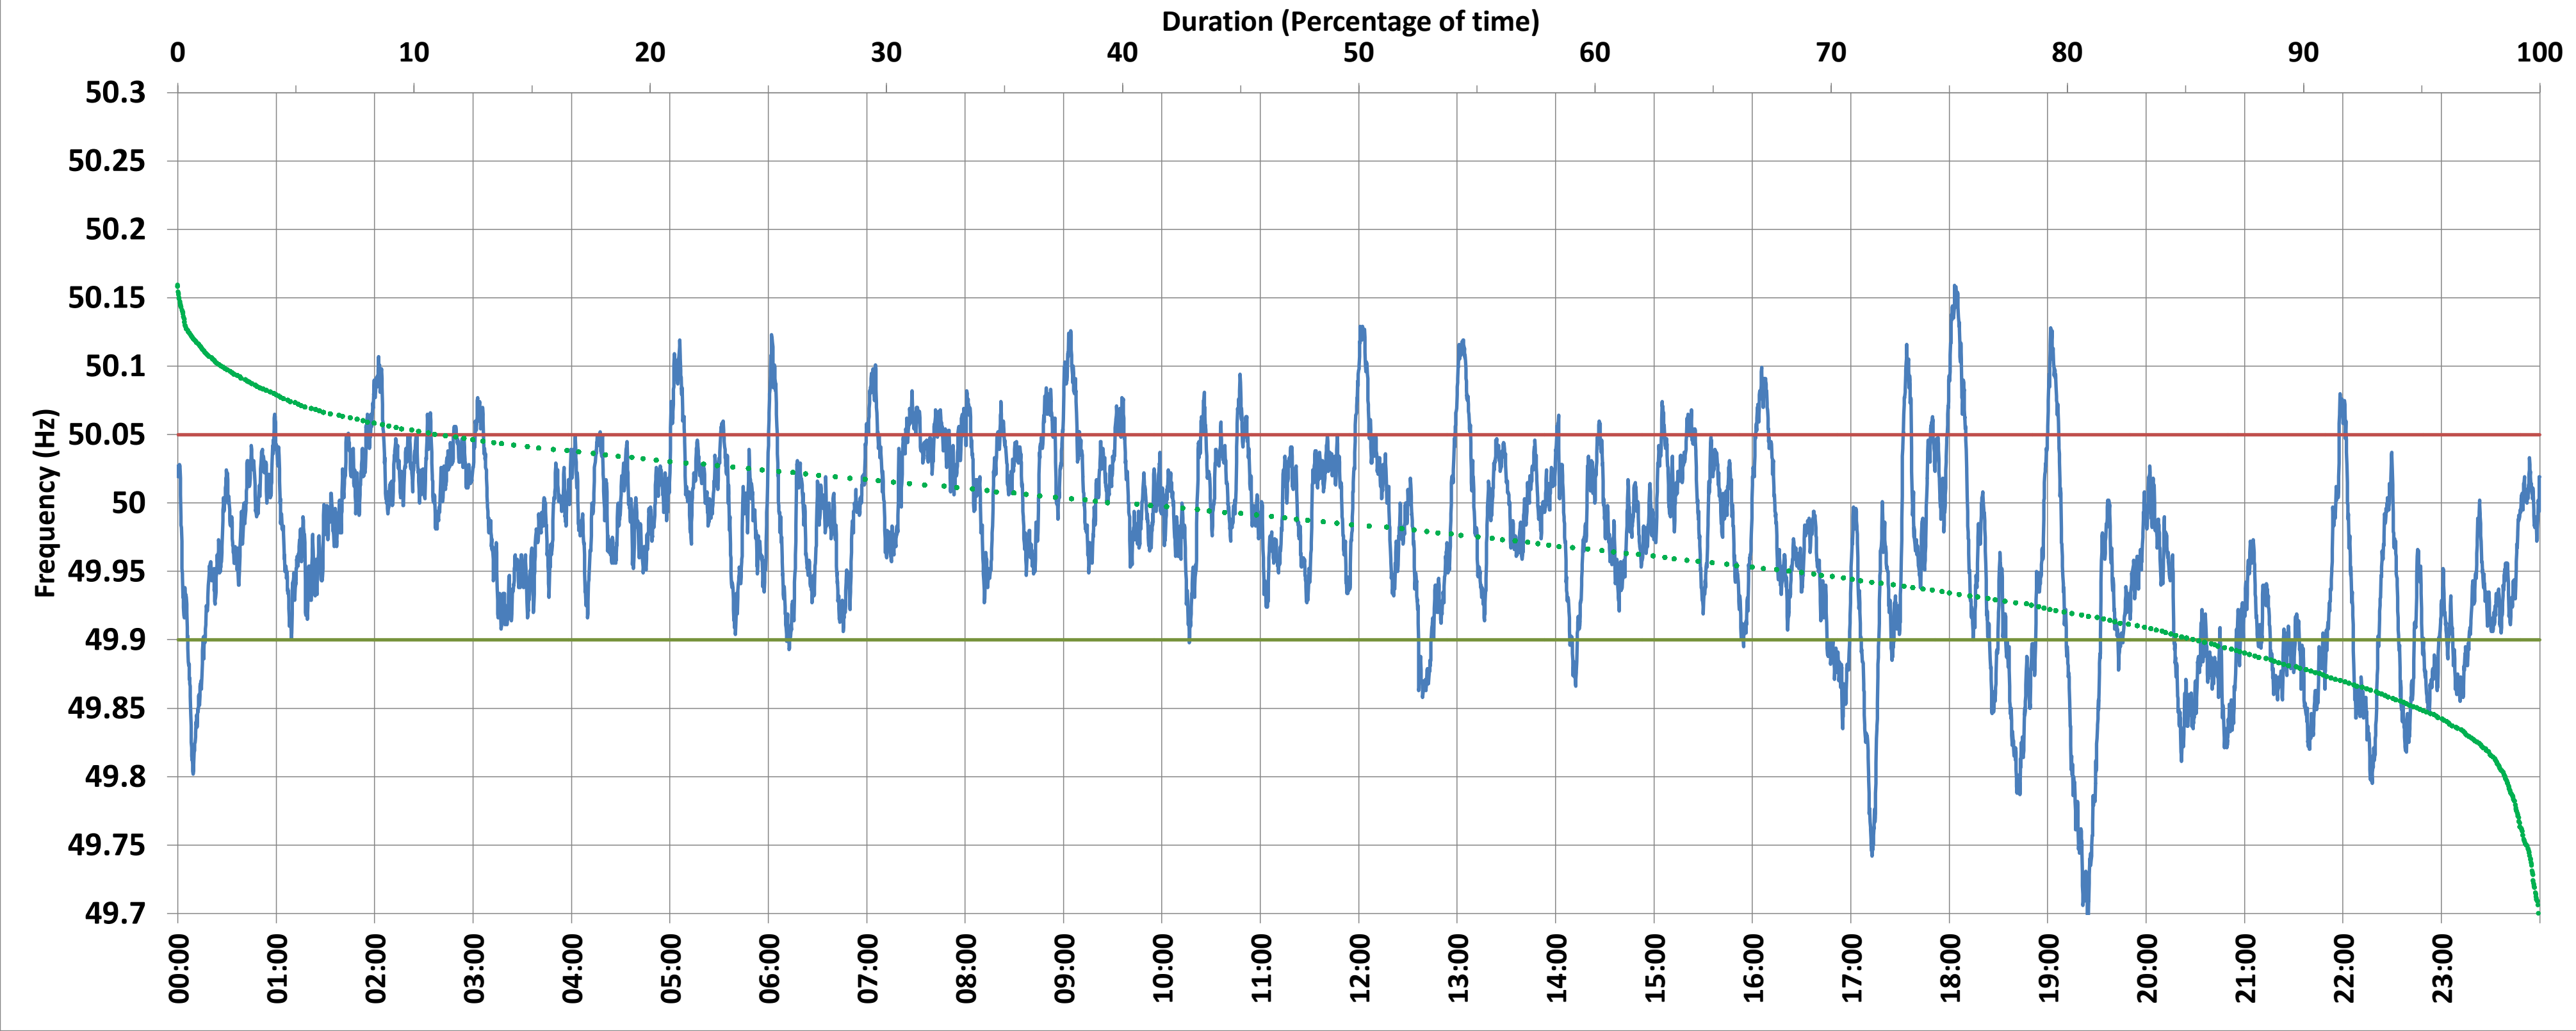

<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0.03	14.42	41.94	1.41	12.97	44.97	38.69	1.92	74.69	99.97	37.20	9.50	39.39	20.86	10.89	0.00

Average Frequency :		49.975	Frequency Variation Index :		0.054	Standard Deviation :		0.069
---------------------	--	--------	-----------------------------	--	-------	----------------------	--	-------

Instantaneous Frequency			15 minute Average Frequency			No. of excursions above 50.03 Hz		100
Max	50.159	18:03:10	Max	50.064	12:15:00	No. of excursions below 49.97 Hz		99
Min	49.688	19:24:30	Min	49.754	19:30:00	No. of excursions above 50.00 Hz		87
						No. of excursions below 50.00 Hz		96

Average time freq remains below 49.97 per excursion	0:06:06	Average time frequency remains above 50.03 per excursion	0:03:00
---	---------	--	---------

[illegible]

DATE OF REPORTING-18.08.2017								
GENERATION OUTAGE REPORT FOR 17.08.2017								
	Name of Line	Voltage (kV)	Region	Ownership	Outage		Revival	REASON
					Date	Time		
IR Links								
1	CHAMPAKURUKSHETRA POLE-II	220	WB	PG&I	25.07.2017	13:40	STILL OUT	No schedule between MS&P and Karnataka. No schedule between MS&P and Karnataka, the line after changed at 10:44am from Chidoli and after maintenance works completed QUARTERLY MAINTENANCE WORKS AND REPLACEMENT OF TAPPER LINE END IS CHANGED FROM UPPER SILVER END AT 12:40 HRS ON 25.05.17
2	TALANGABARIBHAKHAR-II	220	WB	WBSTCL	01.08.2017	0:01	STILL OUT	
3	CHIKORI-MITHINGI SC	220	WB	WBSTCL	01.06.2017	0:06	STILL OUT	
4	KOLHAPUR(TALANGABARIBHAKHAR) SC	220	WB	PG&I	03.08.2017	12:05	STILL OUT	
5	BALIMELA - U SILVER	220	ER	OPTCL / APSEB	27.04.2015	11:41	STILL OUT	
NR								
NR								
1	DHARAMAYAGAR(PG)-JABALPUR(Ps)-I	765	WB	PG&I	08.08.2017	7:54	STILL OUT	HIGH VOLTAGE
2	RAIPUR PS(DURG-WARDHAPG)-II	765	WB	PG&I	08.11.2017	0:04	STILL OUT	HIGH VOLTAGE
3	RAIPUR PS(DURG-WARDHAPG)-IV	765	WB	PG&I	14.08.2017	21:59	STILL OUT	HIGH VOLTAGE
4	AURANGABADWARDHA-III	765	WB	PG&I	15.08.2017	17:39	STILL OUT	HIGH VOLTAGE
5	POINTE CONSIDR(PAP)-RAIPUR(PG)-I	765	WB	PG&I	17.08.2017	17:42	STILL OUT	HIGH VOLTAGE
6	BHACHALPG-ISSAR VADINABRIG(TC)-II	400	WB	PG&I	18.09.2016	2:30	STILL OUT	HIGH VOLTAGE
7	BHACHALPG-ISSAR VADINABRIG(TC)-I	400	WB	PG&I	10.08.2016	0:50	STILL OUT	HIGH VOLTAGE
8	SKA-APR-KARAD(P)ORTION SC	400	WB	HTCL	27.05.2017	23:39	STILL OUT	HIGH VOLTAGE
9	SHIGHARJAWANIA SC-I	400	WB	MPPCL	08.10.2017	20:42	STILL OUT	HIGH VOLTAGE
10	ANGULCHANDAI-II	400	WB	GETCL	15.08.2017	08:16	STILL OUT	HIGH VOLTAGE
11	KANAMIA-KAL-I	400	WB	GETCL	15.08.2017	21:49	STILL OUT	HIGH VOLTAGE
12	KARADJAGAD-I	400	WB	WBSTCL	16.08.2017	20:15	STILL OUT	HIGH VOLTAGE
13	KOLHAPUR(GING)-MAPUSAPG-II	400	WB	PG&I	17.08.2017	06:52	STILL OUT	HIGH VOLTAGE
ER								
1	BALIMELA - U SILVER	220	ER	OPTCL / APSEB	27.04.15	11:41	STILL OUT	HIGH VOLTAGE
2	WADIA - BHIDANAGAR-II	220	ER	WBSTCL	10.09.16	08:46	STILL OUT	HIGH VOLTAGE
3	STERILITE - MERAMUNDAL(DC)	400	ER	OPTCL	15.05.17	15:53	STILL OUT	HIGH VOLTAGE
4	THERUVALINDRAVATHI-II	220	ER	OPTCL	16.07.17	8:59	STILL OUT	HIGH VOLTAGE
5	THERUVALINDRAVATHI-IV	220	ER	OPTCL	16.07.17	17:15	STILL OUT	HIGH VOLTAGE
SB								
1	MAHABOJBINAGAR - URAVAKONDA - 1	400	SB	PG&I	04.06.2017	3:26	STILL OUT	HIGH VOLTAGE
2	MAHABOJBINAGAR - URAVAKONDA - 2	400	SB	PG&I	04.07.2017	1:57	STILL OUT	HIGH VOLTAGE
3	KURNOOR - THIRUVALLAM-2	765	SB	PG&I	17.08.2017	15:04	STILL OUT	HIGH VOLTAGE
4	NETTY - VALLUR-2	400	SB	TNEB	04.08.2017	2:01	STILL OUT	HIGH VOLTAGE
5	KARAKURU-MADURAI	400	SB	PG&I	14.08.2017	25:59	STILL OUT	HIGH VOLTAGE
6	SARABERITHENI	220	SB	PG&I	14.08.2017	10:40	STILL OUT	HIGH VOLTAGE
7	KOTA-SURYAPET-2	400	SB	PG&I	08.06.2017	15:30	STILL OUT	HIGH VOLTAGE
8	MAMIDIPALLY - INDUL-1	400	SB	APTRANSCO	10.08.2017	1:05	STILL OUT	HIGH VOLTAGE
9	SESAILAM - INDUL-1	400	SB	APTRANSCO	10.08.2017	1:03	STILL OUT	HIGH VOLTAGE
10	SESAILAM - INDUL-1	400	SB	APTRANSCO	10.08.2017	1:03	STILL OUT	HIGH VOLTAGE
11	KAYATHAR - KAMURH-1	400	SB	APTRANSCO	28.03.2017	14:45	STILL OUT	HIGH VOLTAGE
12	KURNOOR - SESAILAM	400	SB	APTRANSCO	15.07.2017	0:01	STILL OUT	HIGH VOLTAGE
13	SATTENAPALLI - SESAILAM-1	400	SB	APTRANSCO	01.08.2017	1:48	STILL OUT	HIGH VOLTAGE
14	PUGALUR - KARAKURU-1	400	SB	TNEB	01.08.2017	1:14	STILL OUT	HIGH VOLTAGE
15	KOTA-SURYAPET-1	400	SB	APTRANSCO	14.08.2017	2:38	STILL OUT	HIGH VOLTAGE
16	URAVAKONDA-AMMALMADAGU-2	400	SB	TELANGANA	12.08.2017	8:24	STILL OUT	HIGH VOLTAGE
17	GOOTY-TUMKUR-1	400	SB	PG&I	15.08.2017	16:12	STILL OUT	HIGH VOLTAGE
18	DHARMAPUR-TUTICORIN-PS-1	400	SB	PG&I	15.08.2017	27:25	STILL OUT	HIGH VOLTAGE
19	PUGALUR - KARAKURU-2	400	SB	PG&I	16.08.2017	0:27	STILL OUT	HIGH VOLTAGE
20	THIRUNELVELI-KANDAMALA-2	400	SB	PG&I	16.08.2017	1:51	STILL OUT	HIGH VOLTAGE
21	HANNAK-NEELAMANGA-1	400	SB	PG&I	17.08.2017	1:05	STILL OUT	HIGH VOLTAGE
NER								
1	SALAKATI-ALIPURDAR-I	220	NER	POWERGRID	13.08.2017	16:57	STILL OUT	HIGH VOLTAGE
2	SALAKATI-ALIPURDAR-II	220	NER	POWERGRID	13.08.2018	16:58	STILL OUT	HIGH VOLTAGE

LINES UNDER RD									
CENTRAL SECTOR									
1	PRABH-SILCHAR II	133	NR	POWER/ARD	02.04.2017	4087	STBL	OUT	Upstart on DP
2	KATIPUR-PONDIRA/BA/MD/PA/DP II	765	WR	PGCL	13.05.2017	16050	STBL	OUT	Major Breakdown
3	ATITHINA-KOTRAPPA I	400	WR	PGCL	05.04.2016	2629	STBL	LOCK	1.11.17 High vol. operate at Athina, excessive of diff. relay at Athina and settings are being checked by Athina. Keep out after
4	ATITHINA-KOTRAPPA I	400	WR	PGCL	05.04.2016	2629	STBL	LOCK	1.11.17 High vol. operate at Athina, excessive of diff. relay at Athina and settings are being checked by Athina. Keep out after
5	AAI/PIRUDUR-SAKARATHI DC	220	ER	PGCL	13.08.2017	3995	STBL	OUT	POWER COLLAPSE At loc 19K due to fault
6	KISHANAGAR-KANDIANAGAR (B) & II	220	ER	PGCL	13.08.2017	3995	STBL	LOCK	HAND TRIPPED DUE TO LOCK IN AAI/PIRUDUR SWITCHYARD
7	AKKURU-VADAPPA/BA/MD/PA/DP I	400	NR	PGCL	17.06.2017	2131	STBL	OUT	It control line broken on Pottur, 2 No. diff. relay
STATE SECTOR									
1	BANMAN/DEPTA-BHATIRAPPA I	400	NR	DTL	22.05.2016	2629	STBL	LOCK	Power demand (first and second from Banman) SWN/CAC-II change through FDS reset
2	BANMAN-MANDLA	400	NR	DTL	14.05.2017	2629	STBL	LOCK	For before ARSN/Traver no. 116, in this line
3	BANMAN-MANDLA	400	NR	DTL	14.05.2017	2629	STBL	LOCK	Manually checked the 1st line before ARSN/Traver no. 116, in the line leading to Insulator demand and Traver closed
4	GRAN/400-PARAJA/TPA I	400	NR	OPPTCL	17.05.2017	13353	STBL	LOCK	Traver collapsed
5	MANOJ/BUCA-KARHAD/PTCL I, 2	400	NR	UPTEL	15.05.2017	13353	STBL	LOCK	Traver collapsed
6	DHANONDA-HAJAR (P, 2)	400	NR	HPNL	14.06.2017	15500	STBL	LOCK	Traver No. 12 in 17 collapsed
7	DHANONDA-HAJAR (P, 2)	400	NR	HPNL	14.06.2017	15500	STBL	LOCK	Traver No. 12 in 17 collapsed
8	DHANONDA/PTPA-LAMPUR/BEHAR/GRAN/CHNKT-1	400	NR	APN	17.06.2017	2639	STBL	LOCK	Hand report due to heavy sagging in Y-sh line insulator at Mohanpur end.
9	400 KV RAJA/PAJAL PUR 2 II	400	WR	SPCL	26.05.2017	17580	STBL	LOCK	REPT OPEN AFTER FIRST TIME IDLE CHARGING
10	KARASINHE ROYNA I	400	WR	PGCL	14.06.2017	1446	STBL	LOCK	N PHASE FAULT COLLAPSE AT LOC 30 KNOT AT KARASINHE
11	KARASINHE ROYNA I	400	WR	PGCL	17.06.2017	1446	STBL	LOCK	Reduction swing of control break isolate
12	DWEL/2-KADAR KARVARI II	400	WR	MSCL	17.06.2017	1232	STBL	LOCK	V-C fault
13	ST/BLT - MERAKATUL I/DT	400	FR	PGCL	15.05.2017	15072	STBL	LOCK	POWER SWING ARM DAMAGED
14	WABIA - BHEENAGAR II	220	ER	WBSTCL	10.09.2016	16346	STBL	LOCK	LINE UNDER RD, TOWER COLLAPSED AT LOC NO 81
15	MEYTHARAH I & II	400	NR	PGCL	06.06.2017	19313	STBL	LOCK	1.11.17 NO. 6 TOWERS IN GANDAR RIVER WATER LEVEL IS HIGH
16	VTPS-SURYAPET	400	NR	APTFRANCO	29.07.2017	19313	STBL	LOCK	BUS BAR PROTECTION OPERATED DUE TO CT BLAST AT VTPS
17	NT/PTP - VALLUR 2	400	NR	TNER	04.08.2017	2381	STBL	LOCK	BUS BAR PROTECTION OPERATED
18	VENAGIR-GUNGOPT	400	NR	PGCL	29.07.2017	19313	STBL	LOCK	TO ATTEND BREAKER PROBLEM
19	VTPS-SURYAPET	400	NR	APTFRANCO	29.07.2017	19313	STBL	LOCK	BUS BAR PROTECTION OPERATED DUE TO CT BLAST AT VTPS
20	KADHAPURANAN - CHITTOOR - II	400	NR	PGCL	06.06.2017	19313	STBL	LOCK	CT VFA FAULT
21	BTPS-BTPS TURANAGALU I	400	SR	PGCL	17.09.2017	1723	STBL	LOCK	GRAVY ARNING IN B-PTI ISOLATOR
LINES UNDER SD									
CENTRAL SECTOR									
1	PRABH-SILCHAR I	132	NR	PGCL	10.07.2017	1340	STBL	OUT	RD TO AVOID E.L.E. THROUCTION FROM FALLING OF B SYSTEM AS ENTIRE AREA IS FLOODED
2	DEEGAM-VADAPPA I	400	WR	PGCL	16.05.2017	7480	STBL	OUT	FOR WIRING, TESTING AND COMMISSIONING OF NEW BUS BAR PROTECTION IN SCHEM
STATE SECTOR									
1	SURYAPET - SHANKARAPPA I	400	NR	APTFRANCO	07.08.2017	1036	STBL	OUT	ERRUCTION OF WORK
2	HANMAN - JIPPA	400	NR	APTCL	03.08.2017	1036	STBL	OUT	MAINTENANCE WORKS
3	VTPS-MALANAM	400	NR	APTFRANCO	05.08.2017	1036	STBL	OUT	FOR ERECTION WORKS
4	VTPS-SURYAPET	400	NR	APTFRANCO	29.07.2017	19313	STBL	LOCK	BUS BAR PROTECTION OPERATED DUE TO CT BLAST AT VTPS
5	VENAGIR-GUNGOPT	400	NR	APTFRANCO	29.07.2017	19313	STBL	LOCK	TO ATTEND BREAKER PROBLEM
6	KAMMAN/KALPAKA 2	400	NR	PGCL	17.09.2017	724	STBL	OUT	MAINTENANCE WORKS
CONS CENTRAL SECTOR									
1	VYAVAYANDA - VEMAGIR(GP)	400	NR	PGCL	22.02.2017	925	STBL	OUT	RD FOR POWER REGULATION ON VEMAGIR/AVANAKANA LINE
2	BIANOR-GPCL-I	400	WR	PGCL	02.08.2017	809	STBL	OUT	TO CONTROL LINE LOADING
STATE SECTOR									