


Gross/Sadowski 2002 Figure 9 PC-SAFT replication

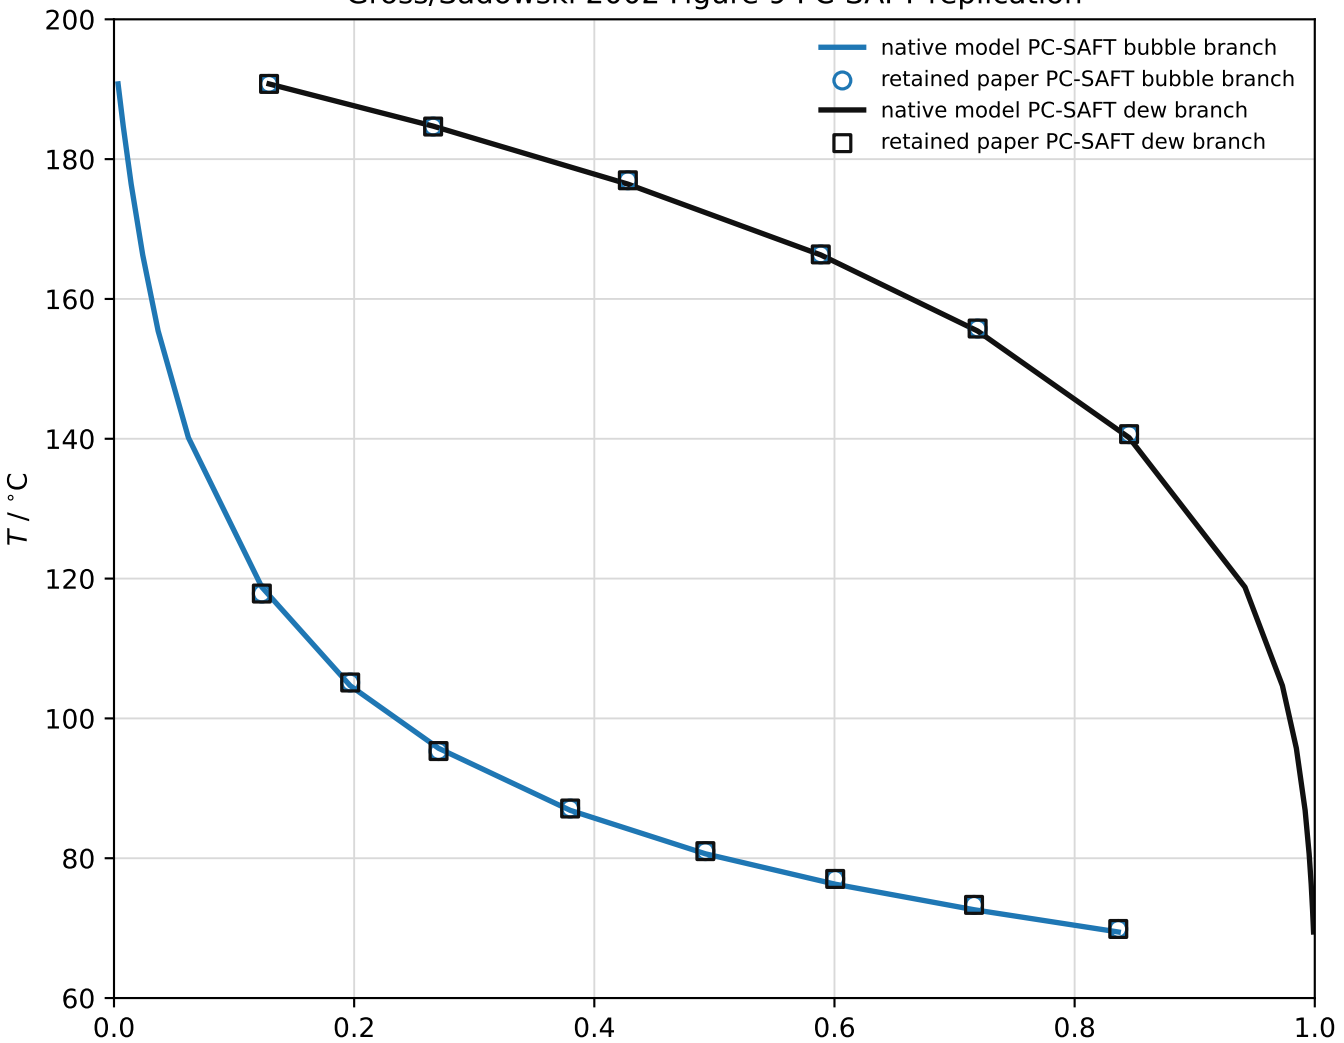

minimum branch score: 8.85; public bubble/dew pressure conversion for Methanol-Air