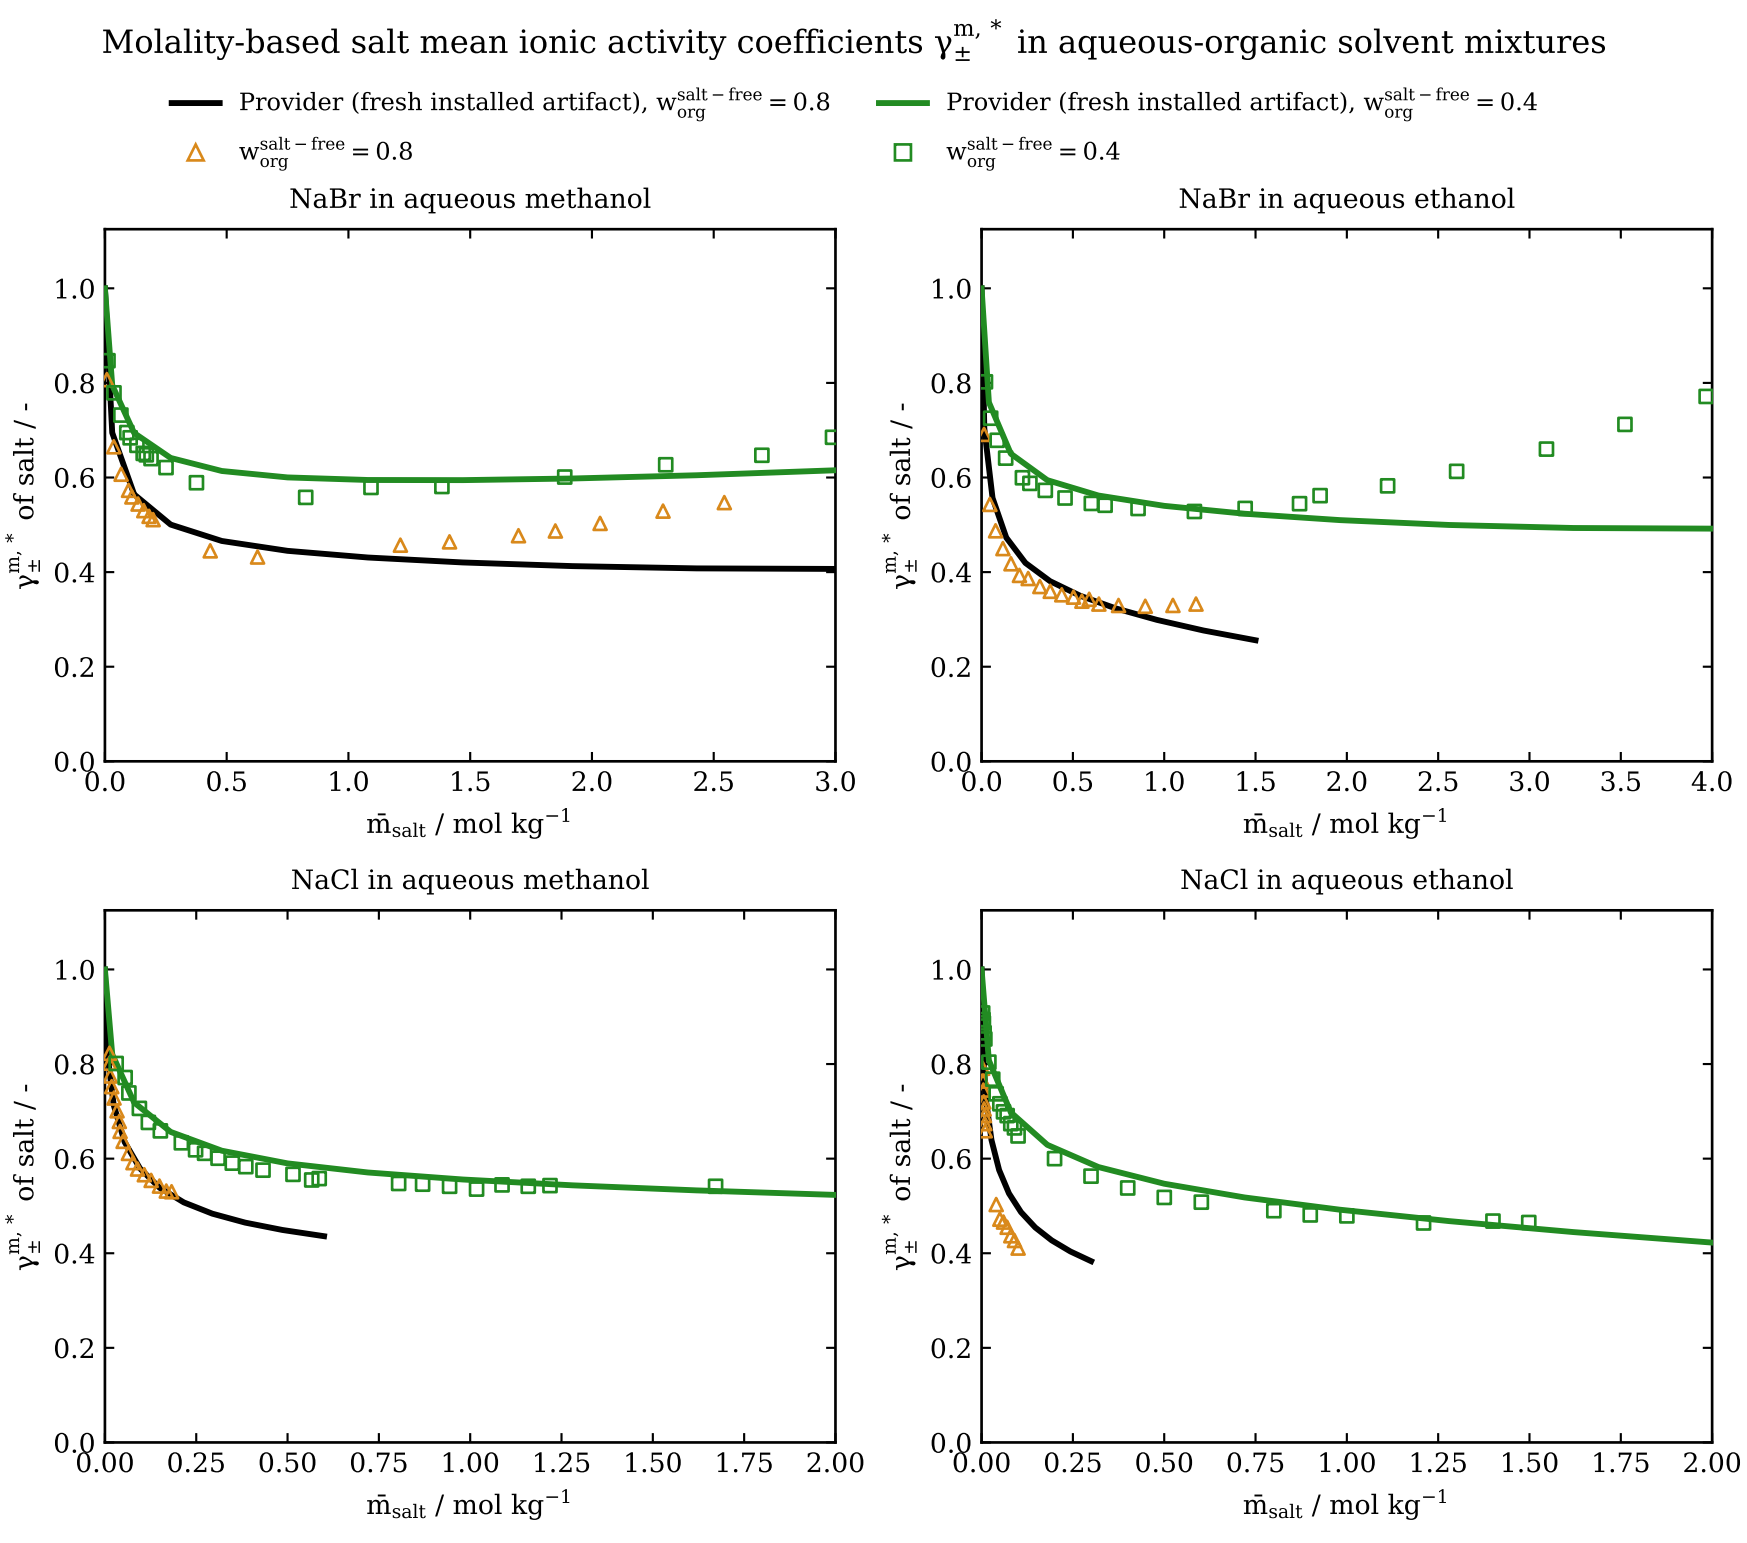
Molality-based salt mean ionic activity coefficients $\gamma_{\pm}^{m,*}$ in aqueous-organic solvent mixtures
Provider (fresh installed artifact), $w_{org}^{salt-free} = 0.8$
$w_{org}^{salt-free} = 0.8$
Provider (fresh installed artifact), $w_{org}^{salt-free} = 0.4$
$w_{org}^{salt-free} = 0.4$
NaBr in aqueous methanol
NaBr in aqueous ethanol
NaCl in aqueous methanol
NaCl in aqueous ethanol
$\gamma_{\pm}^{m,*}$ of salt / -
$\bar{m}_{salt}$ / mol kg^{-1}