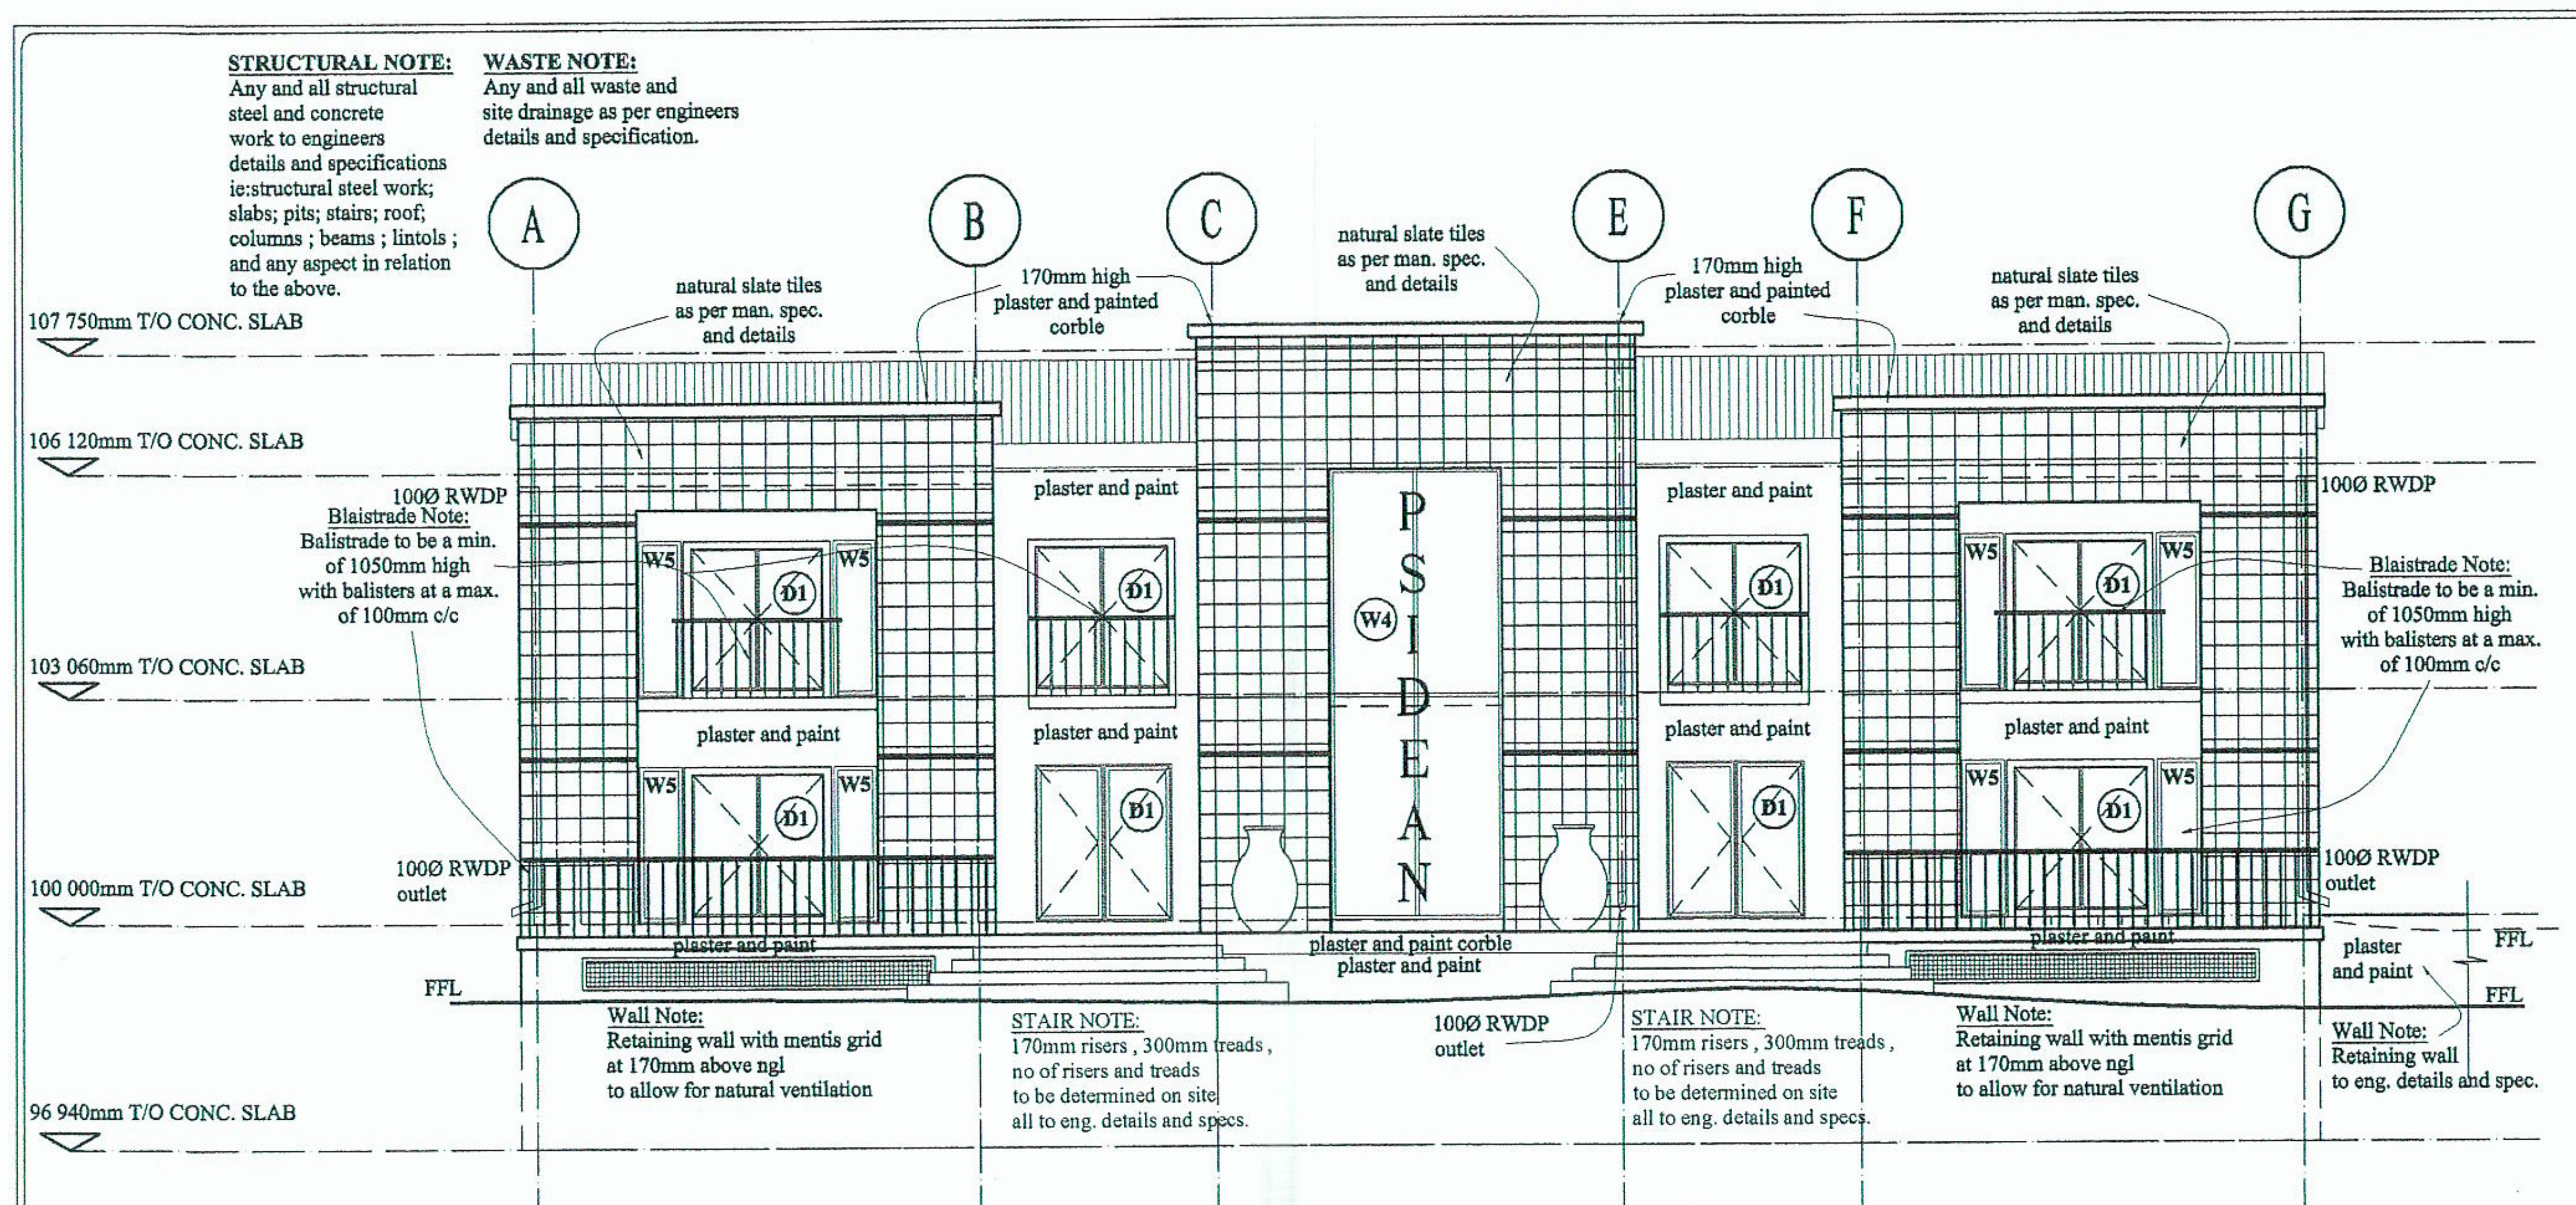
STRUCTURAL NOTE:
Any and all structural steel and concrete work to engineers details and specifications ie:structural steel work; slabs; pits; stairs; roof; columns ; beams ; lintols ; and any aspect in relation to the above.
WASTE NOTE:
Any and all waste and site drainage as per engineers details and specification.
A
B
C
E
F
G
107 750mm T/O CONC. SLAB
106 120mm T/O CONC. SLAB
103 060mm T/O CONC. SLAB
100 000mm T/O CONC. SLAB
96 940mm T/O CONC. SLAB
natural slate tiles as per man. spec. and details
170mm high plaster and painted corble
plaster and paint
100Ø RWDP
Blaistrade Note: Balistrade to be a min. of 1050mm high with balisters at a max. of 100mm c/c
W5
D1
W4
PSIDEAN
FFL
Wall Note: Retaining wall with mentis grid at 170mm above ngl to allow for natural ventilation
STAIR NOTE: 170mm risers , 300mm treads , no of risers and treads to be determined on site all to eng. details and specs.
100Ø RWDP outlet
plaster and paint corble
Wall Note: Retaining wall to eng. details and spec.

NORTH ELEVATION

SCALE 1:100

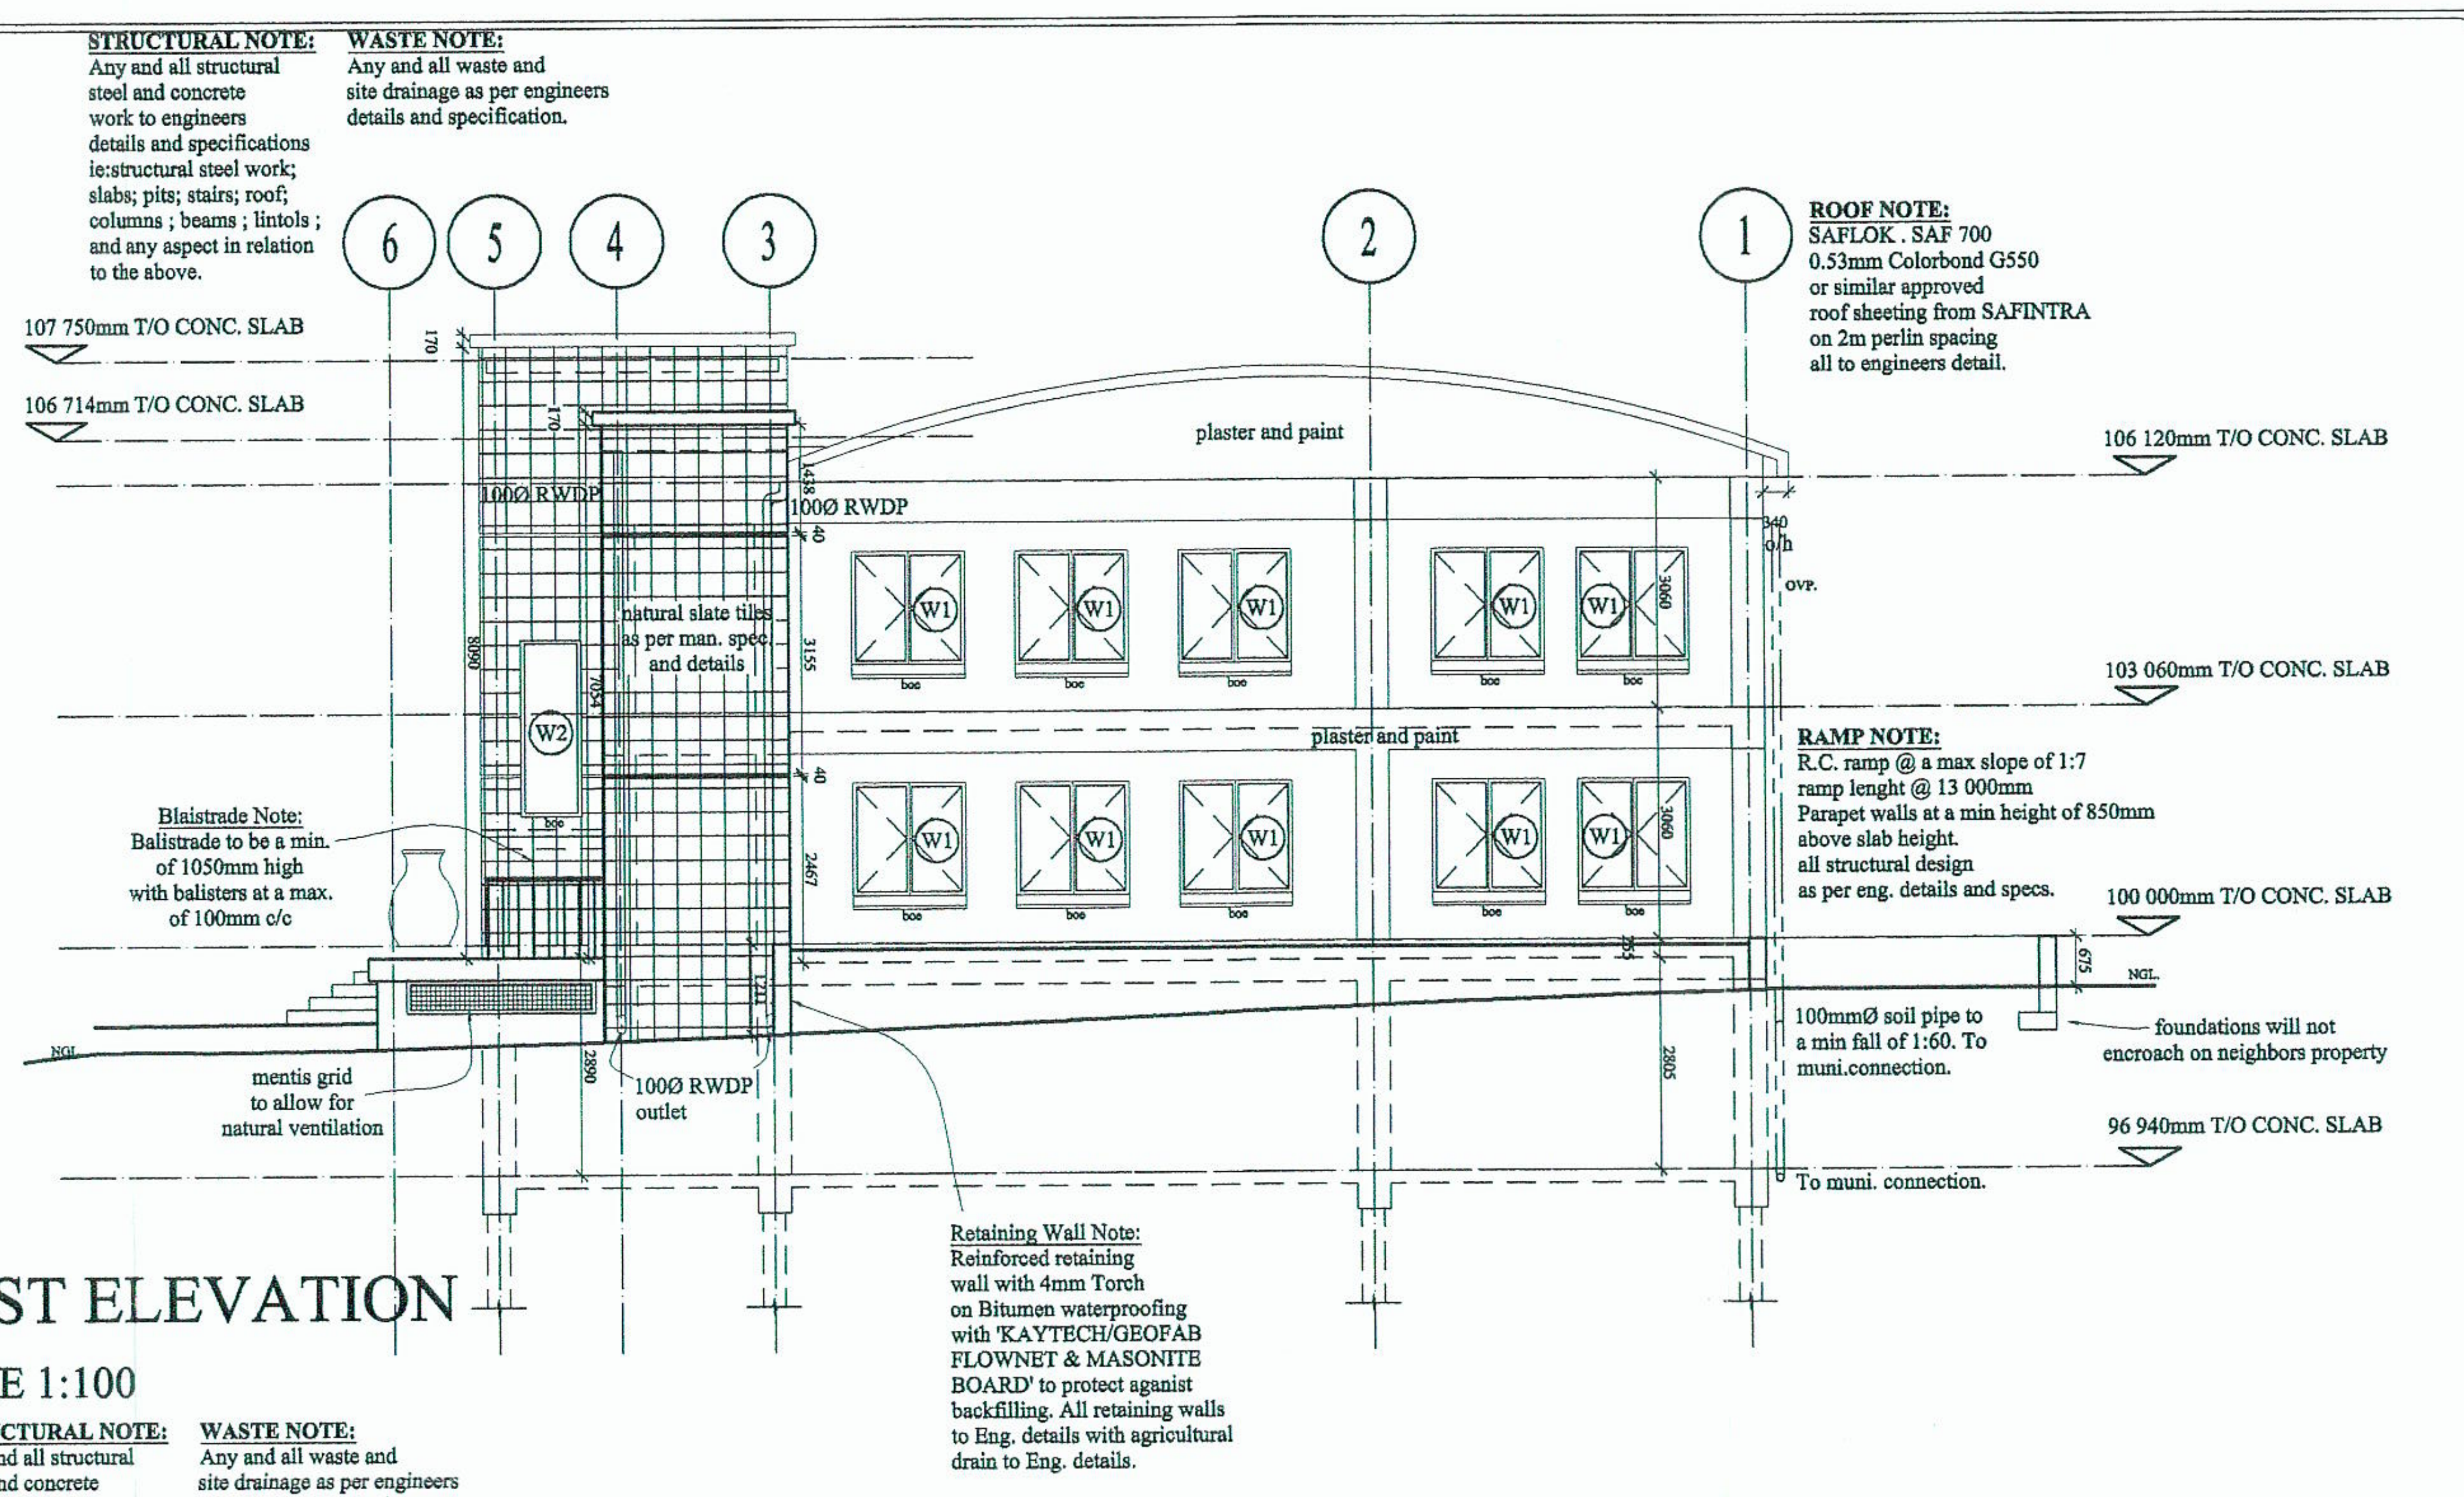
STRUCTURAL NOTE:
Any and all structural steel and concrete work to engineers details and specifications ie:structural steel work; slabs; pits; stairs; roof; columns ; beams ; lintols ; and any aspect in relation to the above.
WASTE NOTE:
Any and all waste and site drainage as per engineers details and specification.
6
5
4
3
2
1
ROOF NOTE:
SAFLOK . SAF 700
0.53mm Colorbond G550 or similar approved roof sheeting from SAFINTRA on 2m perlin spacing all to engineers detail.
107 750mm T/O CONC. SLAB
106 714mm T/O CONC. SLAB
106 120mm T/O CONC. SLAB
103 060mm T/O CONC. SLAB
100 000mm T/O CONC. SLAB
96 940mm T/O CONC. SLAB
plaster and paint
natural slate tiles as per man. spec. and details
100Ø RWDP
W1
W2
RAMP NOTE:
R.C. ramp @ a max slope of 1:7 ramp lenght @ 13 000mm Parapet walls at a min height of 850mm above slab height. all structural design as per eng. details and specs.
Blaistrade Note: Balistrade to be a min. of 1050mm high with balisters at a max. of 100mm c/c
mentis grid to allow for natural ventilation
100Ø RWDP outlet
100mmØ soil pipe to a min fall of 1:60. To muni.connection.
foundations will not encroach on neighbors property
To muni. connection.
Retaining Wall Note: Reinforced retaining wall with 4mm Torch on Bitumen waterproofing with 'KAYTECH/GEOFAB FLOWNET & MASONITE BOARD' to protect aganist backfilling. All retaining walls to Eng. details with agricultural drain to Eng. details.

WEST ELEVATION

SCALE 1:100

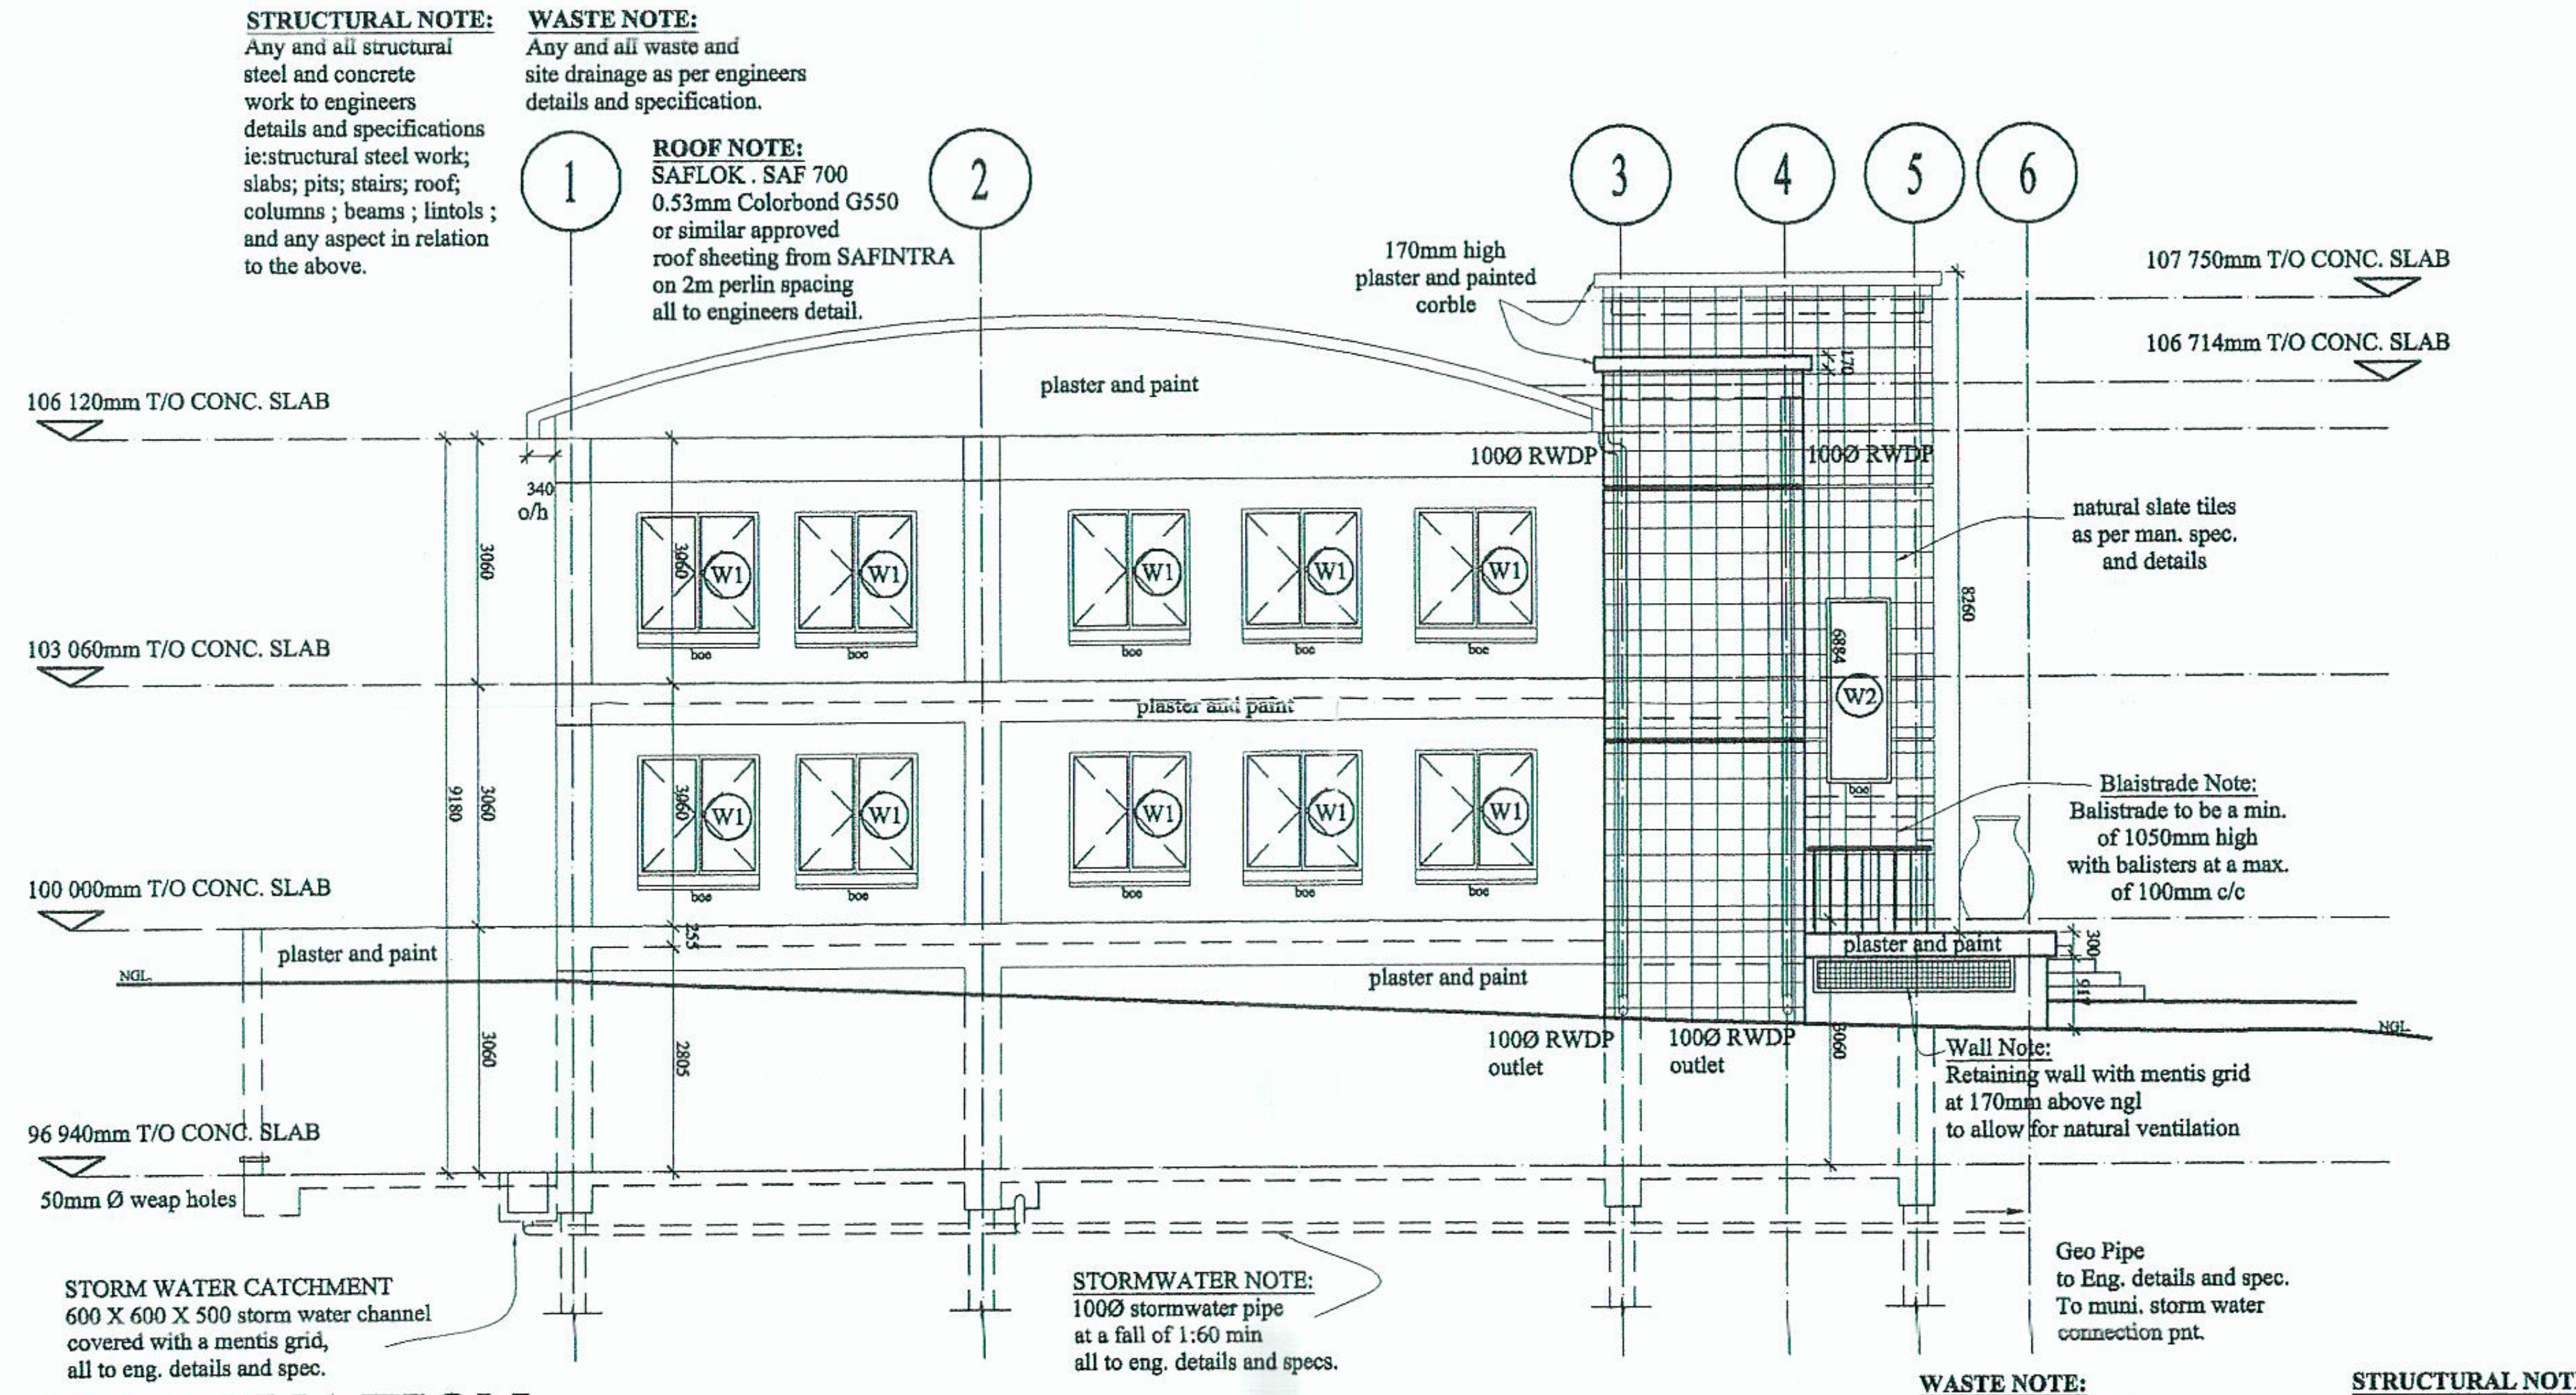
STRUCTURAL NOTE:
Any and all structural steel and concrete work to engineers details and specifications ie:structural steel work; slabs; pits; stairs; roof; columns ; beams ; lintols ; and any aspect in relation to the above.
WASTE NOTE:
Any and all waste and site drainage as per engineers details and specification.
ROOF NOTE:
SAFLOK . SAF 700
0.53mm Colorbond G550 or similar approved roof sheeting from SAFINTRA on 2m perlin spacing all to engineers detail.
1
2
3
4
5
6
170mm high plaster and painted corble
107 750mm T/O CONC. SLAB
106 714mm T/O CONC. SLAB
106 120mm T/O CONC. SLAB
103 060mm T/O CONC. SLAB
100 000mm T/O CONC. SLAB
96 940mm T/O CONC. SLAB
plaster and paint
100Ø RWDP
natural slate tiles as per man. spec. and details
W1
W2
Blaistrade Note: Balistrade to be a min. of 1050mm high with balisters at a max. of 100mm c/c
100Ø RWDP outlet
Wall Note: Retaining wall with mentis grid at 170mm above ngl to allow for natural ventilation
50mm Ø weap holes
STORM WATER CATCHMENT 600 X 600 X 500 storm water channel covered with a mentis grid, all to eng. details and spec.
STORMWATER NOTE: 100Ø stormwater pipe at a fall of 1:60 min all to eng. details and specs.
Geo Pipe to Eng. details and spec. To muni. storm water connection pnt.

EAST ELEVATION

SCALE 1:100

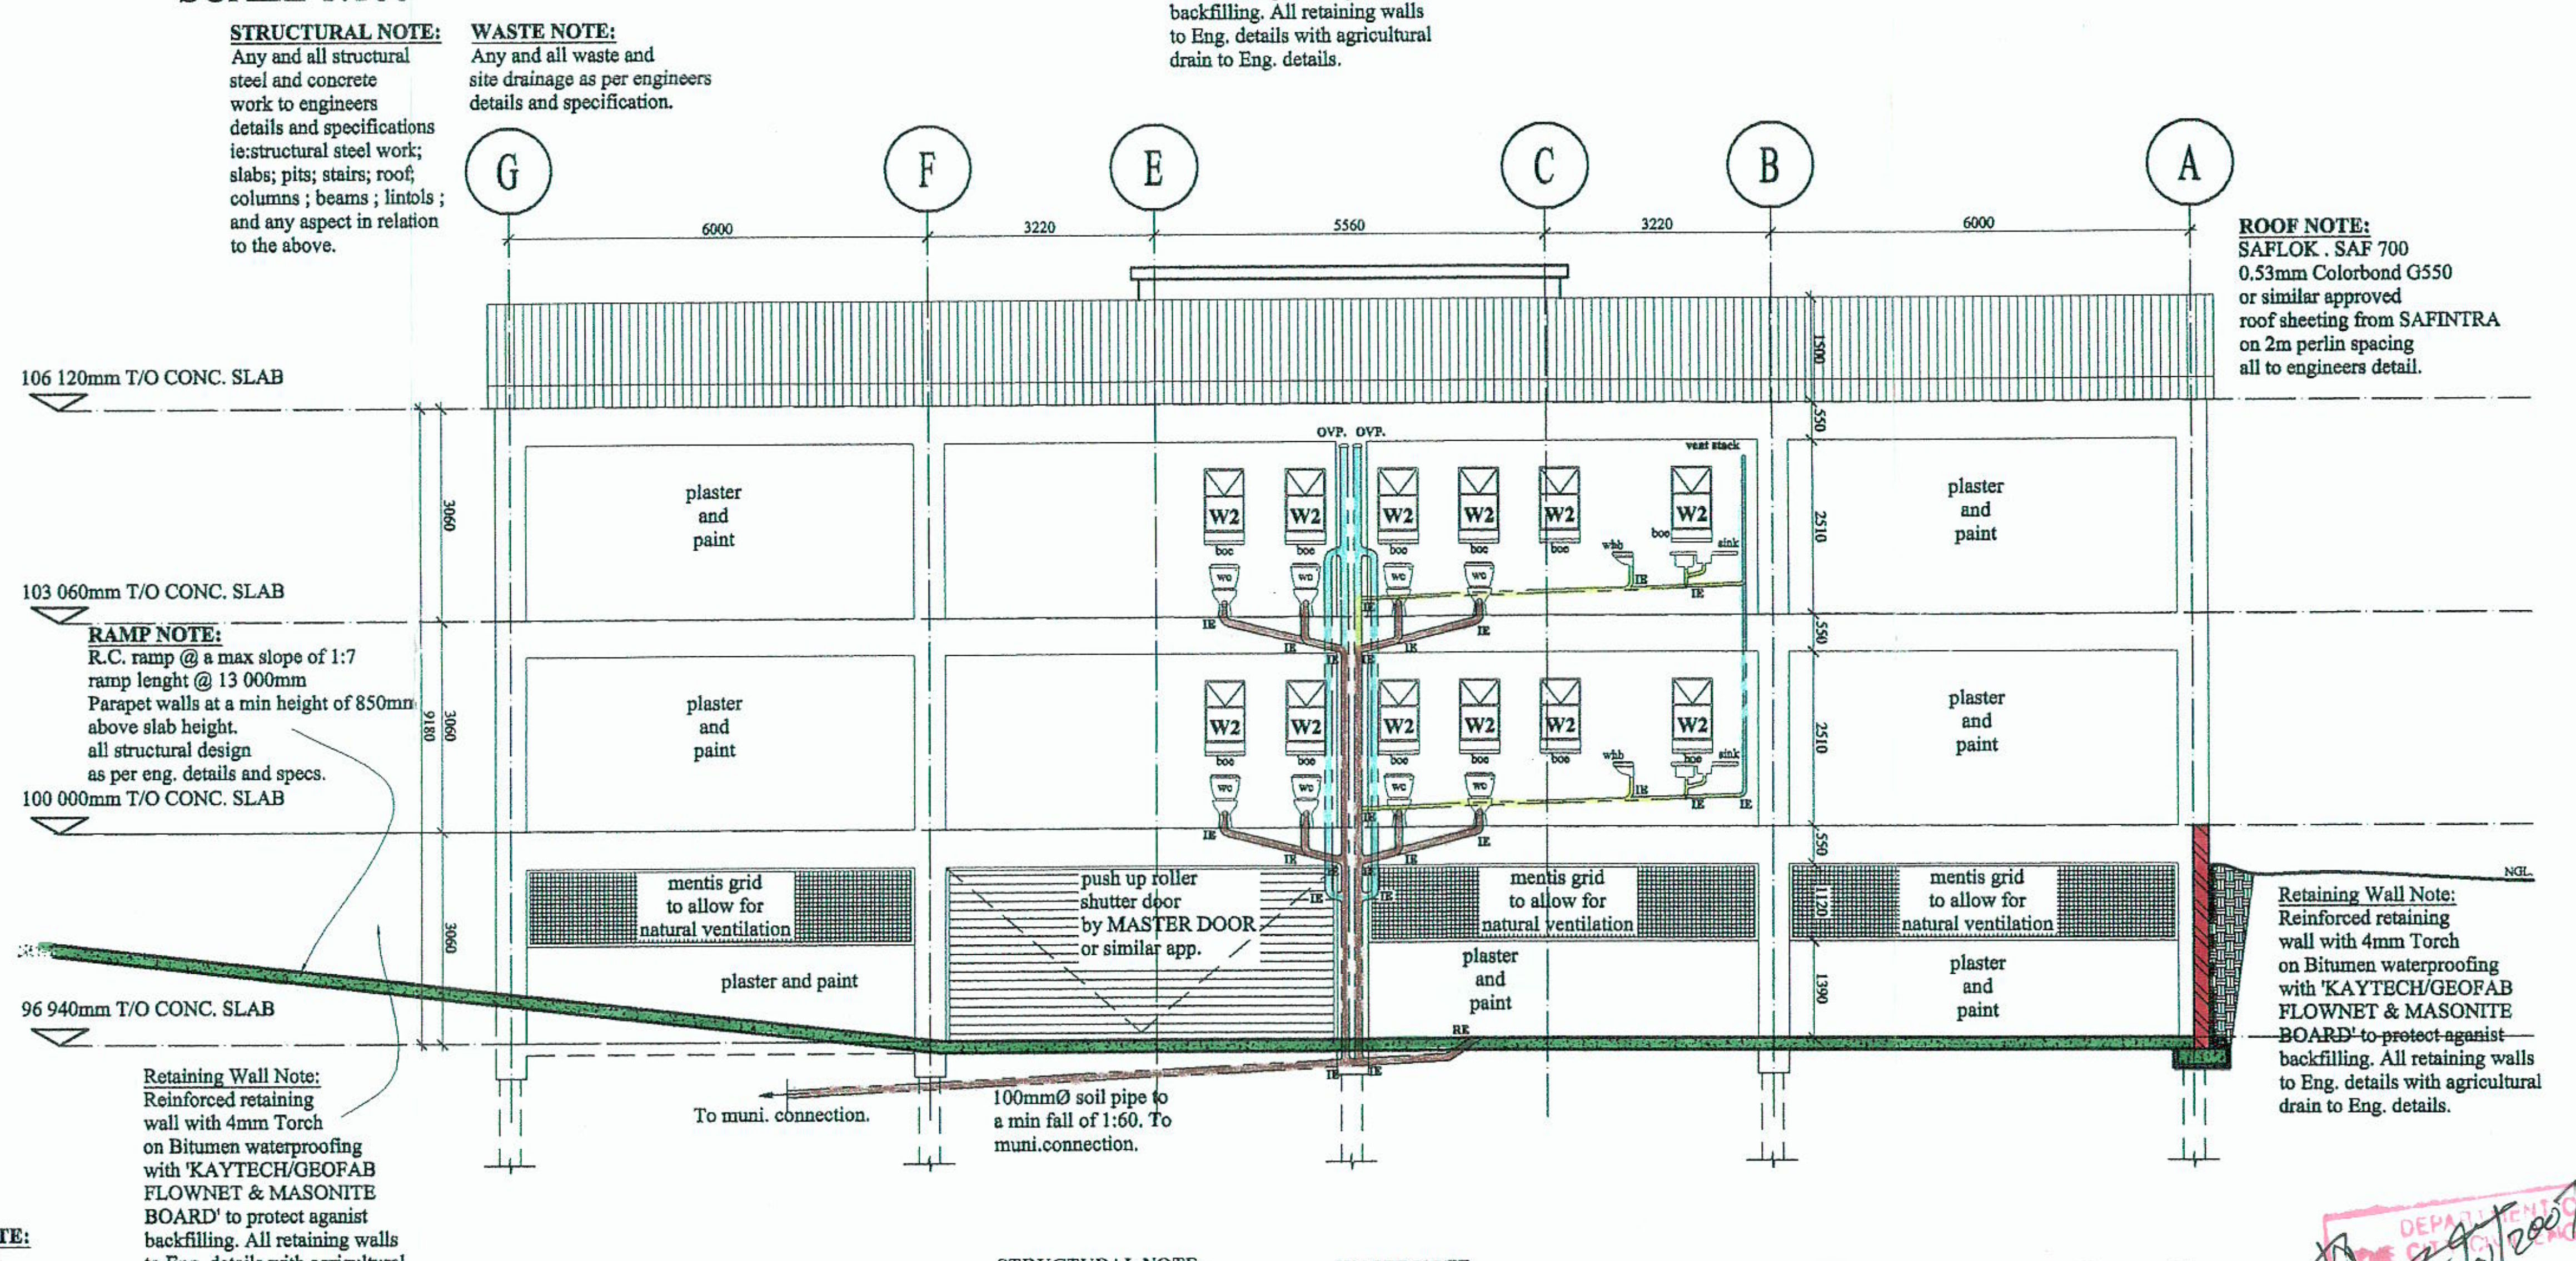
STRUCTURAL NOTE:
Any and all structural steel and concrete work to engineers details and specifications ie:structural steel work; slabs; pits; stairs; roof; columns ; beams ; lintols ; and any aspect in relation to the above.
WASTE NOTE:
Any and all waste and site drainage as per engineers details and specification.
G
F
E
C
B
A
6000
3220
5560
3220
6000
ROOF NOTE:
SAFLOK . SAF 700
0.53mm Colorbond G550 or similar approved roof sheeting from SAFINTRA on 2m perlin spacing all to engineers detail.
106 120mm T/O CONC. SLAB
103 060mm T/O CONC. SLAB
100 000mm T/O CONC. SLAB
96 940mm T/O CONC. SLAB
RAMP NOTE:
R.C. ramp @ a max slope of 1:7 ramp lenght @ 13 000mm Parapet walls at a min height of 850mm above slab height. all structural design as per eng. details and specs.
plaster and paint
W2
mentis grid to allow for natural ventilation
push up roller shutter door by MASTER DOOR or similar app.
To muni. connection.
100mmØ soil pipe to a min fall of 1:60. To muni.connection.
Retaining Wall Note: Reinforced retaining wall with 4mm Torch on Bitumen waterproofing with 'KAYTECH/GEOFAB FLOWNET & MASONITE BOARD' to protect aganist backfilling. All retaining walls to Eng. details with agricultural drain to Eng. details.

SOUTH ELEVATION

SCALE 1:100

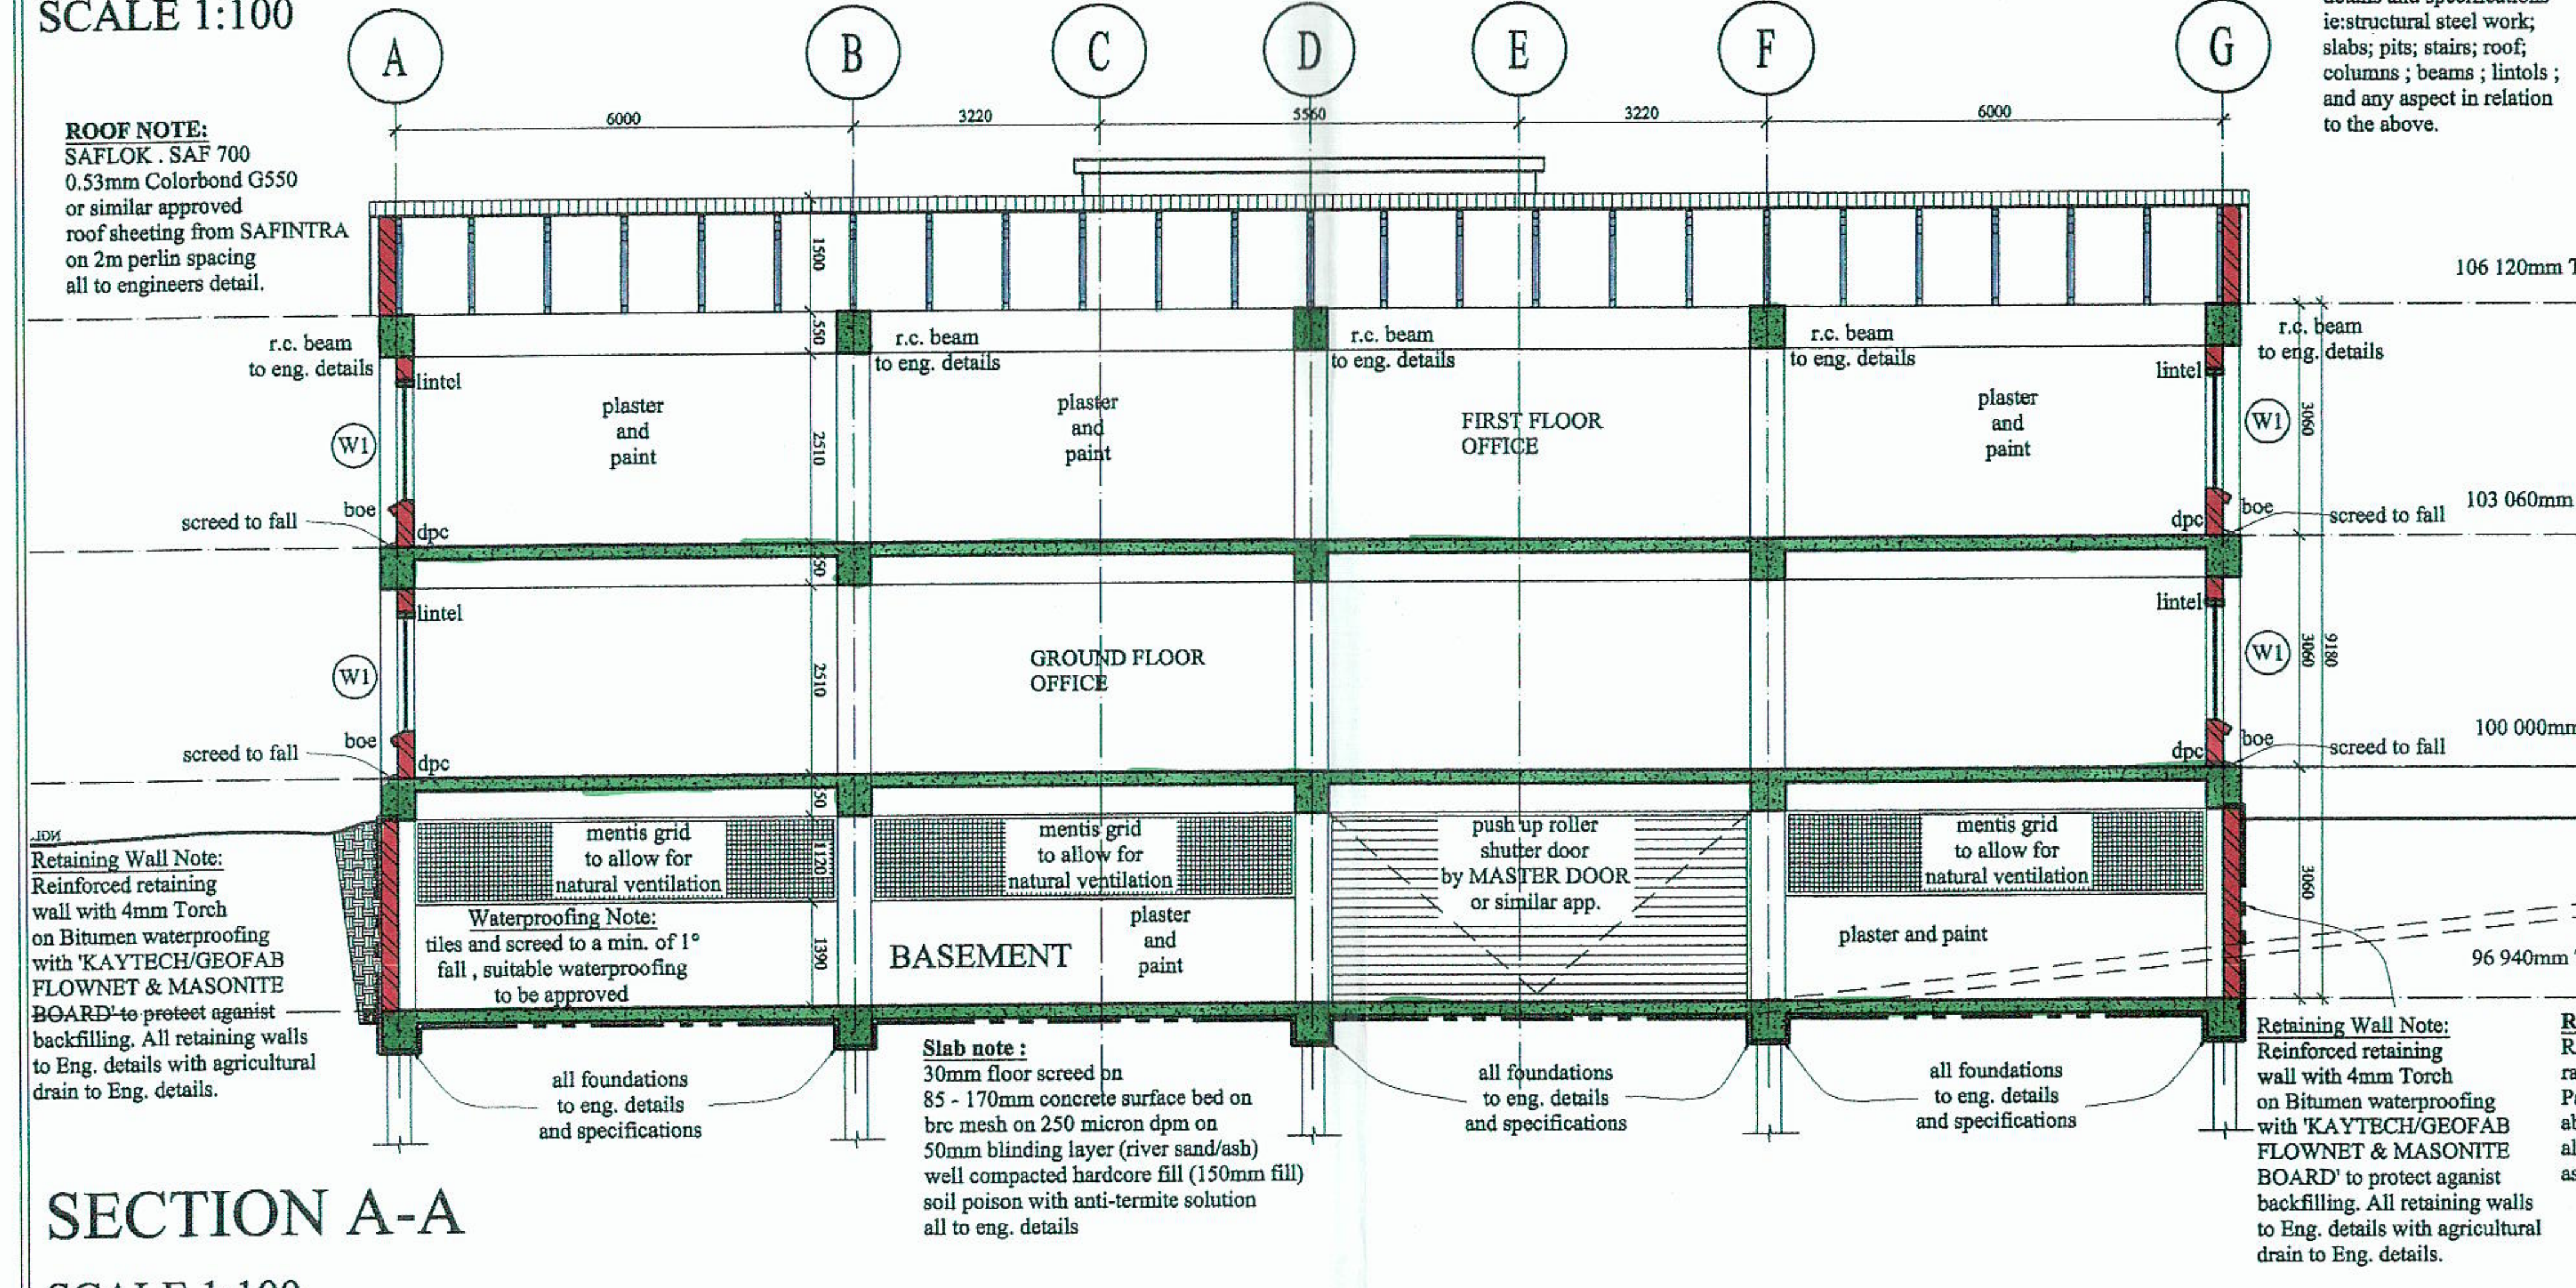
ROOF NOTE:
SAFLOK . SAF 700
0.53mm Colorbond G550 or similar approved roof sheeting from SAFINTRA on 2m perlin spacing all to engineers detail.
A
B
C
D
E
F
G
6000
3220
5560
3220
6000
r.c. beam to eng. details
lintol
W1
screed to fall
dpc
boe
plaster and paint
FIRST FLOOR OFFICE
GROUND FLOOR OFFICE
BASEMENT
103 060mm T/O CONC. SLAB
100 000mm T/O CONC. SLAB
96 940mm T/O CONC. SLAB
mentis grid to allow for natural ventilation
push up roller shutter door by MASTER DOOR or similar app.
Waterproofing Note: tiles and screed to a min. of 1° fall , suitable waterproofing to be approved
Slab note : 30mm floor screed on 85 - 170mm concrete surface bed on brc mesh on 250 micron dpm on 50mm blinding layer (river sand/ash) well compacted hardcore fill (150mm fill) soil poison with anti-termite solution all to eng. details
all foundations to eng. details and specifications
Retaining Wall Note: Reinforced retaining wall with 4mm Torch on Bitumen waterproofing with 'KAYTECH/GEOFAB FLOWNET & MASONITE BOARD' to protect aganist backfilling. All retaining walls to Eng. details with agricultural drain to Eng. details.
RAMP NOTE: R.C. ramp @ a max slope of 1:7 ramp lenght @ 13 000mm Parapet walls at a min height of 850mm above slab height. all structural design as per eng. details and specs.

SECTION A-A

SCALE 1:100

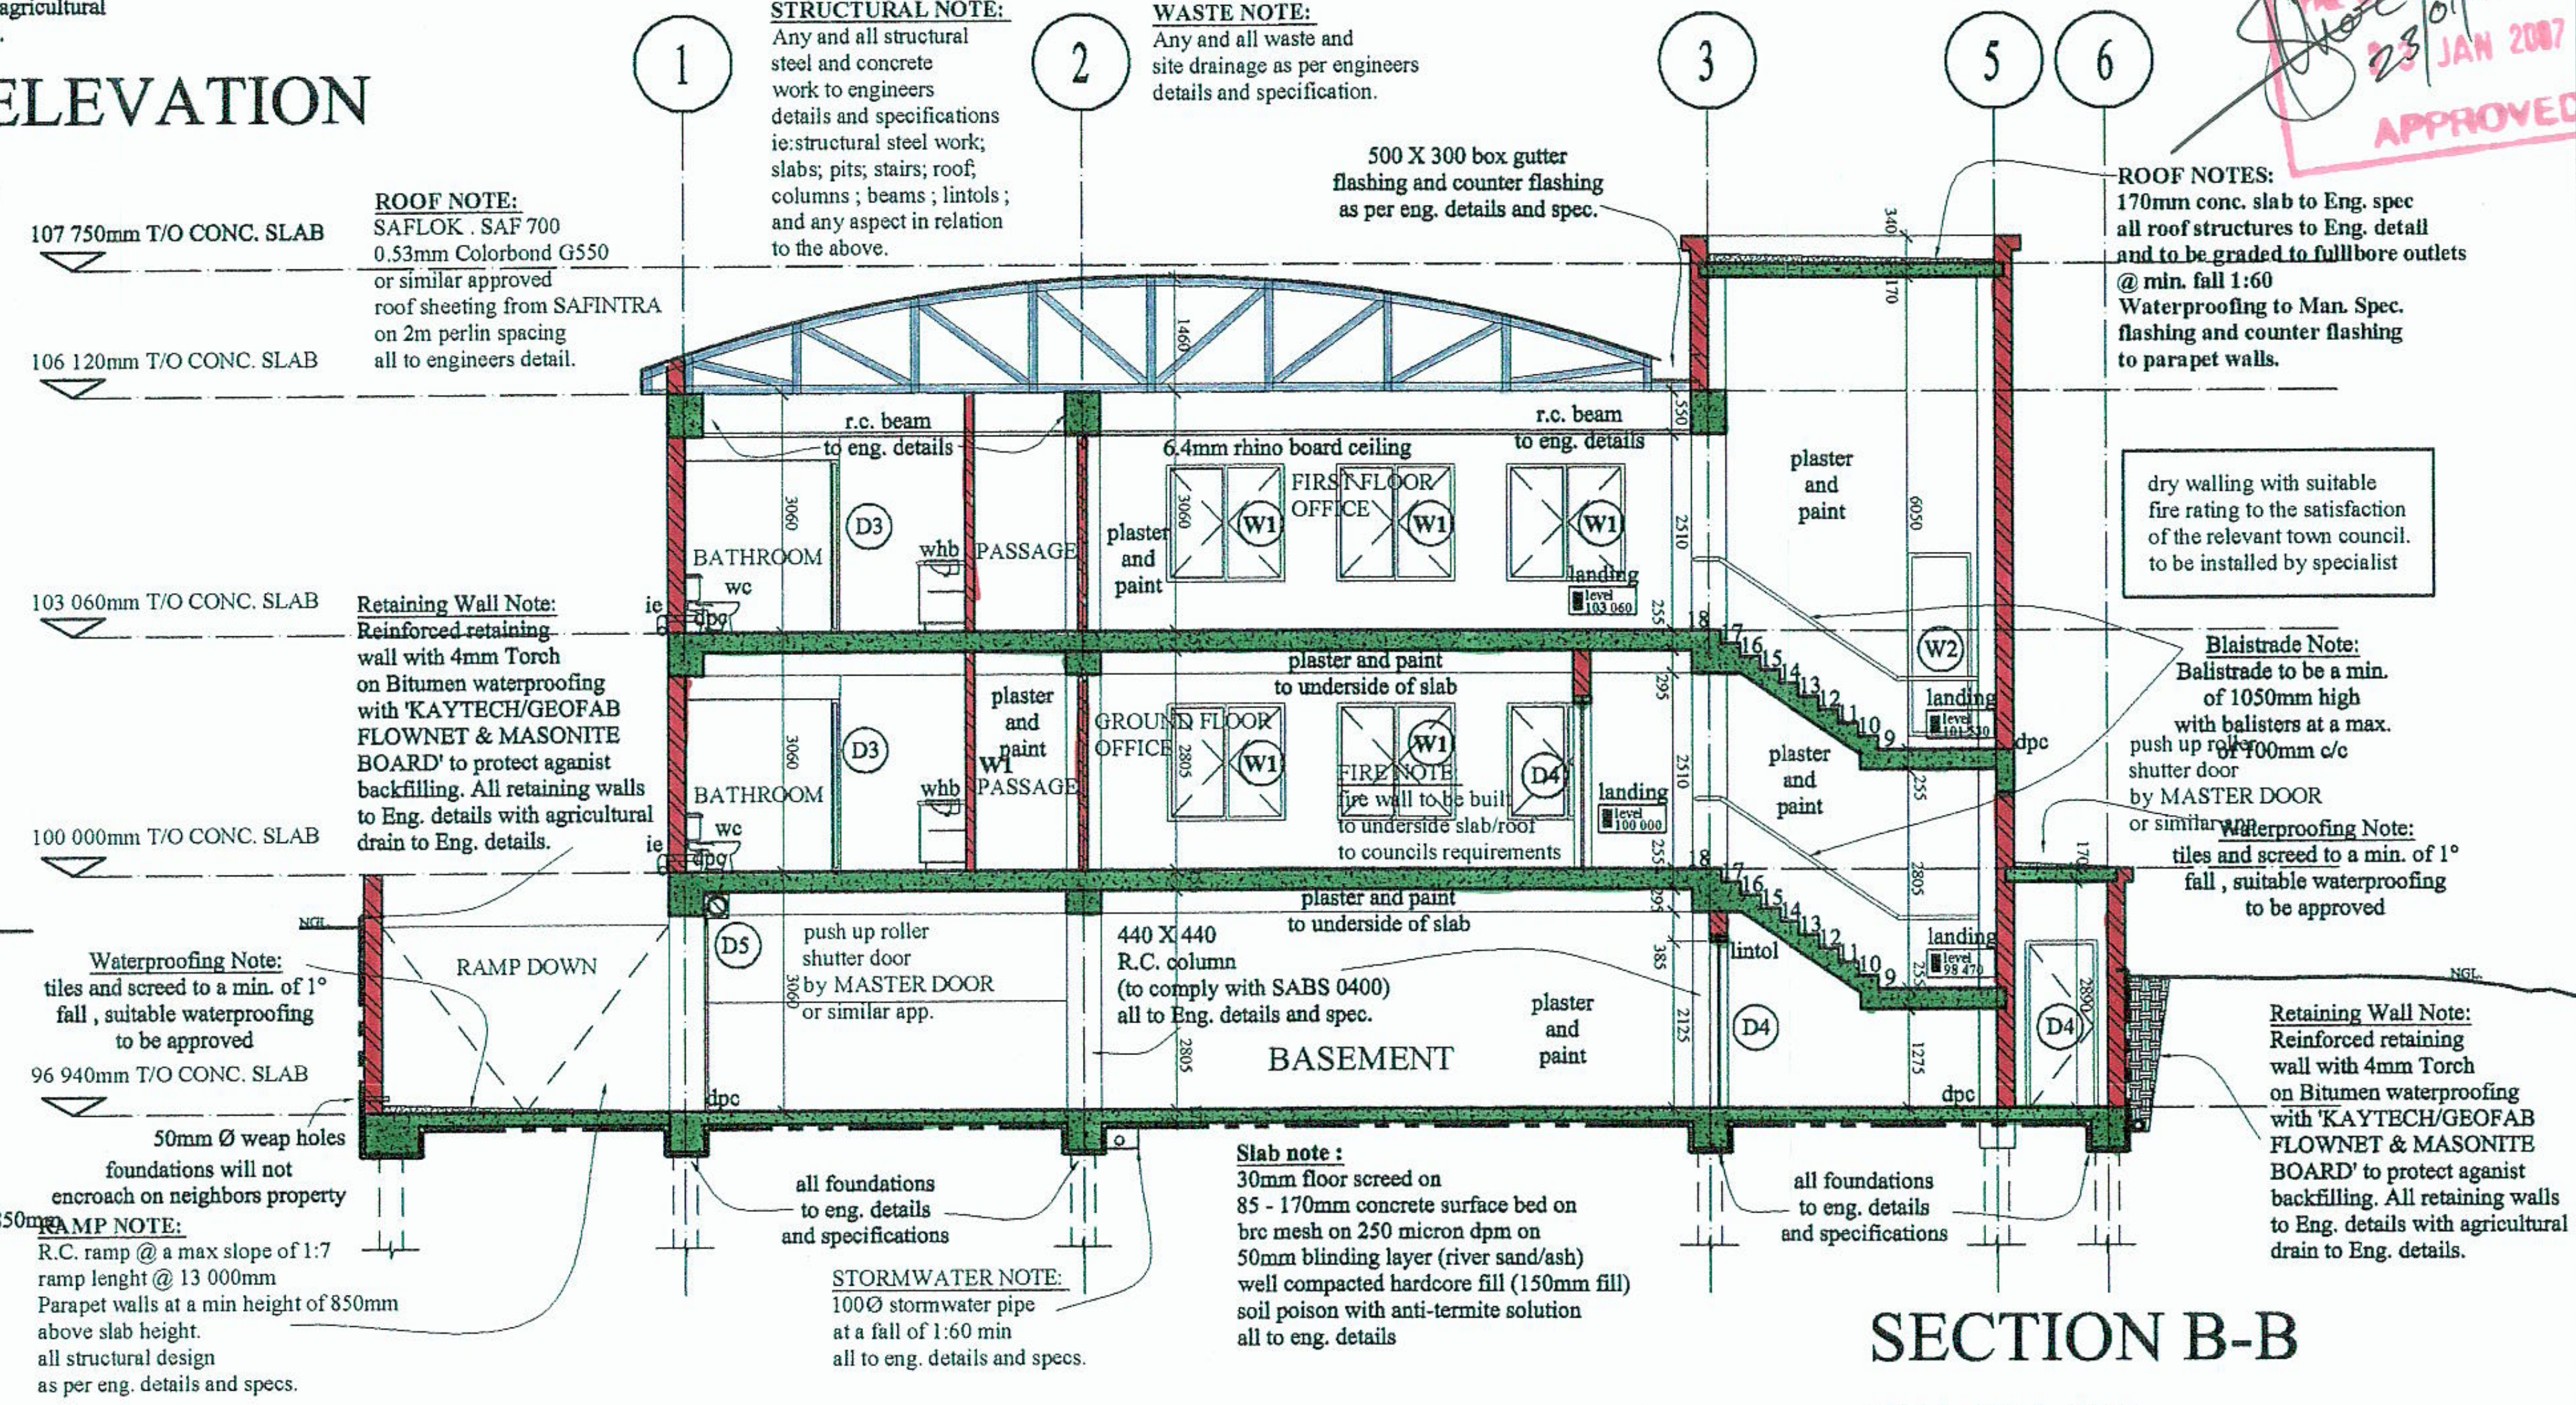
STRUCTURAL NOTE:
Any and all structural steel and concrete work to engineers details and specifications ie:structural steel work; slabs; pits; stairs; roof; columns ; beams ; lintols ; and any aspect in relation to the above.
WASTE NOTE:
Any and all waste and site drainage as per engineers details and specification.
1
2
3
5
6
ROOF NOTE:
SAFLOK . SAF 700
0.53mm Colorbond G550 or similar approved roof sheeting from SAFINTRA on 2m perlin spacing all to engineers detail.
500 X 300 box gutter flashing and counter flashing as per eng. details and spec.
ROOF NOTES:
170mm conc. slab to Eng. spec
all roof structures to Eng. detail
and to be graded to fullbore outlets
@ min. fall 1:60
Waterproofing to Man. Spec.
flashing and counter flashing
to parapet walls.
107 750mm T/O CONC. SLAB
106 120mm T/O CONC. SLAB
103 060mm T/O CONC. SLAB
100 000mm T/O CONC. SLAB
96 940mm T/O CONC. SLAB
6.4mm rhino board ceiling
FIRST FLOOR OFFICE
GROUND FLOOR OFFICE
BATHROOM
PASSAGE
BASEMENT
RAMP DOWN
dry walling with suitable fire rating to the satisfaction of the relevant town council. to be installed by specialist
Blaistrade Note: Balistrade to be a min. of 1050mm high with balisters at a max. of 100mm c/c
push up roller shutter door by MASTER DOOR or similar app.
440 X 440 R.C. column (to comply with SABS 0400) all to Eng. details and spec.
FIRE NOTE: fire wall to be built to underside of slab to councils requirements
Waterproofing Note: tiles and screed to a min. of 1° fall , suitable waterproofing to be approved
Slab note : 30mm floor screed on 85 - 170mm concrete surface bed on brc mesh on 250 micron dpm on 50mm blinding layer (river sand/ash) well compacted hardcore fill (150mm fill) soil poison with anti-termite solution all to eng. details
all foundations to eng. details and specifications
50mm Ø weap holes
foundations will not encroach on neighbors property
RAMP NOTE: R.C. ramp @ a max slope of 1:7 ramp lenght @ 13 000mm Parapet walls at a min height of 850mm above slab height. all structural design as per eng. details and specs.
STORMWATER NOTE: 100Ø stormwater pipe at a fall of 1:60 min all to eng. details and specs.
Retaining Wall Note: Reinforced retaining wall with 4mm Torch on Bitumen waterproofing with 'KAYTECH/GEOFAB FLOWNET & MASONITE BOARD' to protect aganist backfilling. All retaining walls to Eng. details with agricultural drain to Eng. details.

SECTION B-B

SCALE 1:100

DEPARTMENT OF CIVIL ENGINEERING
23 JAN 2007
APPROVED
23/01/2007

Insight
ARCHITECTURAL DESIGNS

98 RONALD ROAD
LINBRO PARK
SANDTON
2145

Tel: (+2711) 608 1813

PROJECT :
**PROPOSED NEW OFFICE
ON ERF: 21 / 1577
BEDFORDVIEW EXT 328**

DRAWING :
**SECTIONS AND
ELEVATIONS**

DATE : **20/06/2006**

DRAWN BY :

ISSUED : **P. VERVERIS**

PROJ. N0. : **001-BVO-04082005**

DRWG. N0. : **300806 BVO-005**

REVISIONS :

REV.	DESCRIPTION	DATE.
	○	01
	○	02
	○	
	○	03
	○	04
	○	05

The approval of this plan does not override the conditions of any restriction which may be applicable on this erf or the exemption from the liability to ensure that the building be designed, erected, completed and used in accordance with the provisions of Act 103 of 1977.

No building may be used or occupied without a certificate of Occupancy being issued by this Municipality.

The design and erection of all structural work, including roof trusses and wooden floors must be certified by a professional Structural Engineer.

This plan is only valid for one year from the date of approval.

CLIENTS SIGNATURE :

DATE :

ENGINEERS SIGNATURE :

DATE : No 740379

NOTES :

All work to be carried out in strict accordance with the ARCHITECTS instructions.

Top of foundations to be a minimum of 300mm below N.G.L. Vertical DPC to all changes in level's.

Reinforced concrete slab to ENGINEER'S details and specifications.

Waterproofing by specialists.
S.A.B.S. approved bitumen based waterproofing laid with required upturns, onto min. 25mm thick screed.
Acrylic based waterproofing to parapet walls & uprisers

All plumbing and drainage installation of sanitary fittings to comply with N.B.R. S.A.B.S. 0400-1990 part P and all relevant local authority by-laws, regulations and requirments.

I.E.'s and R.E.'s to all bends, junctions and changes in direction of soil and waste pipe's.

R.E.'s to all runs exceeding 24m in length.

100Ø GSP. minimum fall 1:60.
100Ø GSP. maximum fall 1:5.

Soil pipes under building's to be encassed in 300mm concrete all round.

All waste fittings to be fitted with re-seal traps.

Staircase specifications to comply with S.A.B.S. 0400-1990 part M.
Balustrades to be minimum 1000mm high.
Balustrades to be minimum 100mm apart.
Risers to be maximum 200mm high.
Treads to be minimum 250mm wide.

THIS DRAWING IS COPYRIGHT.
This is an AUTO CAD generated drawing.
Drawing must not be scaled.
Figured dimensions only may be used.
Dimensions should be verified on site
and any discrepancies reported to
the ARCHITECTS immediately.