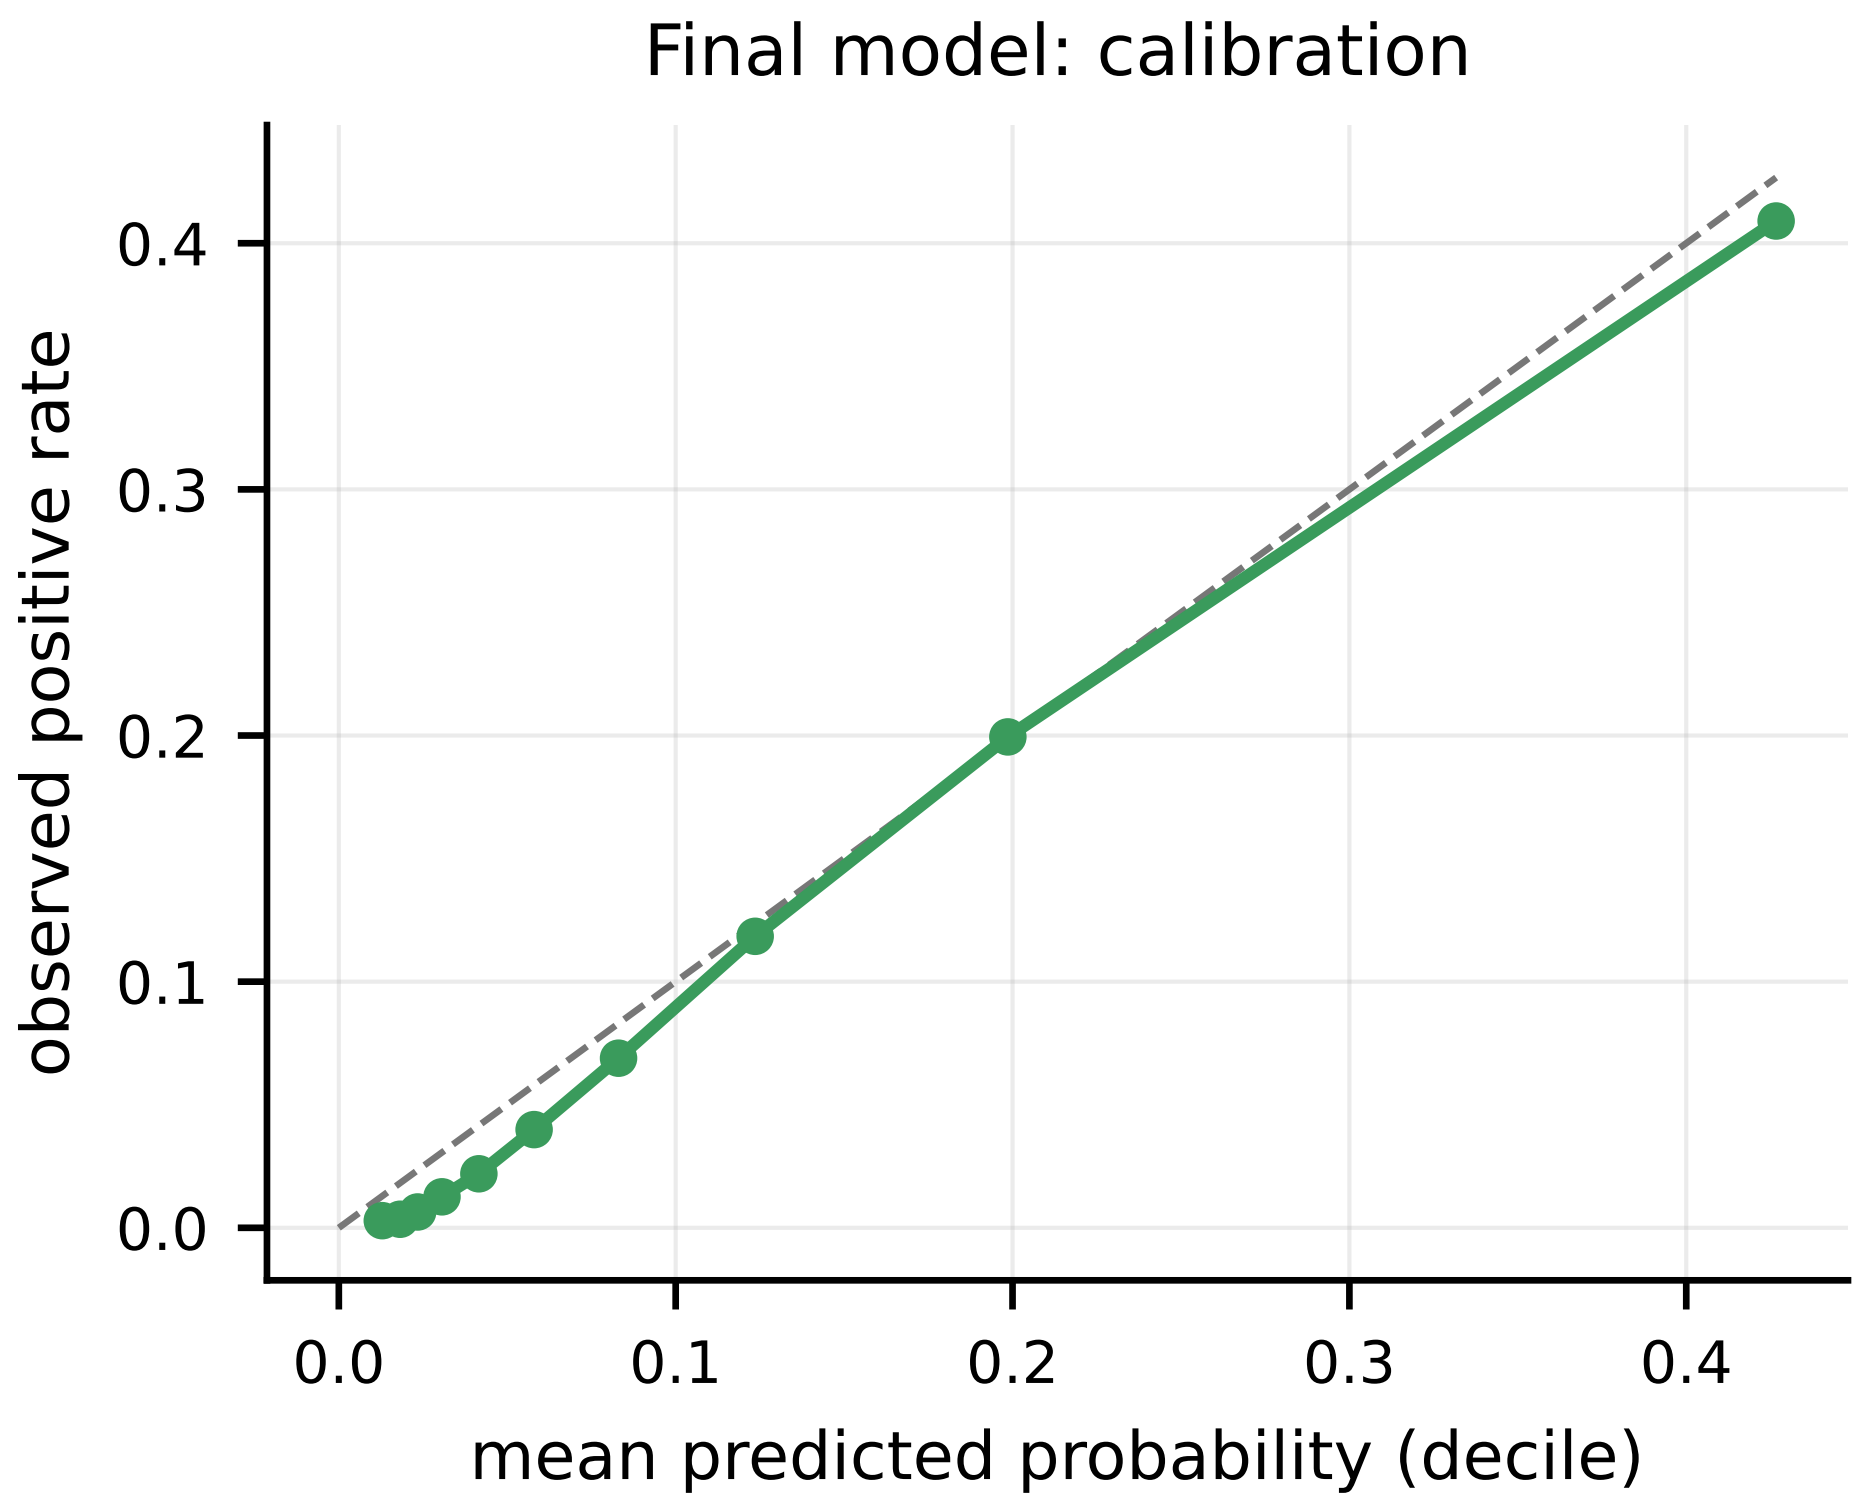
Final model: calibration
observed positive rate
0.0
0.1
0.2
0.3
0.4
0.0
0.1
0.2
0.3
0.4
mean predicted probability (decile)