



বাংলাদেশ স্ট্যান্ডার্ডস এন্ড টেস্টিং ইনস্টিটিউশন

শিল্প মন্ত্রণালয়
প্রধান কার্যালয়, ঢাকা



স্ট্যান্ডার্ড চিহ্ন ব্যবহারের লাইসেন্স

স্মারক নং: ৩৬.০৫.০০০০.৩০২.৪৬.০৩৯.২৪

ট্রাকিং নং: CM-LI-20240827-0005

লাইসেন্স নম্বর: DHK-CM-0000000005032

ইস্যু তারিখ: ২৭-০৮-২০২৪ খ্রিঃ

ইনস্টিটিউশন এতদ্বারা ইলেকট্রো ম্যাক অটোমেশন এন্ড ইঞ্জিনিয়ারিং লিঃ, ১ নং মহাকাশ রোড, উত্তর সানারপাড়, ডেমরা, ঢাকা এর মোঃ সিরাজুল ইসলাম কে নিম্নের ছকে বর্ণিত পণ্য, দ্রব্য, সেবা বা প্রক্রিয়ায় ইনস্টিটিউশন কর্তৃক নির্ধারিত স্ট্যান্ডার্ড মার্ক ব্যবহার করিবার লাইসেন্স প্রদান করা হইল।

পণ্য বা দ্রব্যের মোড়কে ইনস্টিটিউশন কর্তৃক প্রদত্ত মেশিন রিডেবল কোড ব্যবহার করিতে হইবে।

লাইসেন্সধারী লাইসেন্স এর শর্তাবলি প্রতিপালন করিবেন।

লাইসেন্সটির মেয়াদ হইবে ২২-০৮-২০২৪ তারিখ হইতে ৩০-০৬-২০২৭ তারিখ পর্যন্ত।

মেয়াদ উত্তীর্ণের ৩ (তিন) মাস পূর্বে লাইসেন্স নবায়নের জন্য আবেদন করিতে হইবে।

পণ্য, দ্রব্য, সেবা বা প্রক্রিয়ার বিবরণ

স্ট্যান্ডার্ড মার্ক	পণ্য, দ্রব্য, সেবা বা প্রক্রিয়া	সংশ্লিষ্ট বাংলাদেশ স্ট্যান্ডার্ড (বিডিএস) নম্বর
	পণ্য: পাওয়ার ট্রান্সফরমারস ব্র্যান্ড ও পণ্যের বিবরণ সংযুক্ত তালিকায়।	বিডিএস আইইসি ৬০০৭৬ (পার্ট-১):২০১৬

লাইসেন্স ফি'র বিবরণ

ইউনিট	ইউনিট প্রতি লাইসেন্স ফি'র হার	পরিশোধের প্রকৃতি
প্রতি একশত টাকা এক্স ফ্যাক্টরি মূল্য (মূল্য সংযোজন কর ব্যতীত কারখানা বা প্রতিষ্ঠানের উৎপাদিত বা বাজারজাতকৃত দ্রব্যের বিক্রয়মূল্য)	০.১০%	(ক) স্ট্যান্ডার্ড মার্ক ব্যবহারের জন্য নির্ধারিত হার অনুযায়ী বাৎসরিক লাইসেন্স ফি অগ্রিম পরিশোধ করা হইয়াছে; (খ) বাৎসরিক উৎপাদনের ভিত্তিতে হার অনুযায়ী অতিরিক্ত ফি প্রযোজ্য হইলে মেয়াদান্তে উহাও পরিশোধ করিতে হইবে।

বাংলাদেশ স্ট্যান্ডার্ডস এন্ড টেস্টিং ইনস্টিটিউশন এর পক্ষে



মোঃ নূরুল আমিন

পরিচালক (সিএম)


ক্ষমতাপ্রাপ্ত কর্মকর্তার স্বাক্ষর ও সিল



লাইসেন্সের বরাবরে পরীক্ষণ ও পরিদর্শন কর্মসূচিসহ অন্যান্য শর্তাবলি

- ১। সংশ্লিষ্ট পণ্যের/প্রক্রিয়ার গুণগত মান সংরক্ষণ, নিরীক্ষার যন্ত্রপাতি কারখানায় স্থাপন, পরীক্ষা নিরীক্ষার ফলাফল এবং প্রতি কর্মদিবসের উৎপাদন যথাযথভাবে খাতায় লিপিবদ্ধ করিতে হইবে।
- ২। নিরীক্ষার ফলাফলের উপর ভিত্তি করিয়া শুধুমাত্র সংশ্লিষ্ট বাংলাদেশ মানের সমকক্ষ উৎপাদিত/প্রক্রিয়াজাত পণ্যের মোড়কে বিএসটিআই গুণগত মানচিহ্ন পণ্যভিত্তিক কিউ আর কোড ব্যবহার করিতে হইবে।
- ৩। উৎপাদিত/প্রক্রিয়াজাত পণ্যের গুণগত মানের নিশ্চয়তা বিধানকল্পে অত্র প্রতিষ্ঠান বৎসরে একাধিকবার আকস্মিকভাবে আপনার কারখানা পরিদর্শন, নমুনা সংগ্রহ ও পরীক্ষা-নিরীক্ষা করিতে পারিবে।
- ৪। লাইসেন্সের মেয়াদ উত্তীর্ণের ০৩(তিন) মাস পূর্বে নবায়নের জন্য দরখাস্ত করিতে হইবে এবং মেয়াদান্তে বাৎসরিক প্রকৃত উৎপাদনের হিসাব দাখিল করিতে হইবে।
- ৫। উৎপাদন প্রক্রিয়া স্বাস্থ্যসম্মত/ বিপদমুক্ত বিধি, যাহা খাদ্য/ অন্যান্য পণ্য তৈরির জন্য অপরিহার্য তাহা যথাযথভাবে পালন করিতে হইবে।
- ৬। উৎপাদিত/ প্রক্রিয়াজাত পণ্যের গায়ে/ মোড়কে/ লেবেলে উৎপাদনকারীর প্রতিষ্ঠানের নাম ও ঠিকানা, বাংলাদেশ স্ট্যান্ডার্ডস ওজন এবং পরিমাপ (পণ্য সামগ্রী মোড়কজাতকরণ) বিধিমালা, ২০২১-এ নির্দেশিত প্রযোজ্য সকল তথ্য এবং মেট্রিক পদ্ধতিতে পণ্যের পরিমাণ, ওজন/ সংখ্যা, সর্বোচ্চ খুচরা মূল্য, উৎপাদনের তারিখ, ব্যবহারের সময়সীমা এবং বিএসটিআই গুণগতমান চিহ্ন সঠিকভাবে লিপিবদ্ধ থাকিতে হইবে।
- ৭। গুণগতমানের বিচ্যুতি ঘটিলে প্রদান কৃত/নবায়িত সিএম লাইসেন্স প্রত্যাহারের ক্ষমতা অত্র প্রতিষ্ঠানের থাকিবে।
- ৮। লাইসেন্সের মেয়াদ উত্তীর্ণ হওয়ার পূর্বে লাইসেন্স গ্রহণকারী যদি লাইসেন্স নবায়নের জন্য আবেদন না করেন, তবে তাহার লাইসেন্স মেয়াদ উত্তীর্ণ হইবার সাথে সাথে তাহা বাতিল বলিয়া গণ্য হইবে।
- ৯। লাইসেন্স সংশ্লিষ্ট যে কোনো তথ্য সংগ্রহের ক্ষমতা অত্র প্রতিষ্ঠানের থাকিবে।

বাংলাদেশ স্ট্যান্ডার্ডস এন্ড টেস্টিং ইনস্টিটিউশন এর পক্ষে



মোঃ নূরুল আমিন
পরিচালক (সিএম)

ইনস্টিটিউশন এর সীলমোহর



লাইসেন্স নম্বর: DHK-CM-0000000005032

প্রতিষ্ঠানের নাম: ইলেকট্রো ম্যাক অটোমেশন এন্ড ইঞ্জিনিয়ারিং লিঃ।

কারখানার ঠিকানা: ১ নং মহাকাশ রোড, উত্তর সানারপাড়, ডেমরা, ঢাকা।

পণ্য: পাওয়ার ট্রান্সফরমারস।

ক্রমিক নং	ব্রান্ড	টাইপ/সাইজ/ গ্রেড/ক্রেডার/ভ্যারিয়েন্ট এর বিবরণ	পণ্যের ছবি
১	Electro Mech	EM-24.109, 2000 KVA, , Phase: 3, Frequency: 50 Hz HT: 11000 V, LT: 415/240 V, Rated Current: 104.97 (HT) & 2782.41 A (LT), Cooling Type: ONAN, Oil Temperature rise in Oil :60 C, Temperature rise in Coil: 65 C, Percentage Of Impedance: 6, Vector Group	

বাংলাদেশ স্ট্যান্ডার্ডস এন্ড টেস্টিং ইনস্টিটিউশন এর পক্ষে



মোঃ নূরুল আমিন

পরিচালক (সিএম)

ইনস্টিটিউশন এর সীলমোহর



বাংলাদেশ স্ট্যান্ডার্ডস এন্ড টেস্টিং ইনস্টিটিউশন


Company Name: ইলেকট্রো ম্যাক অটোমেশন এন্ড ইঞ্জিনিয়ারিং লিঃ

License No: DHK-CM-0000000005032



Brand: Electro Mech

Variant: EM-24.109, 2000 KVA, , Phase: 3,
Frequency: 50 Hz HT: 11000 V, LT: 415/240
V, Rated Current: 104.97 (HT) & 2782.41 A
(LT), Cooling Type: ONAN, Oil Temperature
rise in Oil :60 C, Temperature rise in Coil:
65 C, Percentage Of Impedance: 6, Vector
Group

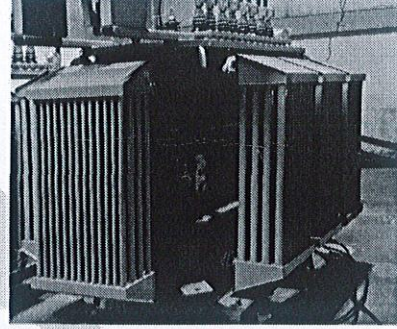

Brand: Electro Mech

Variant: EM-24.109, 2000 KVA, , Phase: 3,
Frequency: 50 Hz HT: 11000 V, LT: 415/240
V, Rated Current: 104.97 (HT) & 2782.41 A
(LT), Cooling Type: ONAN, Oil Temperature
rise in Oil :60 C, Temperature rise in Coil:
65 C, Percentage Of Impedance: 6, Vector
Group

BSTI



BANGLADESH STANDARDS AND TESTING INSTITUTION

MAAN BHABAN

(Physical Testing Wing)

116/A, Tejgaon Industrial Area, Dhaka - 1208.



TEST REPORT

Test Report No. 43724(1)

Phone : 02-55030058

Customer's Reference No : 36.05.0000.302.46.039.24.2024	Lab. Reference No : 36.05.0000.403.15.001.22
Date of receipt of sample : 04/08/2024	Date of testing : 11/08/2024 - 19/08/2024
Identification of test items : EE/575/24-25 Power Transformer Serial No. - EM-24.109, 2000kVA, Phase: 03, Frequency: 50Hz HT: 11000V, LT: 415/240V, Rated Current: 104.97A(HT) & 2782.41A(LT) Cooling type : ONAN, Oil Temperature Rise in Oil: 60°C Temperature Rise in Coil: 65°C, Percentage of Impedance: 6 Full Load Loss: 20000W at 75°C, No Load Loss: 2400W Vector Group: Dyn11, Insulation Level: Class A Tapping: +5% , -5%, Brand: Electro Mech (Stated)	Sampling Plan : Not mentioned
Manufacturer: ইলেকট্রো ম্যাক অটোমেশন এন্ড ইঞ্জিনিয়ারিং লি: , ১ নং, মহাকাশ রোড, উত্তর সানার পাড়া, ডেমরা, ঢাকা।	Test method used : BDS IEC 60076(1):2016
Name and address of customers : Director (CM), BSTI, 116/A, Tejgaon I/A, Dhaka-1208.	

Condition of the test item : The sample was in good condition and received duly sealed & signed.

Sl. No.	Description of tests	Standard limits	Test results	Remarks
1.	High voltage test :			
	a) Bet ⁿ HT to body at 28 KV for 01 minute	Should Withstand	Withstood	Passed
	b) Bet ⁿ LT to body at 3.0 KV for 01 minute	Should Withstand	Withstood	Passed
2.	Insulation resistance in Mega-ohm :			
	a) High Tension (HT) side to Earth	Min ^m : 2.0	2000 ⁺	Passed
	b) Low Tension (LT) side to Earth	Min ^m : 2.0	2000 ⁺	Passed
	c) Low Tension (LT) side to High Tension (HT)	Min ^m : 2.0	2000 ⁺	Passed
3.	Winding resistance in mili-ohm :			
	a) HT(Phase to Phase) Resistance	Max ^m : 756.00	720.0	Passed
	b) LT(Phase to Phase) Resistance	Max ^m : 0.37	0.35	Passed
	c) LT(Phase to Neutral) Resistance	Max ^m : 0.18	0.17	Passed
4.	No load loss at 240V in watt	Max ^m : 2760.00	2380.0	Passed
5.	No load Current at 415V in Ampere	Max ^m : 14.95	11.5	Passed

Mabedin
20.08.2024
Tested by
Engr. Md. Minhajul Abedin
Examiner (E & E)
Physical Testing Wing
BSTI, Dhaka

Arif Haque
20.08.2024
Checked by &
Authorized Signatory
Assistant Director (E & E)
Physical Testing Wing
BSTI, Dhaka.

N. B.

- The results reported above pertain only to the sample tested and supplied to the laboratory.
- This report when required to be quoted or reproduced, has to reproduced or quoted in full.
- Reports are not allowed to be used or reproduced for any commercial purpose.
- Any complaint about test report if any should be reported within a month.
- The unspent portion of the samples may be auctioned/disposed off after three months from the date of issue of the said report.



BANGLADESH STANDARDS AND TESTING INSTITUTION
MAAN BHABAN
 (Physical Testing Wing)
 116/A, Tejgaon Industrial Area, Dhaka - 1208.



TEST REPORT

Test Report No. 43724(2)

Phone : 02-55030058

Customer's Reference No : Date of receipt of sample : Identification of test items : Name and address of customer :	Lab. Reference No : Date of testing : Sampling Plan : Test method used : BDS IEC 60076(1):2016
--	---

Condition of the test item :

Sl. No.	Description of tests	Standard limits	Test results	Remarks
6.	Full load loss in watt at 75°C	Max ^m : 23000.00	19604.0	Passed
7.	Total losses in watt	Max ^m : 24640.00	21984.0	Passed
8.	Vector Group Test	Should Dyn11	Dyn11	Passed
9.	Percentage of Impedance Voltage	5.55 - 6.45	6.00	Passed
10.	Turn ratio test at :			
	Tap position - 1	27.02 - 27.30	27.21	Passed
	Tap position - 2	26.37 - 26.63	26.43	Passed
	Tap position - 3	25.71 - 25.97	25.88	Passed
	Tap position - 4	25.05 - 25.31	25.23	Passed
	Tap position - 5	24.39 - 24.63	24.58	Passed

General Remark :

The Sample having lab. Regn no. EE/575/24-25 **conformed** to the requirments of BDS IEC 60076:2016 in respect of the above mentioned tests.

M. Minhajul Abedin
 20.08.2024

Tested by

Engr. Md. Minhajul Abedin
 Examiner (E & E)
 Physical Testing Wing
 BSTI, Dhaka

M. Minhajul Abedin
 20.08.2024

Checked by &
 Authorized Signatory

N. B.

- The results reported above pertain only to the sample tested and supplied to the laboratory.
- This report when required to be quoted or reproduced, has to reproduced or quoted in full.
- Reports are not allowed to be used or reproduced for any commercial purpose.
- Any complaint about test report if any should be reported within a month.
- The unspent portion of the samples may be auctioned/disposed off after three months from the date of issue of the said report.