

Fleet Performance Summary – June 2026

Asset Operations · operating portfolio 1,100 MW

David Chen · 12 July 2026 · OPS-RPT-2026-06

1. Headlines


The fleet produced **136.0 GWh** from wind and solar in June 2026, 0.2 % above budget (135.7 GWh). Best performer against budget was Ostholstein (+9.0 %); weakest was Nordheide (-14.2 %).

Uckermark central inverter INV-07 failed on 2 June and was replaced on 11 June. 61 hours of negative prices in Germany in June.

2. Asset table

Asset	Technology	Actual (GWh)	Budget (GWh)	Variance	Availability
Kestrel Ridge	Onshore wind	11.2	11.1	+0.9 %	97.5 %
Skerrow Moor	Onshore wind	12.8	12.9	-0.8 %	97.3 %
Dunmore Hill	Onshore wind	8.3	8.0	+3.8 %	96.7 %
Glenquey	Onshore wind	7.8	7.4	+5.4 %	98.0 %
Nordheide	Onshore wind	10.9	12.7	-14.2 %	95.9 %
Wesermarsch	Onshore wind	9.2	9.7	-5.2 %	96.0 %
Ostholstein	Onshore wind	9.7	8.9	+9.0 %	96.6 %
Emsland	Onshore wind	12.3	11.6	+6.0 %	96.2 %
Altmark	Onshore wind	13.4	14.1	-5.0 %	96.7 %
Thy Vest	Onshore wind	15.1	15.4	-1.9 %	96.3 %
Ringkøbing	Onshore wind	5.0	4.6	+8.7 %	94.6 %
Uckermark Solar	Solar PV	12.8	11.9	+7.6 %	99.0 %
Lüneburger Heide Solar	Solar PV	7.5	7.4	+1.4 %	99.8 %

Net generation at the point of connection. Budget = P50 per asset, monthly profile.

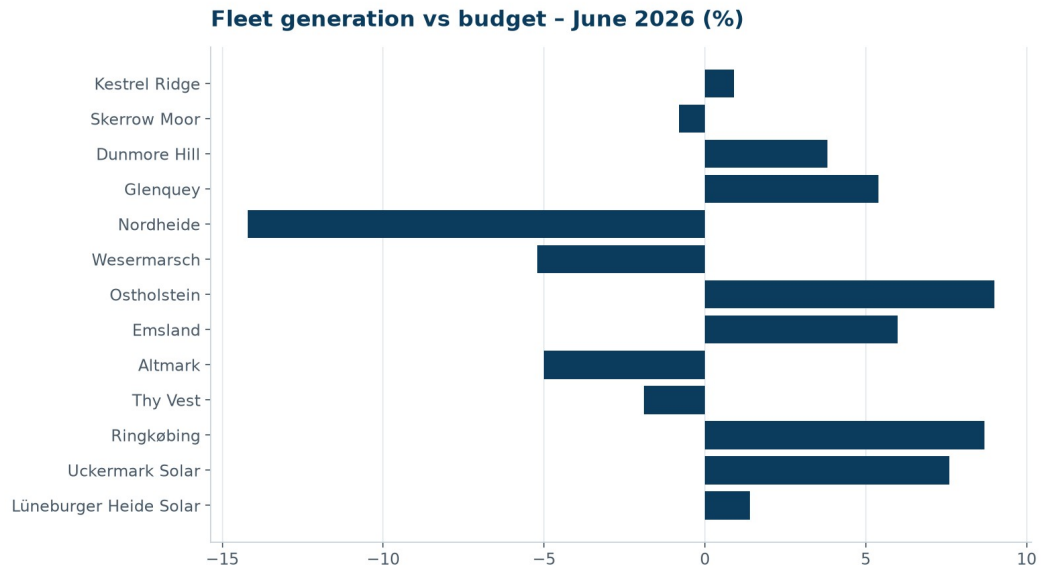

3. Safety

No recordable injuries in operations this month. 12 near misses and 50 safety observations were reported across the operating sites.

4. Actions for next month

- Follow up open warranty items with the OEMs (Skerrow Moor blade bearing seals).
- Close out open corrective work orders older than 30 days at Wesermarsch.
- Prepare O&M readiness steering committee for Harrow Bay.