

Monthly Performance Report – May 2024

Kestrel Ridge Wind Farm (75.6 MW)

David Chen · 09 June 2024 · KR-OPS-RPT-2024-05


1. Summary

Kestrel Ridge generated **12.9 GWh** in May 2024, 9.8 % below the P50 budget of 14.3 GWh. Availability fell to **95.9 %**, below the contract target of 97.0 %. Mean hub-height wind speed of 7.1 m/s was close to the long-term mean (7.3 m/s).

2. Production and key figures

KPI	May 2024	Budget / target	YTD 2024	YTD budget
Net generation (GWh)	12.9	14.3	29.5	30.9
Time-based availability	95.9 %	97.0 %	95.4 %	97.0 %
Capacity factor	22.9 %	25.4 %	26.7 %	–
Mean wind speed at hub height (m/s)	7.1	7.3	–	–

Source: Kestrel Ridge SCADA, revenue meter at 132 kV point of connection. Budget = P50 (2024 post-construction yield assessment).

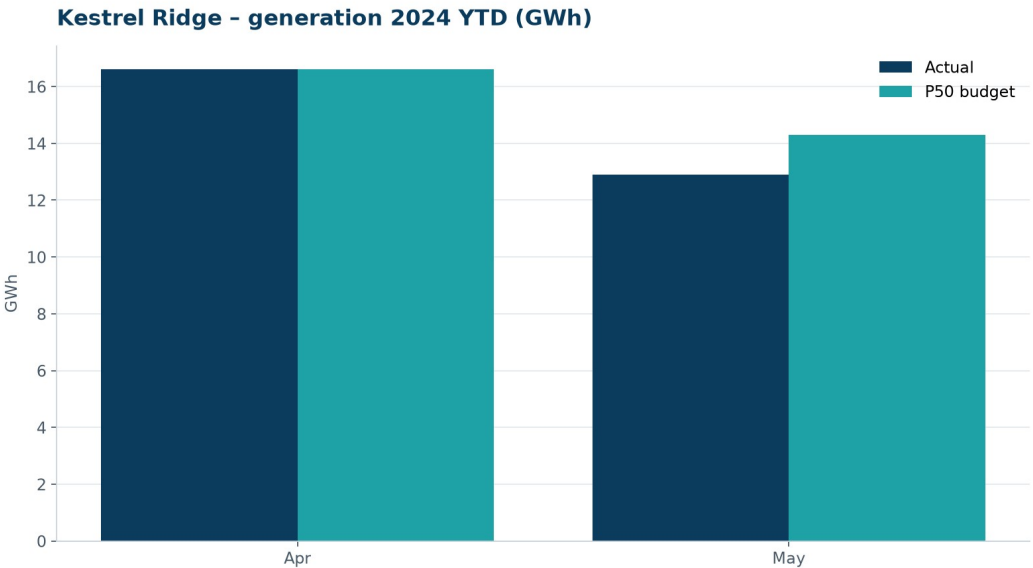

Monthly generation vs. P50 budget, 2024 year to date

3. Availability and downtime

Total turbine downtime attributable to the contractor amounted to 35 turbine-hours for the top events listed below. No grid or force majeure exclusions were claimed this month.

Turbine	Event	Downtime (h)
T-03	main shaft temperature sensor fault	8
T-17	service lift fault – lift locked out,	8

	turbine stopped for rescue cover	
T-15	generator slip ring brush wear alarm	7
T-15	nacelle cooling fan motor failure	7
T-16	service lift fault – lift locked out, turbine stopped for rescue cover	5

Top downtime events of the month (SCADA event log, reviewed with Highline Wind Services).

4. Maintenance

- 20 corrective work orders closed, 3 still open at month end.
- Gearbox oil samples taken on six turbines as per the quarterly rota; results within limits.

5. Health, safety and environment

Indicator	Month
Hours worked on site (Highline + Weyland)	2,644
Lost time injuries	0
First aid cases	0
Near misses reported	1
Safety observations	4
Environmental incidents	0

No environmental incidents. Bird carcass searches were carried out on schedule (fortnightly, all turbines).

6. Outlook

We will review the downtime events above with Highline in the monthly O&M meeting and track the recurring pitch faults.

Prepared by Sara Lindgren (Performance Analyst); reviewed by Ben Okoye (Site Manager) and David Chen (Asset Operations Manager).