

Monthly Performance Report – September 2024

Kestrel Ridge Wind Farm (75.6 MW)

David Chen · 09 October 2024 · KR-OPS-RPT-2024-09


1. Summary

Kestrel Ridge generated **13.5 GWh** in September 2024, 9.4 % below the P50 budget of 14.9 GWh. Availability of **97.0 %** met the contract target of 97.0 %. The wind resource was weak: 7.3 m/s against a long-term monthly mean of 7.6 m/s.

2. Production and key figures

KPI	September 2024	Budget / target	YTD 2024	YTD budget
Net generation (GWh)	13.5	14.9	78.4	80.4
Time-based availability	97.0 %	97.0 %	96.4 %	97.0 %
Capacity factor	24.8 %	27.4 %	23.6 %	–
Mean wind speed at hub height (m/s)	7.3	7.6	–	–

Source: Kestrel Ridge SCADA, revenue meter at 132 kV point of connection. Budget = P50 (2024 post-construction yield assessment).

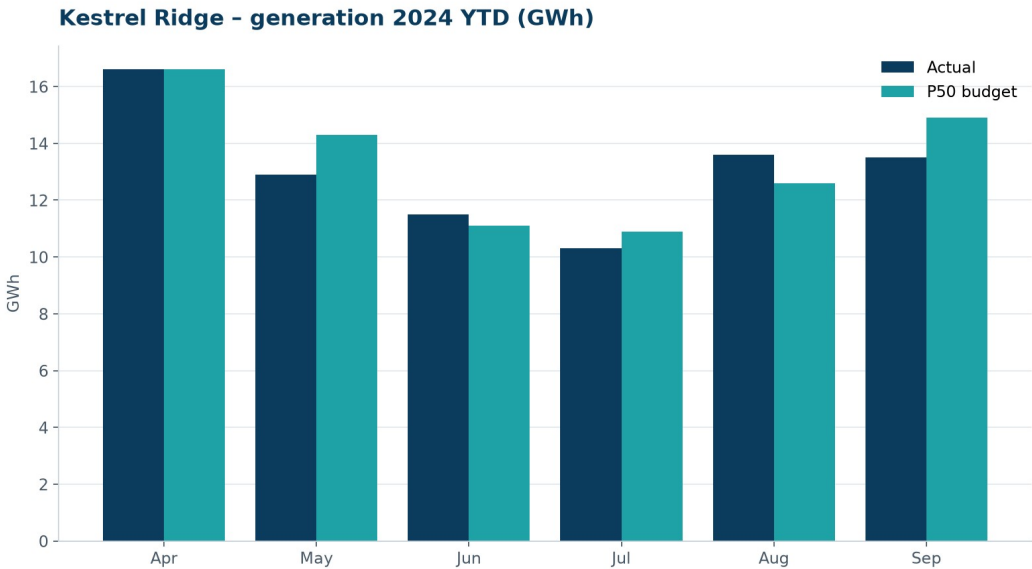

Monthly generation vs. P50 budget, 2024 year to date

3. Availability and downtime

Total turbine downtime attributable to the contractor amounted to 24 turbine-hours for the top events listed below. No grid or force majeure exclusions were claimed this month.

Turbine	Event	Downtime (h)
---------	-------	--------------

T-16	hydraulic oil leak at rotor brake caliper	8
T-18	anemometer heater failure – sensor replaced	6
T-04	anemometer heater failure – sensor replaced	5
T-13	hydraulic oil leak at rotor brake caliper	5

Top downtime events of the month (SCADA event log, reviewed with Highline Wind Services).

4. Maintenance

- 18 corrective work orders closed, 4 still open at month end.
- Monthly safety equipment checks (fall arrest, rescue kits, fire extinguishers) completed on all towers.

5. Health, safety and environment

Indicator	Month
Hours worked on site (Highline + Weyland)	2,835
Lost time injuries	0
First aid cases	0
Near misses reported	2
Safety observations	8
Environmental incidents	0

No complaints from neighbours were received this month.

6. Outlook

Next month's focus: closing open corrective work orders and preparing the quarterly O&M review with Highline Wind Services.

Prepared by Sara Lindgren (Performance Analyst); reviewed by Ben Okoye (Site Manager) and David Chen (Asset Operations Manager).