

Monthly Performance Report – October 2024

Kestrel Ridge Wind Farm (75.6 MW)

David Chen · 09 November 2024 · KR-OPS-RPT-2024-10

1. Summary


Kestrel Ridge generated **19.0 GWh** in October 2024, 0.5 % above the P50 budget of 18.9 GWh. Availability fell to **96.6 %**, below the contract target of 97.0 %. Mean hub-height wind speed was 8.6 m/s, above the long-term monthly mean of 8.3 m/s.

Shadow flicker modules on T-03, T-04 and T-15 were recalibrated after the first autumn season; no complaints received.

2. Production and key figures

KPI	October 2024	Budget / target	YTD 2024	YTD budget
Net generation (GWh)	19.0	18.9	97.4	99.3
Time-based availability	96.6 %	97.0 %	96.4 %	97.0 %
Capacity factor	33.8 %	33.6 %	25.1 %	–
Mean wind speed at hub height (m/s)	8.6	8.3	–	–

Source: Kestrel Ridge SCADA, revenue meter at 132 kV point of connection. Budget = P50 (2024 post-construction yield assessment).

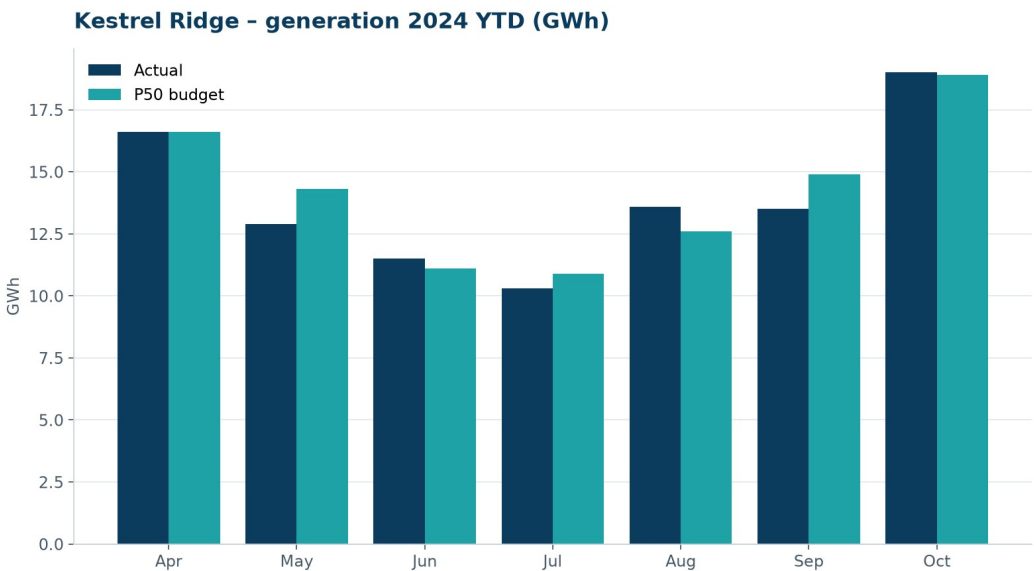

Monthly generation vs. P50 budget, 2024 year to date

3. Availability and downtime

Total turbine downtime attributable to the contractor amounted to 66 turbine-hours for the top events listed below. No grid or force majeure exclusions were claimed this month.

Turbine	Event	Downtime (h)
T-10	converter fault – IGBT module replaced	36
T-07	yaw brake pad wear – pads replaced	18
T-13	service lift fault – lift locked out, turbine stopped for rescue cover	8
T-16	generator slip ring brush wear alarm	4

Top downtime events of the month (SCADA event log, reviewed with Highline Wind Services).

4. Maintenance

- 9 corrective work orders closed, 5 still open at month end.
- Monthly safety equipment checks (fall arrest, rescue kits, fire extinguishers) completed on all towers.

5. Health, safety and environment

Indicator	Month
Hours worked on site (Highline + Weyland)	2,461
Lost time injuries	0
First aid cases	0
Near misses reported	1
Safety observations	13
Environmental incidents	0

No complaints from neighbours were received this month.

6. Outlook

We will review the downtime events above with Highline in the monthly O&M meeting and track the recurring pitch faults.

Prepared by Sara Lindgren (Performance Analyst); reviewed by Ben Okoye (Site Manager) and David Chen (Asset Operations Manager).