
Core and grid-selected comparison activity

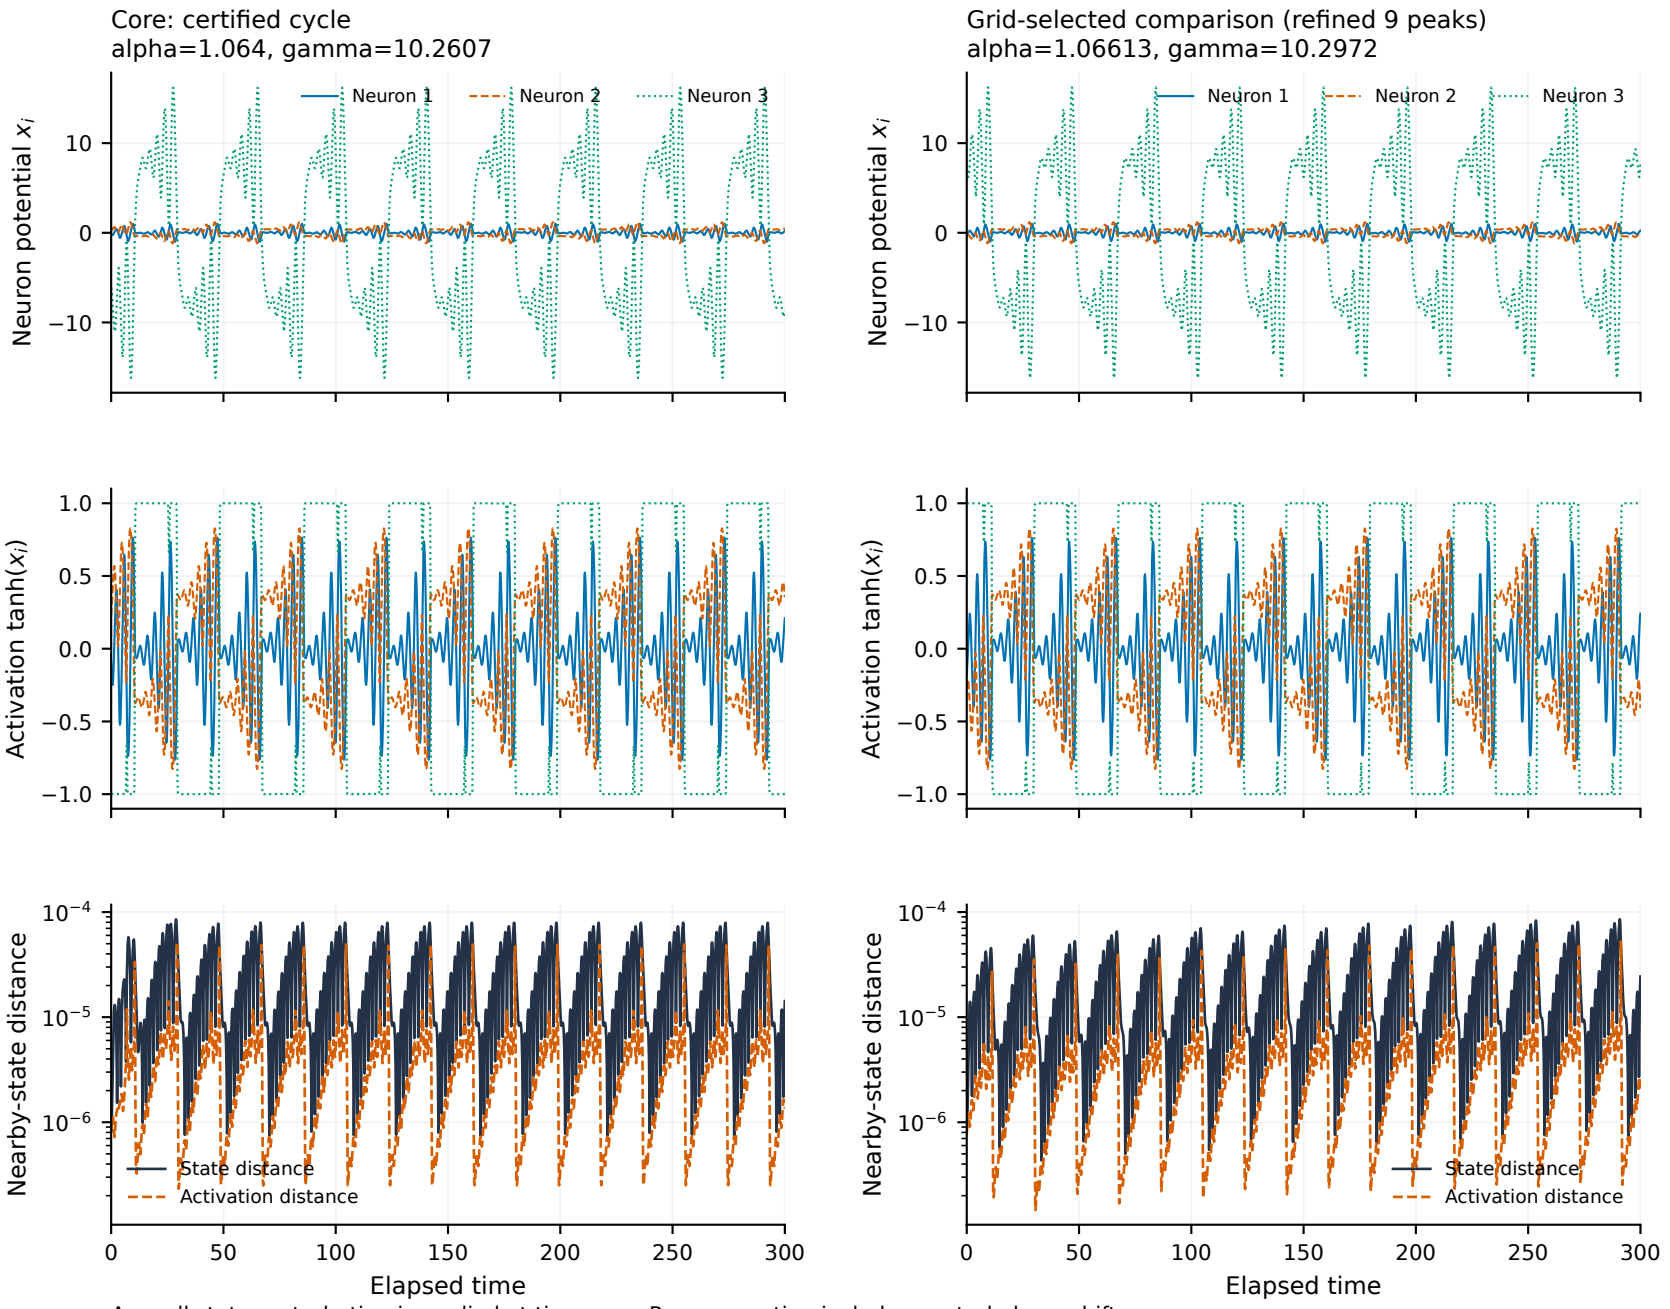

A small state perturbation is applied at time zero. Raw separation includes neutral phase shifts; it is not a direct measure of transverse recovery or task correctness.