CATHODE POWER | SPREADING GOODNESS WITH TRUST

User Manual

Installation | Operation | Maintenance

PV GRID CONNECTED INVERTER

CP30HL CP33HL CP36HL

CP40HL CP45HL CP50HL

Foreword

The Manual describes the inverter in terms of product details, installation, operation, and maintenance, except for all information of photovoltaic system (PV system). Welcome to visit **www.cathodepower.com** for more details.

Scope

The Manual applies to the following models:
CP30HL , CP33HL , CP36HL , CP40HL , CP45HL , CP50HL

Intended audience

The Manual is available for technical personnel who install, operate, and maintain the inverters and users who check the inverter parameters on the Manual.

The installation and service require knowledge of high voltage electricity and should only be performed by qualified individuals. Cathode Power assumes no liability for injury or property damage due to repairs attempted by unqualified individuals or a failure to properly follow this Guide.

The qualified individuals shall satisfy the following requirements:

- They shall be familiar with electronic, electrical wiring and mechanical expertise, and understand electrical and mechanical schematics;
- They shall have received the professional training on installation and commissioning of electrical equipment;
- They shall be able to tackle with hazards or emergencies during installation or commissioning;
- They shall be acquainted with local standards and relevant safety codes for electrical systems;
- They must read the whole Manual carefully and master the related safety precautions.

Although we are constantly updating and modifying the Manual, Product in kind prevail, specifications maybe change without notice.

Contents

Safety Precaution 3
Warning symbol | Unpacking for inspection | Installation security | Electrical connection security | Operation security | Maintenance security | Disposing security

Product Overview 6
Dimension and weight | LED indicator | Photovoltaic system | Principle description | Function description

Unpacking and Storing 10
Unpacking for inspection | Inverter storage

Mechanical Installation 11
Installation precaution | Tool preparation for installation | Installation site | Space requirement | Installation step

Electrical Connection 15
Safety precaution | Cable requirement | Earthing connection | AC/DC side connection

Communicating Connection / Commissioning 24
Communicating connection | Inspection before commissioning | Commissioning steps

Shutdown / Removing / Disposing 25
Shutting down the inverter | Removing the inverter | Disposing the inverter

Troubleshooting & Maintenance 26
Failure exception | Alarm exception | Regular maintenance | Maintenance notes | Fan maintenance | Fan cleaning and replacement

Quality Warranty 32

Technical Parameters 33

Safety code shall be followed during the installation, commissioning, operation, and maintenance of inverter. A failure to properly follow this Manual.

- **Threatening the personal safety of the operator or third party;**
- **Damaging the inverter or other property of the operator or third party.**

- The manual includes not all safety precautions to be followed, but only serves as a supplement. Therefore, the user shall operate according to the actual situation.
- When installing, operating, and maintaining the equipment, users shall comply with local laws and regulations and codes, supplemented by safety precautions in the Manual.

***To avoid the above hazards, please follow the Manual strictly.**

Warning Symbol

Symbol	Description
	Switch off the machine before any operation and maintenance.
	Beware of scalding due to the equipment surface temperature maybe higher than 60°C.
	Before wiring and checking, ensure that the DC/AC circuit breakers of inverter have been disconnected and wait at least 5 minutes.
	Read the Manual before any operations on the inverter.
	Do not connect and disconnect wires, dismantle the case, and replace devices under electric condition due to the fatal high-voltage risk.
	Comply with the CE certification.
	Do not discard the inverter as the household waste.
	Reliably earth the inverter for protective grounding.

Unpacking for Inspection

⚠ WARNING

- Inspect all safety signs, warning labels, and nameplates on the inverter;
- Ensure that safety signs, warning labels, and nameplates are clearly visible, and not removed or covered before the inverter is discarded.

Installation Security

⚠ DANGER

• Ensure the product has no electrical connections prior to installation;
• Ensure that the drilling, if required during installation, has avoided the electrical wiring inside the wall.

⚠ CAUTION

Improper installation may cause personnel injury!

• Do not stay under the inverter when it is carried and lifted by lifting tools;
• Control the weight when the inverter is carried to keep balance, thus avoiding products toppling or falling.

Electrical Connection Security

⚠ WARNING

• Before electrical connections, ensure that the inverter is intact.
• Before electrical connections, be sure to keep the inverter and all connected switches in "OFF" state to avoid electric shock.

⚠ DANGER

The exposure of PV string to sunlight may cause danger!

• For electrical connections, wear personal protective equipment;
• Ensure that the cable is not charged through checking with test equipment before touching the DC cable;
• Read the safety precautions listed in the PV string-related documents;
• Do not connect the inverter with the PV string that needs either positive or negative grounding.

⚠ DANGER

There may be fatal high voltage inside the inverter!

• Please use special insulation tools when wiring;
• Operate in compliance with the instructions of warning symbols;
• Read safety precautions listed in the Manual and other inverter-related documents.

⚠ WARNING

• Verify the PV string's positive and negative polarities so that the DC connector is connected to the inverter and inserted to the corresponding DC terminal;
• When the inverter is installed and operated, ensure that the positive and the negative of the PV string do not short circuit to the ground. Otherwise, it may lead to inverter AC/DC short circuit, resulting in product damage, which is not covered under warranty.

⚠ WARNING

• Note that the incorrect wiring may damage the product, which is not covered under warranty;
• Electrical connection must be done by qualified individuals;
• Ensure that cables used in the PV system are properly sized, reliably connected, and well insulated.

Operation Security

⚠ DANGER

• Do not touch the product enclosure when it is in operation;
• Do not insert or remove connectors on the inverter when it is in operation;
• Do not touch any terminals on the inverter when it is in operation to avoid electric shock;
• Do not remove any parts of the inverter when it is in operation to avoid electric shock;
• Do not touch the scorching parts of the inverter (e.g. heat sink) when it is in operation to avoid burns;
• Do not shift the DC switch on the product when it is in operation to avoid equipment damage or personnel injury.

Maintenance Security

⚠ DANGER

• Do not touch the Grid or contacts and terminals that are connected to or inside the product to avoid electric shock;
• Use a standard voltmeter to confirm that the Grid is free of voltage before touching to avoid electrical shock.

⚠ DANGER

The improper maintenance may cause personnel injury or product damage!
• Before maintenance, disconnect the Grid-side AC circuit breaker and check the inverter status. switch off the DC switch at night as the inverter indicator is off, and if it is still on, switch off the DC switch directly;
• Use test equipment to check that the inverter is free of voltage and current after 5 min's power off, and then maintain the inverter with protective equipment;
• Avoid burns even after the inverter is shut down. Operate with protective gloves after the inverter has cooled down.

⚠ CAUTION

To avoid unrelated personnel from mishandling or accidents, place obvious warning signs or alarm belts around the products.

Disposing Security

⚠ WARNING

Discard products based on the relevant local regulations and standards to avoid property losses or casualties.

Appearance

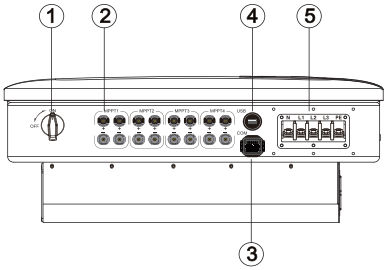

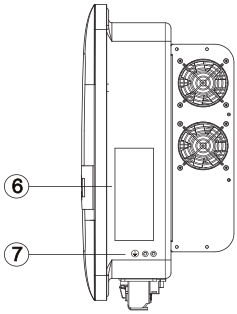

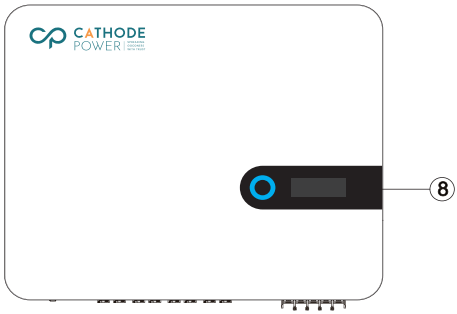

No.	Name	Description
1	DC Switch	For controlling the DC input
2	PV Connectors	CP33HL,CP33HL,CP36 HL, CP40HL 6 to PV connectors ;
3	Communication Terminal	Communication interface of RS485 and DRM
4	USB Interface	Wi-Fi/4G monitoring
5	AC Wiring Port	For AC output wiring
6	Labels	Including nameplate, warning label, and QR code
7	External Grounding Terminal	For reliable grounding of inverters
8	LED Indicator & LCD Screen	For indicating the current inverter status

Dimension & Weight

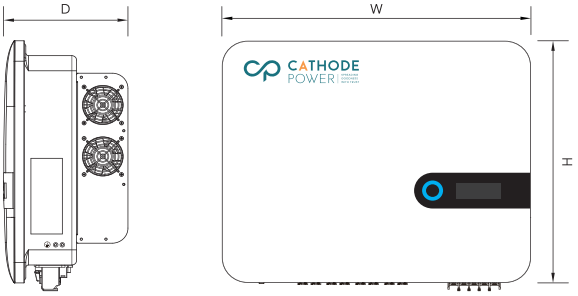

No.	Models	Dimension (W×H×D)	Weight
1	CP30HL - CP36HL,	590 x 480 x 237mm	34kg
2	CP40HL - CP50HL,	590 x 480 x 237mm	36kg

LED Indicator

LED indicator + LCD screen, a human-machine interface on the front panel of inverter, may display the current inverter status.

Indicator	Status	Indication
	Steady **Blue**	The inverter is in Grid-connected mode.
	Blinking **Blue** at 0.2s intervals	USB is connected with data communication and the inverter is free of faults.
	Blinking **Blue** at 2s intervals	DC or AC is on, and the inverter is in standby or start-up mode (non-Grid-connected mode).
	Steady **Green**	PID enabled.
	Blinking **Green** at 0.2s intervals	Program download.
	Steady **Red**	The inverter is faulty.
	Blinking **Red**	USB is connected with data communication and the inverter is faulty.
	Off	AC and DC or DC only are/is off.

Note: Since the AC side may still be energized when the indicator is off, it is necessary to avoid electric shock when operating the inverter.

Photovoltaic System

The grid-connected inverter of three-phase transformerless string type is a vital part of PV system.

The inverter converts the DC power from the PV string into AC power that meets the Grid requirements and feeds into the Grid. Typical application scenarios of the inverter are shown below.

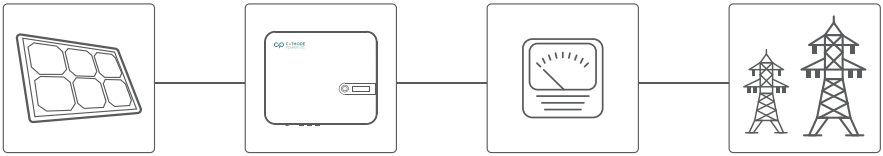

Application of PV Grid-connected inverter to PV system

No.	Name	Description
A	Pv String	Monocrystalline silicon, polycrystalline silicon, and thin-film cell without grounding
B	Inverter	CP30HL - CP50HL
C	Electricity Meter	A standard tool for metering inverter output power
D	Grid	Types of Grid supported by the inverter are shown below

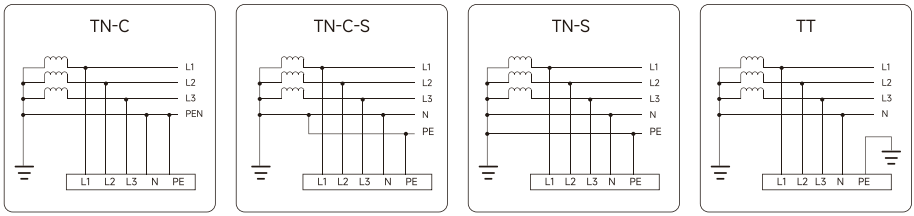

Types of Grid supported by the PV Grid-connected inverter

⚠ WARNING

- Do not connect the inverter with the PV string that needs either positive or negative grounding.
- When installing or operating the inverter, ensure the positive and negative of the PV string are short-circuit to the ground. Otherwise, it may lead to inverter AC/DC short circuit, resulting in product damage, which is not covered under warranty.
- Do not connect local loads between the inverter and AC-side circuit breaker.
- Use the inverter only in the scenarios described in the Manual.

Principle Description

The principle design of inverter is illustrated below:

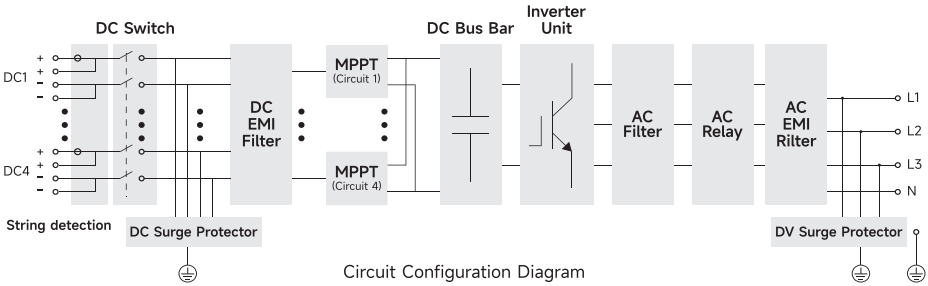

Circuit Configuration Diagram

• If needed, use the DC switch to safely cut off the DC current to keep the operating inverter and personnel safe;

• EMI filter removes the electromagnetic interference inside the inverter to ensure that the inverter meets the EMC standards;

• The inverter provides DC input via two MPPT circuits, ensuring maximum power even under different PV input conditions;

• The inverter converts the DC power into AC power that meets the Grid requirements and feeds into the Grid;

• The AC filter removes the high-frequency component of output current from the inverter, ensuring that the output current meets the Grid requirements;

• The output relay isolates the AC output of inverter from the Grid so that the inverter can be safely disconnected from the Grid in case of inverter or Grid failure;

• The AC surge protector provides a relief circuit to the AC-side overvoltage energy to prevent its energy shock from damaging the inverter's internal circuit.

Function Description

The inverter has the following functions in summary:

Inverse transformation	Convert DC power into AC power that meets the requirements of the Grid and feeds it into the Grid.
Data storage	Save system information, such as operation information and fault records.
Parameter configuration	Provide users with multiple parameter configurations, so that they may adjust the inverter by using App to meet various needs, such as the best operating performance.
Communication interface	Provide communication accessory port to access the Company's communication module. Upload monitoring data through wireless communication to the monitoring backend that has connected with the communication device, allowing users check the inverter information or set operation and protection parameters through the Smart Energy Management Platform, etc.
Protection	Provide anti-island protection, DC reverse-connection protection, AC short-circuit protection, leakage-current protection, surge protection, etc.

Unpacking for Inspection

Although the equipment is completely tested and inspected before shipping, damages may still occur during transportation. So, users shall inspect the product in detail before signing.

- Check packing boxes for damages;
- Check if the goods are complete and consistent as per the packing list;
- Unpack and check if the internal parts are intact;
- In case of any damage or incomplete goods, contact the transport company or Slenergy and provide photos of the damage for accurate service;
- Do not discard the shipping packaging of equipment after it is removed, but store it in the original packing box.

The packing list:			
Inverter	1	AC Waterproof Cover	1
Wall Mount	1	16pin Communication Connection	1
DC Connectors(pairs)	6/6/6/8/8	Accessory Kit of Installing Screw	1
OT Terminals	6	Quick Installation Guide	1
AC Waterproof Lock	1	Passport	1

Inverter Storage

The inverter shall be stored in a specific condition if it is not operated at once:

- It shall be repacked by the shipping packing box with the desiccant;
- It shall be stored at a temperature range from -30°C ~ 70°C, with a relative humidity range from 0% ~ 95% and without condensation;
- The stacking of multiple inverters shall adhere to the "maximum stacking layers limit" indicated on the outer box;
- The packaging box may not be tilted or reversed;
- The inverter shall be carefully packaged before re-transportation;
- It shall not be stored in places exposed to direct sunlight, moisture from rain, strong electric fields, etc.;
- It shall not be stored together with objects that may damage the inverter;
- It shall be stored in a clean and dry place to protect it from the erosion of dust and water vapor;
- It shall not be stored in places with chemical corrosive substances or susceptible to pest infestation;
- Regular inspections shall be conducted at least half a year. In case of any signs of peat or rodent damage, the packaging materials need to be replaced;
- If the inverter has been in warehouse for one year or longer, it requires professional inspection and testing before operation.

This chapter describes the inverter installation and its connection to the PV system;
For connection of the PV inverter to the PV system, it includes inverter's connection to the PV string and public grid;
Prior to inverter installation, users shall read this chapter and ensure it is installed by professional personnel after meeting all installation conditions.

Installation Precautions

DANGER

- Ensure that the product has no electrical connections before installation;
- Ensure that the drilling, if required during installation, has avoided the electrical wiring inside the wall.

WARNING

- Avoid improper installation conditions affecting the inverter's performance;
- Install the inverter in a well-ventilated place;
- Ensure that product cooling system or ventilation port is uncovered;
- Do not install the inverter in a flammable, explosive, or smoky environment.

CAUTION

- Improper installation may cause personnel injury!
- Control the weight when the inverter is carried to keep balance, thus avoiding the inverter toppling or falling;
- Wear suitable protective equipment when operating the inverter;
- Do not expose the inverter and its bottom terminals and interfaces directly to the ground or other supports.

Tool Preparation for Installation

Before installation, the prepared tools include but are not limited to the recommended tools below, with other auxiliary tools available if needed.

Marker


Electric drill


Hammer


Wrench

Electric meter


Hydraulic clamp


Mc4 crimping pliers


Spirit level

Socket wrench


Mc4 wrench


Utility knife


Cross screwdriver

Installation Site

• For the inverter, optional installation sites play a vital role in ensuring its safe operation, long service life, and good performance;
• With IP66 protection class, the inverter may be installed indoors or outdoors, but for longer service life, it is more suitable for installation in a sheltered place, such as with an awning;
• The installation site shall be easily accessible for electrical connections, operation, and maintenance;
• Due to relatively high temperature at case and heat sink during operation, the inverter shall be placed in a site that is not easily accessible;
• The inverter shall not be installed in a flammable and explosive site;
• The inverter shall be installed in an airy place for good heat dissipation;
• The temperature for installation shall be -25°C ~ 60°C;
• The installation site shall be away from electronic equipment with strong electromagnetic interference;
• The installation site shall be a fixed and solid surface, such as wall, metal bracket, etc.;
• In a suitable installation location, the inverter shall be reliably grounded and the grounding metal conductor material shall be consistent with that of the inverter reserved grounding.

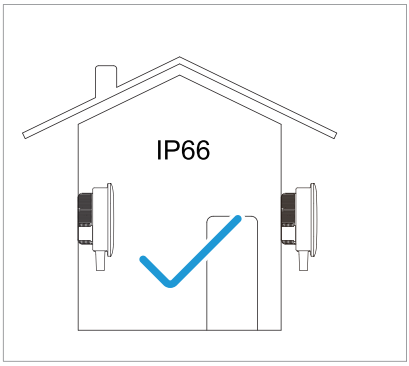

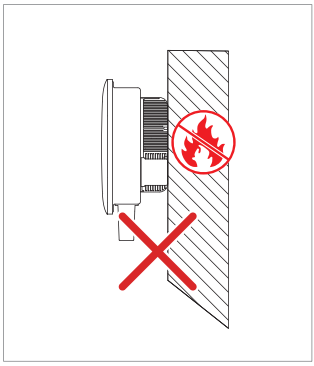

Space Requirements

At a suitable installation height, the user's sight is at the same level as the display window of LED and LCD, making it easy to check the inverter status.

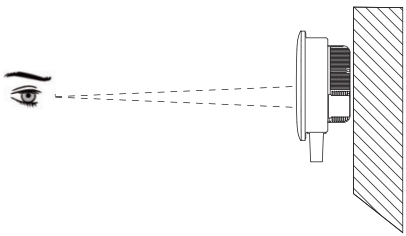

Sufficient reserved space around the installation site may facilitate the inverter disassembly and air convection. The installation space requirements for a inverter are illustrated on the right.

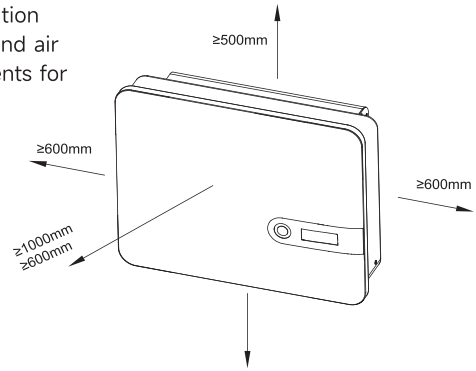

When multiple inverters are installed, a certain distance shall be reserved between inverters, and a linear installation is recommended. The left and right spacing is shown below.

The inverter is recommended to be installed vertically for heat dissipation, avoiding forward-leaning, backward-leaning, reverse, horizontal, or inclined installations.

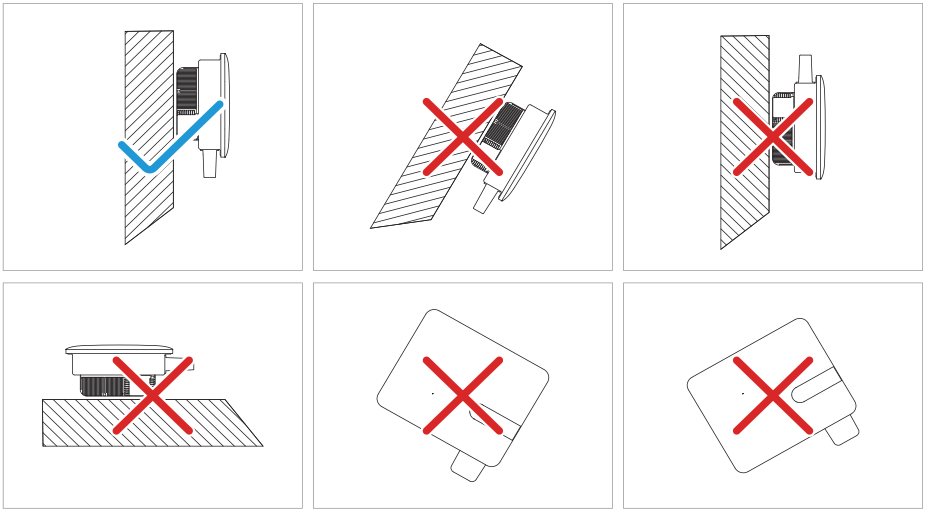

Installation Steps

Before drilling, avoid the electrical wiring inside the wall.

STEP 1:
Draw a horizontal reference line with a level on the wall.

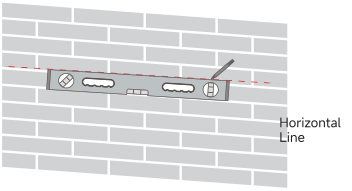

STEP 2:
Place the hanging plate flush on the wall, mark the recommended holes as shown, and drill the holes to a depth of about 70 mm.



STEP 3:
Knock the plastic expansion pipe into the hole.

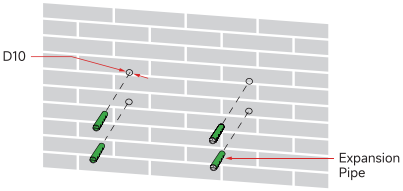

STEP 4:
Use the self-tapping screw+flat washer to fix the hanging plate on the wall with a tightening torque of 9 N.m.

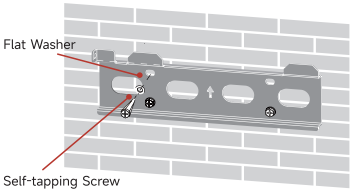

STEP 5:
Lift the inverter and hang the installation lug to the hanging plate. Release your hands until the inverter has been fixed in the backing plate.



STEP 6:
In terms of the left side hole of case and wall hangings, fasten the inverter to the hanging plate using M5x12 screws, with a torque of 2.6 N.m.

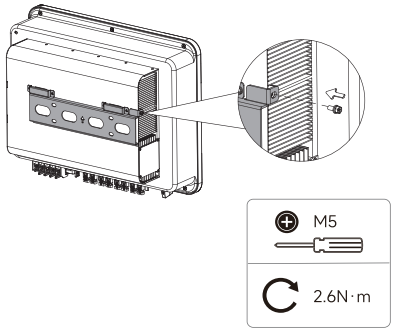

Electrical Connection

DANGER

- Beware of high voltage in the inverter;
- Avoid the exposure of PV string to sunlight, otherwise, it may cause hazardous voltage;
- Keep the AC/DC circuit breaker switch off before connecting to avoid a false connection;
- Ensure all cables are uncharged before electrical connection.

WARNING

- During wiring, avoid any improper operation that may cause product damage or personnel injury;
- Complete wiring operations only by professional personnel;
- Use solid, intact, well-insulated and properly sized cables for PV systems.

CAUTION

- Follow local Grid-related rules and PV string-related safety instructions during wiring;
- Ensure that all electrical installations meet the relevant standards of the country/region in which it is located;
- Connect the inverter to Grid only with the permission of local power department.

Safety Precaution

Remember that the inverter has dual power before electrical connection. Wear protective equipment during electrical connection.

Name	Mark	Quantity
DC Input Terminals	MPPT1+MPPT1- MPPT2+MPPT2- MPPT3+MPPT3 MPPT4+MPPT4-	MC4 PV connector CP30HL, CP33HL, CP36HL, CP40HL: 6 pairs of Terminals, 3 to PV input; CP50HL: 8 pairs of Terminals, 4 to PV input
Communication Terminal	COM / USB	Suitable for RS485/DRM/GPRS communication module
AC Output Terminal	AC	For Grid connection, use the circular connector in the accessory
Protective Earth Terminal	⏚	Use protective earth terminal for reliable secondary grounding

Cable Requirements

Name	Type	Specification/Outer Diameter (mm)	Conductor Cross-sectional Area(mm^2)
DC Cable	Multi-core PV cable with a maximum tolerance voltage of 1,100 V	6 ~ 9	4 ~ 6
Secondary Grounding Cable	Outdoor single-core copper wire	/	≥10mm^2
AC Cable	Outdoor Copper-core Cable	**CP30 - CP50HL**: 18~38	**CP30HL-CP40HL**: 16–30, with a recommended value of 20; **CP50HL** : 35~50, with a recommended value of 40

External Grounding Connection

For the transformerless inverter, it is vital to note that the positive and negative terminals of the PV string shall not be grounded, otherwise, the inverter cannot operate normally. The external grounding connection shall be conducted before the AC-side connection, PV string connection, and communication connection.

The grounding connection of the external PE terminal shall not replace that of the AC wiring. Both connections shall be reliably grounded. Otherwise, the Slenergy assumes no liability for any potential consequences.

External Grounding Requirements

- In PV systems, all non-current-carrying metal parts and equipment enclosures shall be grounded (e.g. PV brackets, inverter enclosures, etc.)
- For a inverter, the external grounding terminal is required to be grounded at the near end.
- For multiple inverters, all external grounding terminals and the grounding points of PV brackets shall be connected to an equipotential line (as per case-specific analysis) to ensure equipotential connection.

Grounding Steps

The cross-section area of the secondary grounding cable must be identical to that of the PE core wire in the AC cable.

STEP 1: Assemble the cable and crimp the OT/DT terminals.

STEP 2: Remove the screws from the grounding terminal and fix the cable using a screwdriver.

STEP 3: Apply silicone gel or paint to the grounding terminal to enhance its corrosion resistance.

END

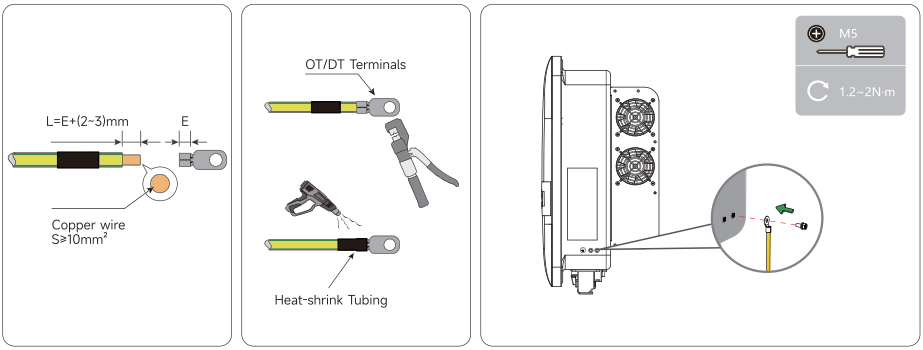

AC-side Connection Requirement

Before connecting the AC side to Grid, the Grid voltage and frequency shall comply with the requirements of the inverter. See Technical Data for detailed parameters. If not, users shall contact the power utility company for resolution.

***Inverters may be connected to the Grid only with the access permit of the local power utility company.**

AC Circuit Breaker

Equip each inverter with an independent three-pole or four-pole circuit breaker on the AC side to make a safe disconnection between the inverter and Grid.

Inverter Model	Recommended AC Circuit Breaker Parameters
CP30HL	63A
CP33HL to CP36HL	80A
CP40HL	100A
CP50HL	125A

- **Multiple inverters shall not share a single AC circuit breaker.**
- **No load shall be connected between the inverter and AC circuit breaker.**

Leakage-current Protector

An integrated leakage-current monitoring unit is equipped inside the inverter, which will quickly disconnect the inverter from the Grid when a leakage current is detected greater than the allowed value.

Com Communication Interfaces

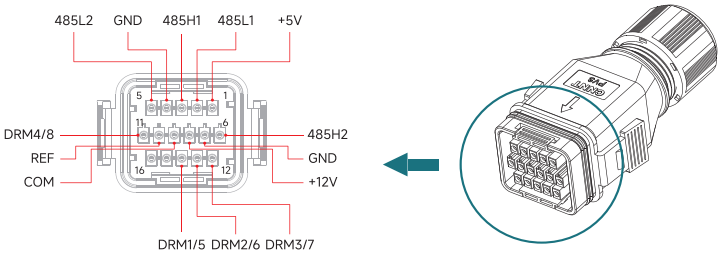

AC-side Wiring

STEP 1: Disconnect the AC-side circuit breaker and prevent it from reconnecting by accident.

STEP 2: Remove the AC circular connector and loosen the lock nut of waterproof connector. Select the sealing washer according to the cable outer diameter. Thread the cable through the lock nut in sequence.

STEP 3: Strip off a certain length of the protective layer and insulation layer as per the diagram requirements.

STEP 4: Lock the N, L1, L2, L3, PE of the crimp terminals to a torque of 7.9 N.m.

STEP 5: Gently pull the cable backwards to ensure that it is securely connected, tighten the lock nuts clockwise, and tighten the AC waterproof cover and lock.
End

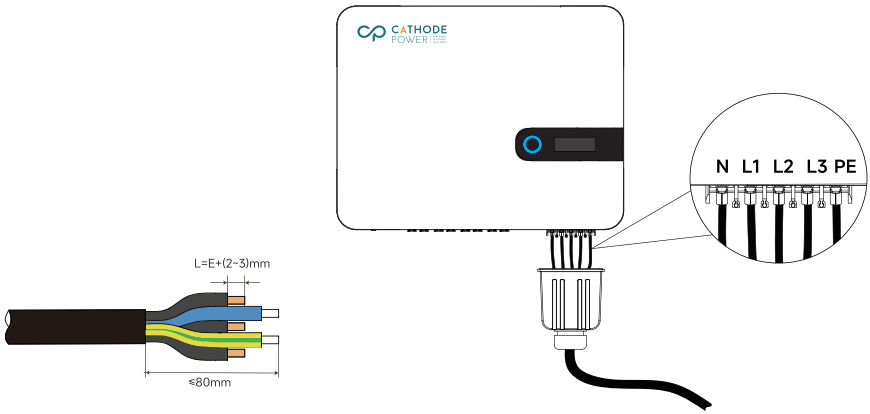

⚠ CAUTION

Pay much attention to the positioning of the "**PE**" cable and "**N**" cable. If the phase wire is connected to the terminal of "**PE**" or "**N**" cable, the inverter may be permanently damaged.

DC-side Connection

⚠ ELECTRIC SHOCK

• Before electrical connection, protect the PV array from exposure to sunlight, otherwise it may cause risky voltages;
• Ensure good insulation of the PV array from the ground before connecting it to the inverter;
• When the inverter is installed and operated, ensure that the PV string is not short-circuit for positive or negative polarity to ground. Otherwise, it may lead to inverter AC/DC short circuit, resulting in product damage, which is not covered under the warranty.

• The connection of the PV string shall meet the following requirements, otherwise the inverter may be permanently damaged, and such damage is not covered under the warranty;
• The voltage and maximum short-circuit current of each PV string shall be within the range. See Technical Data for details;
• When the same PV string is mixed with different brands or models of PV modules or connected to PV modules with different orientation angles or tilt angles, such conditions may not damage the inverter, but will affect the system performance.
• When the input voltage is 1,000V ~ 1,100V, the inverter will be in the standby mode. When the voltage is restored within the MPPT working voltage range of 160V ~ 1,000V, the inverter will return to its normal operation.

PV Input Configuration

CP30HL , CP33HL , CP36HL , CP40HL To CP50HL inverters have multiple PV inputs, and each PV input area is equipped with an independent MPPT for independent operation. To maximize the utilization of PV cell panel input power, the PV strings in the same input section shall be consistent in terms of the following aspects:
identical model, number of cell panels, tilt angle, and azimuth angle. PV strings in different input sections may have different configurations, including disparate types of cell panels, number of panels in the string, tilt angle, and azimuth angle.

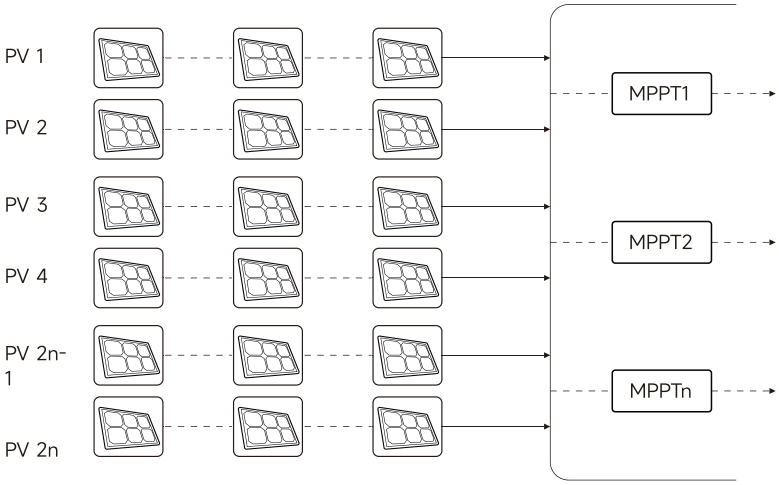

The configuration shall satisfy the following requirements before connecting the PV input to inverter.

Models	Open-circuit voltage per input	Maximum input current per string
All Models	**1100V**	**32A**

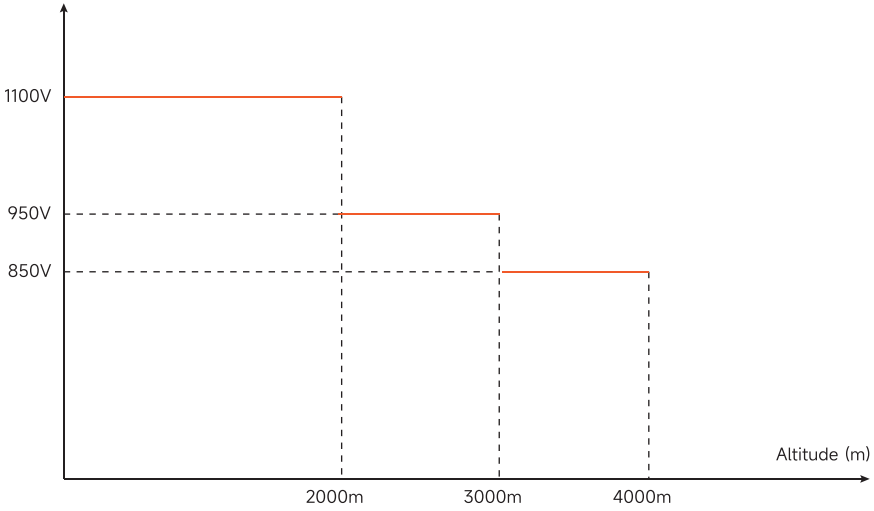

Altitude derating curve of inverter open circuit voltage

Assembling DC Connectors

⚠ CAUTION

Beware of high voltage in the inverter!

- Ensure all cables are uncharged before electrical connection;
- Keep the AC circuit breaker switch off before connecting the electrical to the inverter;
- Use the MC4 DC terminal in the shipping accessories when the maximum DC input voltage is not more than 1,000V;
- If the maximum DC input voltage exceeds 1,000V, use MC4-Evo2 DC terminal. Please contact the Company if needed;
- Please choose the required terminals if not, the damage is not covered under the warranty.

*Use only the supplied connectors to ensure that the inverter has an IP66 protection class.

STEP 1:
Strip 7 mm of insulation layer from each DC cable.



STEP 2:
Harness cable wire ends at wire terminals with crimping pliers.

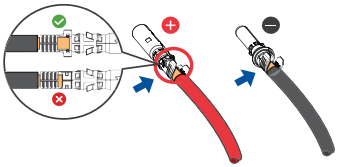

STEP 3:
Thread the cable into the cable gland and fasten it by inserting it into the insulating sleeve. Pull the cable lightly to ensure it is connected tightly. Fasten the cable gland and the insulating sleeve with a force of 2.5 ~ 3 N·m.

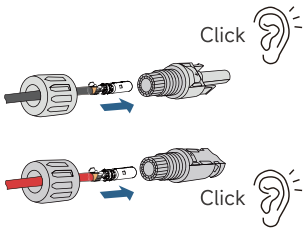

Ensure that the PV string is connected to the correct cable polarity.
If the DC input polarity is reversed, the inverter in fault or alarm status fails to operate normally.

Installing DC Connectors

STEP 1:

Rotate the DC switch to "OFF".



STEP 2:

Check whether the PV string is connected to the correct cable polarity, and ensure that the open-circuit voltage never exceeds the upper inverter input limit of 1,100V.



STEP 3:

Connect other PV strings as above and block the vacant DC terminals with MC4 waterproof plugs.

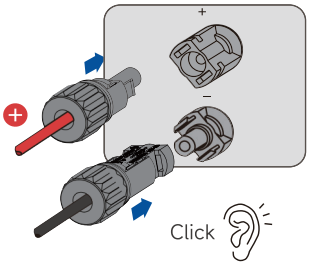

⚠ CAUTION

- Verify the panel's positive and negative polarities so that the DC connector is connected to the inverter and inserted to the corresponding DC terminal;
- The DC connector that is not in place may cause the rapid shutdown or connector overheating, and the resulting loss will not be covered by the warranty;
- Use the MC4 waterproof plug to block the vacant DC terminal.

Communicating Connection

The wireless communication module is installed to the communication accessory port (silkscreen marked USB) at the bottom of inverter.
Via the communication accessory port, users can access the Wi-Fi wireless communication module from our company. You can check the power generation and operation status of inverter through the mobile App after successful connection.

Please see the Manual for its installation, configuration and the supporting App.

Inspection Before Commissioning

The inverter needs to be inspected before its first start-up as follows:

S/N	Inspection Item	Inspection Result	
		Normal	Abnormal
1	Check and confirm that all equipment is reliably installed.	☐	☐
2	Check if the DC switch and AC breaker are in "OFF".	☐	☐
3	Check the ground wire for proper connection.	☐	☐
4	Check the AC cable for proper connection.	☐	☐
5	Check the DC cable for proper connection.	☐	☐
6	Check the communication cable for proper connection.	☐	☐
7	Check if vacant terminals are sealed.	☐	☐
8	Ensure that no construction tools are left on top of the equipment or inside the wiring box (if any).	☐	☐
9	Select AC circuit breakers as per the Manual and local standards.	☐	☐
10	Ensure that all safety signs and warning labels are fixed and visible.	☐	☐

Commissioning Steps

STEP 1: Rotate the DC switch on the inverter to "ON".
STEP 2: Turn on the AC switch if it is configured between the inverter and Grid.
STEP 3: Turn on the DC switch if it is configured between the inverter and PV string.
STEP 4: Ensure that there is plenty of light and it meets the requirements for Grid connection to make the inverter operate normally.
STEP 5: Observe the status of LED indicator (and see LED Indicator for details).
End

Shutting Down The Inverter

Avoid burns even after the inverter is shut down. Operate with protective gloves after the inverter has cooled. Shut down the inverter for maintenance or repair (except under normal circumstances). Disconnect the inverter from the AC/DC power supply according to the following steps to avoid casualties or equipment damage.

STEP 1: Disconnect the external AC circuit breaker and avoid reconnection by improper operation.

STEP 2: Disconnect the external DC circuit breaker and rotate the DC switch of inverter to "OFF".

STEP 3: Wait at least 10 min to discharge the internal capacitance completely.

STEP 4: Use the current clamp to confirm that there is no current on the DC cable.

End

Removing The Inverter

⚠ BURNS AND ELECTRIC SHOCK

- Disconnect the inverter from Grid and PV cell panels, and wait at least 10 min before touching the internal conductive device;
- Before removing the inverter, disconnect both AC and DC connections;
- When the DC terminal of inverter exceeds two layers, remove the outer DC connector first, and then remove the inner DC connector.

With reference to Electrical Connection, disconnect all electrical connections of inverter in reverse steps. Specifically, use the MC4 wrench to remove the DC connector by loosening its locking parts, and install the waterproof plug.
With reference to Mechanical Installation, remove the inverter in reverse steps.
If needed, remove the hanging plate on the wall.
Please see Inverter Storage to store the inverter properly for future use.

Disposing The Inverter

- Handle the inverter by users themselves;
- Avoid environmental pollutions caused by some parts and equipment of inverter, such as capacitors;
- Do not mix the disposed inverter with household waste, Follow the electronic waste regulations.

Once the inverter is faulty, you can check the corresponding fault information via fault codes on the mobile App or PC interface. All fault codes and troubleshooting methods of the PV inverter are detailed in the following table, only some of which may be applicable for the model you purchased.

Failure Exception

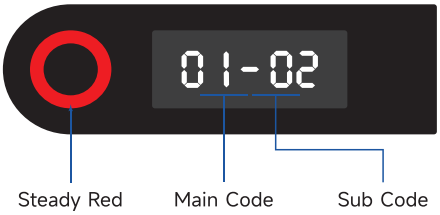

Main Code	Type	Sub Code	Fault Information	Troubleshooting Method
01	PV Voltage Fault	01	Low PV voltage	Check the inverter voltage and current abnormalities to determine fault causes: □ Check if parts corresponding to the fault is obscured, and if so, remove the shelters and ensure that the parts are clean; □ Check the cell panel wiring for loose connections, and if so, replug it to ensure its stable connection; □ Check the DC fuse for damage, and if so, replace it; □ Contact the Customer Service Center if the fault still exists not for the above reasons.
		02	High PV voltage	
02	PV Reverse Connection Fault	01	PV1 Reverse Connection Fault	□ Check if the positive and negative polarity of corresponding strings on the inverter is reversed, and if so, wait the PV string current lower to below 0.5A, turn off the DC switch, and adjust the opposite string polarity; □ Contact the Customer Service Center if the fault still exists not for the above reasons.
		02	PV2 Reverse Connection Fault	
		03	PV3 Reverse Connection Fault	
		04	PV4 Reverse Connection Fault	
03	PV Short Circuit Fault	01	PV1 Short Circuit Fault	
		02	PV2 Short Circuit Fault	
		03	PV3 Short Circuit Fault	
		04	PV4 Short Circuit Fault	
04	Abnormal BUS Voltage	01	Low BUS Voltage	□ Check if parts corresponding to the fault is obscured, and if so, remove the shelters and ensure that the parts are clean; □ Check the cell panel wiring for loose connections, and if so, replug it to ensure its stable connection; □ Check the DC fuse for damage, and if so, replace it; □ Contact the Customer Service Center if the fault still exists not for the above reasons.
		02	High BUS Voltage	
		03	Unbalanced BUS Voltage	□ Check the cell panel wiring for loose connections, and if so, replug it to ensure its reliable connection; □ Check the DC fuse for damage, and if so, replace it; □ Via the monitoring software, confirm the voltage of positive BUS and negative BUS and calculate their differential pressure value. When the above value exceeds the equipment protection threshold (50 V), contact the Customer Service Center.

Failure Exception

Main Code	Type	Sub Code	Fault Information	Troubleshooting Method
05	PV/AC Overcurrent Fault	01	Inverter Hardware Overcurrent	Check if parts corresponding to the fault is obscured, and if so, remove the shelters, ensure that the parts are clean, and then connect it to Grid; In case of AC overcurrent, check if the Grid voltage fluctuation exceeds 50 V, and if so, wait for the local Grid to stabilize and then connect to the Grid; Contact the Customer Service Center if the fault still exists not for the above reasons.
		02	Inverter Software Overcurrent	
		03	BOOST Hardware Overcurrent	
		04	BOOST Software Overcurrent	
		05	PowerFail	
		06	Hardware BUS Overvoltage	
06	Temperature Fault	01	Abnormal Inverter Temperature	Generally, the inverter will operate again after its internal or module temperature returns to normal, but if the fault recurs: Check the inverter for high ambient temperatures; Check if the inverter is located in an airy site; Check if the inverter is exposed to direct light, and if so, provide some shelters; Check the fan for normal operation, and if not, replace it; Contact the Customer Service Center if the fault still exists not for the above reasons. Shut down and disconnect the inverter, wait for the ambient temperature rising to the normal operating temperature range, and then restart the inverter.
		02	Abnormal BOOST Temperature	
		03	Abnormal Ambient Temperature	
07	Insulation-detection Fault	01	Insulation-detection fault	Wait for the inverter to return to normal, but if the fault is repeated: Via the App, check if the ISO impedance-protection value is too high and confirm that it meets local regulatory requirements; Check the earth impedance of PV strings and DC cables and take corrective measures if the short-circuited or cable-insulation layer is broken; If the fault occurs on rainy days (with normal cables), reconfirm it when the weather condition improves; Contact the Customer Service Center if the fault still exists not for the above reasons.
08	Drive Failure	01	Drive failure	Contact the Customer Service Center.
09	Communication Fault	01	ARM to main DSP communication fault	A humid cell panel condition or poor lighting may cause the fault. Generally, reconnect the inverter to the Grid after the condition has improved; If the environment is normal, check if the DC/AC cable insulation is normal; Contact the Customer Service Center if the fault still exists not for the above reasons.
		02	Main DSP to ARM communication fault	
		03	ARM to main DSP communication fault	
		04	Main DSP to ARM communication fault	
		05	Main-slave chip communication fault-main chip fault	
		06	Main-slave chip communication fault-slave chip fault	
10	Leakage-current Fault	01	30 mA abrupt fault	Check if the communication wire or collection stick is loose, and if so, rewire or replug the collection stick; Contact the Customer Service Center if the fault still exists not for the above reasons.
		02	60 mA abrupt fault	
		03	150 mA abrupt fault	
		04	High-static leakage current	

Failure Exception

Main Code	Type	Sub Code	Fault Information	Troubleshooting Method
11	Relay Fault	01	R-phase relay short-circuit	Contact the Customer Service Center.
		02	S-phase relay short-circuit	
		03	T-phase relay short-circuit	
		04	R-phase DSP relay short-circuit	
		05	S-phase DSP relay short-circuit	
		06	T-phase DSP relay short-circuit	
		07	R-phase MO relay short-circuit	
		08	S-phase MO relay short-circuit	
		09	T-phase MO relay short-circuit	
		10	Relay protection fault	
12	DCI Fault	01	R-phase DCI fault	
		02	S-phase DCI fault	
		03	T-phase DCI fault	
13	Signal Sampling Fault	01	Inconsistent BUS voltage detection	
		02	Inconsistent BOOST voltage detection	
		03	Inconsistent ISO voltage detection	
		04	Inconsistent PV voltage detection	
		05	Inconsistent GFCI	
		06	Abnormal BUS voltage sampling	
		07	Abnormal PV current sampling	
14	Mains Voltage Fault	01	No mains voltage	In general, reconnect the inverter to the Grid after the Grid returns to normal.If the fault is repeated: Check if the Grid is stably supplied; Check if the AC wiring is tight; Check if the AC cable is connected to the correct terminal (or if the fire wire is connected to the N wire); Check if the AC circuit breaker is turned on; Contact the Customer Service Center if the fault still exists not for the above reasons.
		02	Mains undervoltage level 1	
		03	Mains undervoltage level 2	
		04	Mains overvoltage level 1	
		05	Mains overvoltage level 2	
		06	Mains start-up undervoltage	
		07	Mains start-up overvoltage	
		08	Interrupted instantaneous undervoltage	
		09	Interrupt instantaneous overvoltage	
		10	Island overvoltage	
15	Mains Frequency Fault	01	Mains underfrequency level 1	In general, reconnect the inverter to the Grid after the Grid returns to normal.If the fault is repeated: Measure the actual Grid frequency, and if it exceeds the set range indeed, contact the local power utility company for resolution; Check if the set protection parameter is qualified; Contact the Customer Service Center if the fault still exists not for the above reasons.
		02	Mains underfrequency level 2	
		03	Mains overfrequency level 1	
		04	Mains overfrequency level 2	
		05	Mains start-up underfrequency	
		06	Mains start-up overfrequency	
16	Remote Shutdown	01	Shutdown instruction fault	Contact the Customer Service Center.
17	Leakage Current Self-test Fault	01	Leakage current sensor fault	
18	Strings Detection Fault	01	Strings fault	
19	Auxiliary Power Fault	01	Auxiliary power failed	
21	Invalid flash drive file format	01	Multiple invalid file format during the upgrading of USB flash drive	

Alarm Exception

Main Code	Type	Sub Code	Alarm Message	Troubleshooting Method
01	Abnormal Fan-speed Alarm	01	Fan 1	Contact the Customer Service Center.
		02	Fan 2	
		03	Fan 3	
		04	Fan 4	
		05	Fan 5	
		06	Fan 6	
		07	Internal Fan 1	
		08	Internal Fan 2	
		09	Fan 9	
		10	Fan 10	
02	Surge Protector Alarm	01	DC Surge Protector	
		02	AC Surge Protector	
03	Abnormal String Alarm	01	Abnormal String 1 Alarm	Check the number of cell panels configured for the corresponding string is fewer than other strings, and if so, wait the PV string current to lower below 0.5A, turn off the DC switch, and adjust the panel configuration for the string; Check the cell panels of string for shelters; Wait the PV string current lower to below 0.5A, turn off the DC switch, and check if the open-circuit voltage of strings is abnormal. If so, check the cell panel for its wiring and configuration; Check the cell panel for its abnormal orientation.
		02	Abnormal String 2 Alarm	
		03	Abnormal String 3 Alarm	
		04	Abnormal String 4 Alarm	
		05	Abnormal String 5 Alarm	
		06	Abnormal String 6 Alarm	
		07	Abnormal String 7 Alarm	
		08	Abnormal String 8 Alarm	
		09	Abnormal String 9 Alarm	
		10	Abnormal String 10 Alarm	
		11	Abnormal String 11 Alarm	
		12	Abnormal String 12 Alarm	
		13	Abnormal String 13 Alarm	
		14	Abnormal String 14 Alarm	
		15	Abnormal String 15 Alarm	
		16	Abnormal String 16 Alarm	
		17	Abnormal String 17 Alarm	
		18	Abnormal String 18 Alarm	
		19	Abnormal String 19 Alarm	
		20	Abnormal String 20 Alarm	
		21	Abnormal String 21 Alarm	
		22	Abnormal String 22 Alarm	
		23	Abnormal String 23 Alarm	
		24	Abnormal String 24 Alarm	
04	Anti-reverse Current Meter Communication Alarm	01	Abnormal Alarm of A-phase Meter	Check the meter for improper position of wiring; Check if the input and output wiring direction of meter is reversed; If the retrofit system is enabled, check if the rated power is correctly set for the inverter.
		02	Abnormal Alarm of B-phase Meter	
		03	Abnormal Alarm of C-phase Meter	
		04	Abnormal Meter Communication Alarm	
		05	Abnormal CT Wiring Alarm	
05	Grid Overload Alarm	01	Overvoltage alarm	In general, reconnect the inverter to the Grid after the Grid returns to normal. If the fault is repeated: Check if the Grid is stably supplied; Check if the AC wiring is tight; Check if the AC cable is connected to the correct terminal (or if the fire wire is connected to the N wire); Check if the AC circuit breaker is turned on; Contact the Customer Service Center if the fault still exists not for the above reasons.

Maintenance Notes

• Avoid personnel injury or product damage due to improper maintenance!
• Always remember that the inverter is powered by dual power sources: the PV string and public Grid.

Before maintaining the inverter, obey the following steps:

• First disconnect the Grid-side AC circuit breaker, and then turn off the DC switch;
• Wait at least 10 min to discharge the internal energy-storage element completely, and then maintain or repair the internal parts of inverter;
• Use test equipment to check if the inverter is free of voltage and current;
• Post temporary warning signs or erect barriers to avoid unrelated personnel from entering the working area during electrical connections and maintenance;
• Restart the inverter after troubleshooting faults that affect the inverter's safety performance;
• Without permission, do not replace the inverter's internal components, as it does not contain repair parts;
• Contact the Customer Service Center for any maintenance service;
• The damages caused by the improper operation are not covered under the warranty, and the Company does not bear the joint liability;
• Avoid damage to devices by touching printed circuit boards or other electrostatic sensitive parts;
• Avoid unnecessary circuit board contact;
• Comply with electrostatic protection norms and wear antistatic wristbands.

Routine Maintenance

See the table below for routine maintenance items and intervals of equipment:

Item	Inspection Method	Maintenance Period
System cleaning	Check the air outlet and heat sink for dust and other blockages. If needed, clean the air outlet and heat sink.	Semi-annually annually (as per the ambient dust content)
Equipment inlet hole	Check the equipment inlet holes for incomplete blocking or large gaps, and if so, block it tightly.	Annually
Electrical connection	Check the cable connection for looseness, detachment, and damage, especially the contact part with the metal enclosure for cuts.	Semi-annually annually

Fan Maintenance

When the inverter is operated in a thermal environment, good ventilation and heat dissipation may minimize the chance of load shedding. The cooling fan, which is equipped outside the inverter, will reduce the excessive external temperature of the inverter. If the inverter's output power is reduced due to the excessive external temperature, the possible causes and countermeasures are listed below.

1. Clogged fan or excessive dust on the heat sink. Clean the fan, fan cover or heat sink;
2. Damaged fan. Replace it with a new fan.
3. Poor ventilation of inverter installation site. Choose a suitable installation site according to the basic installation requirements.

Fan Cleaning and Replacement Steps

Before cleaning or replacing the fan, ensure the DC/AC sides of the inverter are disconnected:

- Turn off the DC switch;
- Unplug the DC terminal (for users, use tools to disconnect the DC connection terminal);
- Turn off AC switch.

Use a screwdriver to remove the plate screws of the fan shown as below:

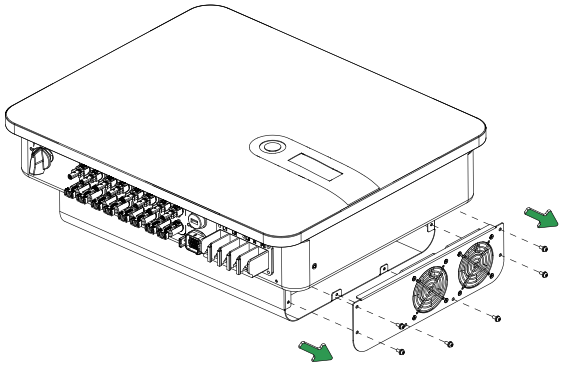

1. Disconnect the fan connector, remove the plate screws of the fan with a screwdriver, and finally remove the fan;
2. Clean the fan, fan grid, and heat sink or replace the fan:
   - Clean the heat sink with air pump, and use the brush or damp cloth to clean the fan and fan grid;
   - If needed, remove the fan and clean it separately;
   - Remove the fan to be replaced with a cross screwdriver;
   - Replace with a new fan.
3. Reinstall the fan plate and inverter.

Quality Warranty

For faulty inverters during the warranty period, **CATHODE POWER PRIVATE LIMITED** will repair or replace them for free.

Proof

During the warranty period, customers are required to present the invoice and purchase date of inverter. Moreover, the trademark on the inverter shall be clearly visible, or the **CATHODE POWER** assumes no liability for the warranty.

Condition

- Replaced failed inverters shall be handled by the Company;
- Customers shall reserve a reasonable time for the Company to repair faulty equipment.

Immunity From Liability

The Company assumes no liability for the warranty of the product in the event of:

- Entire inverter and/or parts beyond the free warranty period;
- Damage in transportation;
- Improper installation, modification or use;
- Operation in extremely harsh conditions beyond those described in the Manual;
- Equipment failure or damage not caused from the installation, repair, modification or disassembly by our service team and personnel;
- Non-conformance to the relevant international standards for installation and use;
- Damage caused by abnormal natural environment.

For the product failure caused by above reasons, the Company may provide paid maintenance service based on the customers' service requests which will be decided by the service institute.

As the dimension and parameter of products change, the latest information of our company shall prevail without prior notice.

TECHNICAL DATA
(CP30HL TO CP50HL)

MODEL NO.	CP30HL	CP33HL	CP36HL	CP40HL	CP45HL	CP50HL
DC Side | Input Parameters						
Max. Input Power	36kWp	40kWp	43.2kWp	48kWp	54kWp	60kWp
Max. P.V. Power (Per MPPT)	12kWp	13.5kWp	15kWp	16kWp	14kWp	15kWp
Max. DC Voltage	1000V					
Start-up Voltage	180V					
Nominal Voltage	600V					
MPPT Voltage Range	200V - 900V					
No. of MPP Trackers	3	3	3	3	4	4
No. of PV Strings Per MPP Tracker	2					
Max. Input Current Per MPP Tracker	32A					
Max. Input Short-Circuit Current Per MPPT	40A					
AC Side | Output Parameters						
AC Nominal Output Power	30kW	33kW	36kW	40kW	45kW	50kW
Max. AC Apparent Power	33kVA	36kVA	39.6kVA	44kVA	49.5kVA	55kVA
Nominal AC Voltage L-N / L-L (Range*)	230V / 400V (290V - 490V)					
AC Grid Frequency (Range*)	50Hz (45Hz - 55Hz)					
Max. Output Current (PF=0.9)	48.3A	54.5A	60A	66.7A	75A	84.1A
Adjustable Power Factor	>0.99, 0.8 Leading To 0.8 Lagging					
TDHi	<3%					
AC Grid Connection Type	3L/N/PE or 3L/PE					
Efficiency						
Maximum Efficiency	98.5%					
European Efficiency	98.2%					
MPPT Efficiency	99.9%					
Safety & Protection						
Anti-Flow Protection	OPTIONAL					
DC Switch	YES					
DC Reserve Polarity Protection	YES					
AC / DC Surge Protection	TYPE I + II / TYPE II					
Insulation Resistance Monitoring	YES					
AC Short - Circuit Protection	YES					
Grid Monitoring	YES					
Anti-islanding Protection	YES					
Residual-Current Monitoring Unit (GFCI)	YES					
String Fault Monitoring	YES					
AFCI Protection	OPTIONAL					
Anti PID Function	YES					
General Parameters						
Noise	<50dB					
Dimension (WxHxD)	590x480x237mm					
Weight (Kg)	32 kg				34 kg	
Operating Temperature Range	-25°C To +60°C (>45°C Derating)					
Relative Humidity	0-100%					
Altitude	4000m (>3000m Derating)					
Self-Consumption At Night	<4w					
Topology	Transfomerless					
Cooling	Intelligent Air Cooling					
Protection Degree	IP66					
DC Connection	H4 / MC4 (Optional)					
AC Connection	Lug Connector					
Warranty	10 Years					
Display	LED					
Communication Interface	Yes: RS 485/USB/Bluetooth, Optional: 4G/WI-FI					

#YEHSWADESHIHAI

CATHODE POWER | SPREADING GOODNESS WITH TRUST

Cathode Power Pvt. Ltd..

Corporate Office: SF 201-203, Fortune Platinum, Nr. Tulsidham Circle, Manjalpur, Vadodara, Gujarat-390011

Factory Office: R.S. No.229, Sugar Factory, Ta. Karjan, Opp. Gandhara Gandhara, Gujarat-391210

Contact: +91 98002 68002

Email: hello@cathodepower.com

Website: www.cathodepower.com