
TEMCO LEARN

TStat8

Output Setting · built Nov 12, 2026

Output Setting

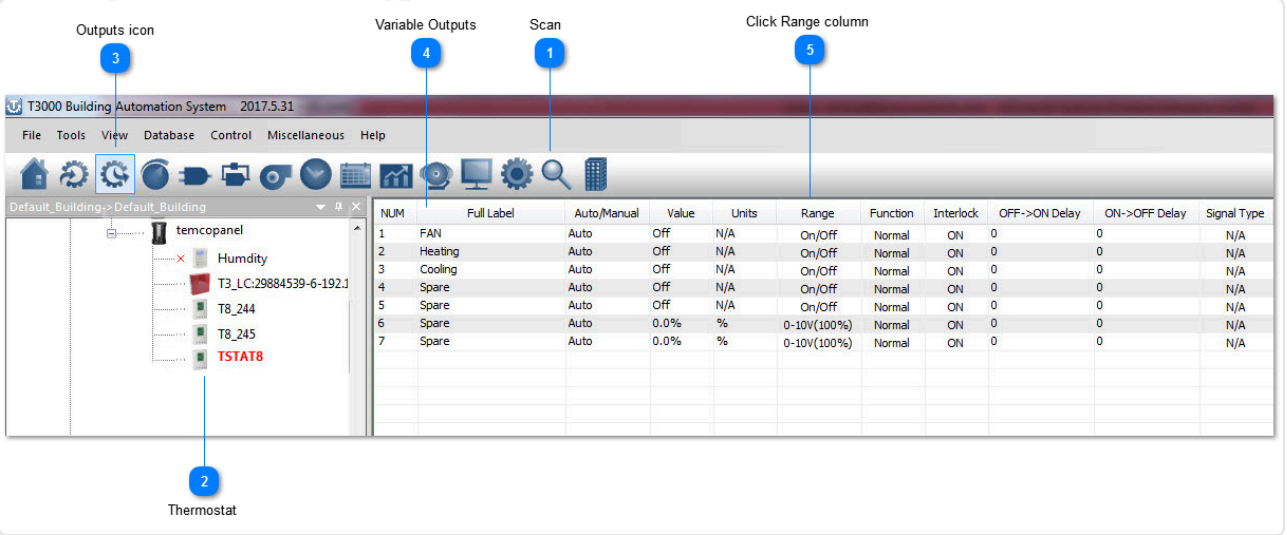

Scan




Scan the network and discover all devices.

Thermostat



Select the thermostat from the tree.

For a fast way to set up the stat you can just load the config file, attached. The steps I did to create this config file are explained below.



Outputs icon



Select the outputs icon.

Variable Outputs

NUM	Full Label
1	FAN
2	Heating
3	Cooling
4	Spare
5	Spare
6	Spare
7	Spare

Click to give each output a name and a range, in the case of the fan the outputs are on-off and the valves are modulating 0-10V = 0-100% which are the default ranges already.

Click Range column

Range
On/Off
On/Off
On/Off
On/Off
On/Off
0-10V(100%)
0-10V(100%)

Click the Range column to see many options available for the range setting such as PWM and floating three wire control for modulating actuators using two relay outputs.