
TEMCO LEARN

TStat8

Two heat two cool setting · built Nov 12, 2026

Two heat two cool setting

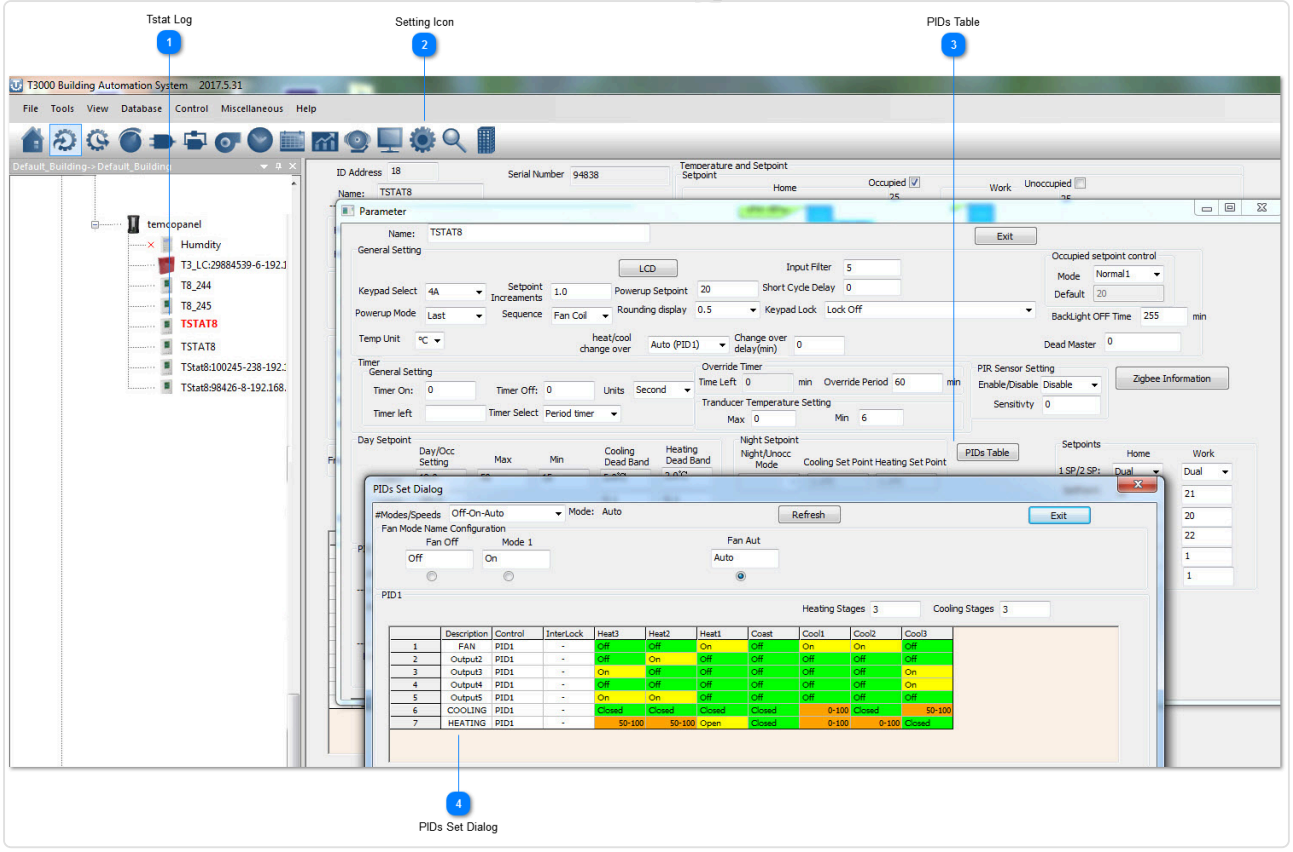

Tstat Log




Click on the gear icon to get to the advanced settings.

Setting Icon




Click to get to the PID tables, this is where we assign outputs to act over each stage of heating and cooling.

PIDs Table



: Insert description text here...

PIDs Set Dialog

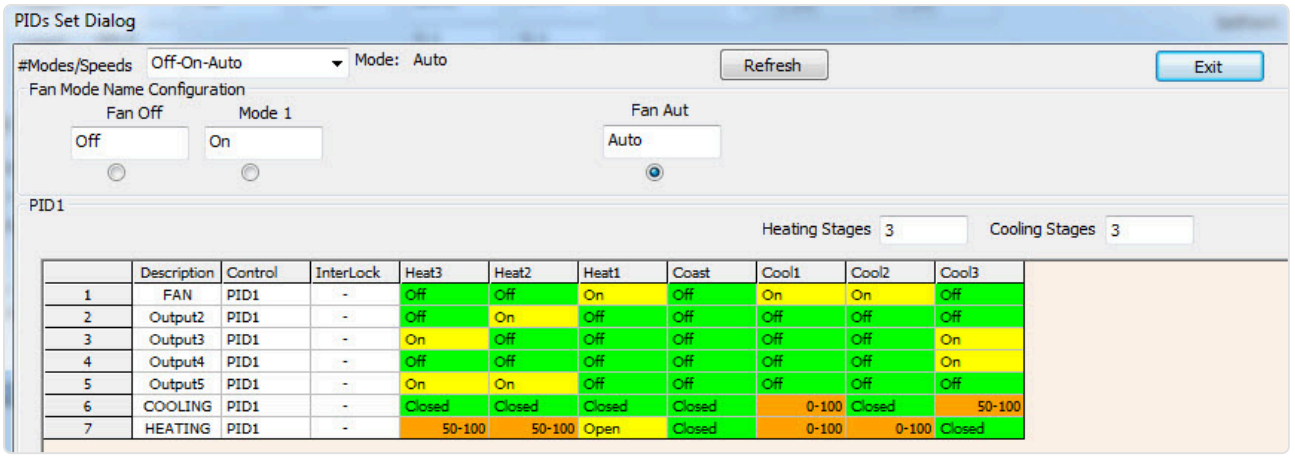

	Description	Control	InterLock	Heat3	Heat2	Heat1	Coast	Cool1	Cool2	Cool3
1	FAN	PID1	-	Off	Off	On	Off	On	On	Off
2	Output2	PID1	-	Off	On	Off	Off	Off	Off	Off
3	Output3	PID1	-	On	Off	Off	Off	Off	Off	On
4	Output4	PID1	-	Off	Off	Off	Off	Off	Off	On
5	Output5	PID1	-	On	On	Off	Off	Off	Off	Off
6	COOLING	PID1	-	Closed	Closed	Closed	Closed	0-100	Closed	50-100
7	HEATING	PID1	-	50-100	50-100	Open	Closed	0-100	0-100	Closed

PIDs Set Dialog shows the details of the setting.

The contents of Two heat two cool setting