



GPIO0GPIO boot mode, pull-up
GPIO1GPIO, UARTTXD0 (UART0)
GPIO2GPIO boot mode, pull-down
GPIO3GPIO, UARTRXD0 (UART0)
GPIO4GPIO-
GPIO5GPIO-
GPIO12GPIO boot mode, pull-down
GPIO13GPIO-
GPIO14GPIO-
GPIO15GPIO boot mode, pull-up
GPIO16GPIO-
GPIO17GPIO-
GPIO18GPIO, SPISCK (SPI)
GPIO19GPIO, SPIMISO (SPI)
GPIO21GPIO, I2CSDA (I2C)
GPIO22GPIO, I2CSCL (I2C)
GPIO23GPIO, SPIMOSI (SPI)
GPIO25GPIO, DACDAC1 (8-bit)
GPIO26GPIO, DACDAC2 (8-bit)
GPIO27GPIO-
GPIO32GPIO, ADCADC1_CH4
GPIO33GPIO, ADCADC1_CH5
GPIO34GPIO, ADCADC1_CH6 ()
GPIO35GPIO, ADCADC1_CH7 ()
GPIO36GPIO, ADCADC1_CH0 ()
GPIO39GPIO, ADCADC1_CH3 ()

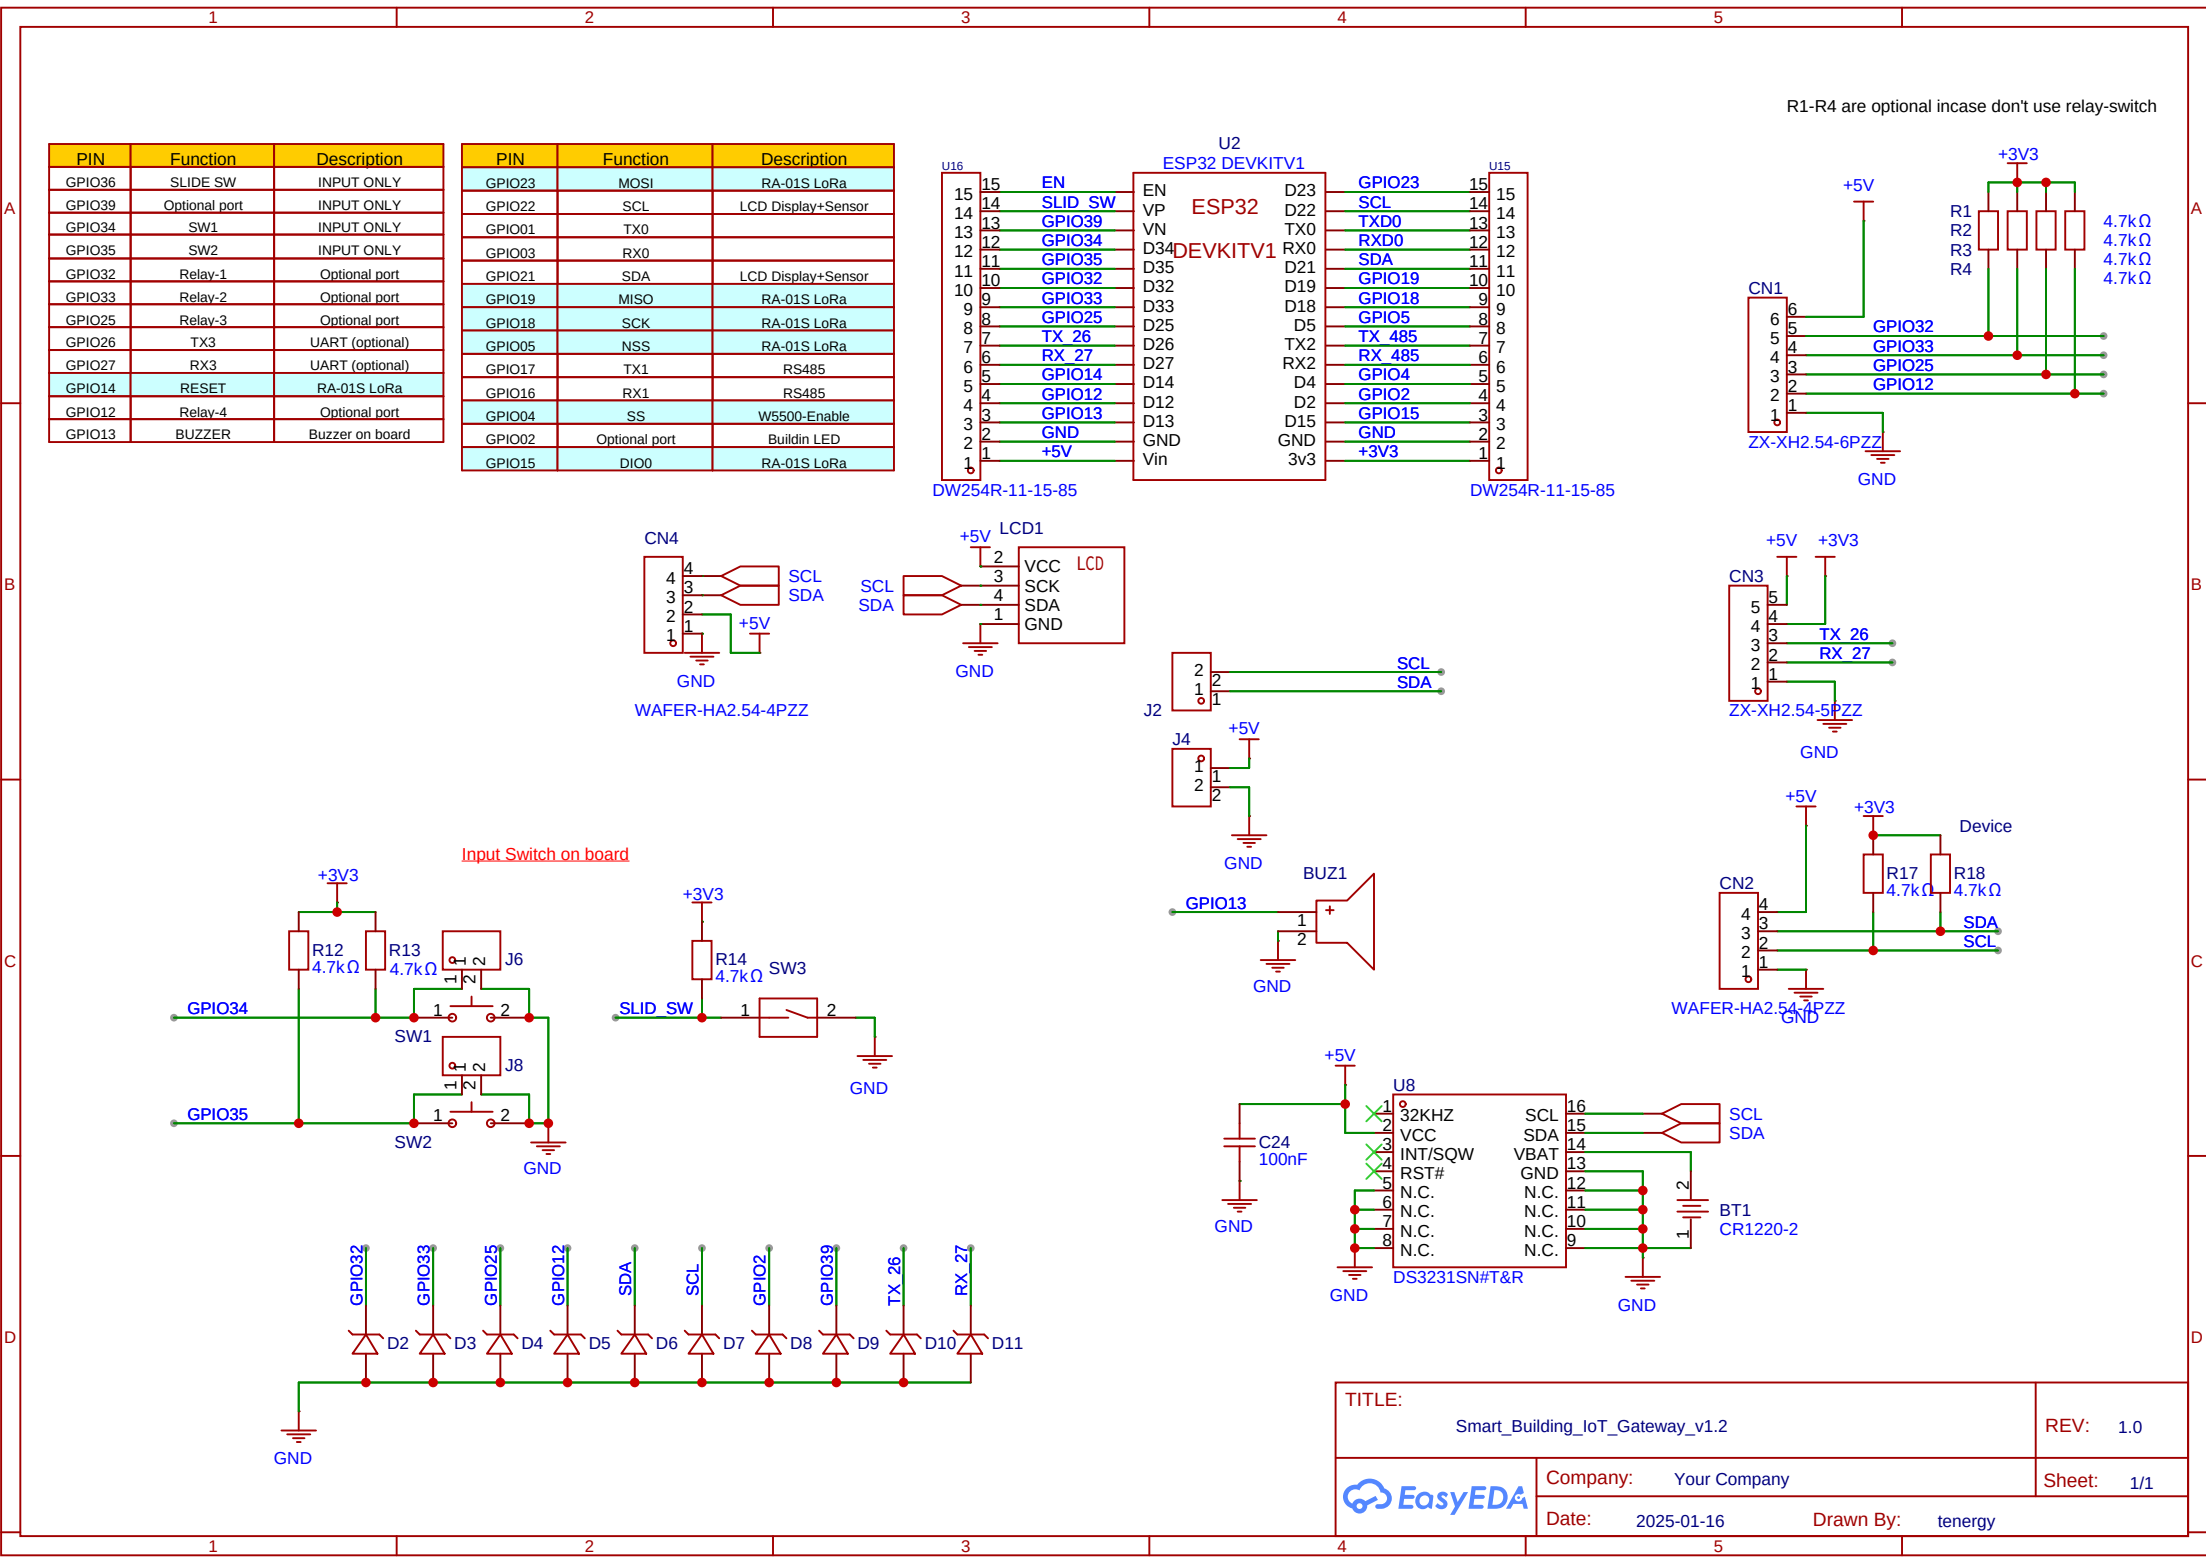


RS485 Circuit

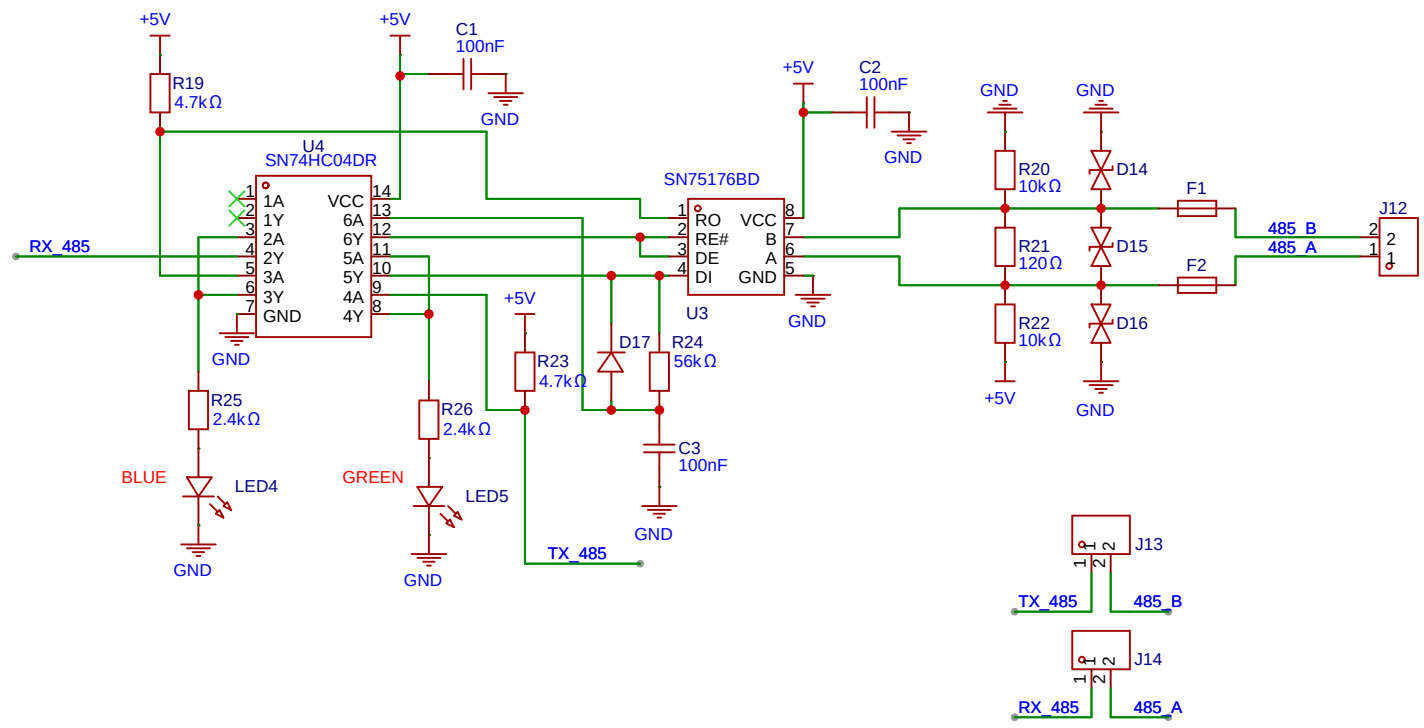

TITLE: Smart_Building_IoT_Gateway_v1.2		REV: 1.0
EasyEDA	Company: Your Company	Sheet: 1/1
	Date: 2025-01-17	Drawn By: tenergy


Power Supply Circuit

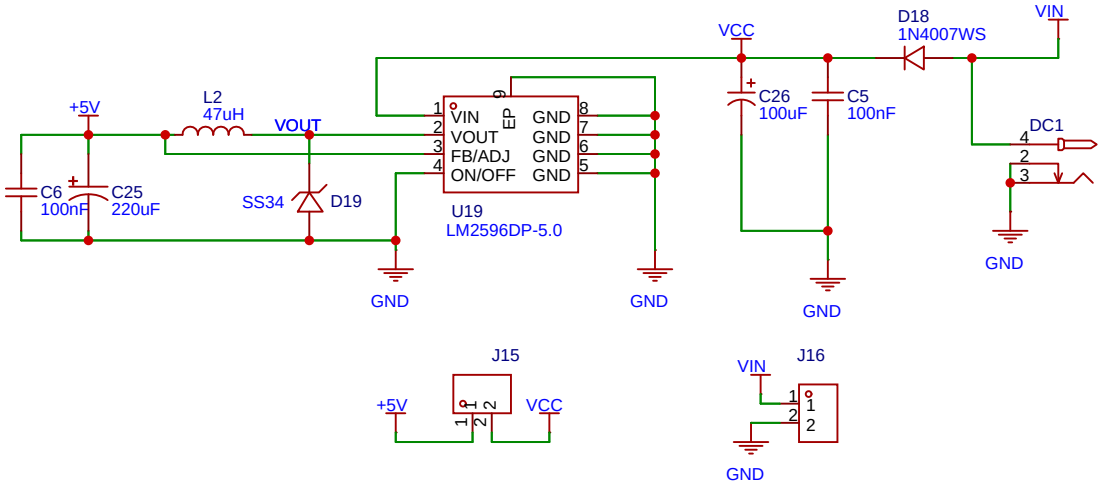

TITLE:		REV: 1.0
Smart_Building_IoT_Gateway_v1.2		
EasyEDA	Company: Your Company	Sheet: 1/1
	Date: 2025-01-17	Drawn By: tenergy

LoRa Module RA-01S


PIN	TYPE
GPIO19	MISO
GPIO23	MOSI
GPIO18	SCK
GPIO05	NSS (RA-01S)
GPIO14	RESET
GPIO15	DIO0

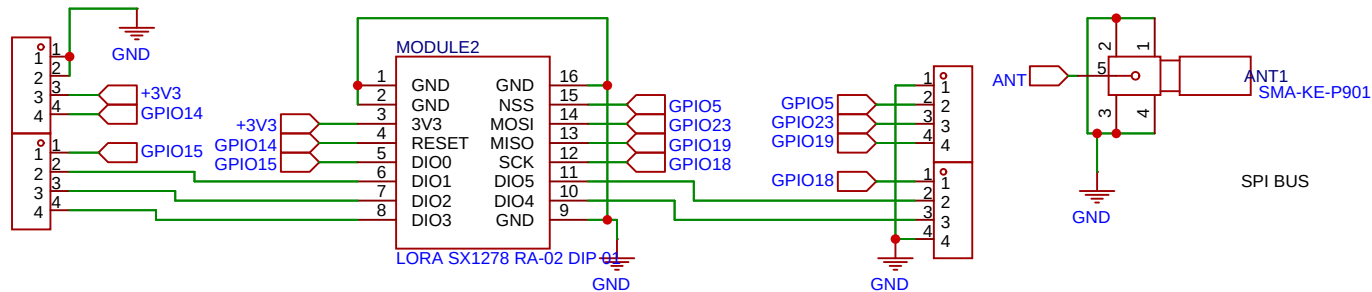

W5500 INTERNET

SPI BUS


PIN	TYPE
GPIO19	MISO
GPIO23	MOSI
GPIO18	SCK
GPIO04	SS (W5500)

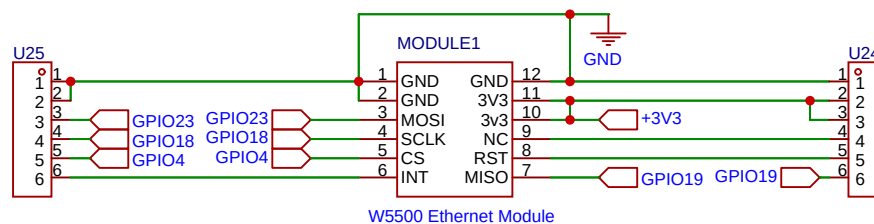

TITLE: Smart_Building_IoT_Gateway_v1.2		REV: 1.0
Company: Your Company		Sheet: 1/1
Date: 2025-01-17	Drawn By: tenergy	



Dry Contact Relay

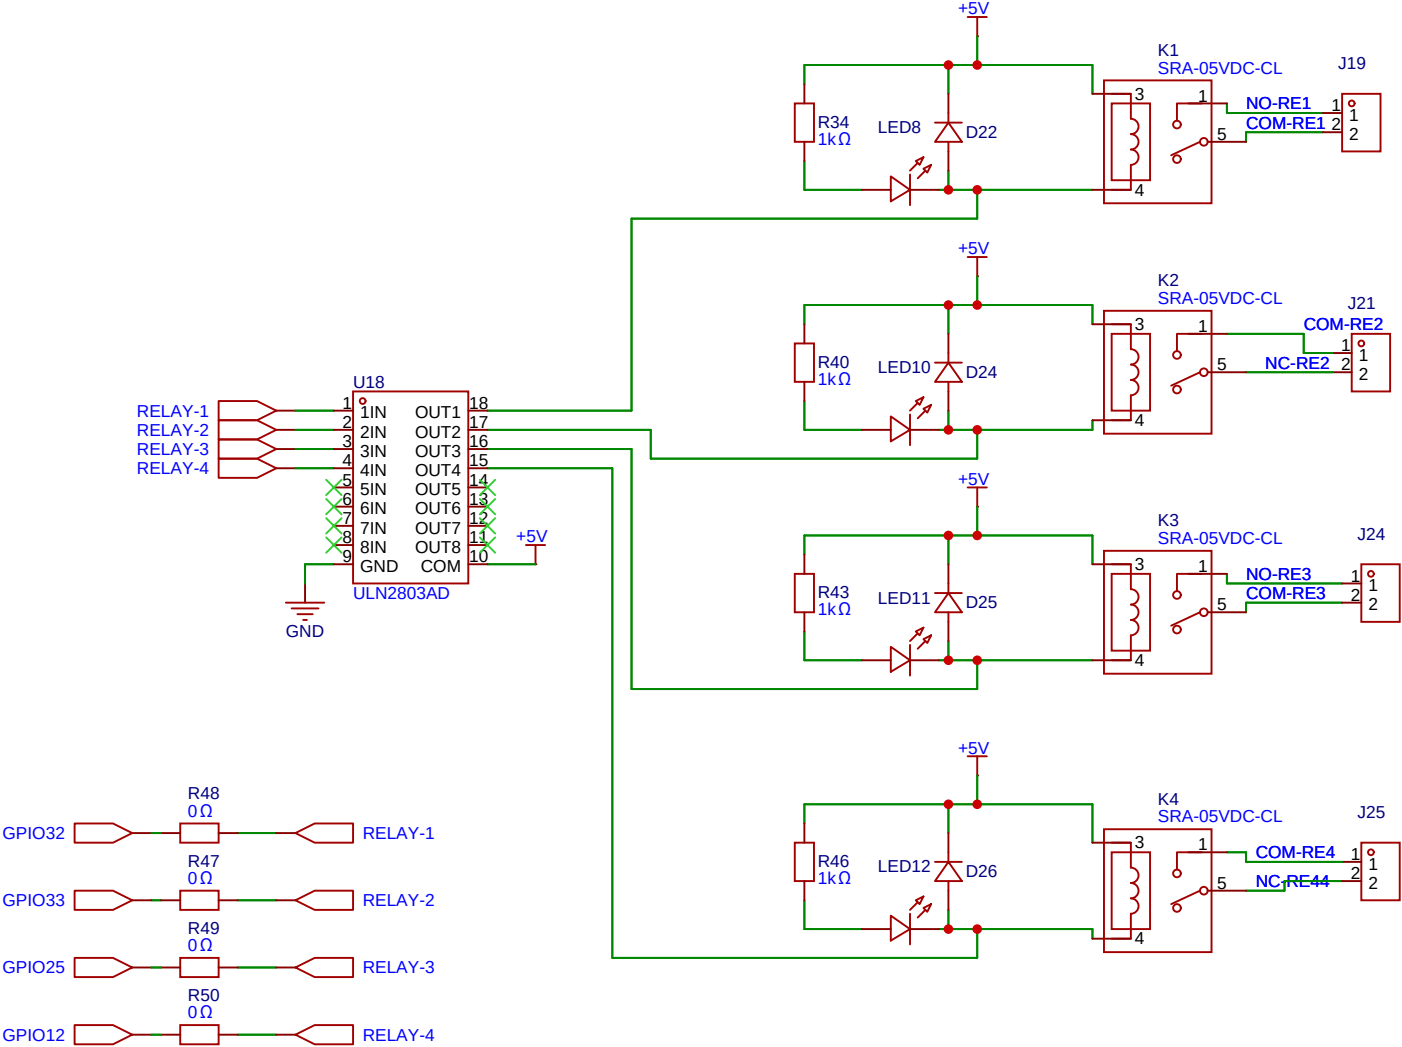

Remove R48-R5 incase don't use relay-switch

TITLE:		Smart_Building_IoT_Gateway_v1.2	REV: 1.0
EasyEDA	Company:	Your Company	Sheet: 1/1
	Date:	2025-01-17	Drawn By: tenergy