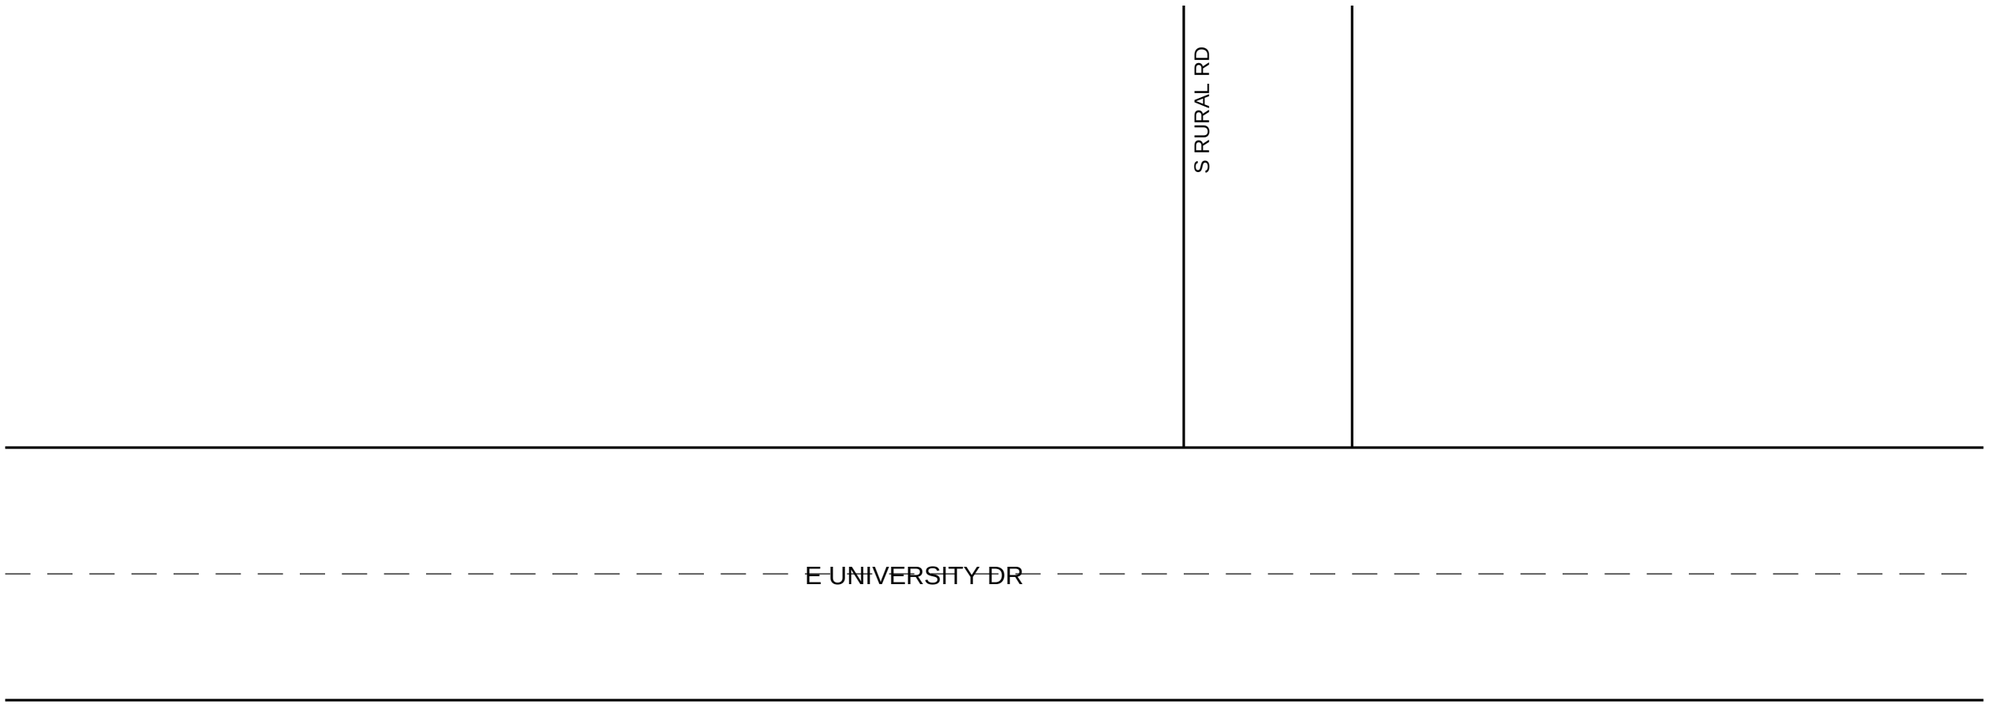

REMOVE EXIST. 40' POLE

REMOVE TRANSFORMER

CONSTRUCT SPAN #2 PRIMARY

CONSTRUCT 45' CL2 POLE

CONSTRUCT 50 KVA XFMR

GENERAL NOTES

1. ALL REMOVED MATERIAL SHALL BE RETURNED TO THE YARD.
2. CONTRACTOR SHALL CALL AZ811 PRIOR TO EXCAVATION.
3. CONSTRUCT PER UTILITY STANDARDS LATEST REVISION.

SCALE: 1" = 40'

ELECTRIC UTILITY

DISTRIBUTION DESIGN

W.O. # 7654321

1200 E UNIVERSITY DR

TEMPE, AZ

SCALE: 1" = 40'

SHEET 1 OF 1