



ISOMETRIC VIEW


MATERIAL LIST						
Mark	Qty.	Description	Length	Grade	Part(kg)	Total(kg)
M191	1	610UB113-BH607*228*12*18	7346	Q355B	876.0	876.0
P1	2	PL32*350	827	Q355B	72.7	145.4
P2	4	PL12*110	110	Q355B	1.1	4.6
P9	1	PL10*241	330	Q355B	6.2	6.2
P15	1	PL10*240	333	Q355B	6.3	6.3
P50	5	PL10*75	256	Q355B	1.5	7.6
P51	4	PL6*94	100	Q355B	0.4	1.8
Totals for ONE assembly					1047.8	
Combined Total for Assembly CONSULTANT S5.0 R2 SPLICE REQUIREMENT						

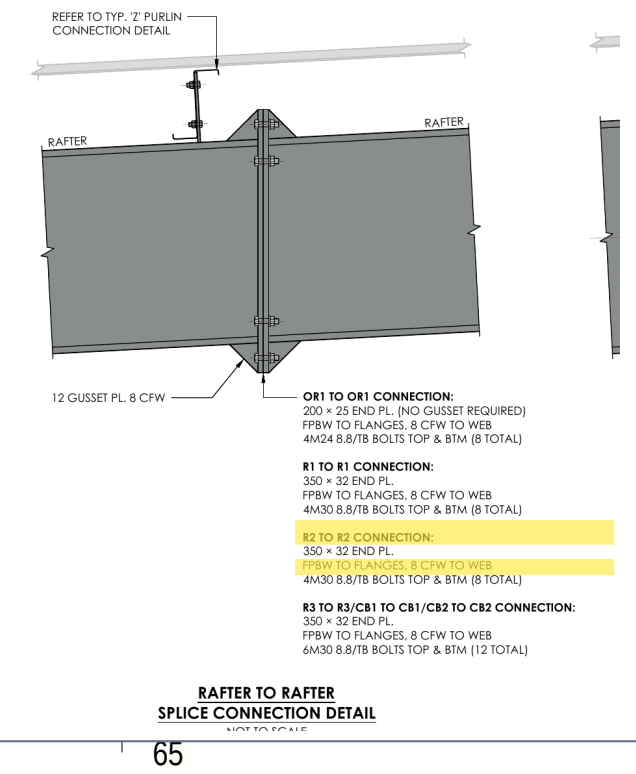

B - B

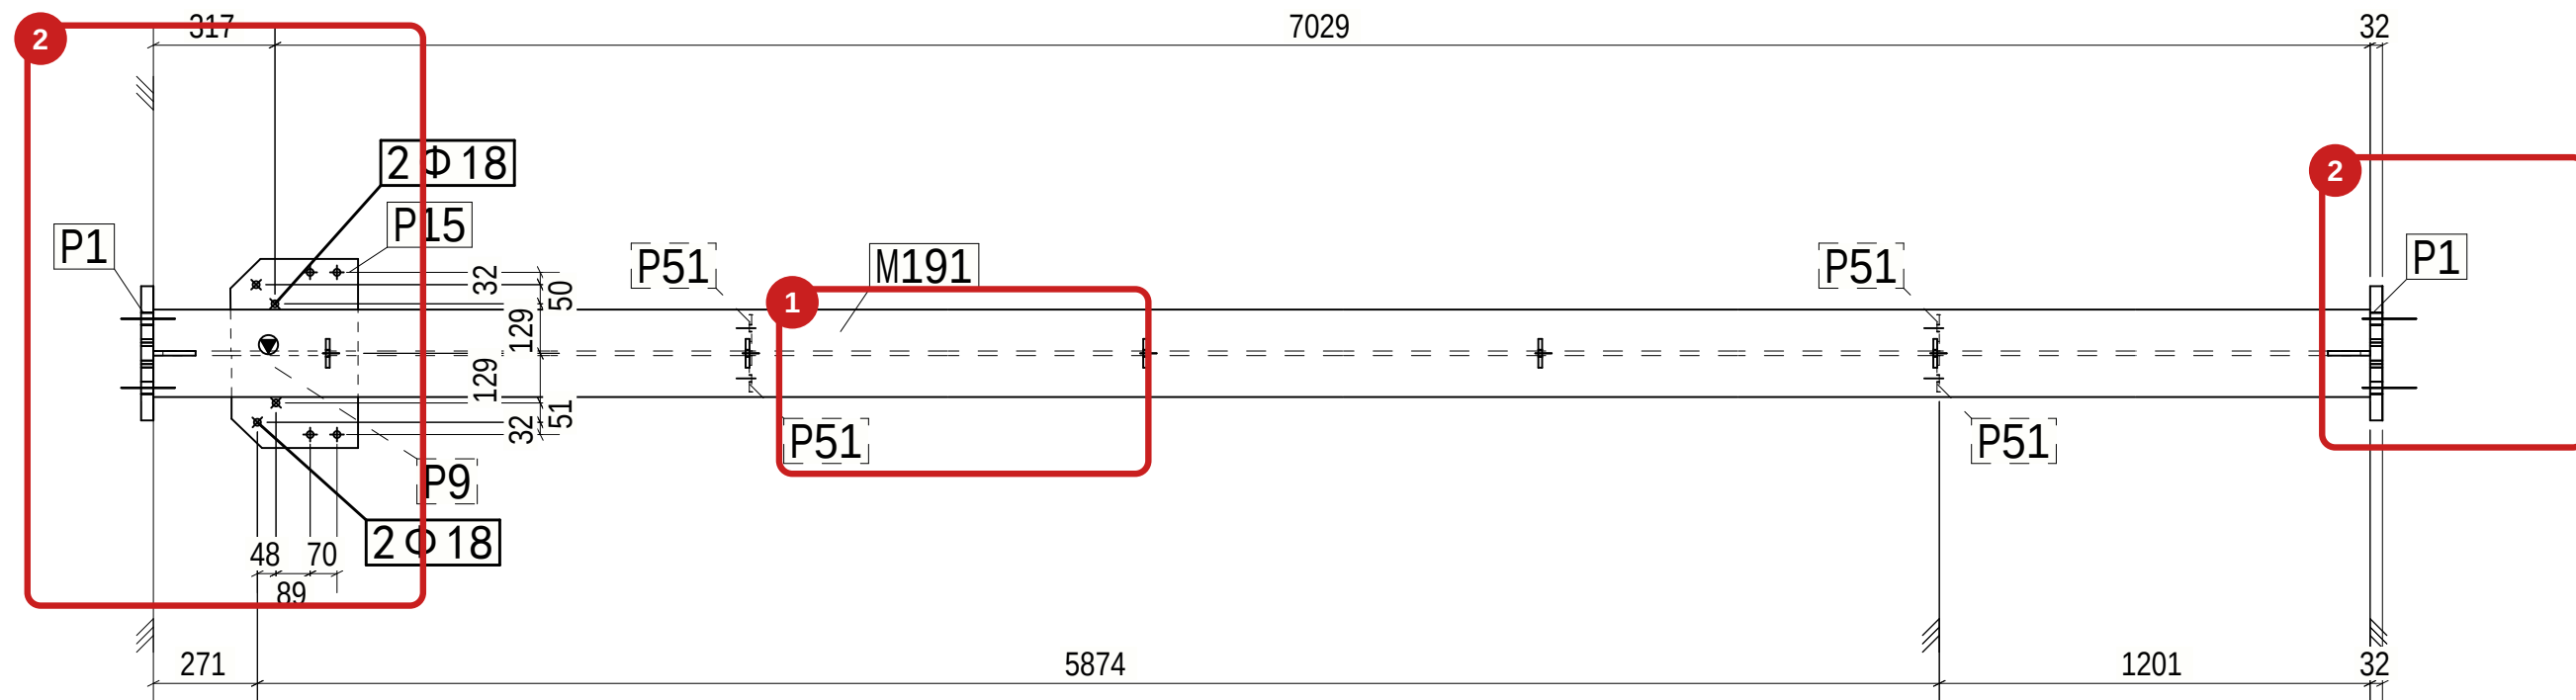

A - A

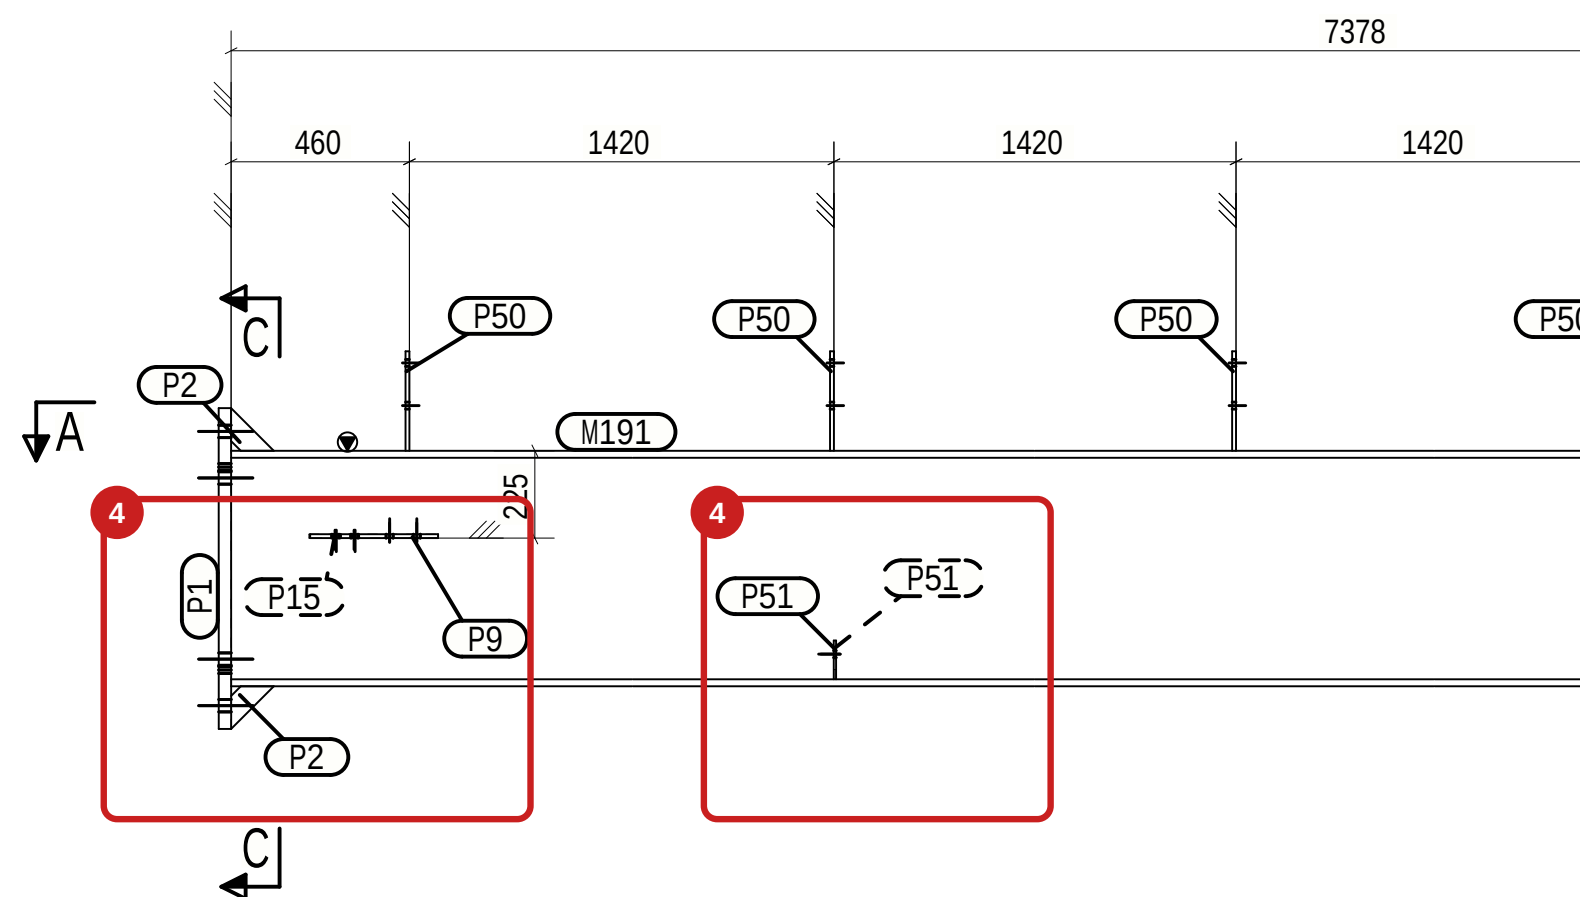

1 REQ'D AS DRAWN MK: BM101


FINSH: HDG

ISSUES BM101-01 / 02 / 03 / 04 | R2 RAFTER SPLICES

1. Consultant R2 requires PRESET 100 mm; direction, datum and verification are not defined.
2. Consultant S5.0 requires 8 CFW TO WEB; only the general 6 CFW U.N.O. note is shown.
3. P1 Part: 32 hole centre is 60 mm from plate edge, giving 44 mm edge distance; minimum is 48 mm.
4. P9/P15 and P51 groups lack explicit along-member location dimensions from a clear datum.

ACTION: revise preset, weld, P1 edge-distance and fitting-plate location information.

Bolt report cross-check: BM101-BM49 / BM104 | 8 x M30 HS8.8/TB, 120 long, grip 64 | RP9 matched.

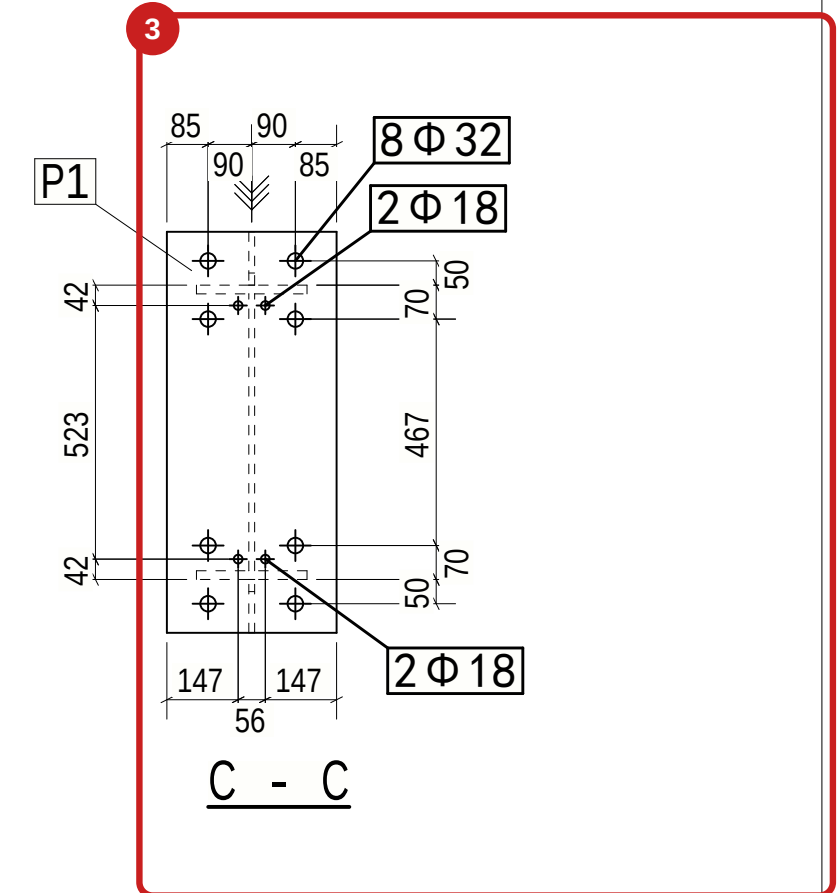
$$\underline{C - C}$$

B	ISSUED FOR APPROVAL	13/1/2026	J M	P T	Paul T
A	ISSUED FOR APPROVAL	4/1/2026	J M	P T	Paul T
REV	DESCRIPTION	DATE	DRN	CHK	APPO

GENERAL NOTES

1. MARK TO BE STAMPED ON TOP FACE WHERE INDICATED
2. STEEL FABR. & CONST. IN ACCORDANCE W/ AS/NZS 5131
3. HOLES SHALL BE 22 U.N.O
4. ALL SNIPES TO BE 15x15 U.O.N.
5. ALL NOTCHES SHALL HAVE 11mm RAD AT INSIDE CORNER
6. ALL WELDS TO BE STRUCTURAL PURPOSE, 6mm CFW U.N.O.
7. WELD TO BE PERFORMED IN ACCORDANCE W/ AS/NZS 1554
8. FABRICATION TOLERANCE -2/+0

DOCUMENTATION



CLIENT



PROJECT:

FINSBURY GREEN FACILITY

Project No.
MSC-J-239

Scale: 1:20

DO NOT SCALE - IF IN DOUBT ASK

DESCRIPTION:

BEAM DETAILS

Drawing No.

BM101

REV
B