




MATERIAL LIST						
Mark	Qty.	Description	Length	Grade	Part(kg)	Total(kg)
M352	1	CHS114*4	4587	Q355B	53.9	53.9
P53	2	PL10*160	150	Q355B	1.9	3.8
P54	2	PL10*150	150	Q355B	1.8	3.5
Totals for ONE assembly					61.2	
Combined Total for Assembly of			5	306.1		

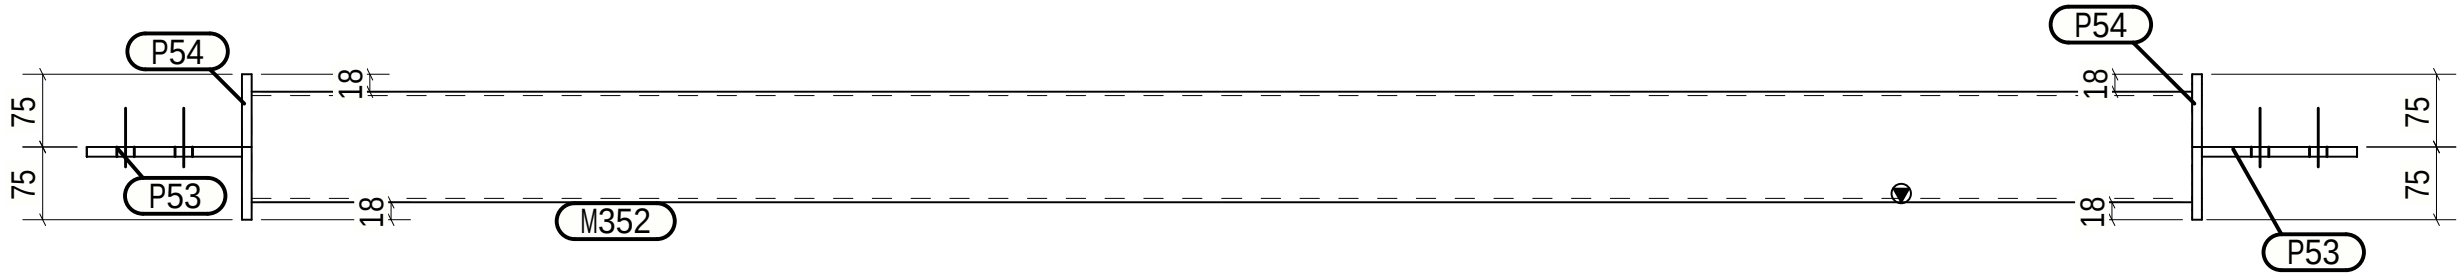

A - A

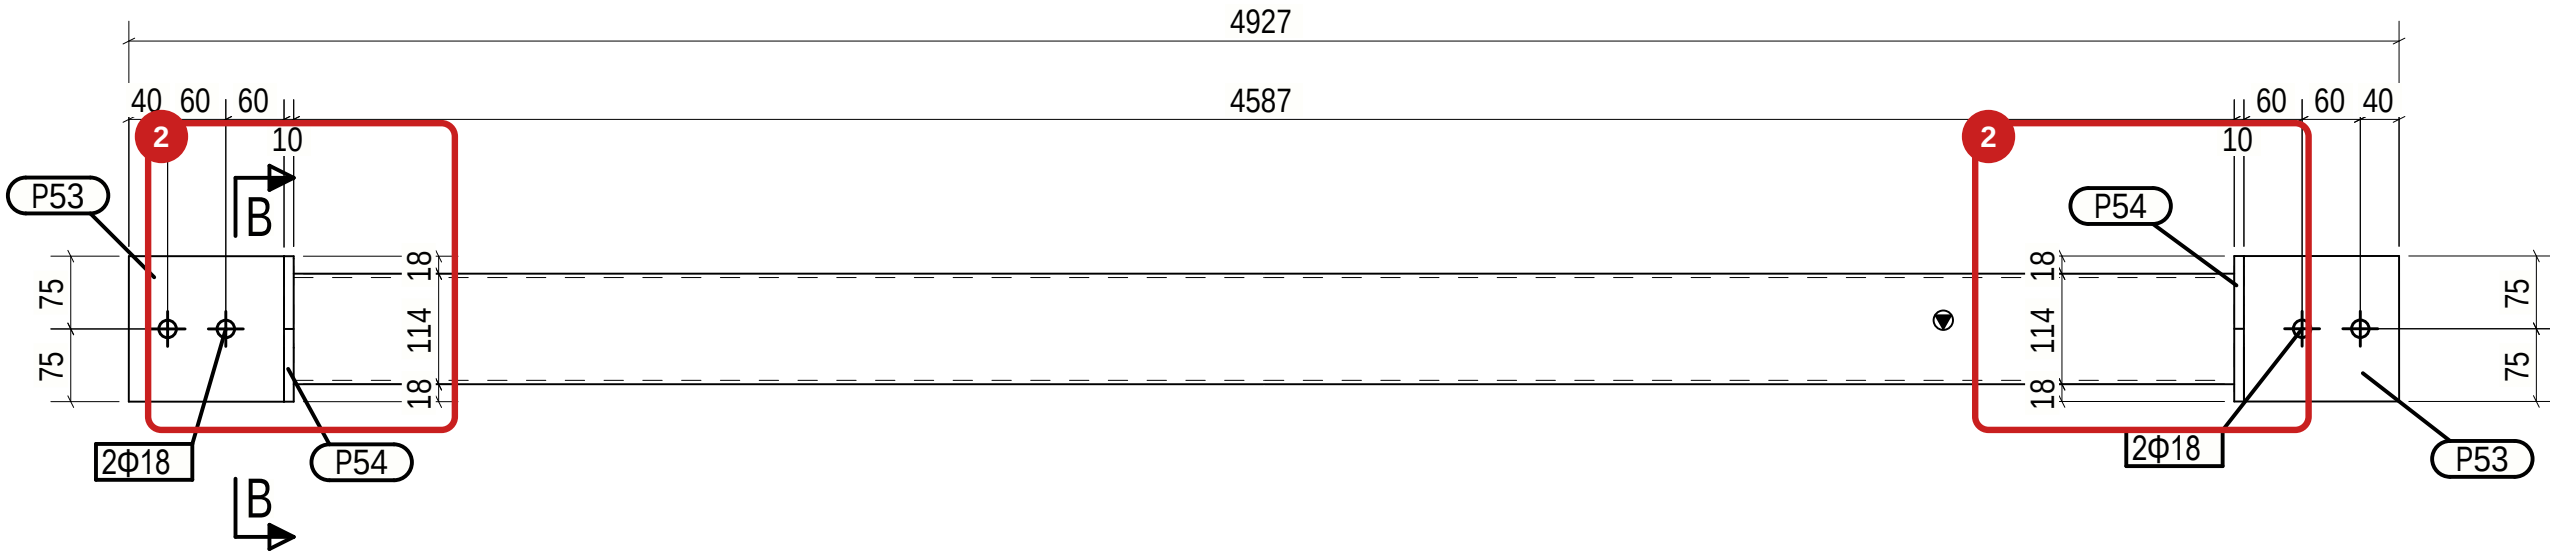

B - B
1:10

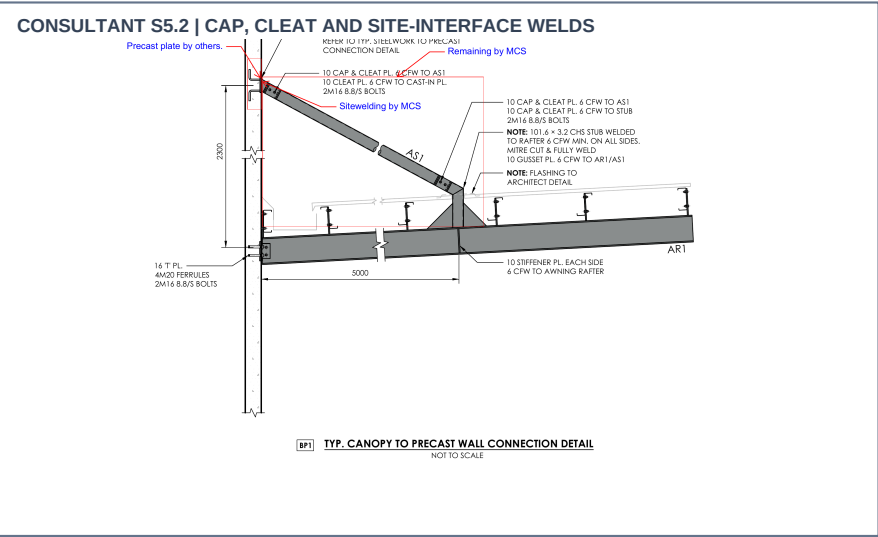

ISSUES CTB1-01 / 02 | AS1 AWNING STRUT

- P54 solid end caps close the CHS114x4 member; no HDG vent/drain holes or approved alternative are shown.
- Consultant S5.2 cap/cleat and site-interface weld requirements are not explicitly located or defined on CTB1.

ACTION: add galvanizing vent/drain strategy and explicit shop/site weld callouts at both end interfaces.

Bolt report cross-check: CTB1-BM12/BM13/BM14/BM15/BM18 | 2 x M16 HS8.8 each | RP9 matched.

5 REQ'D AS DRAWN MK: CTB1

FINSH: HDG

REV	DESCRIPTION	DATE	DRN	CHK	APPD
B	ISSUED FOR APPROVAL	13/1/2026	J M	P T	Paul T
A	ISSUED FOR APPROVAL	4/1/2026	J M	P T	Paul T

GENERAL NOTES
1. MARK TO BE STAMPED ON TOP FACE WHERE INDICATED
2. STEEL FABR. & CONST. IN ACCORDANCE W/ AS/NZS 5131
3. HOLES SHALL BE 22 U.N.O.
4. ALL SNIPES TO BE 15x15 U.O.N.
5. ALL NOTCHES SHALL HAVE 11mm RAD AT INSIDE CORNER
6. ALL WELDS TO BE STRUCTURAL PURPOSE. 6mm CFW U.N.O.
7. WELD TO BE PERFORMED IN ACCORDANCE W/ AS/NZS 1554
8. FABRICATION TOLERANCE -2/+0

DOCUMENTATION



CLIENT



PROJECT:

FINSBURY GREEN FACILITY

DESCRIPTION:

Diagonal Brace DETAILS

Project No.

MSC-J-239

Scale: 1:10

DO NOT SCALE - IF IN DOUBT ASK

Sheet Size:

A3

Drawing No.

CTB1

REV

B