Road 4

Vertical Exaggeration: 5
Datum: 86.000M AOD

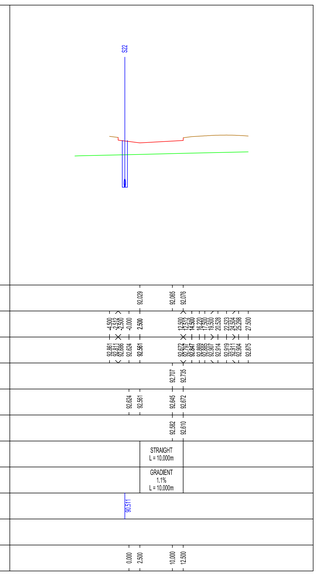

Road 5

Vertical Exaggeration: 5
Datum: 86.000M AOD

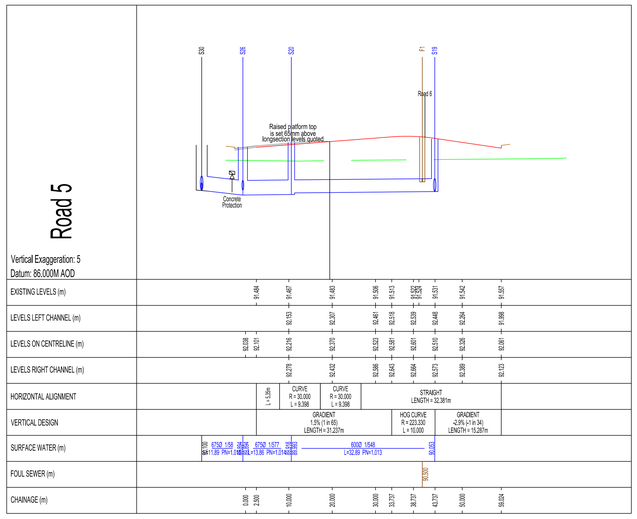

Road 6

Vertical Exaggeration: 5
Datum: 86.000M AOD

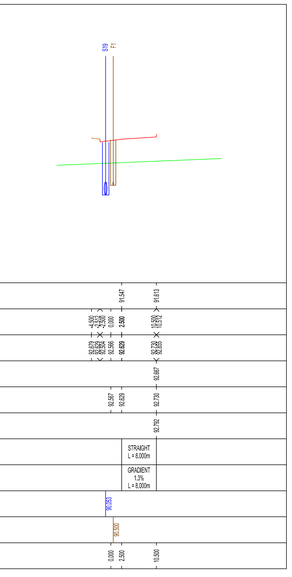

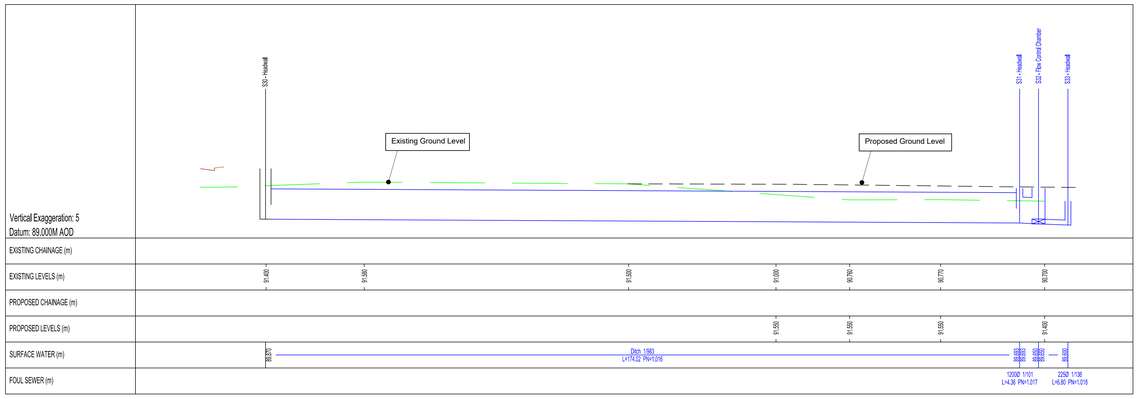

NOTES.

All sewers works to be constructed to the satisfaction of Adopting WATER Authority.

All adoptable drainage shall be in accordance with Sewer Sector Guidance appendix C: The Design and Construction Guidance and statutory undertakers requirements.

Standard Manhole Details are contained within the above document (DCG)

All roads to be constructed to the satisfaction of Swindon Borough Council together with current 'Design Guide', and the DT's Specification for Highway Works.

Trench backfill below formation within the Highway to be of an approved granular material (approved by Authority Inspector
- this includes service trenches.

All pipes to be laid on Class S bed and surround unless otherwise indicated. Hatching indicate concrete bed and surround.

Pipes 150mm-300mm (Clay)
Pipes 375mm - 675mm dia to be Concrete CN120.

Where pipes are laid at shallow depths, concrete cover slabs to be used as oppose to bed and surround, concrete cover slabs to be used where pipes are laid with a minimum depth of 1.2m or less. Where pipes are protected by a 150mm thick concrete slab placed above the pipe, this shall span the pipe trench and extend a minimum of 150mm both sides, widening the trench above the pipe surround, and there shall be a min. of 150mm of surround between the crown of the pipe and underside of the slab.

PLEASE NOTE.

Groundworks contractor to liaise with ADOPTING WATER AUTHORITY at tender stage to ensure they have approval for preffered manufacturer.

The groundworks contractor will be required (by ICOSA WATER) to demonstrate by an acceptable physical test that the pipe work satisfies the long-term deformation criteria.

Lateral Drain Chamber Location:

- Inside the Property Boundary
- Preferably in the driveway
- Not more than 1m from boundary
- Located outside of vehile wheel tracks
- Chamber diameter to be a min. of 450mm for 100/150mm pipes
- Chamber access to be restricted to 350mm opening if chamber is more than 1.2m deep
- Chambers may be of Plastic construction to BS7158 with integral seals
- Backdrops not permitted - ramps prefered.



Typical Slab Protection Detail - cover less than 1.2m

REV	DATE	DESCRIPTION	DRAWN
A	26.09.24	Planning Issue	DM

PROJECT: Swindon NEV
R8 & R9

TITLE: Road & Sewers

Taylor Wimpey Bristol
Ground Floor
730 Waterside Drive
Aztec West
Almondsbury
Bristol BS31 2AU

T 01454 628400
F 01454 628401
DX 124894 Almondsbury 3

www.taylorwimpey.com

NHBC REG No 76463

Taylor Wimpey

DRN	D Morgan	SCALE	LAND CODE	DRAWING NUMBER	REV
DATE	Feb 24	1:500 H 1:100 V	20933	05-02	A

Paper Size - ISO A0 (841.00 x 1189.00 MM)
C:\Users\DMorgan\Taylor Wimpey\Bristol Technical Team - Documents\General\cur-site\20933 Skylark, Woodlands, NEV Swindon\03-Design\03-Engineering\05-01-Road-Sewers.dwg