

Long-Term Power System Dynamic Simulation using Time Sequenced Power Flows

Thad Haines


Montana Tech - Master's Thesis Research Project

February 5th, 2019

Overview of Project

What are long-term dynamics (LTD)? [1]

Power System Dynamic Time Scales

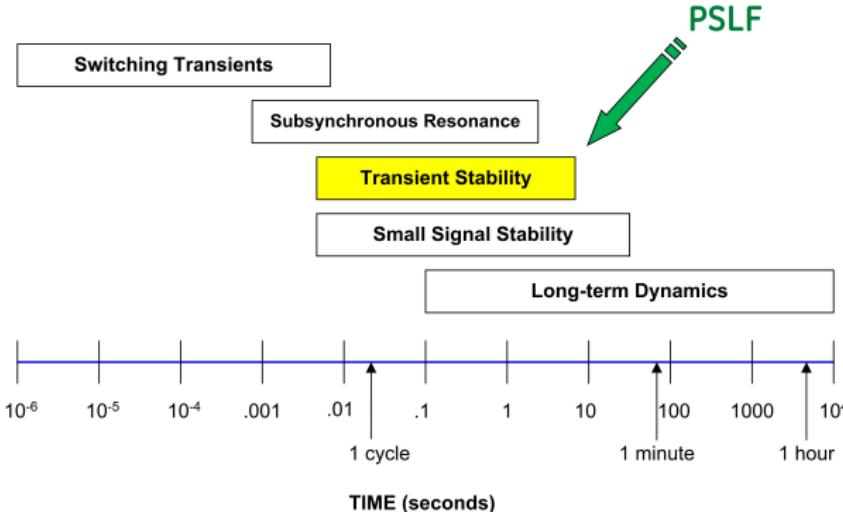

Overview of Project

This simulation assumes:

1. System remains stable.
2. System frequency is described by the combined PU swing equation:

$$\dot{\omega}_{sys} = \frac{1}{2H_{sys}} \left(\frac{P_{acc,sys}}{\omega_{sys}(t)} - D_{sys} \Delta\omega_{sys}(t) \right)$$

3. Time steps of 1 or 0.5 seconds.
4. Fast dynamics are 'mostly' ignored.

Overview of Project

Project Goals:

- ▶ Develop computer software for LTD simulations using PSLF systems (*.sav*), dynamic data (*.dyd*), and customized dynamic models.
- ▶ Use software to investigate system reactions that may be impractical to simulate using other approaches.
- ▶ Write a master's thesis about it.

Coding decisions, approaches, and software operation.

Python will be used because:

- ▶ PSLF communication
- ▶ Free
- ▶ Community Libraries
- ▶ Object Oriented Programming
(Agent-Based Modeling)

Coding decisions, approaches, and software operation.


► Agent

An autonomous individual object with properties and methods in a computer simulation.

► Agent-Based Modeling


The idea that a system can be modeled using agents in an environment, and a description of agent-agent and agent-environment interactions. [2]

Coding decisions, approaches, and software operation.

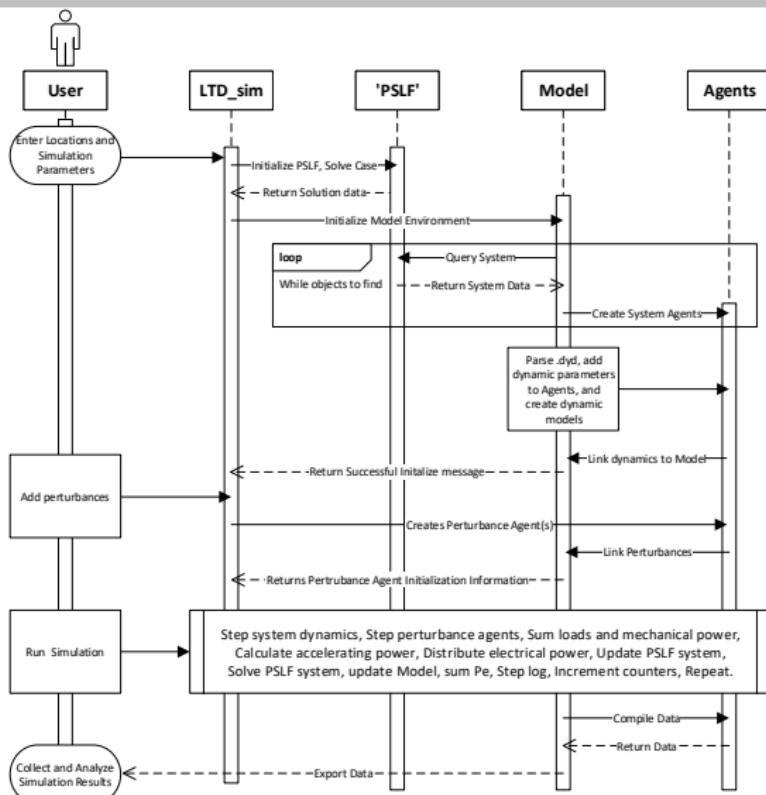

System Used for Initial Frequency Validation and Proof of Concept.





EE554.sav test system:

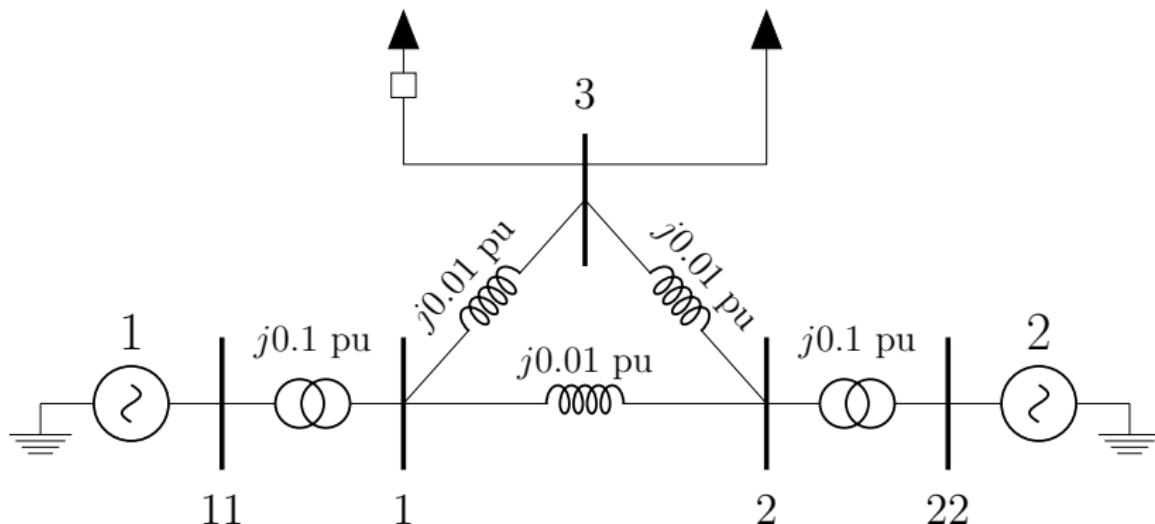

Generators are identical.
PSLF models have exciters.



+20 MW Load Step at t=2

System Response

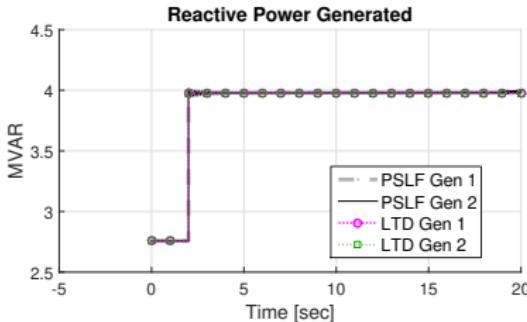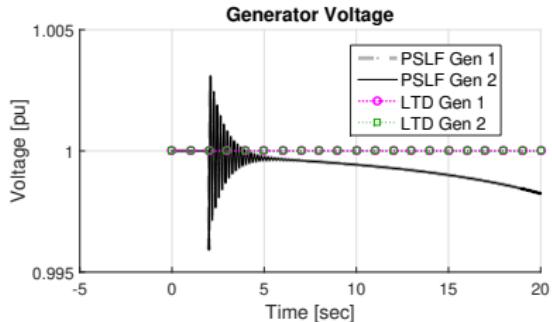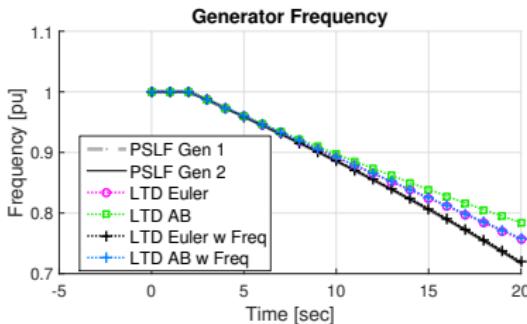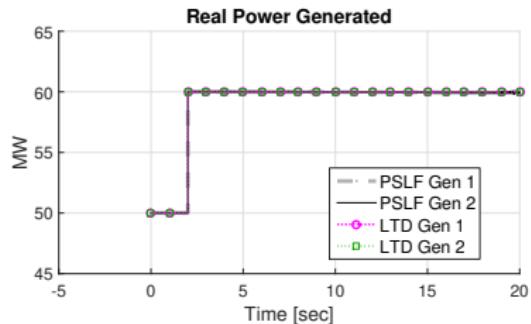





+20 MW Load Step at t=2

Detailed Frequency Response

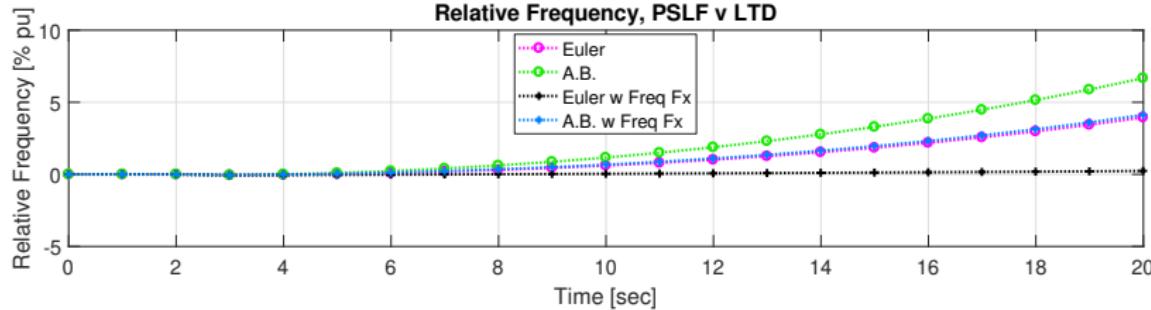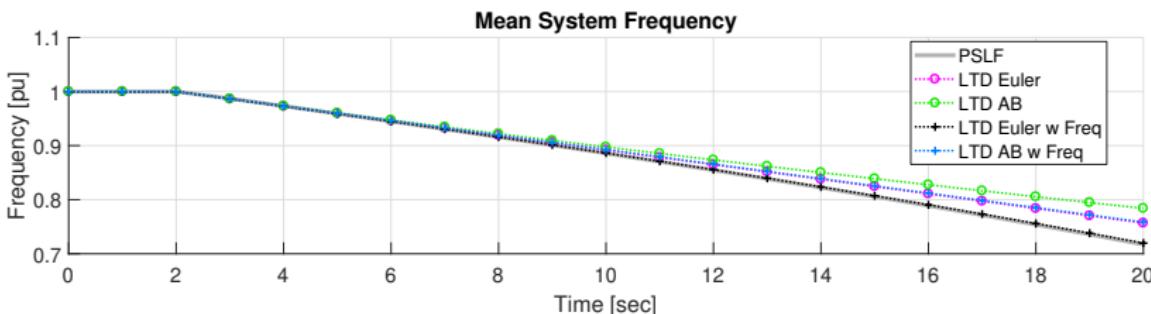



-20 MW Load Step at t=2

System Response

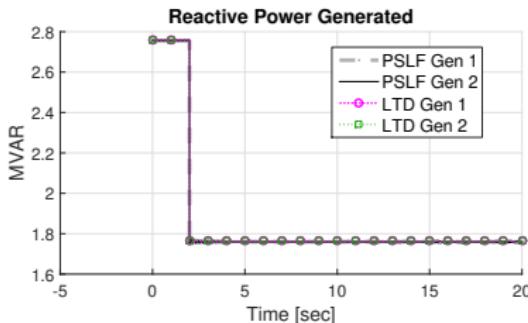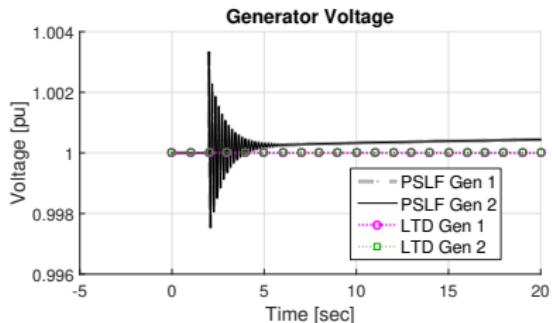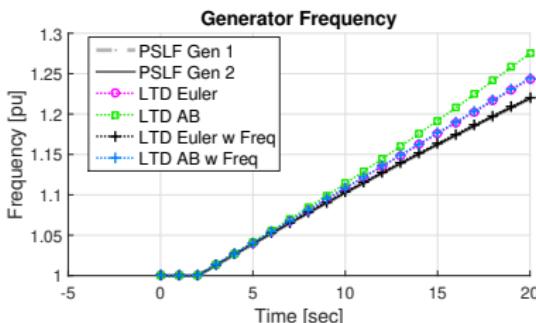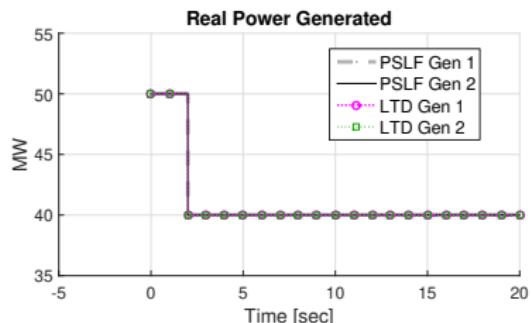


-20 MW Load Step at t=2

Detailed Frequency Response

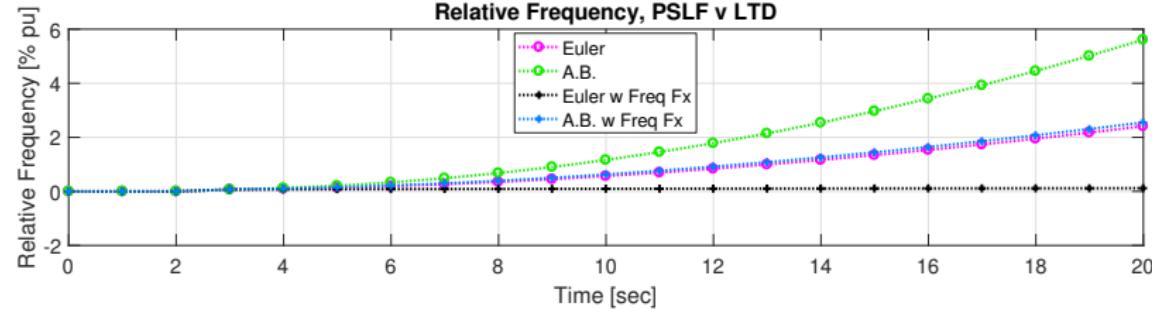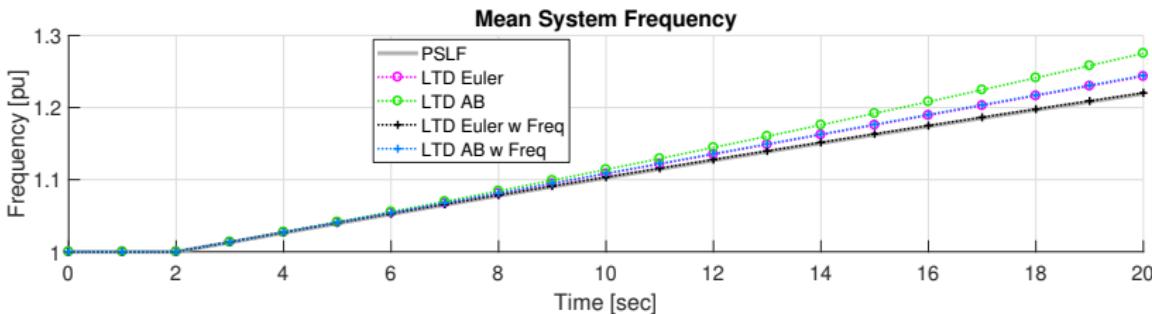

Dynamic model 'pgov1' defined

pgov1 : Proportional gain control of P_M

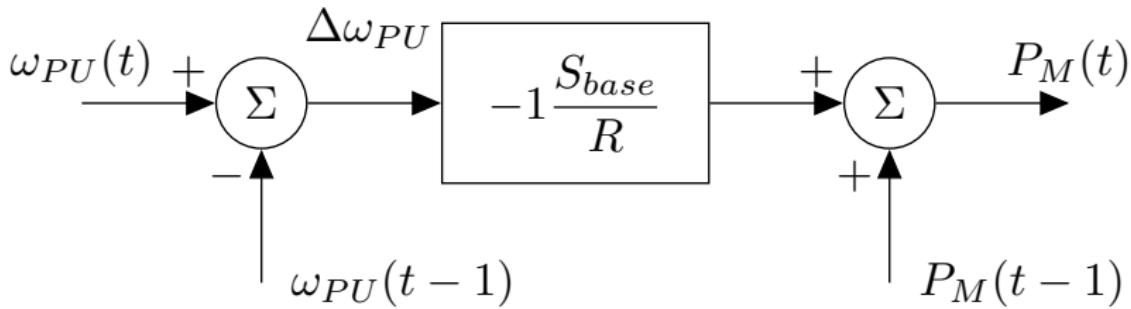



Entered into system via parsed text file:

```
# model busnum busnam basekv id : #9 mwcap droop
#!pgov1 11 "11" 22.00 "1" : #9 mwcap=100.0 0.05
```

Model adapted from [3]



Dynamic model 'pgov1' experiment: +1 MW t=2, -1 MW t=30

pgov1 on Gen 1, $t_{step} = 1$ second

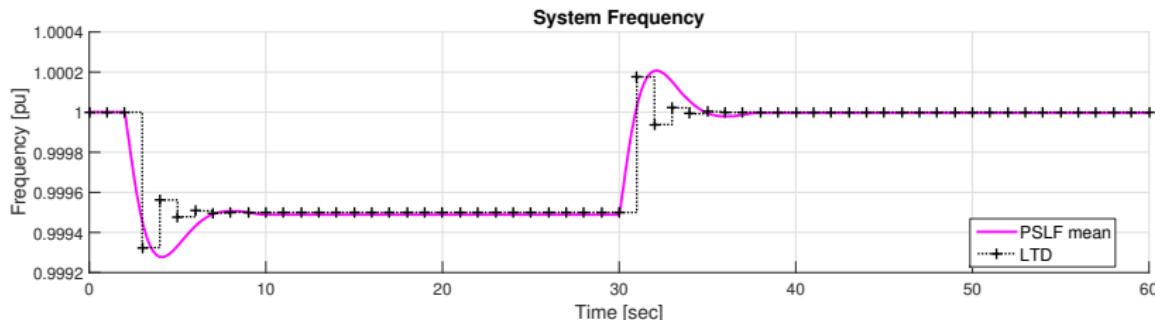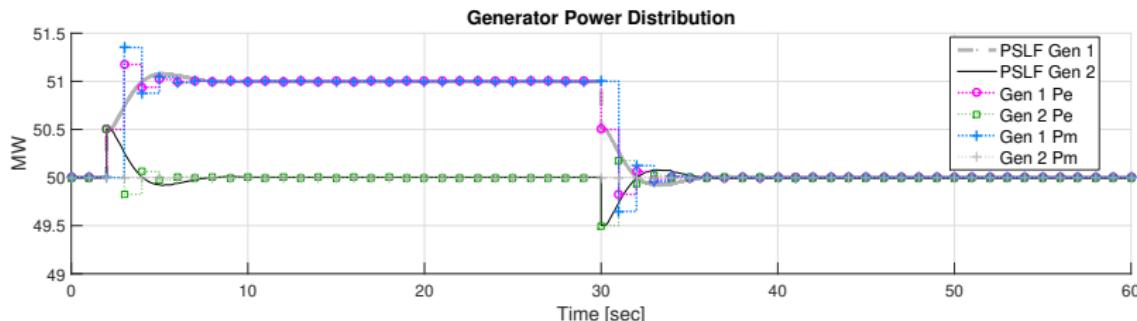


Dynamic model 'pgov1' experiment: +1 MW t=2, -1 MW t=30

pgov1 on Gen 1, $t_{step} = 0.5$ second

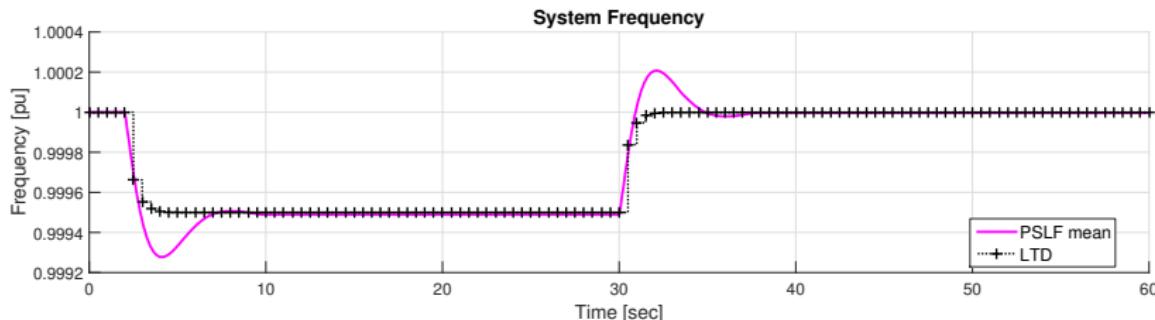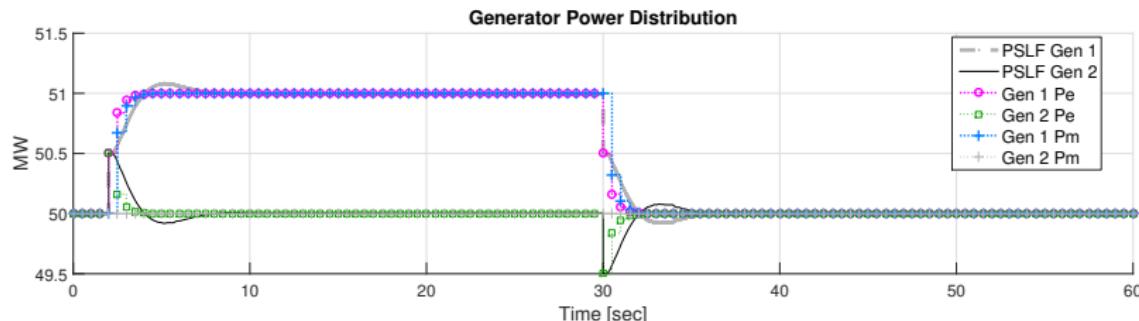


Dynamic model 'pgov1' experiment: +1 MW t=2, -1 MW t=30

pgov1 on both Gens, $t_{step} = 0.5$ second

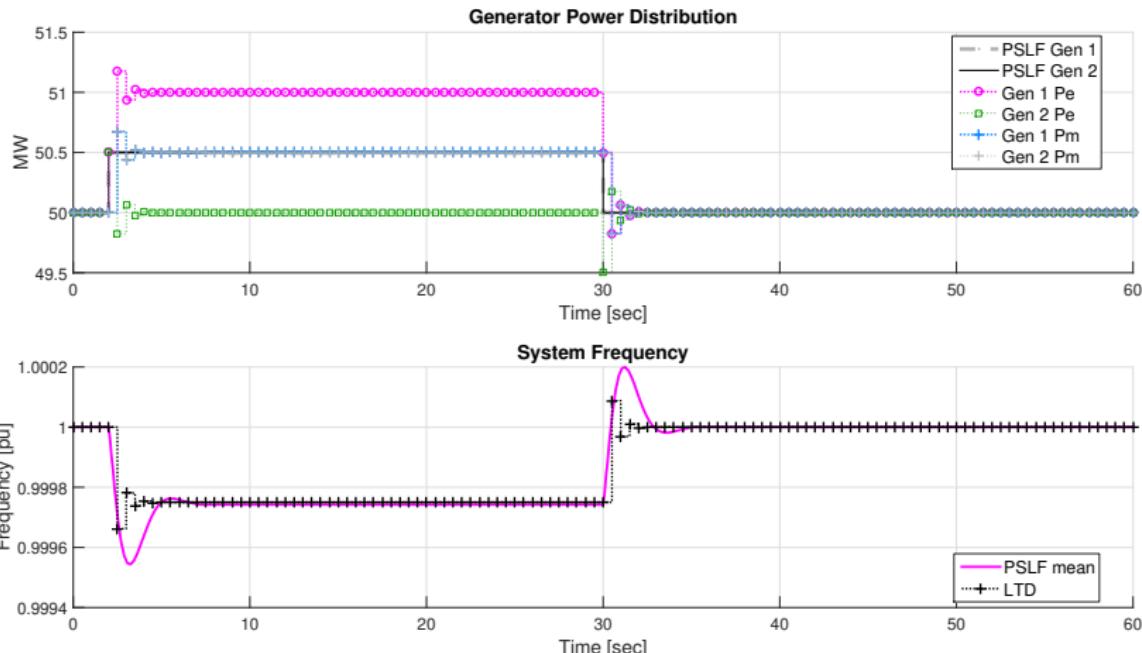



Dynamic model 'pgov1' experiment: +1 MW t=2, -1 MW t=30

pgov1 on both Gens, $t_{step} = 0.5$ sec., alt. P_e

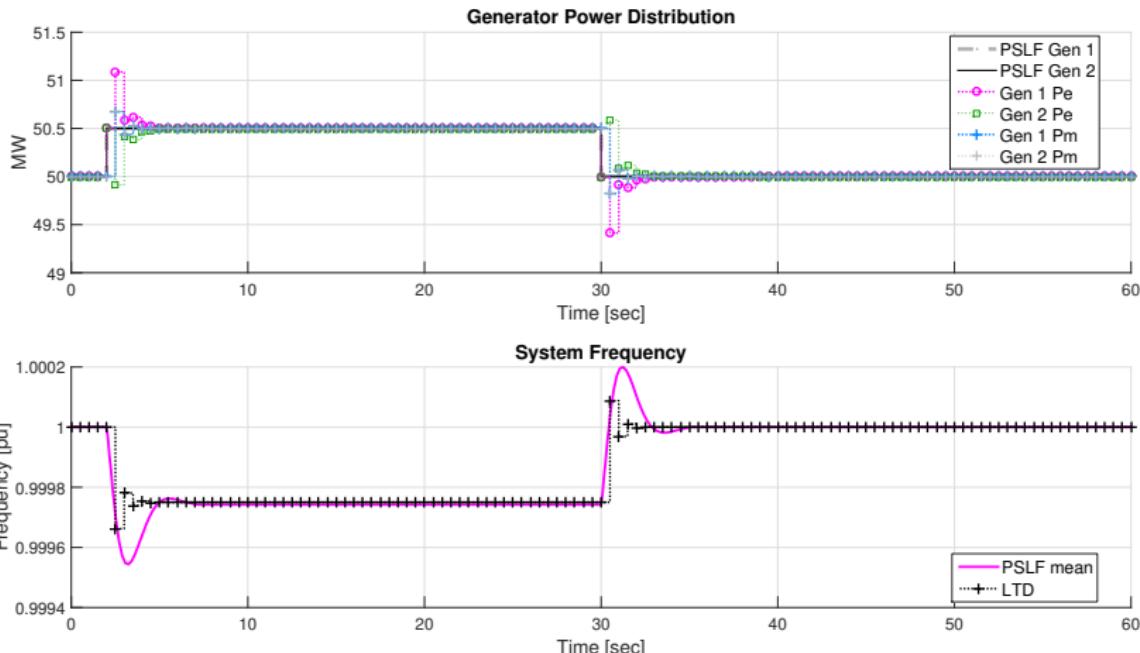


Dynamic model 'pgov1' experiment: +1 MW t=2, -1 MW t=30

pgov1 on both Gens, $t_{step} = 1$ sec., alt. P_e

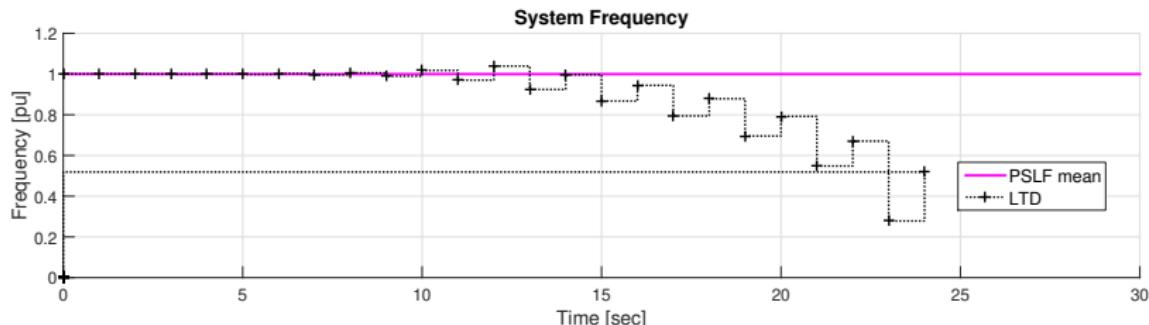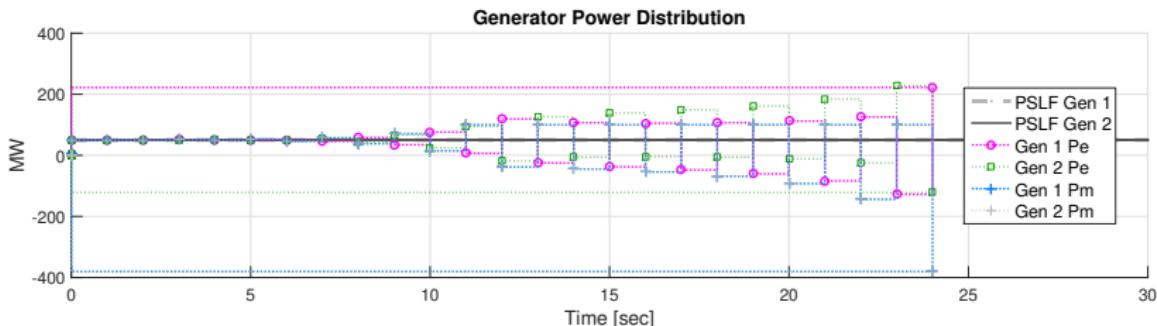

Dynamic model 'pgov1' experiment: +1 MW t=2, -1 MW t=30

Detail, $t_{\text{step}} = 1 \text{ sec.}$, alt. P_e

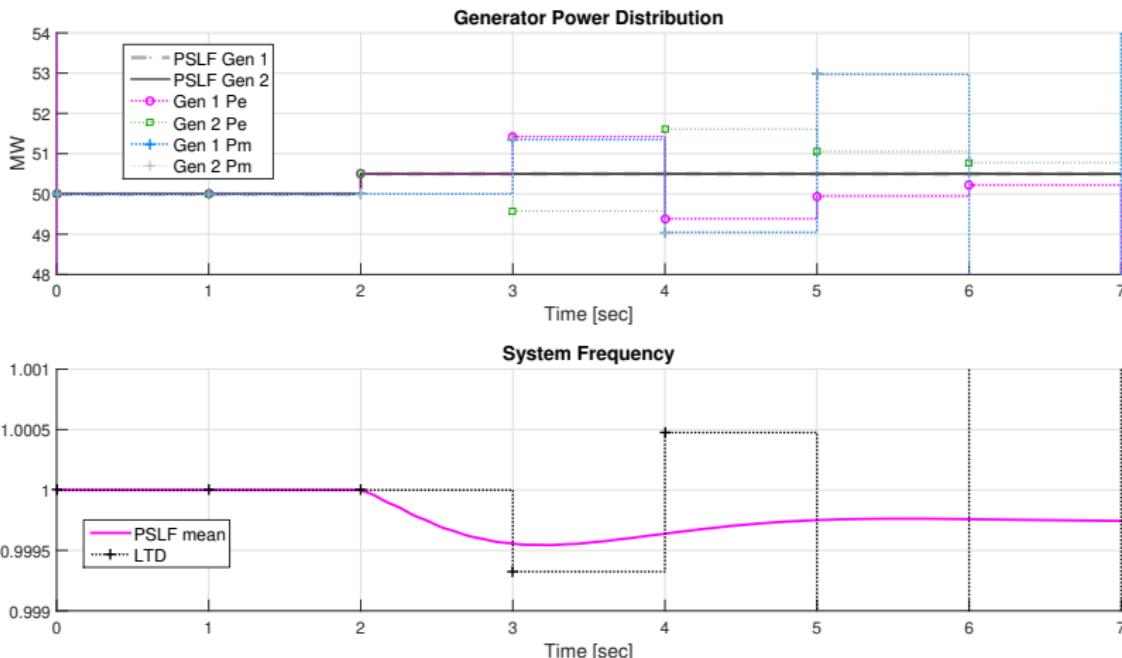

- ▶ Much more work to do.

However,

- ▶ Frequency effects should be accounted for in swing equation.
- ▶ Euler Integration tracks PSLF mean frequency well.
- ▶ Custom dynamic model implementation seems realizable.

References

- [1] GE Energy. "Mechanics of Running PSLF Dynamics" Phoenix, AZ, 2015
- [2] Rand, W. (2018). Agent-Based Modeling: What is Agent-Based Modeling? [Online] Available: <https://www.youtube.com/watch?v=FMqQbfsOkGc>
- [3] P.M. Anderson and A.A. Fouad, Power System Control and Stability, 2nd ed. IEEE Press, 2003, p20.