


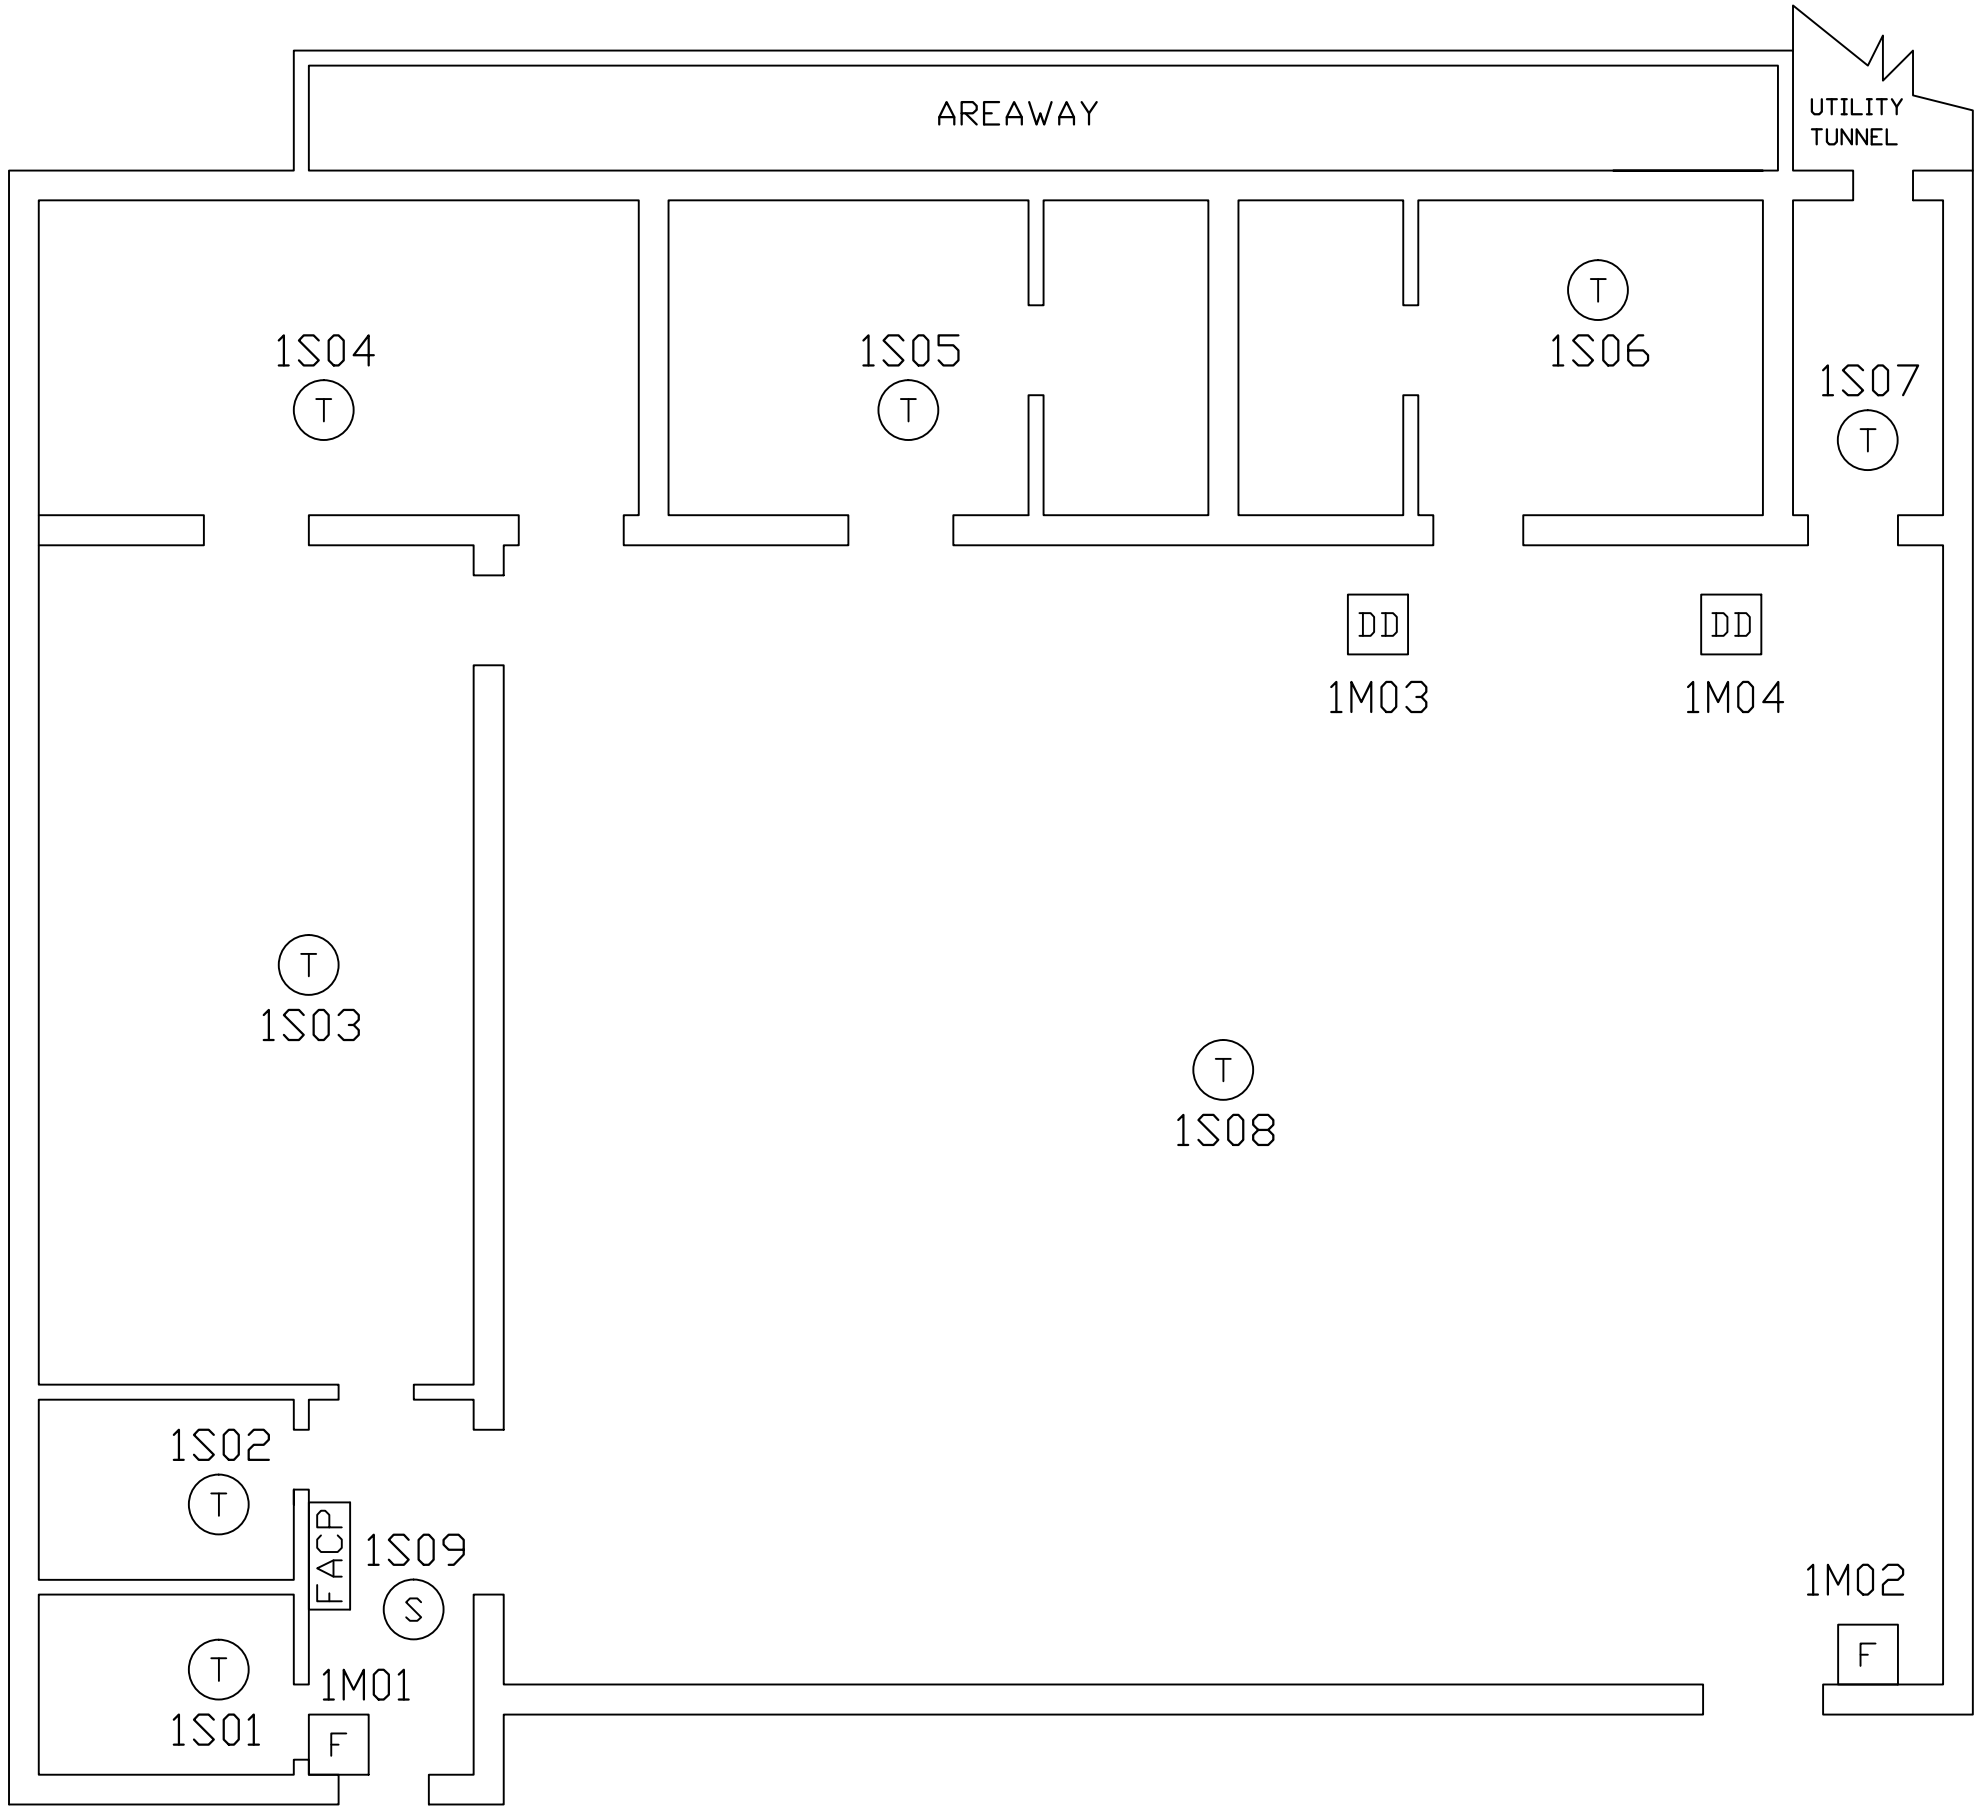

ADDRESS LABEL CLARIFICATION


ADDRESSABLE LOOP NUMBER
SENSOR ("M" MONITOR)
DEVICE NUMBER

1S01

HORN ("S" STROBE)
CIRCUIT NUMBER
DEVICE NUMBER

H1-T

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR W/BASE
○	THERMAL DETECTOR
⌬	MANUAL PULL STATION
▢	DUCT SMOKE DETECTOR



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
VOICE & OPERA CENTER
BUILDING 002
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	ZM
DESIGNED BY:	DS
APPROVED BY:	DS
DATE:	09/23/04
SCALE:	N.T.S.
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	XXXX.DWG

FIRE ALARM SYSTEM
ADDRESSABLE LOOP NUMBERS

PAGE:
FA-01