


GARDNER HALL
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
GRDNR0-3.DWG
JANUARY 8, 2010




LEGEND

- ⊙ SMOKE DETECTOR ASD-I/ADB-F
- ⊙ HEAT DETECTOR ATD-R/ADB-F
- ⌘ MANUAL PULL STATION- MS-2/AMM-2
- ⌘ DUCT DETECTOR- DH500 AC/DC
- ⌘ MONITOR MODULE-AMM-2
- ⌘ WATERFLOW SWITCH- AMM-4
- ⌘ TAMPER SWITCH- AMM-4
- ⌘ STROBE/HORN- P2475FC
- ⌘ WEATHERPROOF HORN- MT-12/24-R
- ⌘ CONTROL MODULE- ADM-2
- ⌘ REMOTE ANNUNCIATOR- RHFB
- ⌘ FIRE ALARM CONTROL PANEL- EN-24
- ⌘ TRANSPONDER PANEL- EN-24


LEVEL 0

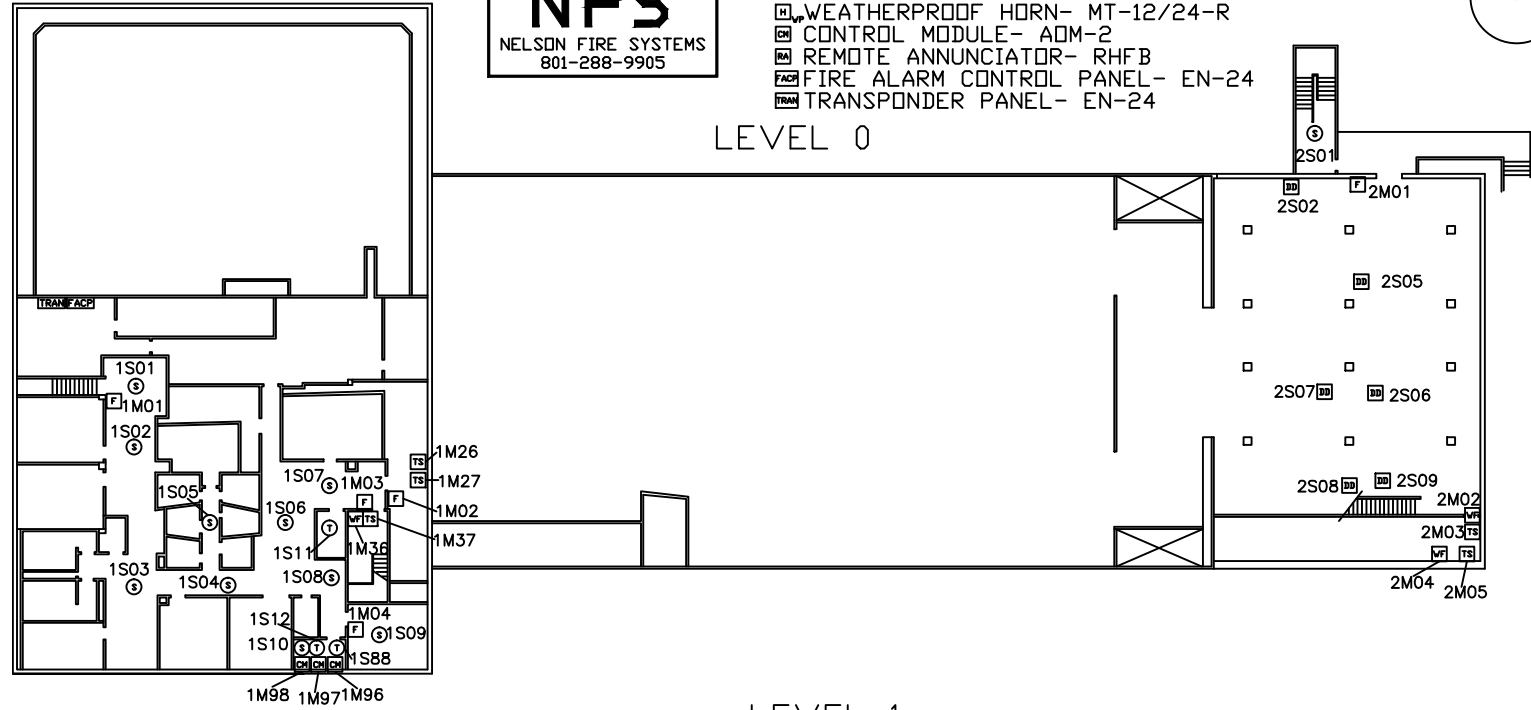


LEVEL 1

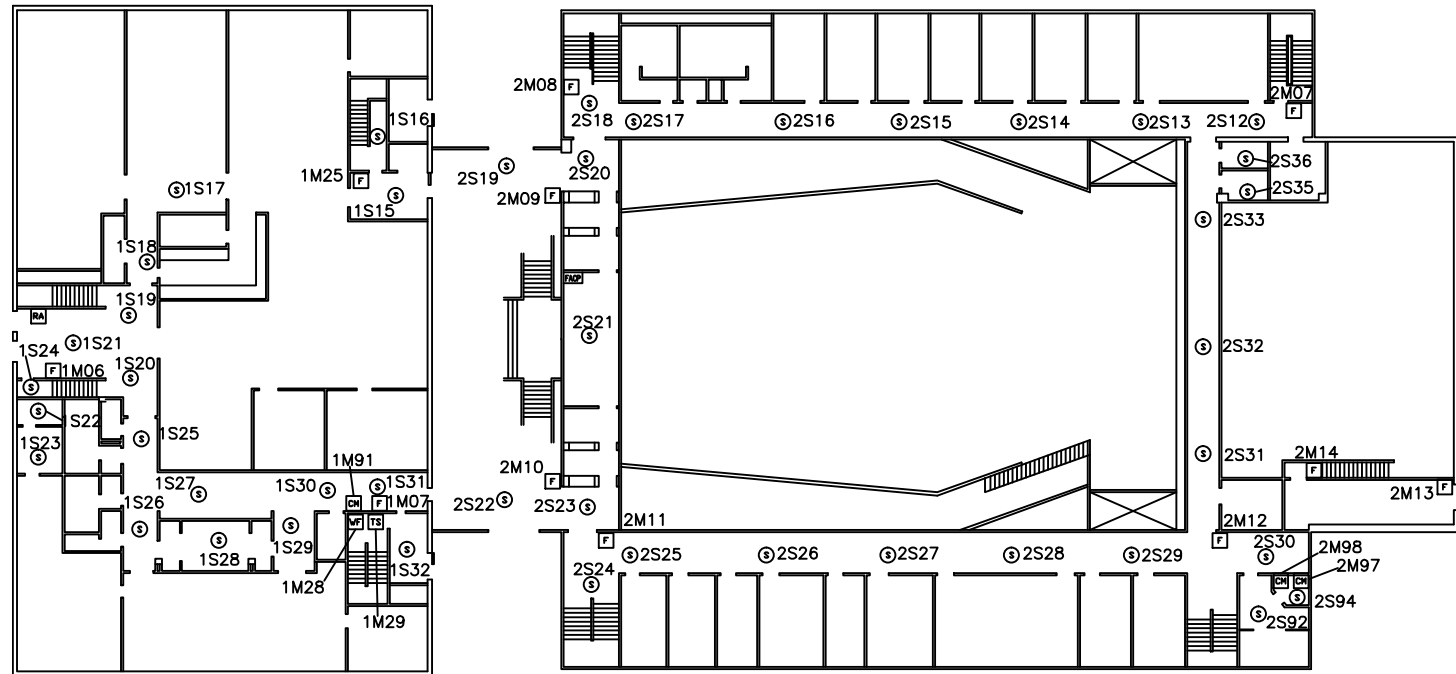

LEVEL 2

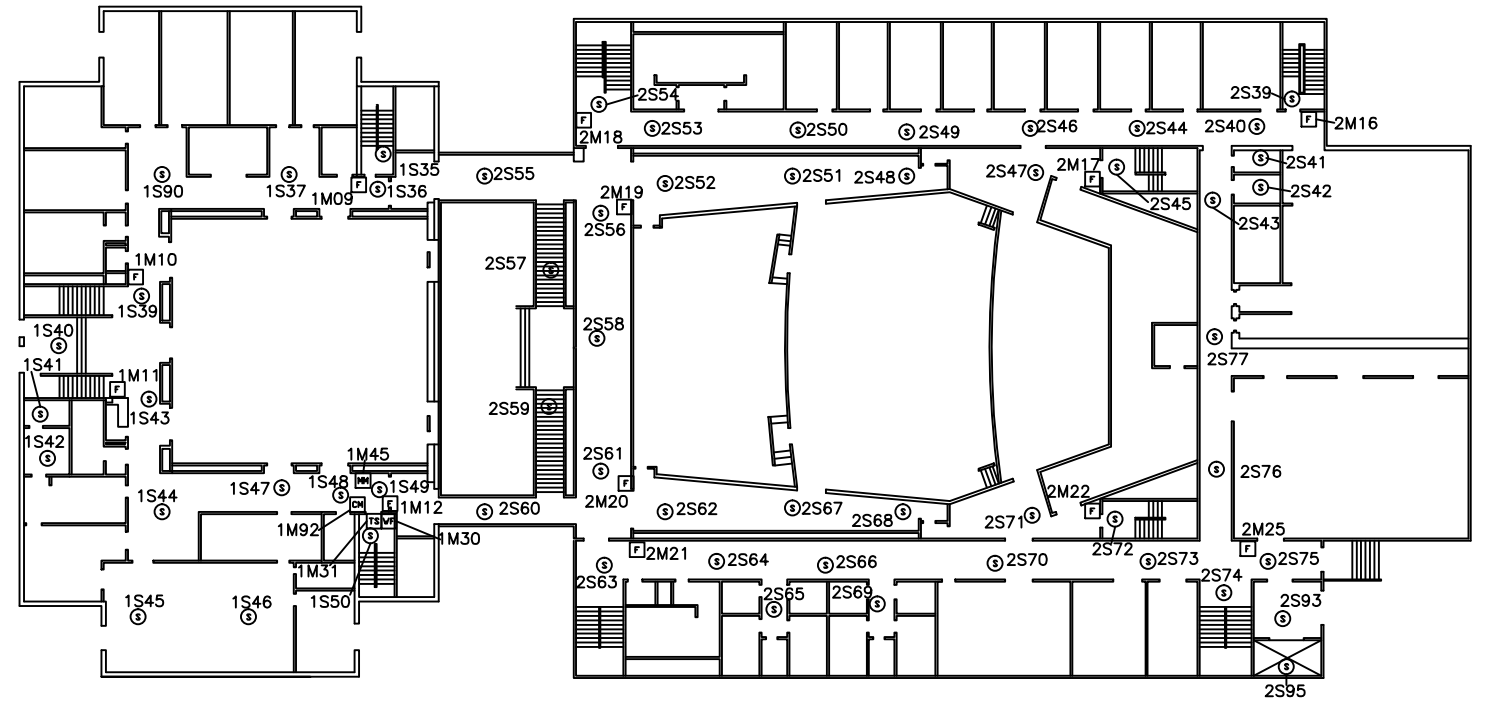

LEVEL 3

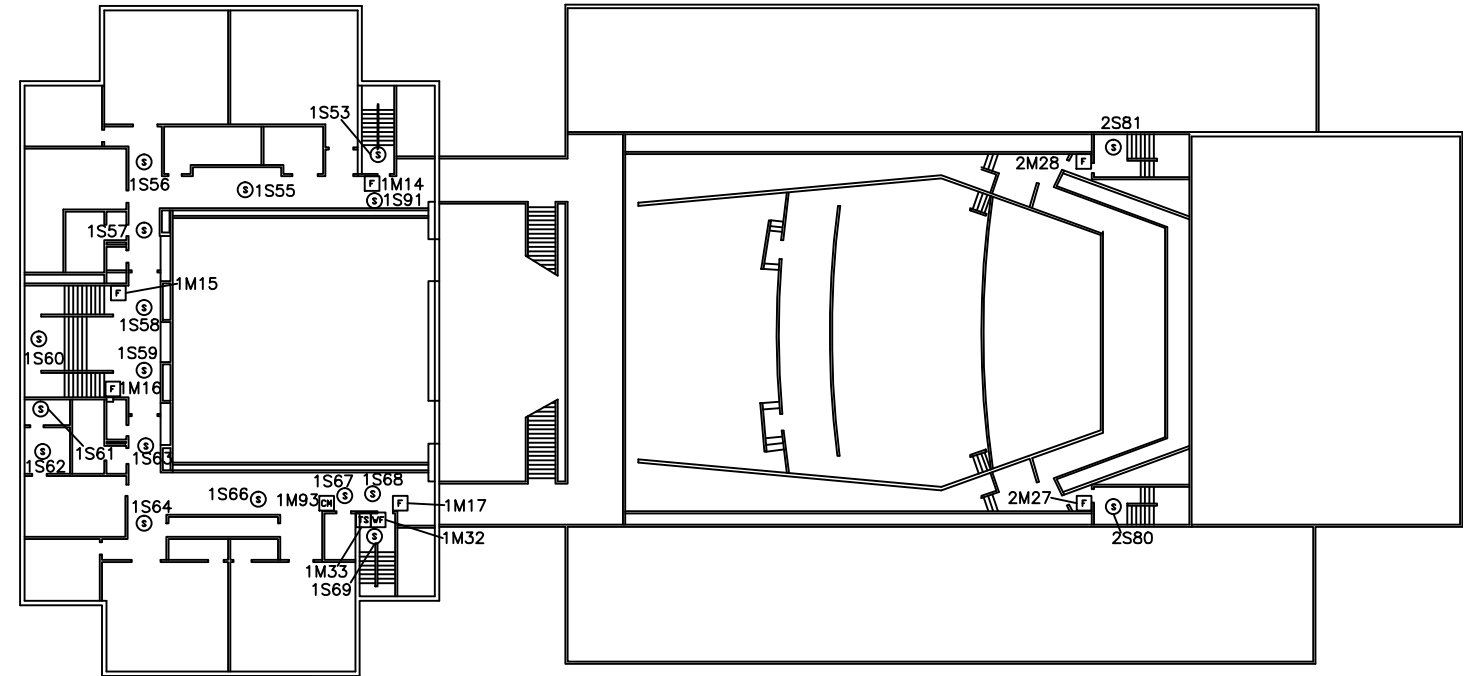

GARDNER HALL
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
GRDNR4.DWG
AUGUST 11, 1999

LEGEND

- Ⓢ SMOKE DETECTOR ASD-I/ADB-F
- Ⓣ HEAT DETECTOR ATD-R/ADB-F
- ⓕ MANUAL PULL STATION- MS-2/AMM-2
- ⓓ DUCT DETECTOR- DH500 AC/DC
- Ⓦ WATERFLOW SWITCH- AMM-4
- Ⓣ TAMPER SWITCH- AMM-4
- Ⓜ STROBE/HORN- P2475FC
- Ⓜ_{VP} WEATHERPROOF HORN- MT-12/24-R
- Ⓢ CONTROL MODULE- ADM-2
- Ⓡ REMOTE ANNUNCIATOR- RHFB
- ⓕⓕ FIRE ALARM CONTROL PANEL- EN-24
- ⓉⓇⓂ TRANSPONDER PANEL- EN-24

LEVEL 4

