

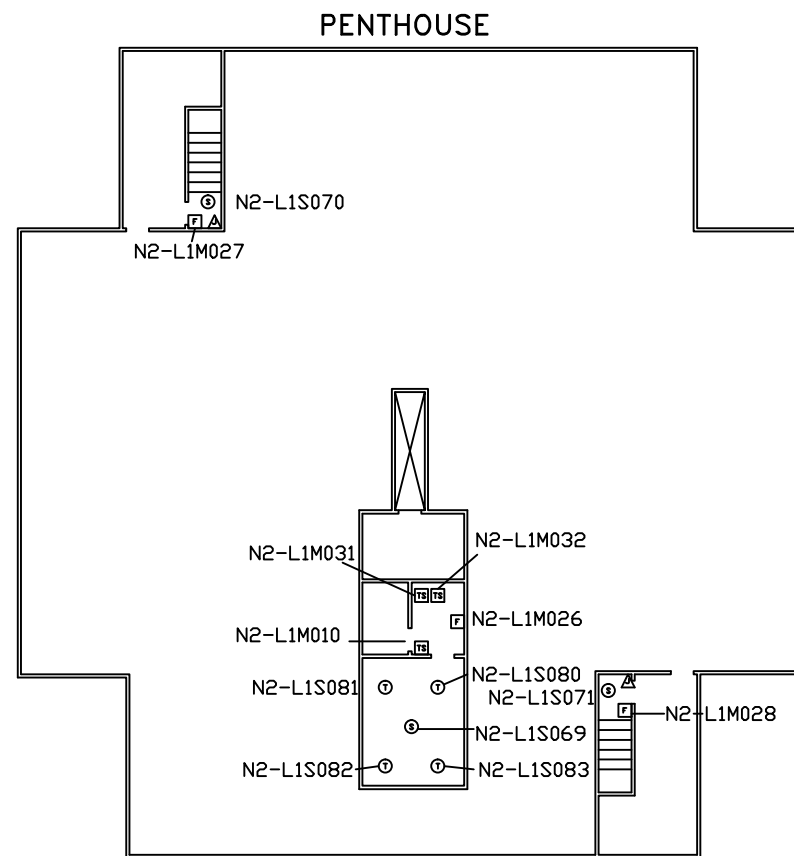
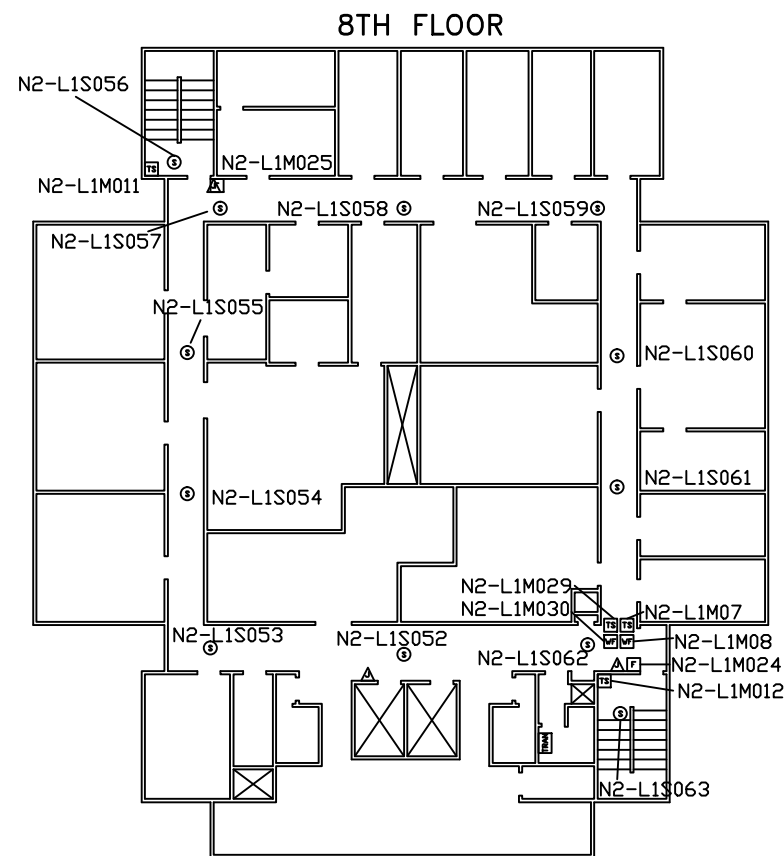
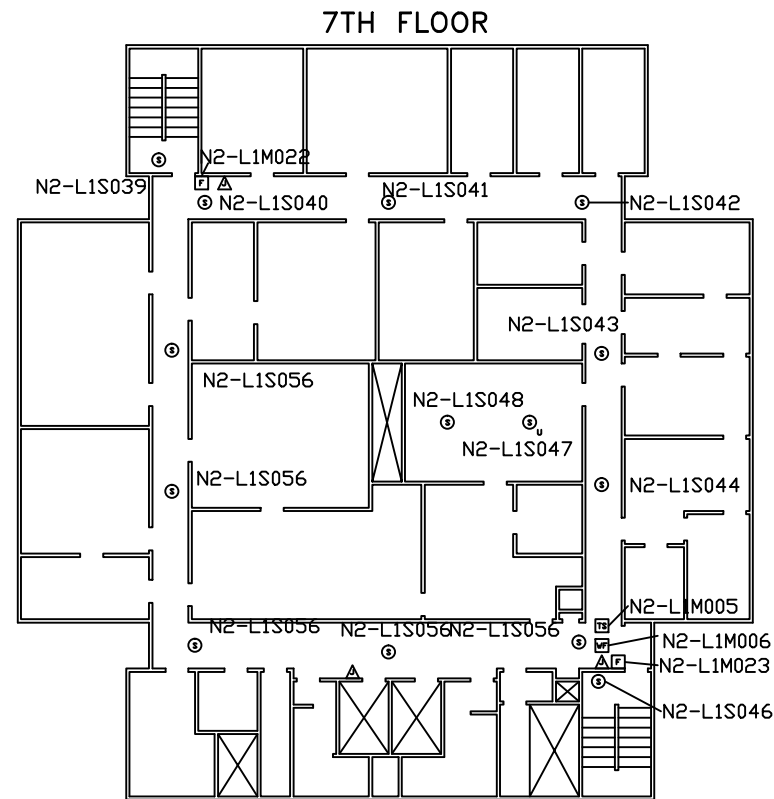


A horizontal scale bar with tick marks at 0', 5', 10', 15', 25', and 50'. The word "SCALE" is centered below the bar.

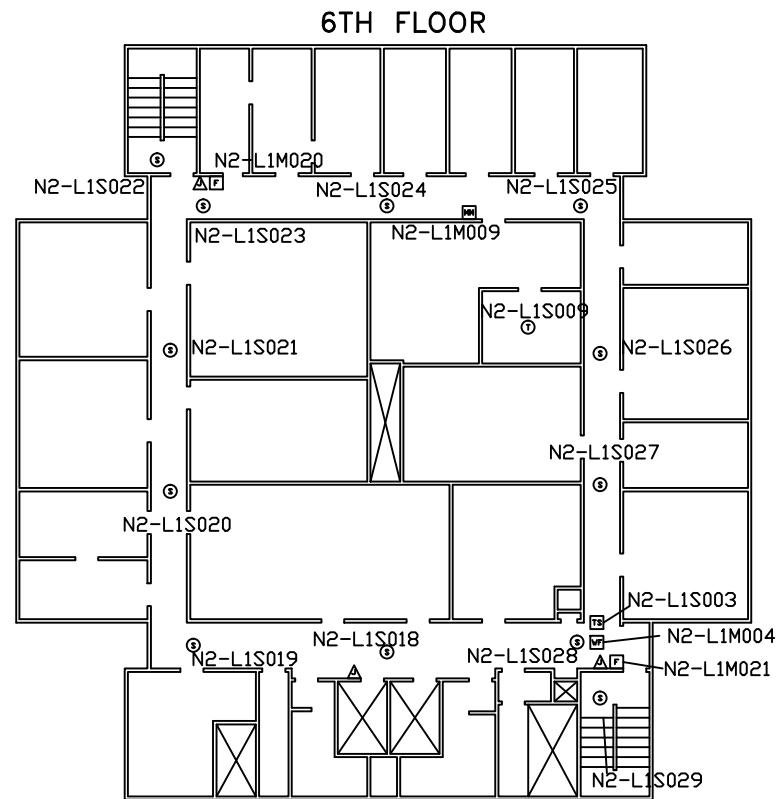

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	HEAT DETECTOR
Ⓢ	CARBON MONOXIDE DETECTOR
F	MANUAL PULL STATION
DD	DUCT DETECTOR
TS	TAMPER SWITCH
WS	WATERFLOW SWITCH
CM	CONTROL MODULE
L	STROBE ONLY
HS	HORN/STROBE
HS VP	WEATHERPROOF HORN/STROBE
R	RELAY
DH	DOORHOLDER
RA	REMOTE ANNUNCIATOR
TRAN	TRANSPONDER PANEL
FACU	FIRE ALARM CONTROL UNIT
FSD	FIRE/SMOKE DAMPER



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

WILLIAM BROWNING BUILDING
UNIVERSITY OF UTAH
6TH FLOOR - PENTHOUSE
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: KN
DESIGNED BY: XXXX
APPROVED BY: XXXX
DATE: 6/16/2014
SCALE: N.T.S.
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME: BROWNING 6TH-PENTHOUSE

FIRE ALARM SYSTEM
LEVEL XX
NUMBERS

PAGE:
FA-I-03

