

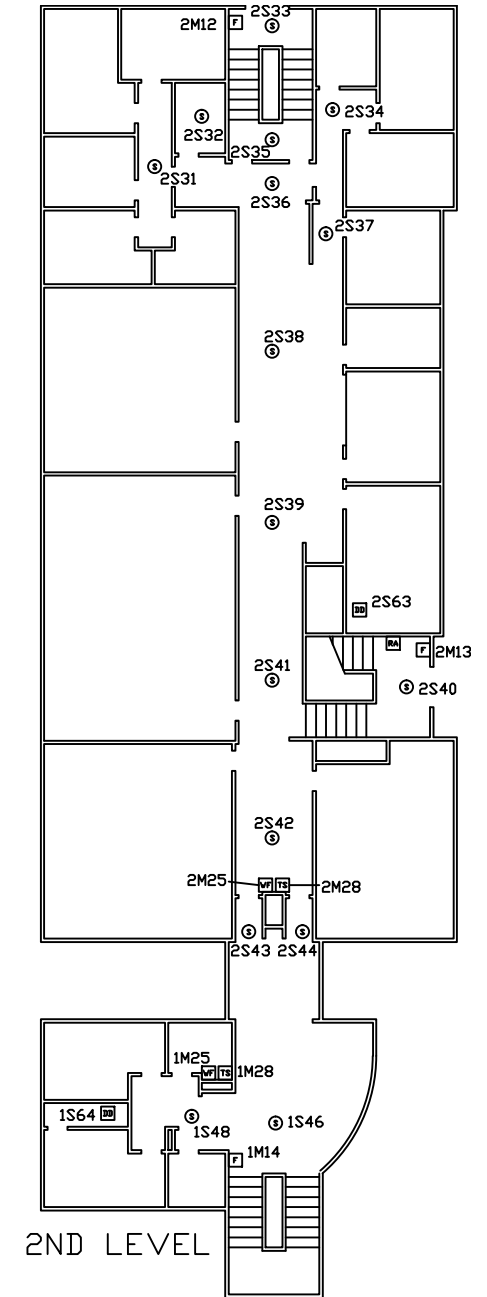
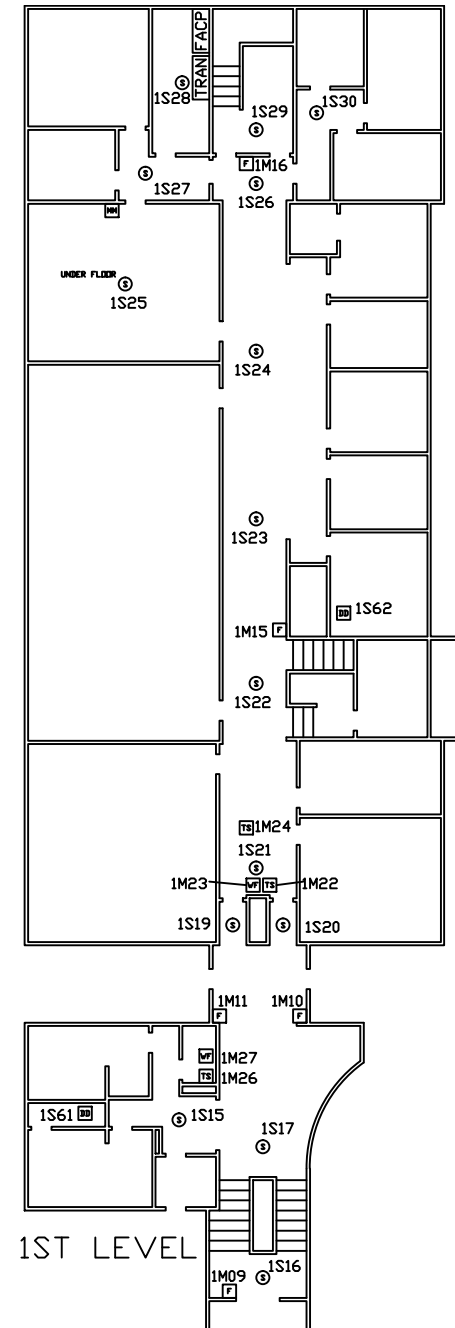
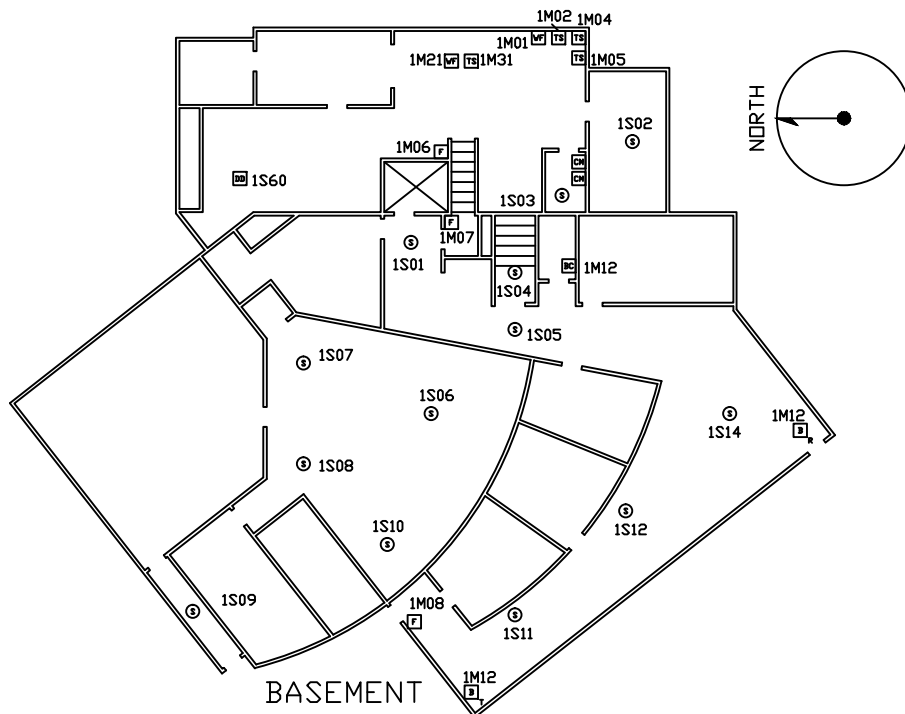


NFS
NELSON FIRE SYSTEMS
801-468-8300


- ③ SMOKE DETECTOR
- ⌘ MANUAL PULL STATION
- Ⓜ DUCT DETECTOR
- Ⓜ WATERFLOW SWITCH
- Ⓜ TAMPER SWITCH
- Ⓜ MONITOR MODULE
- Ⓜ BEAM DETECTOR TRANSMITTER
- Ⓜ BEAM DETECTOR RECEIVER
- Ⓜ BEAM DETECTOR CONTROL PANEL
- Ⓜ CONTROL MODULE
- Ⓜ REMOTE ANNUNCIATOR
- Ⓜ FIRE ALARM CONTROL PANEL
- Ⓜ TRANSPONDER PANEL

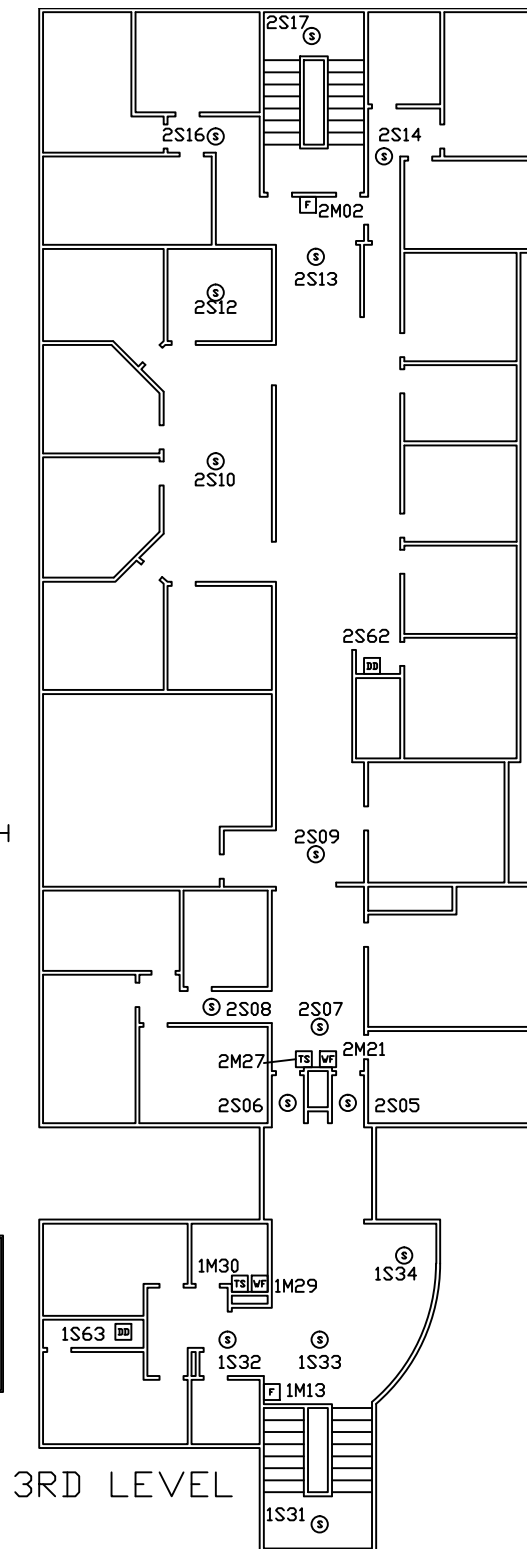

COWLES BUILDING
UNIVERSITY OF UTAH
3RD & 4TH LEVELS
FIRE ALARM SYSTEM
DECEMBER 30, 2003
COWLES2.DWG



3RD LEVEL

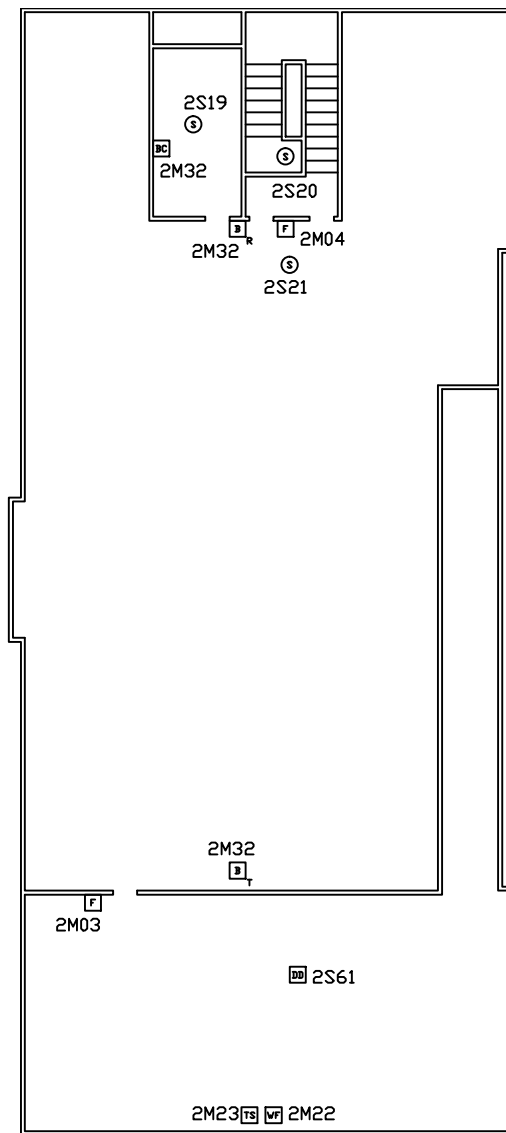

4TH LEVEL

LEGEND

- Ⓢ SMOKE DETECTOR
- ⓕ MANUAL PULL STATION
- ⓓ DUCT DETECTOR
- ⓑ BEAM DETECTOR TRANSMITTER
- Ⓡ BEAM DETECTOR RECEIVER
- ⓑ BEAM DETECTOR CONTROL PANEL