



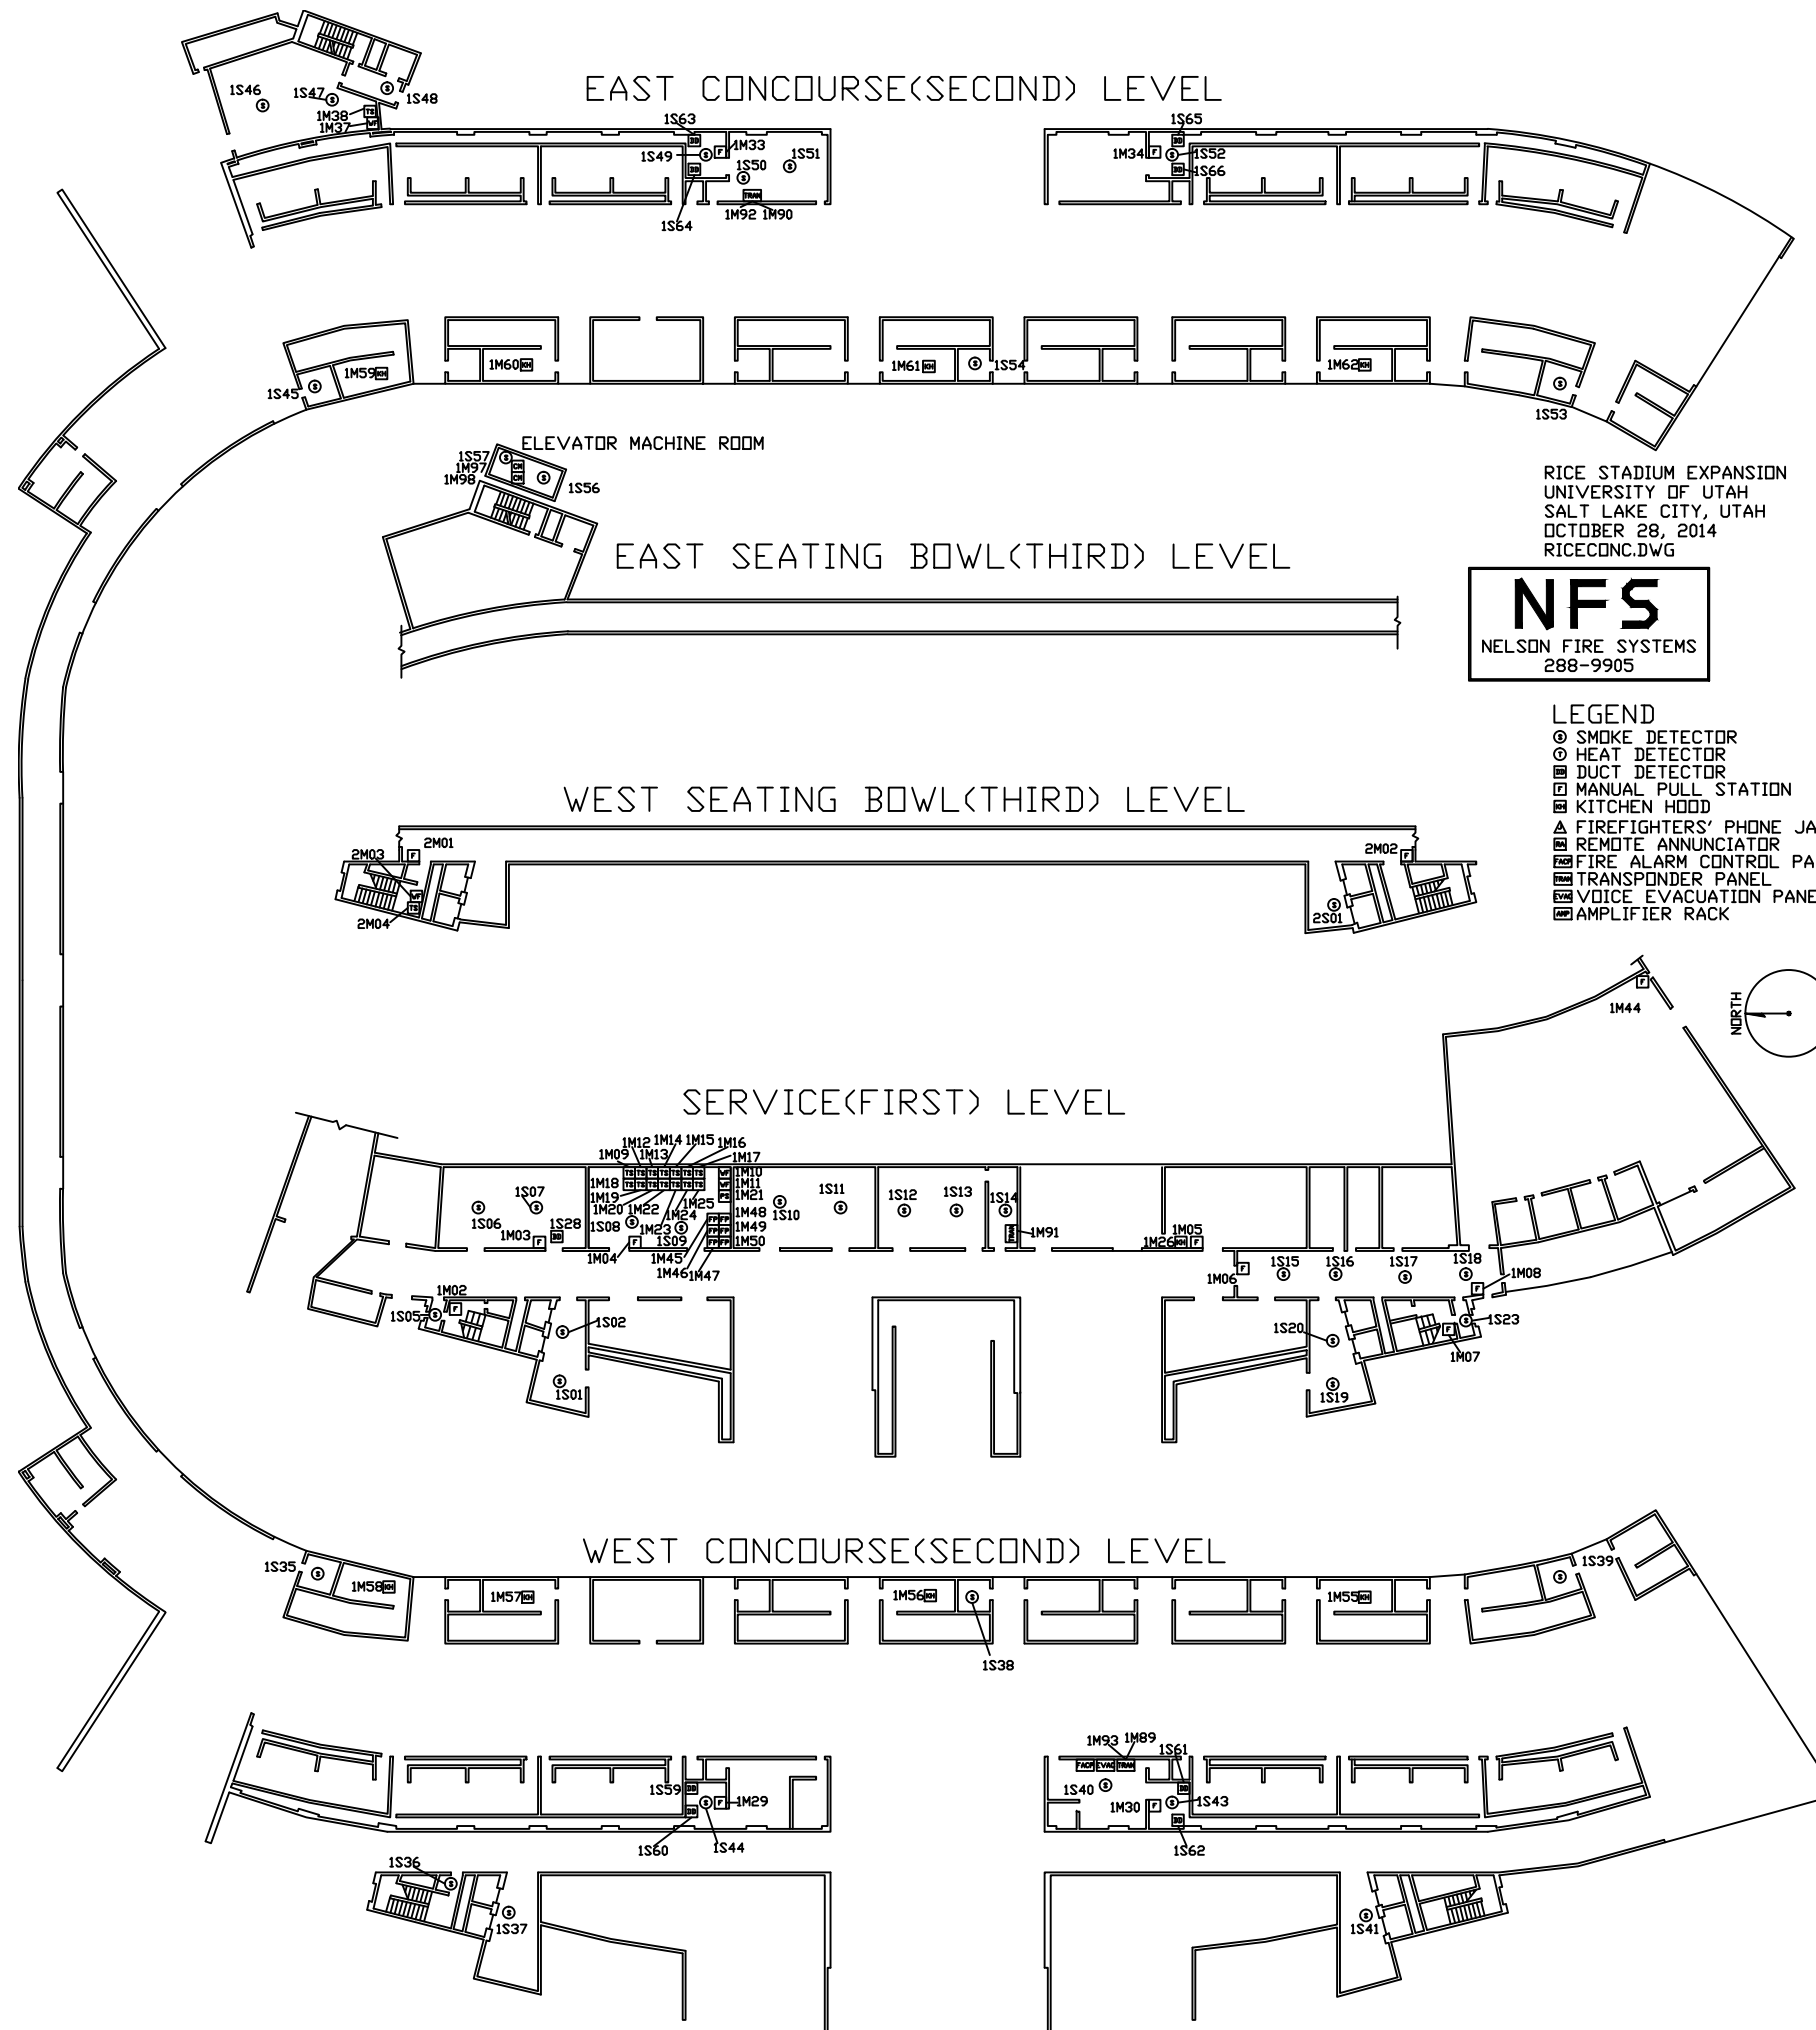

RICE STADIUM EXPANSION
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
OCTOBER 28, 2014
RICECONC.DWG


NFS
NELSON FIRE SYSTEMS
288-9905

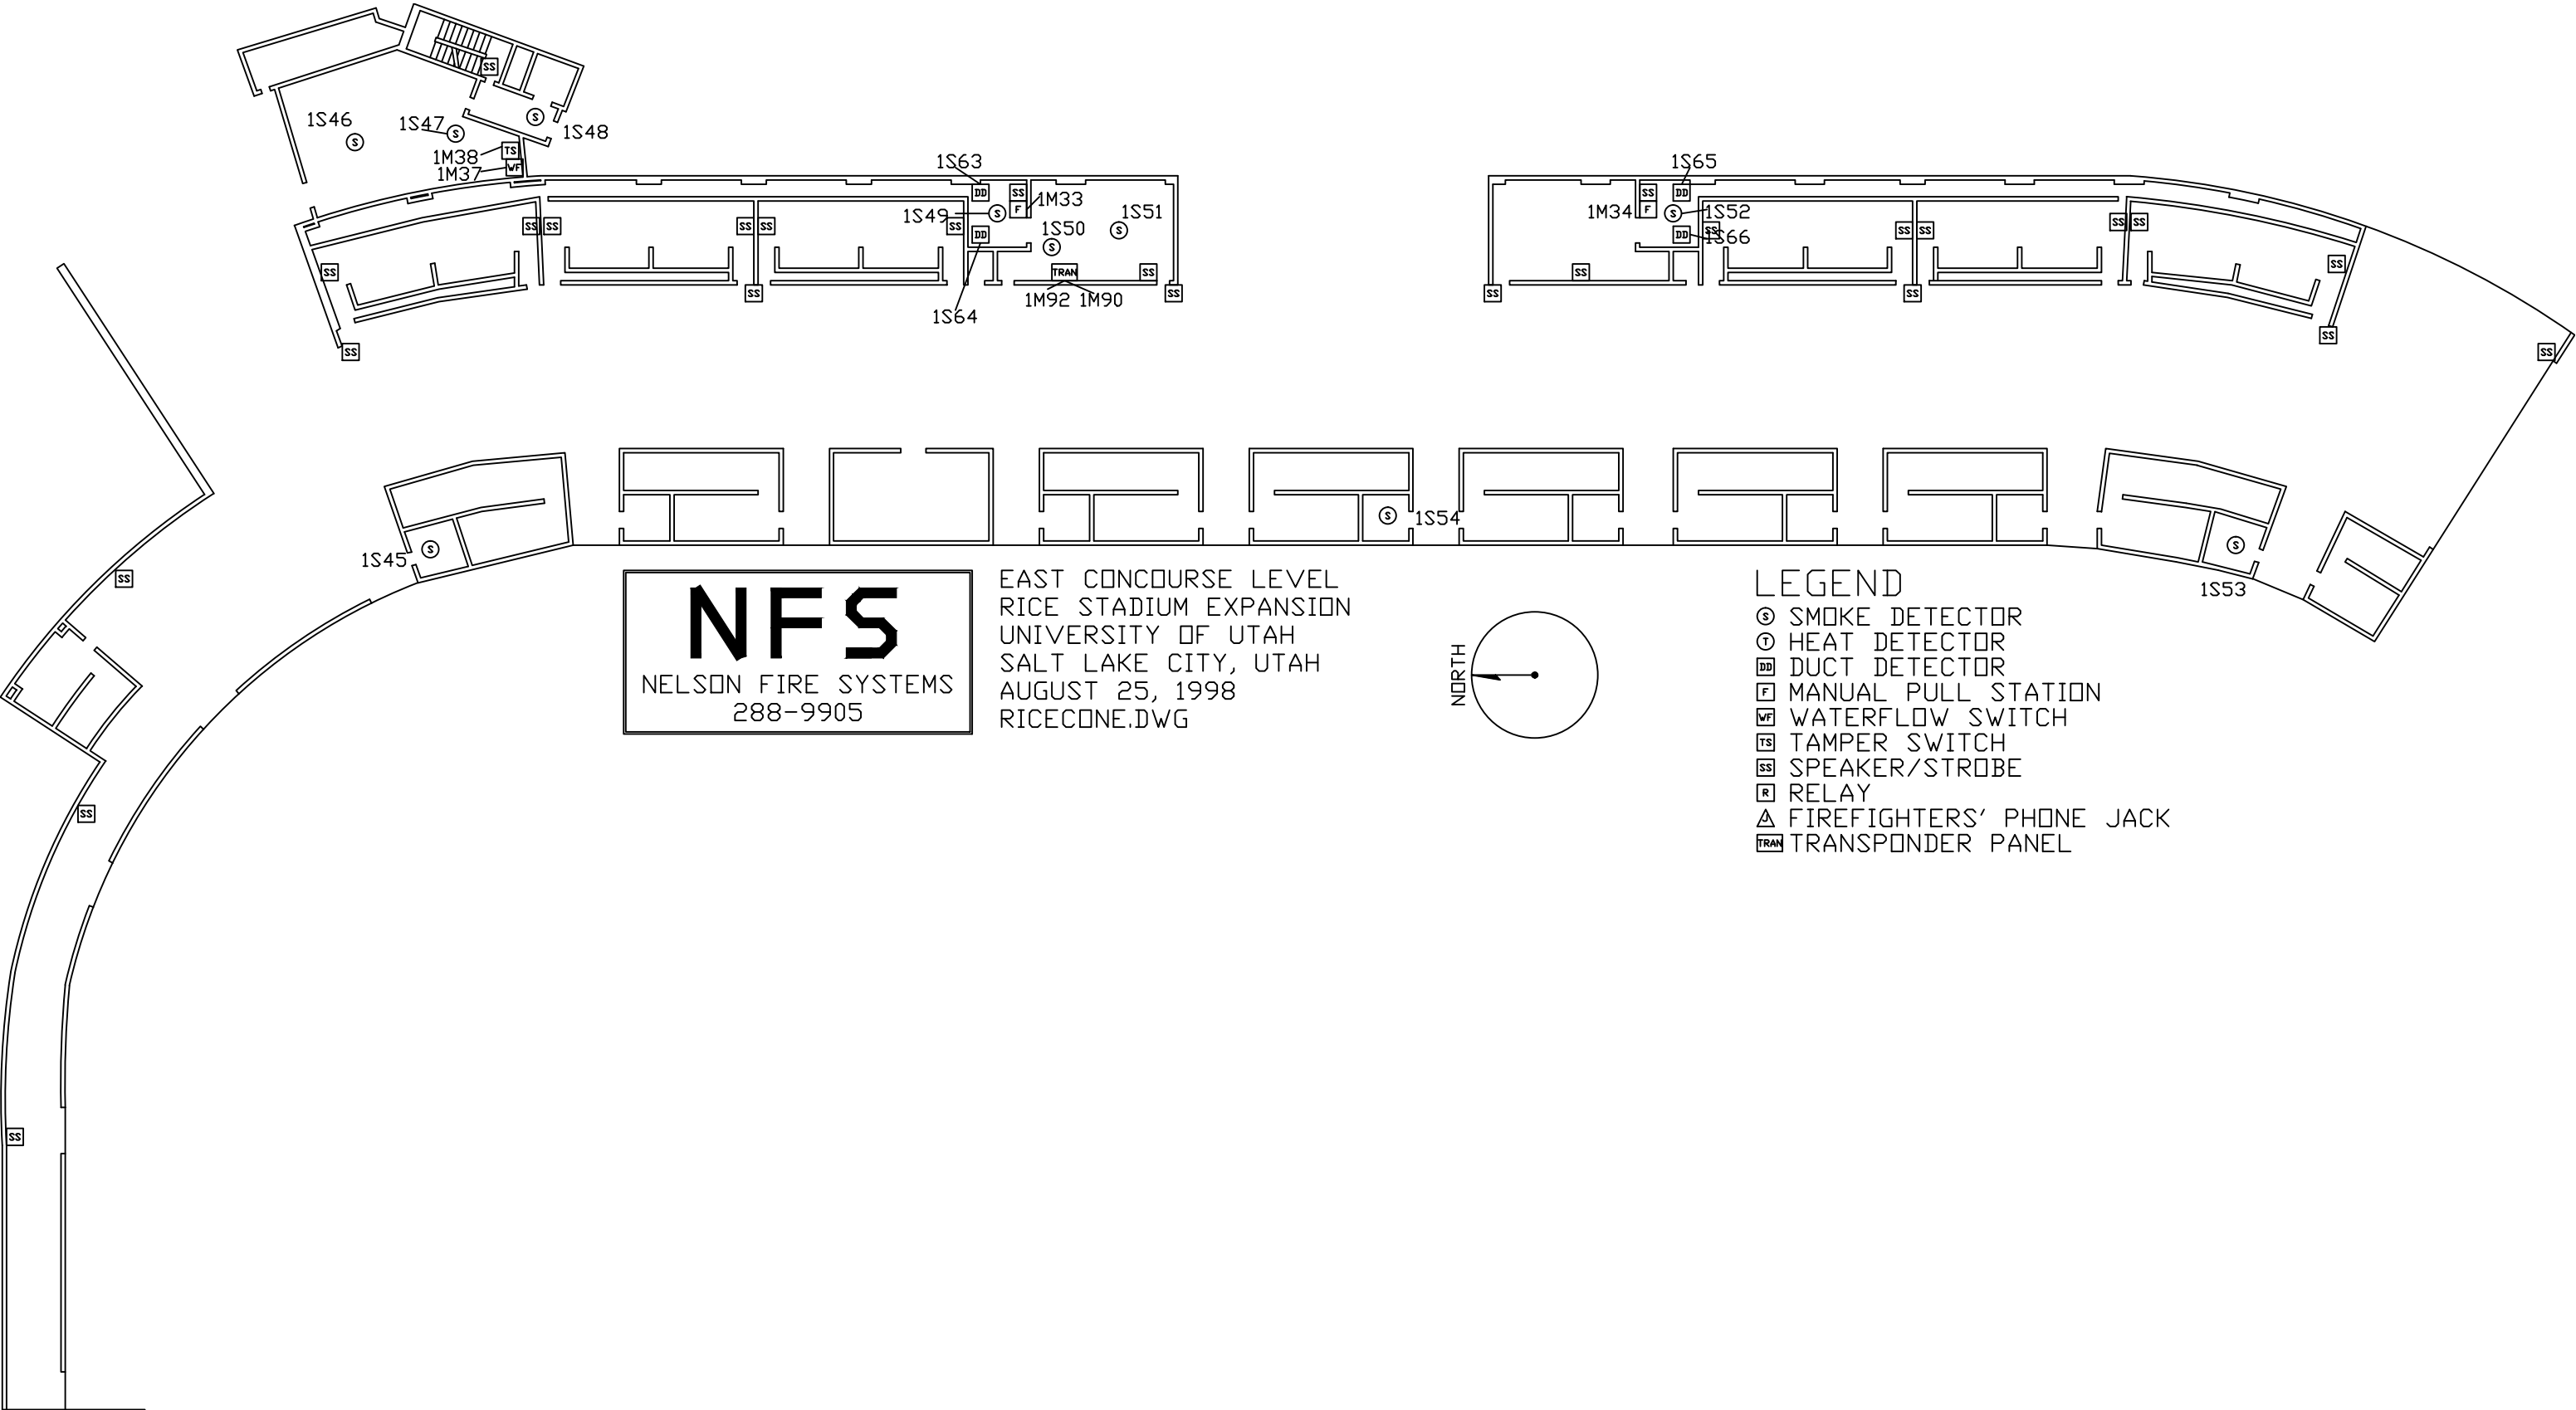


NFS

NELSON FIRE SYSTEMS
288-9905

EAST CONCOURSE LEVEL
RICE STADIUM EXPANSION
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
AUGUST 25, 1998
RICECONE.DWG




- LEGEND
- SD SMOKE DETECTOR
 - HD HEAT DETECTOR
 - DD DUCT DETECTOR
 - F MANUAL PULL STATION
 - WF WATERFLOW SWITCH
 - TS TAMPER SWITCH
 - SS SPEAKER/STROBE
 - R RELAY
 - PJ FIREFIGHTERS' PHONE JACK
 - TRAN TRANSPONDER PANEL

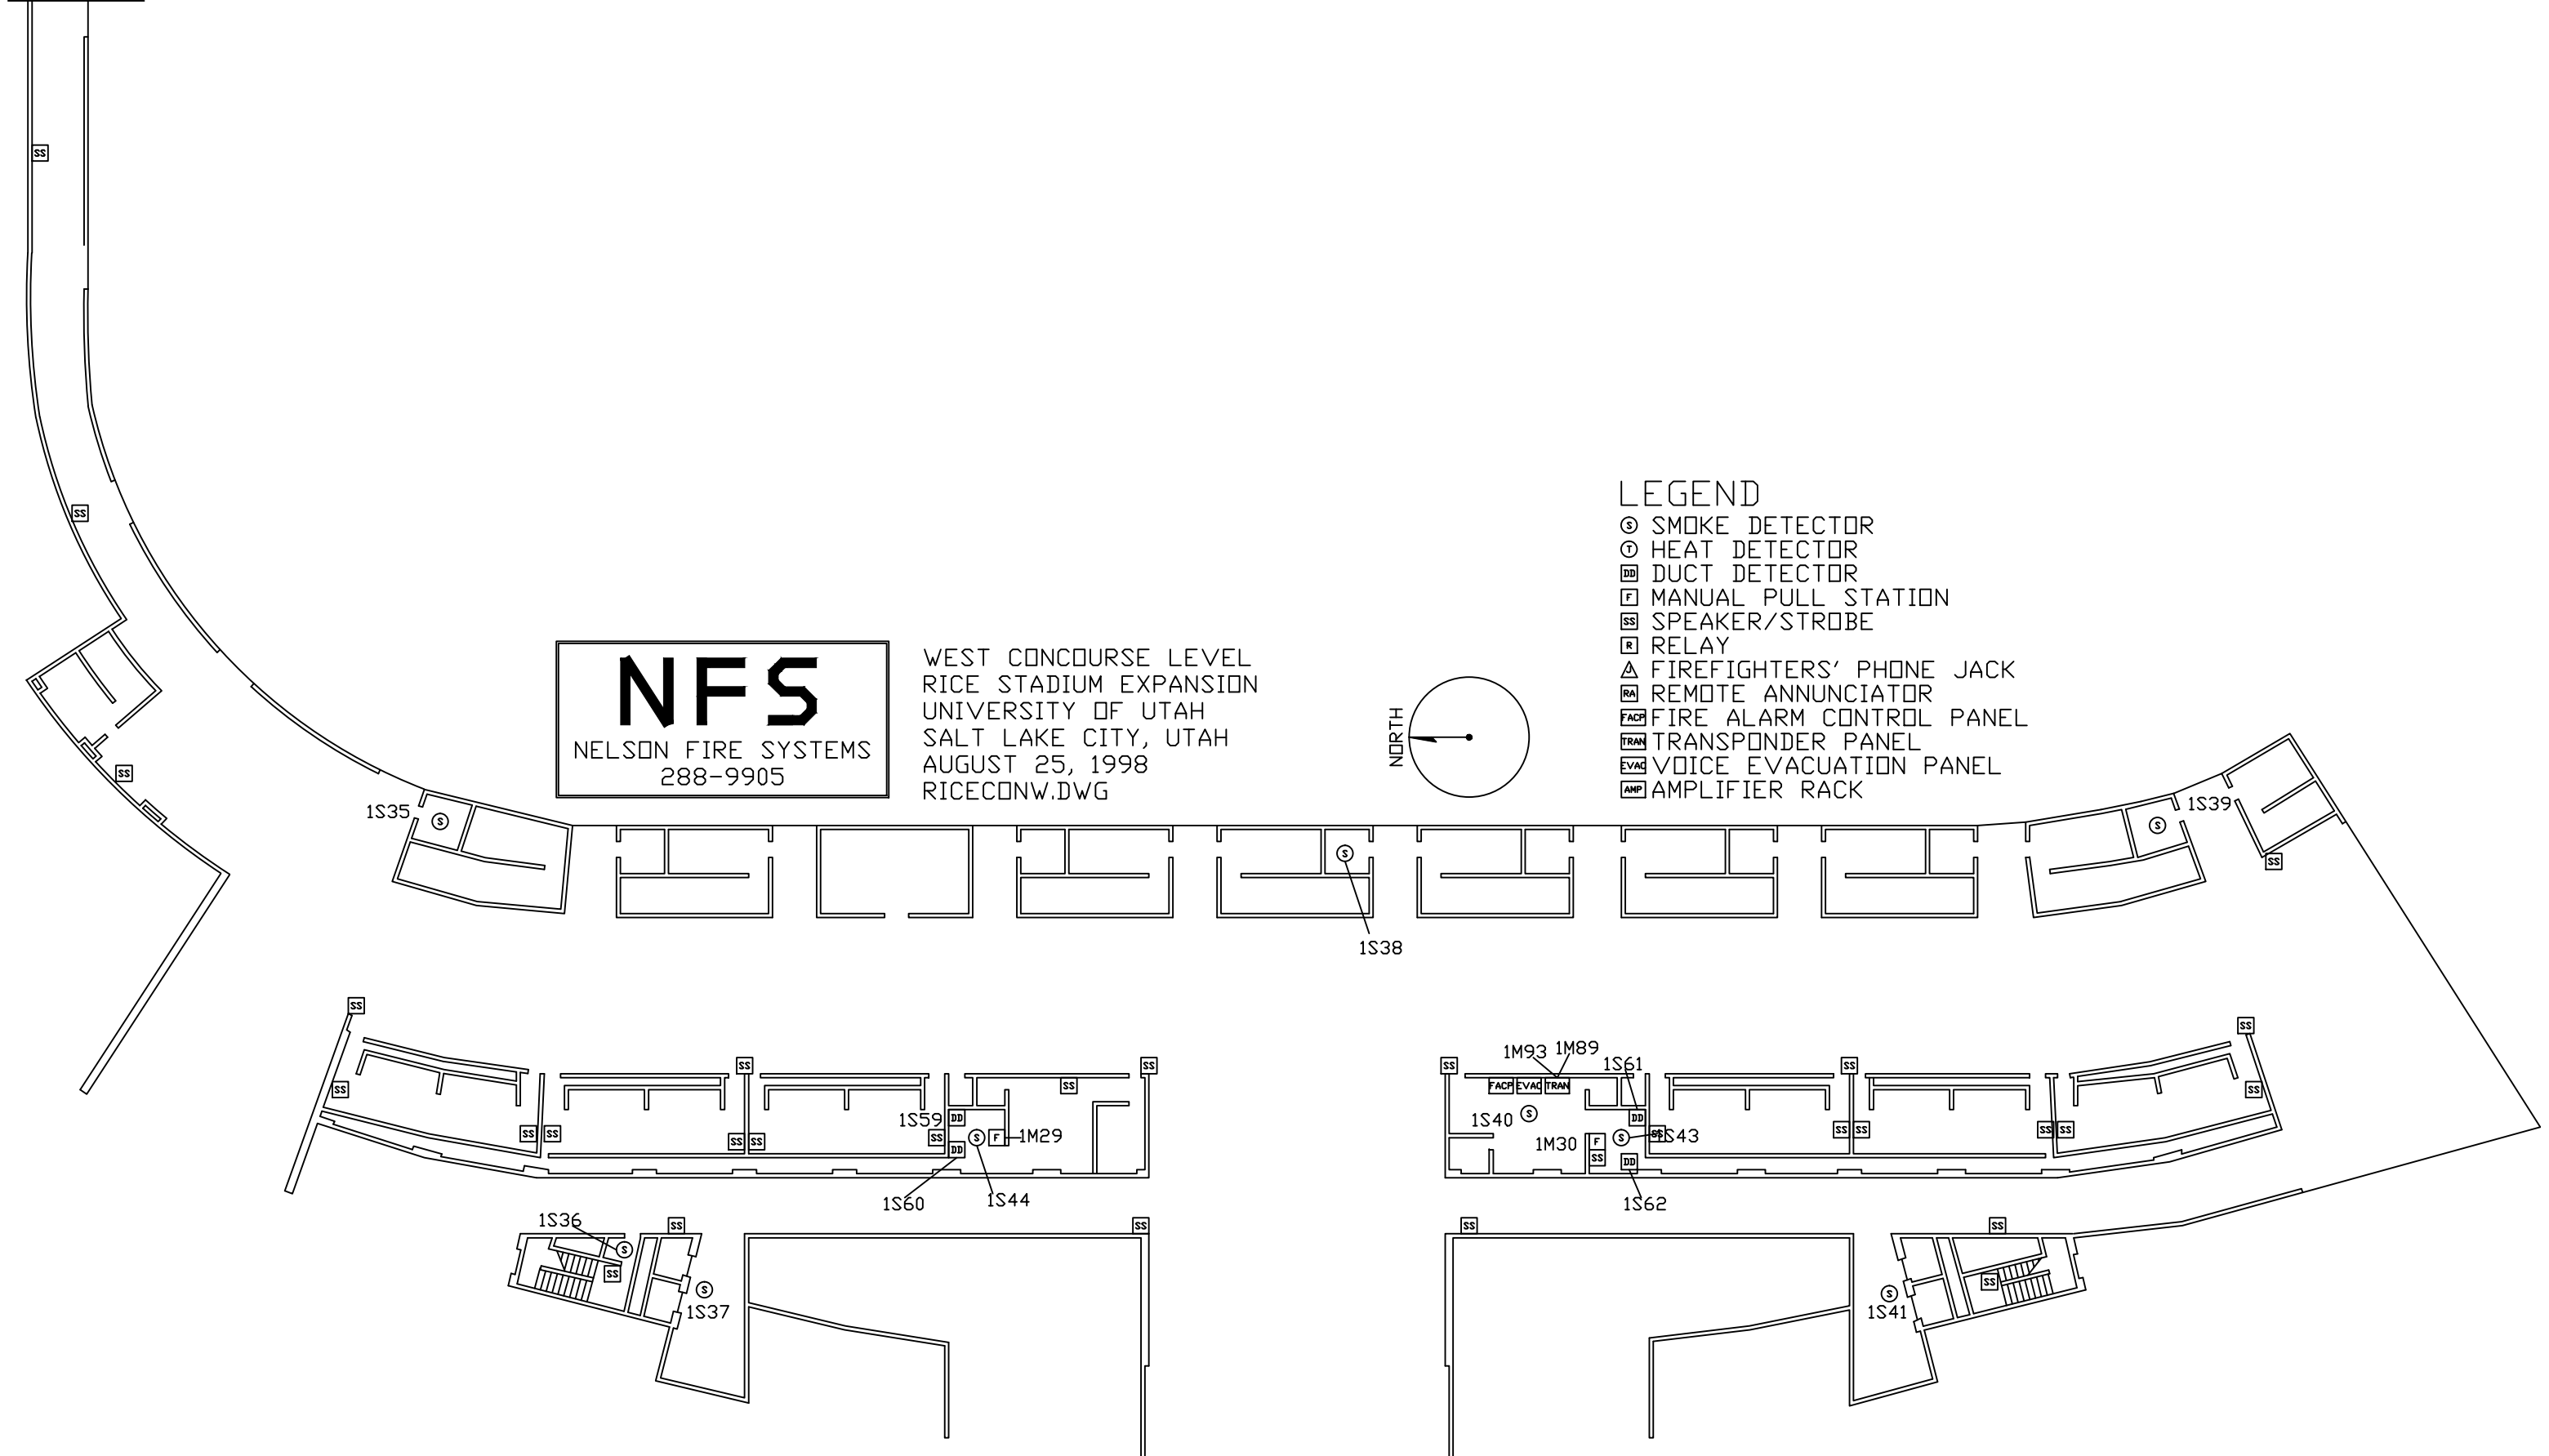



NFS
NELSON FIRE SYSTEMS
288-9905


WEST CONCOURSE LEVEL
RICE STADIUM EXPANSION
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
AUGUST 25, 1998
RICECONW.DWG



- LEGEND
- Ⓢ SMOKE DETECTOR
 - Ⓡ HEAT DETECTOR
 - DD DUCT DETECTOR
 - F MANUAL PULL STATION
 - SS SPEAKER/STROBE
 - R RELAY
 - △ FIREFIGHTERS' PHONE JACK
 - RA REMOTE ANNUNCIATOR
 - FACP FIRE ALARM CONTROL PANEL
 - TRAN TRANSPONDER PANEL
 - EVAC VOICE EVACUATION PANEL
 - AMP AMPLIFIER RACK

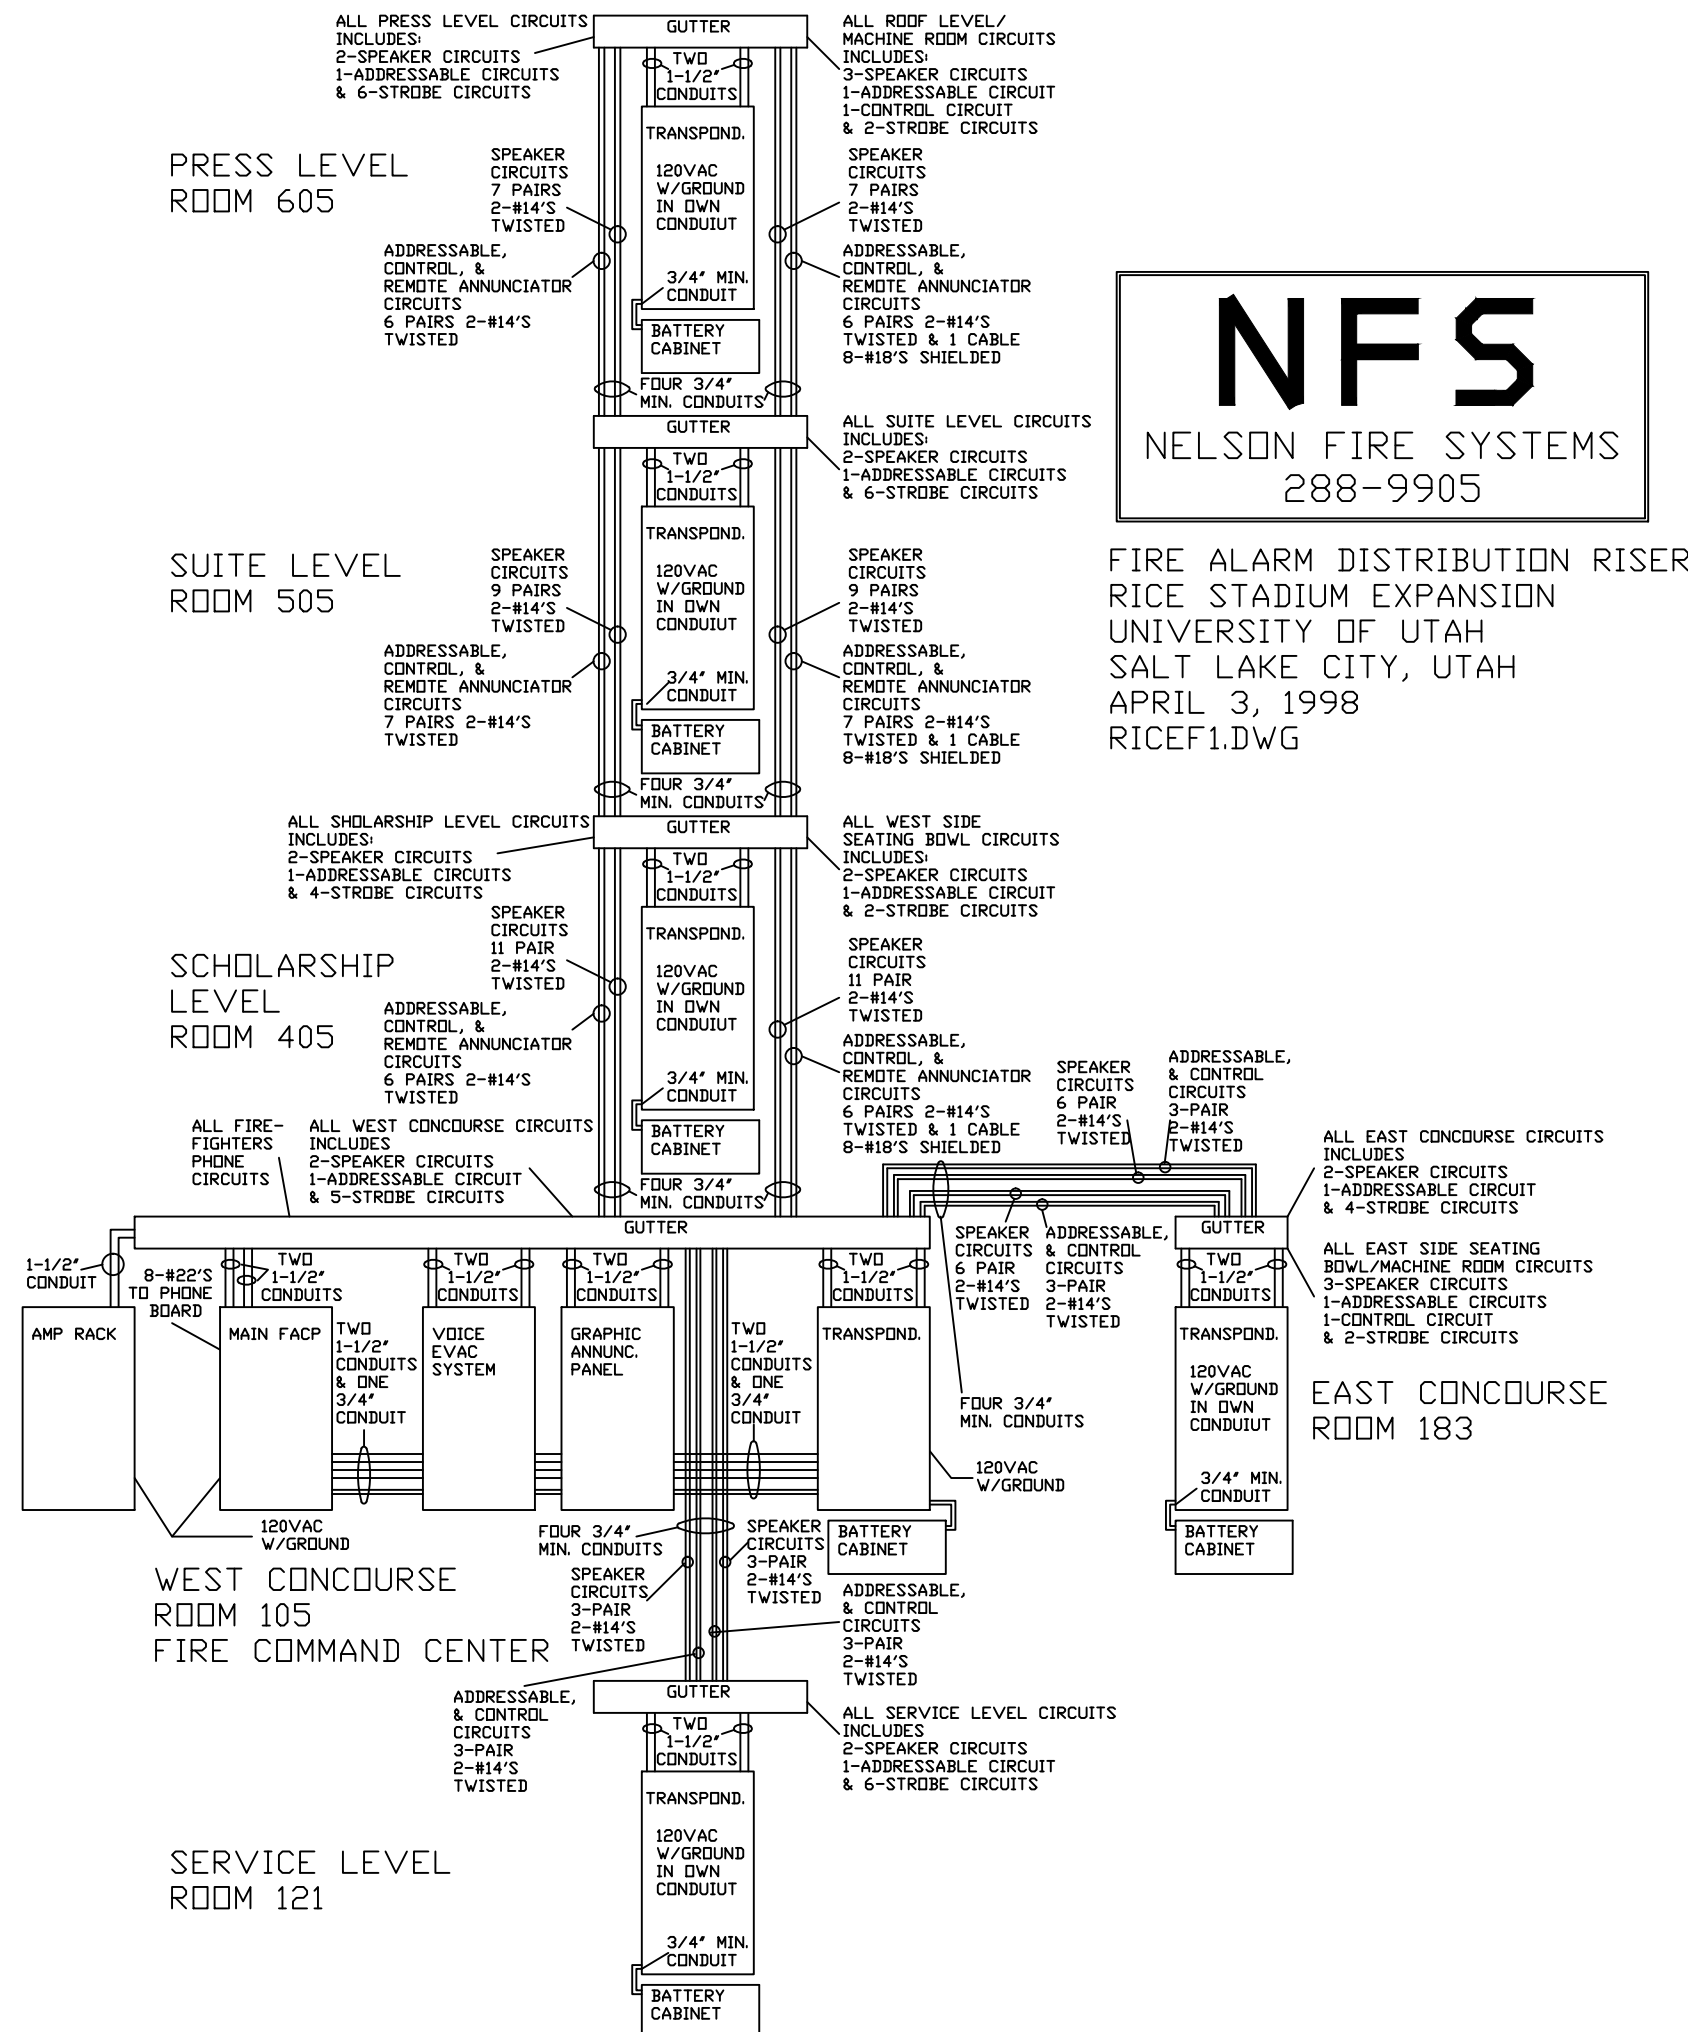


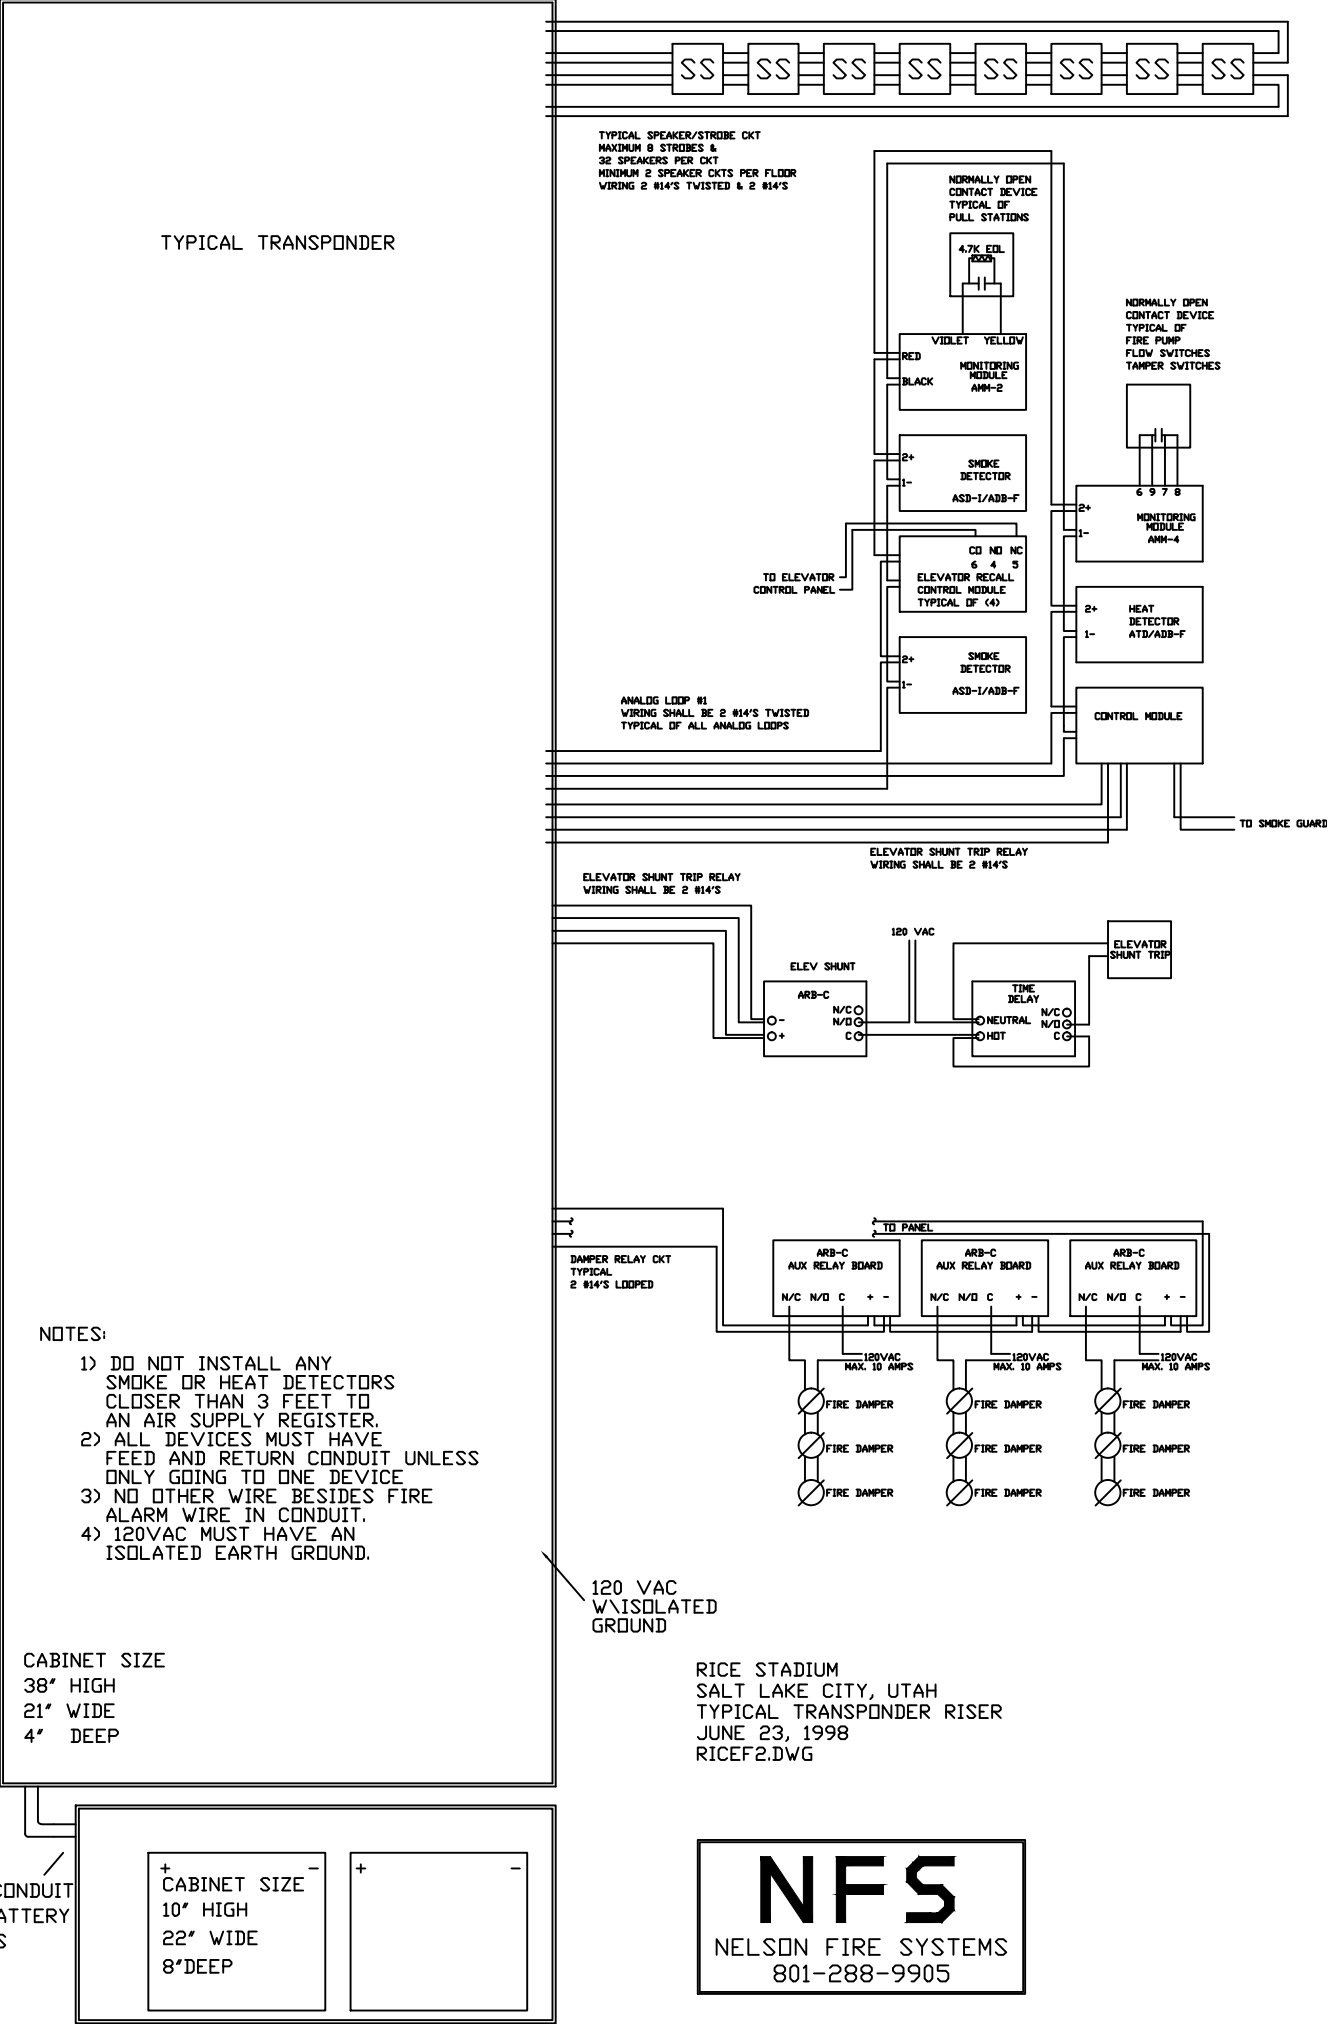

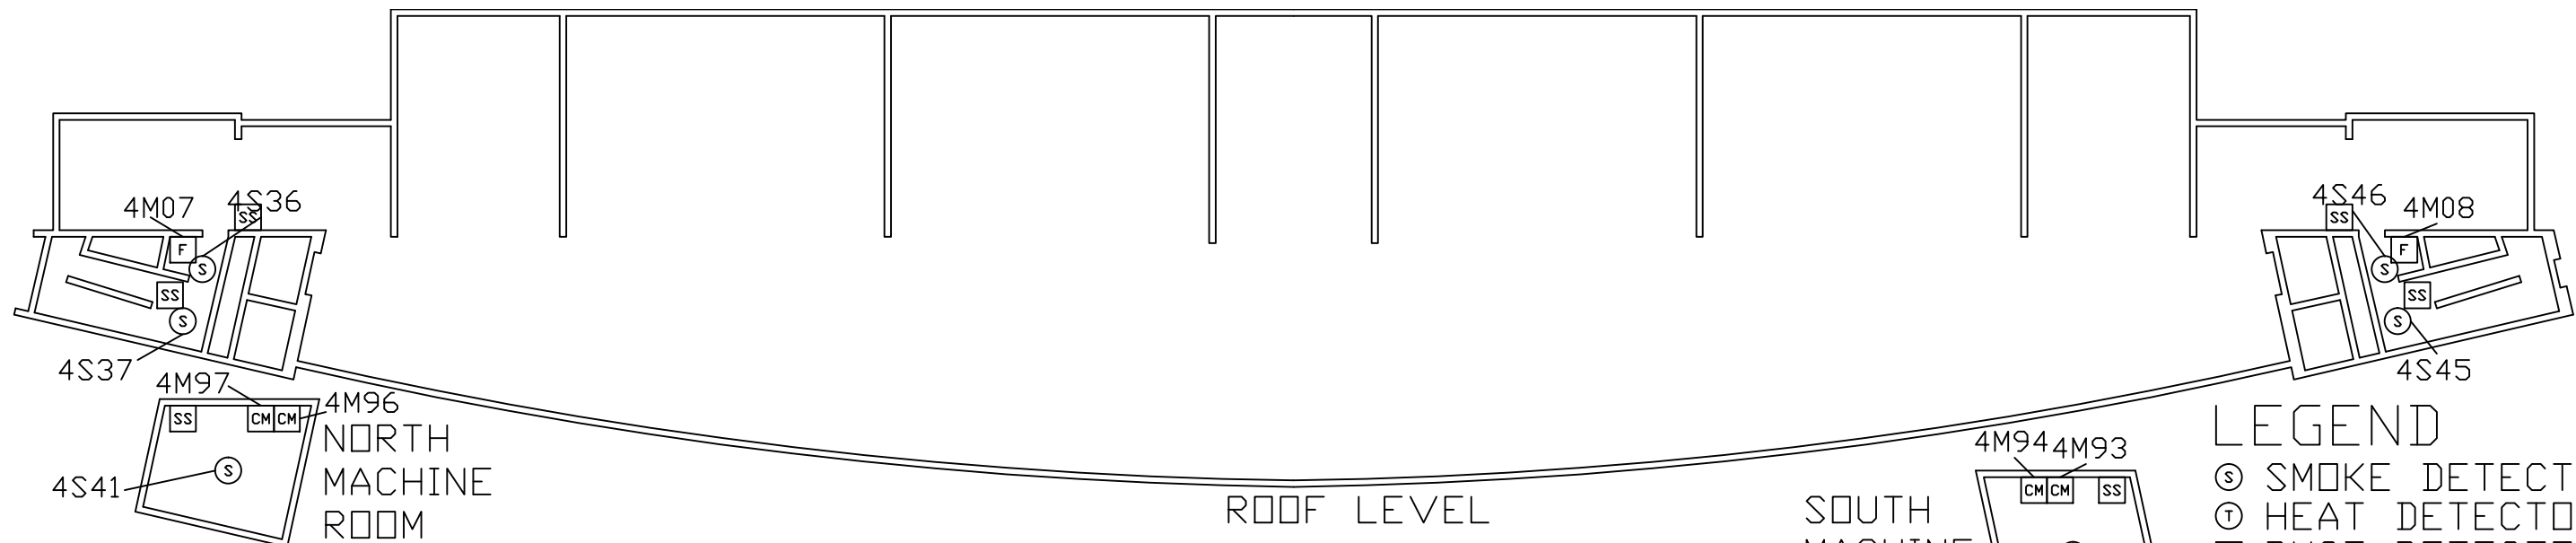


NFS
NELSON FIRE SYSTEMS
288-9905


PRESS & ROOF LEVELS
RICE STADIUM EXPANSION
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
AUGUST 25, 1998
RICEPRES.DWG



LEGEND


- Ⓢ SMOKE DETECTOR
- Ⓣ HEAT DETECTOR
- DD DUCT DETECTOR
- F MANUAL PULL STATION
- WF WATERFLOW SWITCH
- TS TAMPER SWITCH
- CM CONTROL MODULE
- SS SPEAKER/STROBE
- R RELAY
- △ FIRE PHONE JACK
- RA REMOTE ANNUNCIATOR
- TRAN TRANSPONDER PANEL

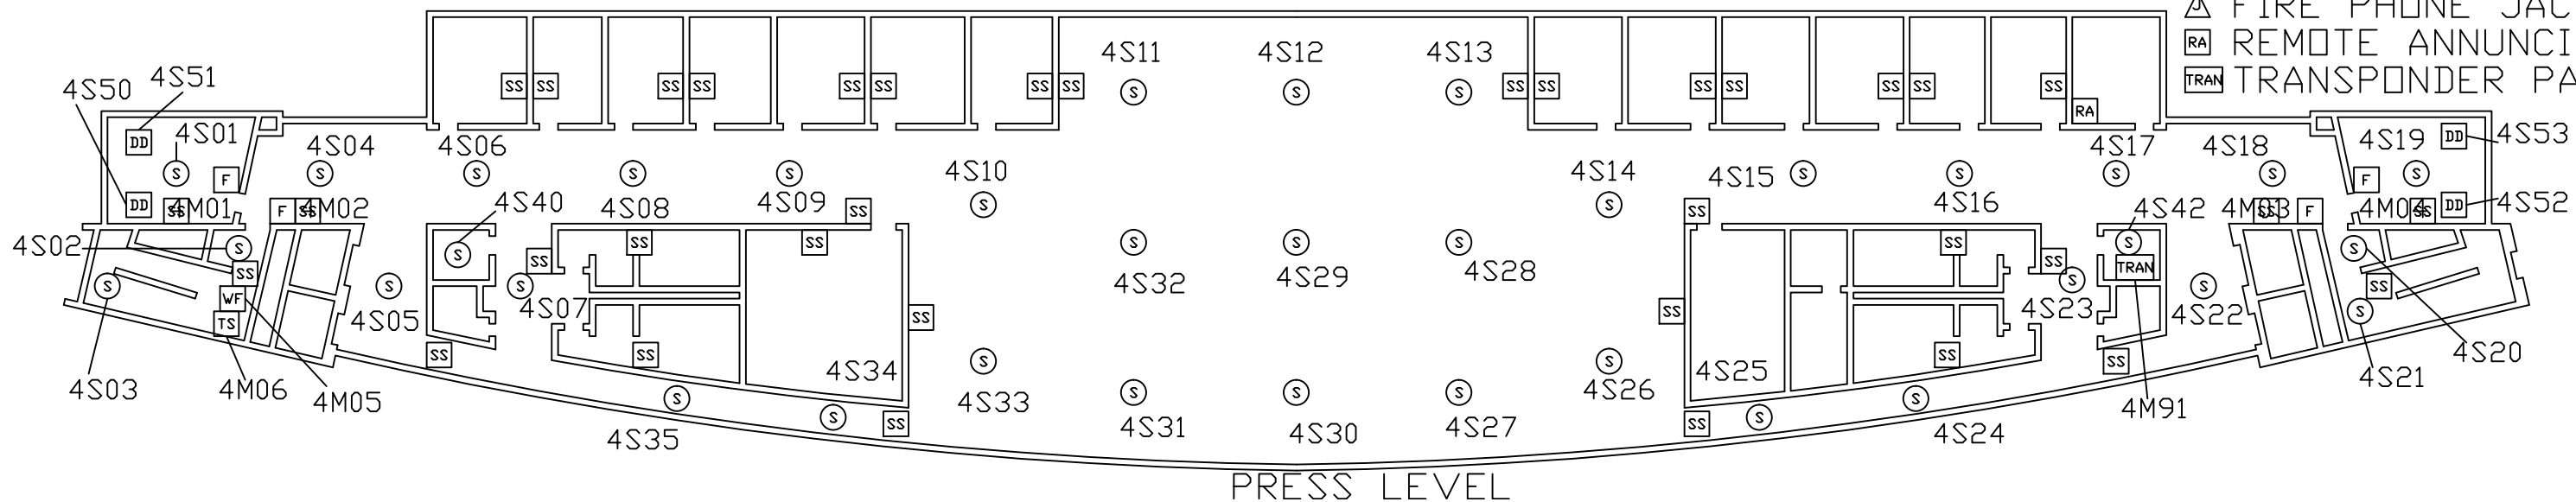

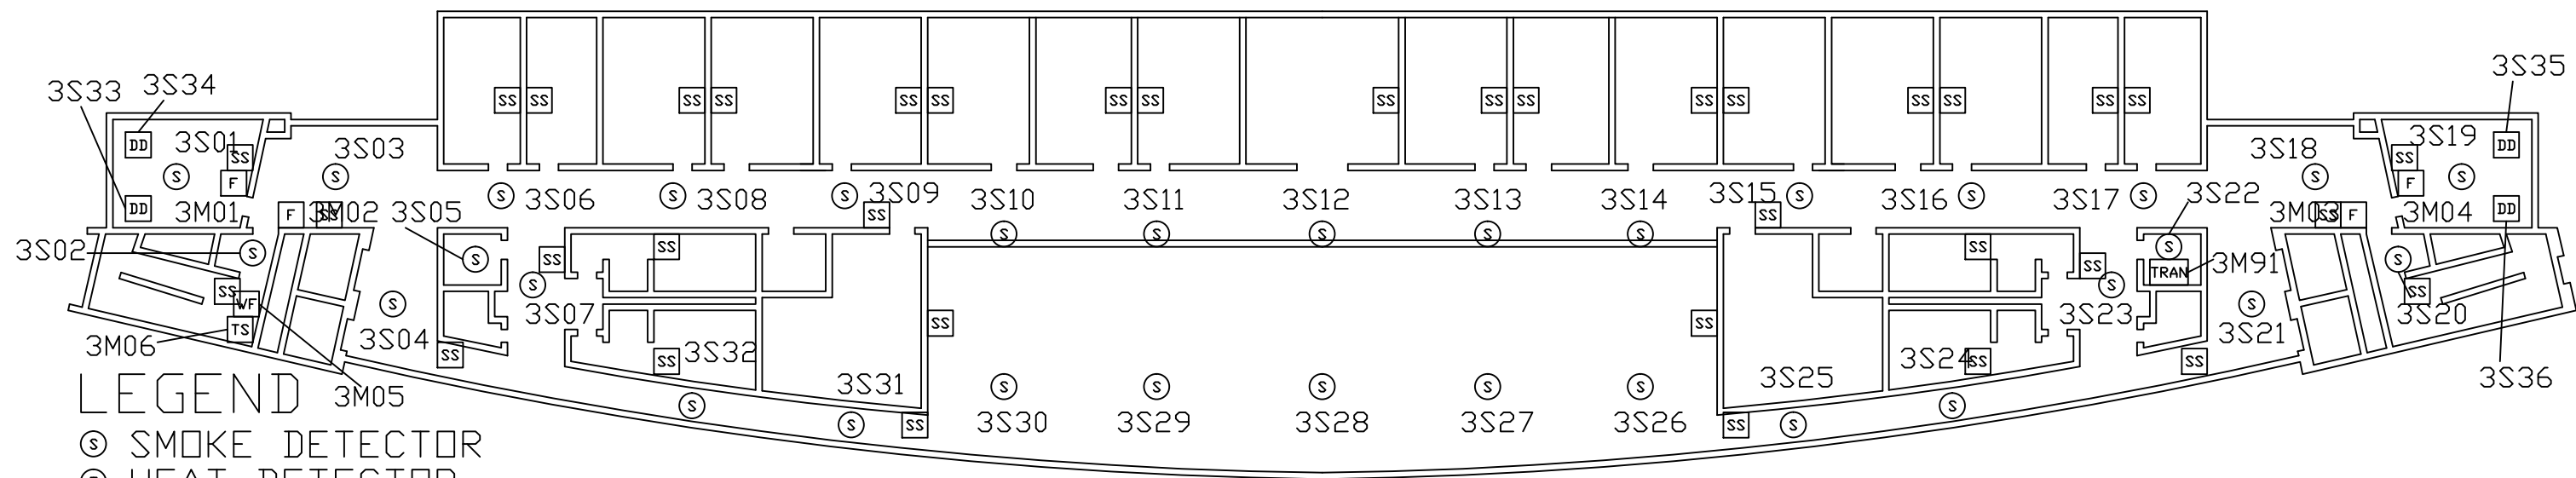


SUITE LEVEL

SCHOLARSHIP & SUITE LEVELS
 RICE STADIUM EXPANSION
 UNIVERSITY OF UTAH
 SALT LAKE CITY, UTAH
 AUGUST 25, 1998
 RICESCHL.DWG

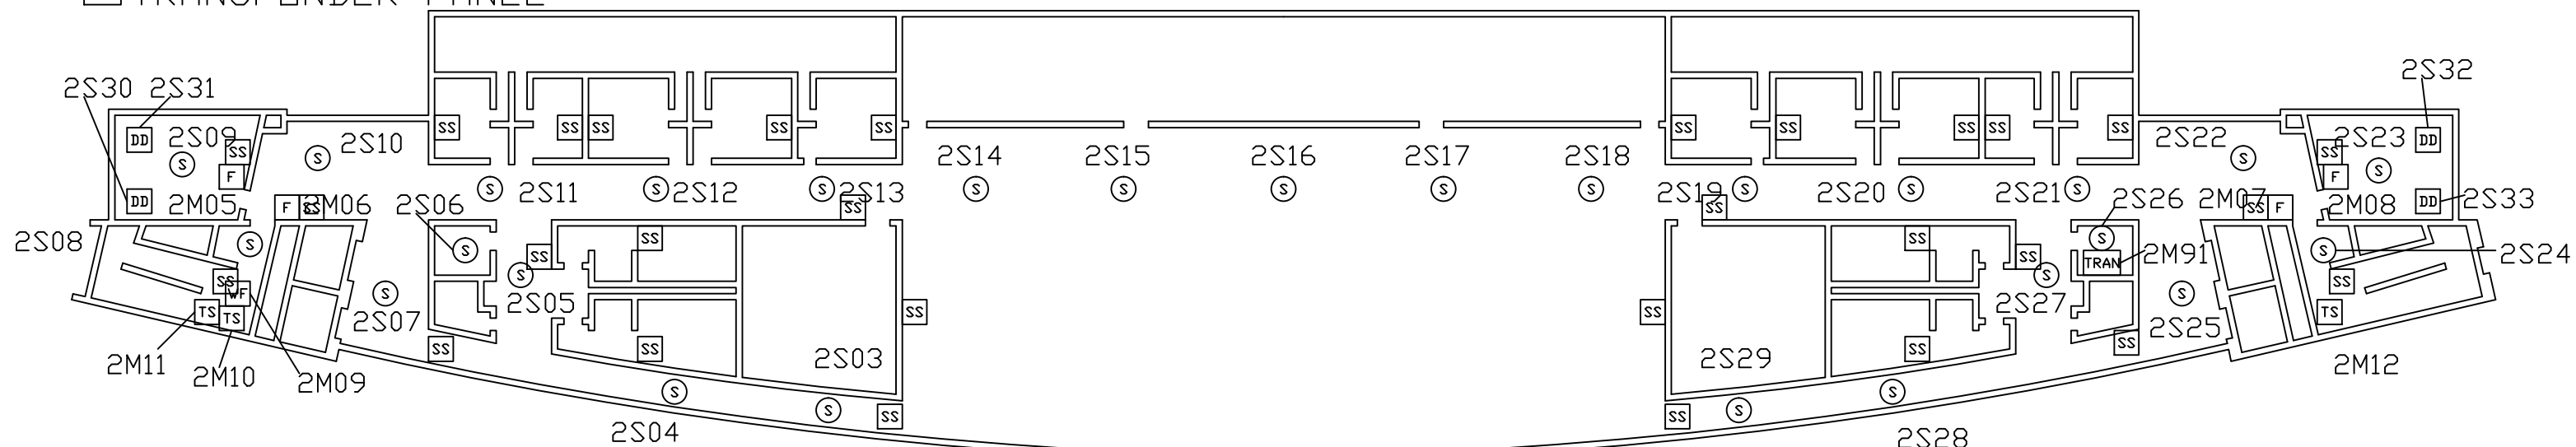


SCHOLARSHIP LEVEL

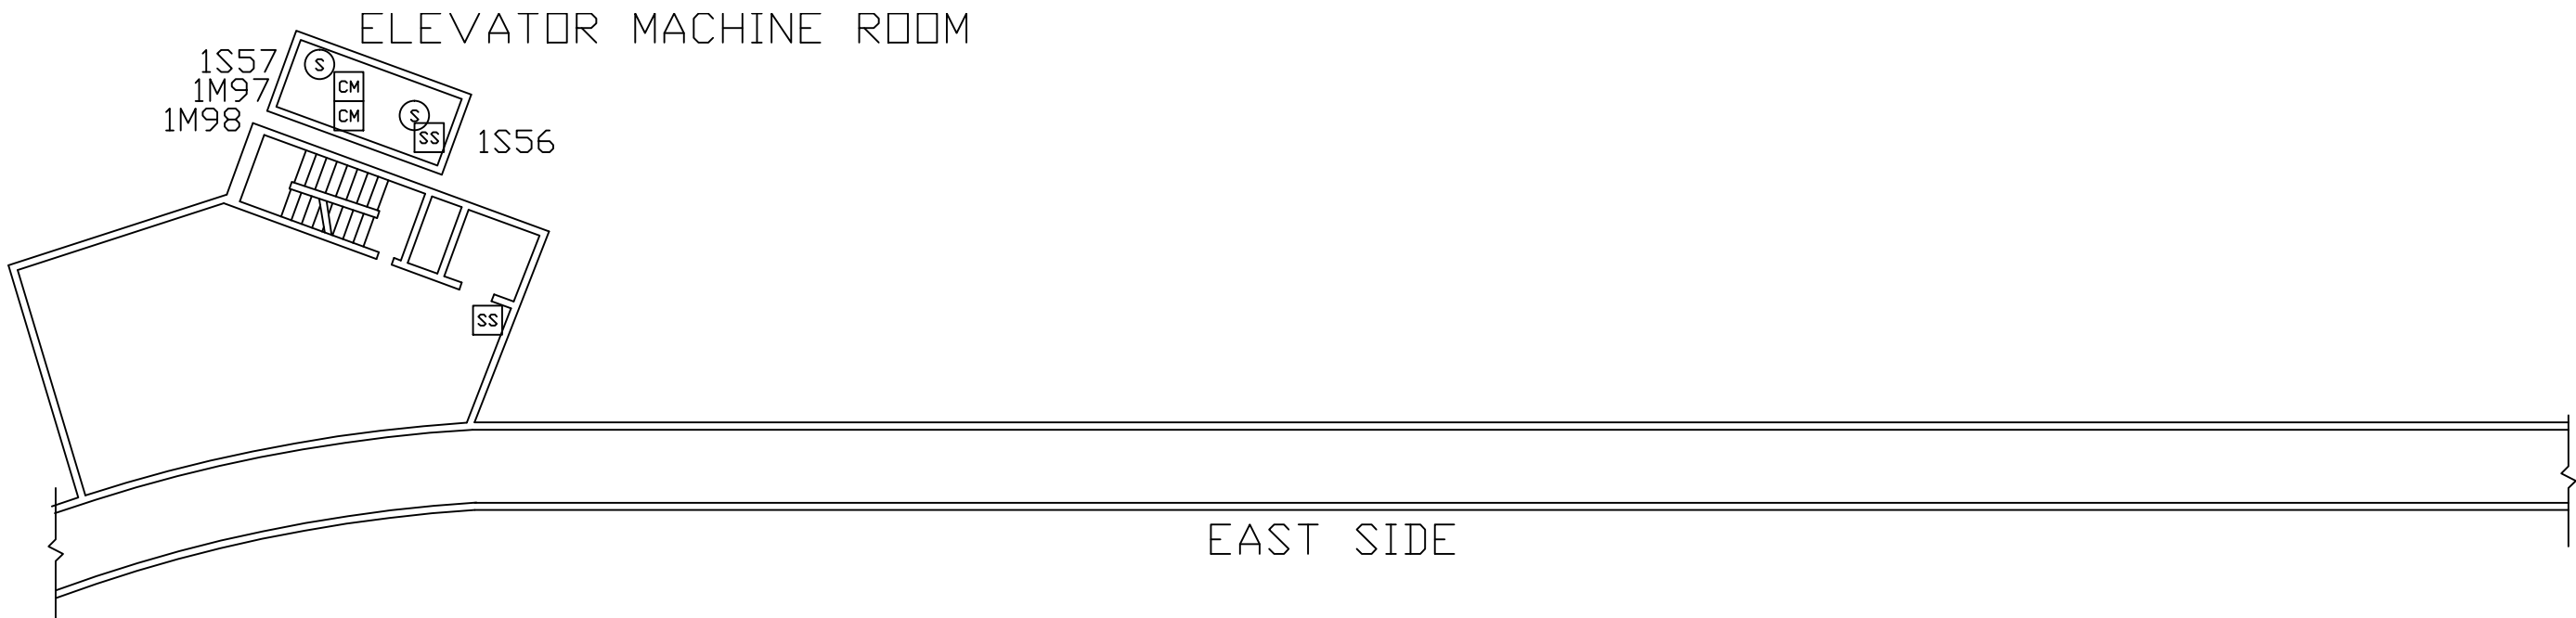

NFS

NELSON FIRE SYSTEMS
288-9905

SEATING BOWL LEVEL
RICE STADIUM EXPANSION
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
AUGUST 25, 1998
RICESEAT.DWG



- LEGEND
- Ⓢ SMOKE DETECTOR
 - Ⓣ HEAT DETECTOR
 - ⓕ MANUAL PULL STATION
 - Ⓦⓕ WATERFLOW SWITCH
 - ⓉⓈ TAMPER SWITCH
 - ⓈⓈ SPEAKER/STROBE
 - △ FIREFIGHTERS' PHONE JACK




NELSON FIRE SYSTEMS
288-9905


RICESERV.DWG



- ③ SMOKE DETECTOR
- ④ HEAT DETECTOR
- DD DUCT DETECTOR
- F MANUAL PULL STATION
- WF WATERFLOW SWITCH
- TS TAMPER SWITCH
- PS PRESSURE SWITCH
- KH KITCHEN HOOD
- FP FIRE PUMP
- S_{WP} WEATHERPROOF SPEAKER
- SS SPEAKER/STROBE
- △ FIREFIGHTERS' PHONE JACK
- TRAN TRANSPONDER PANEL

- ③ SMOKE DETECTOR
- ④ HEAT DETECTOR
- DD DUCT DETECTOR
- F MANUAL PULL STATION
- WF WATERFLOW SWITCH
- TS TAMPER SWITCH
- PS PRESSURE SWITCH
- KH KITCHEN HOOD
- FP FIRE PUMP
- S_{WP} WEATHERPROOF SPEAKER
- SS SPEAKER/STROBE
- △ FIREFIGHTERS' PHONE JACK
- TRAN TRANSPONDER PANEL

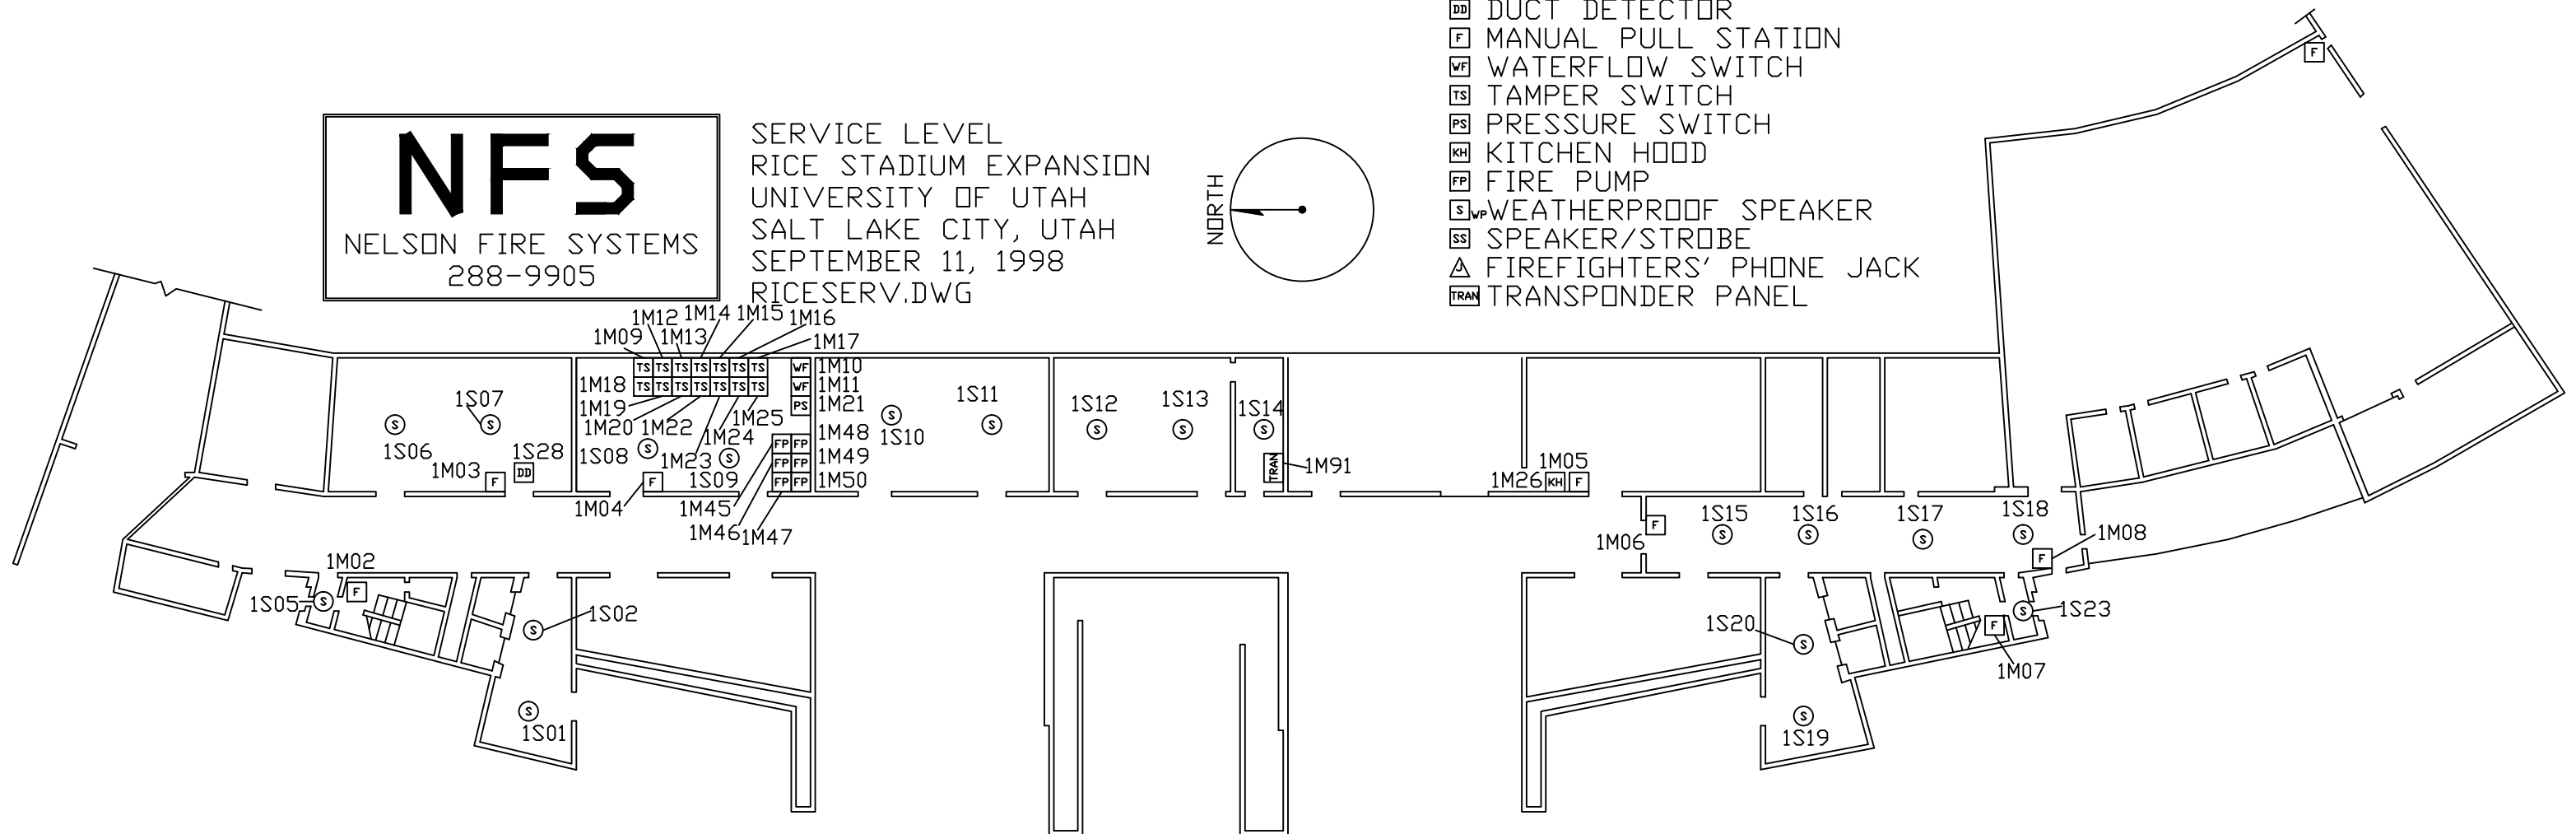


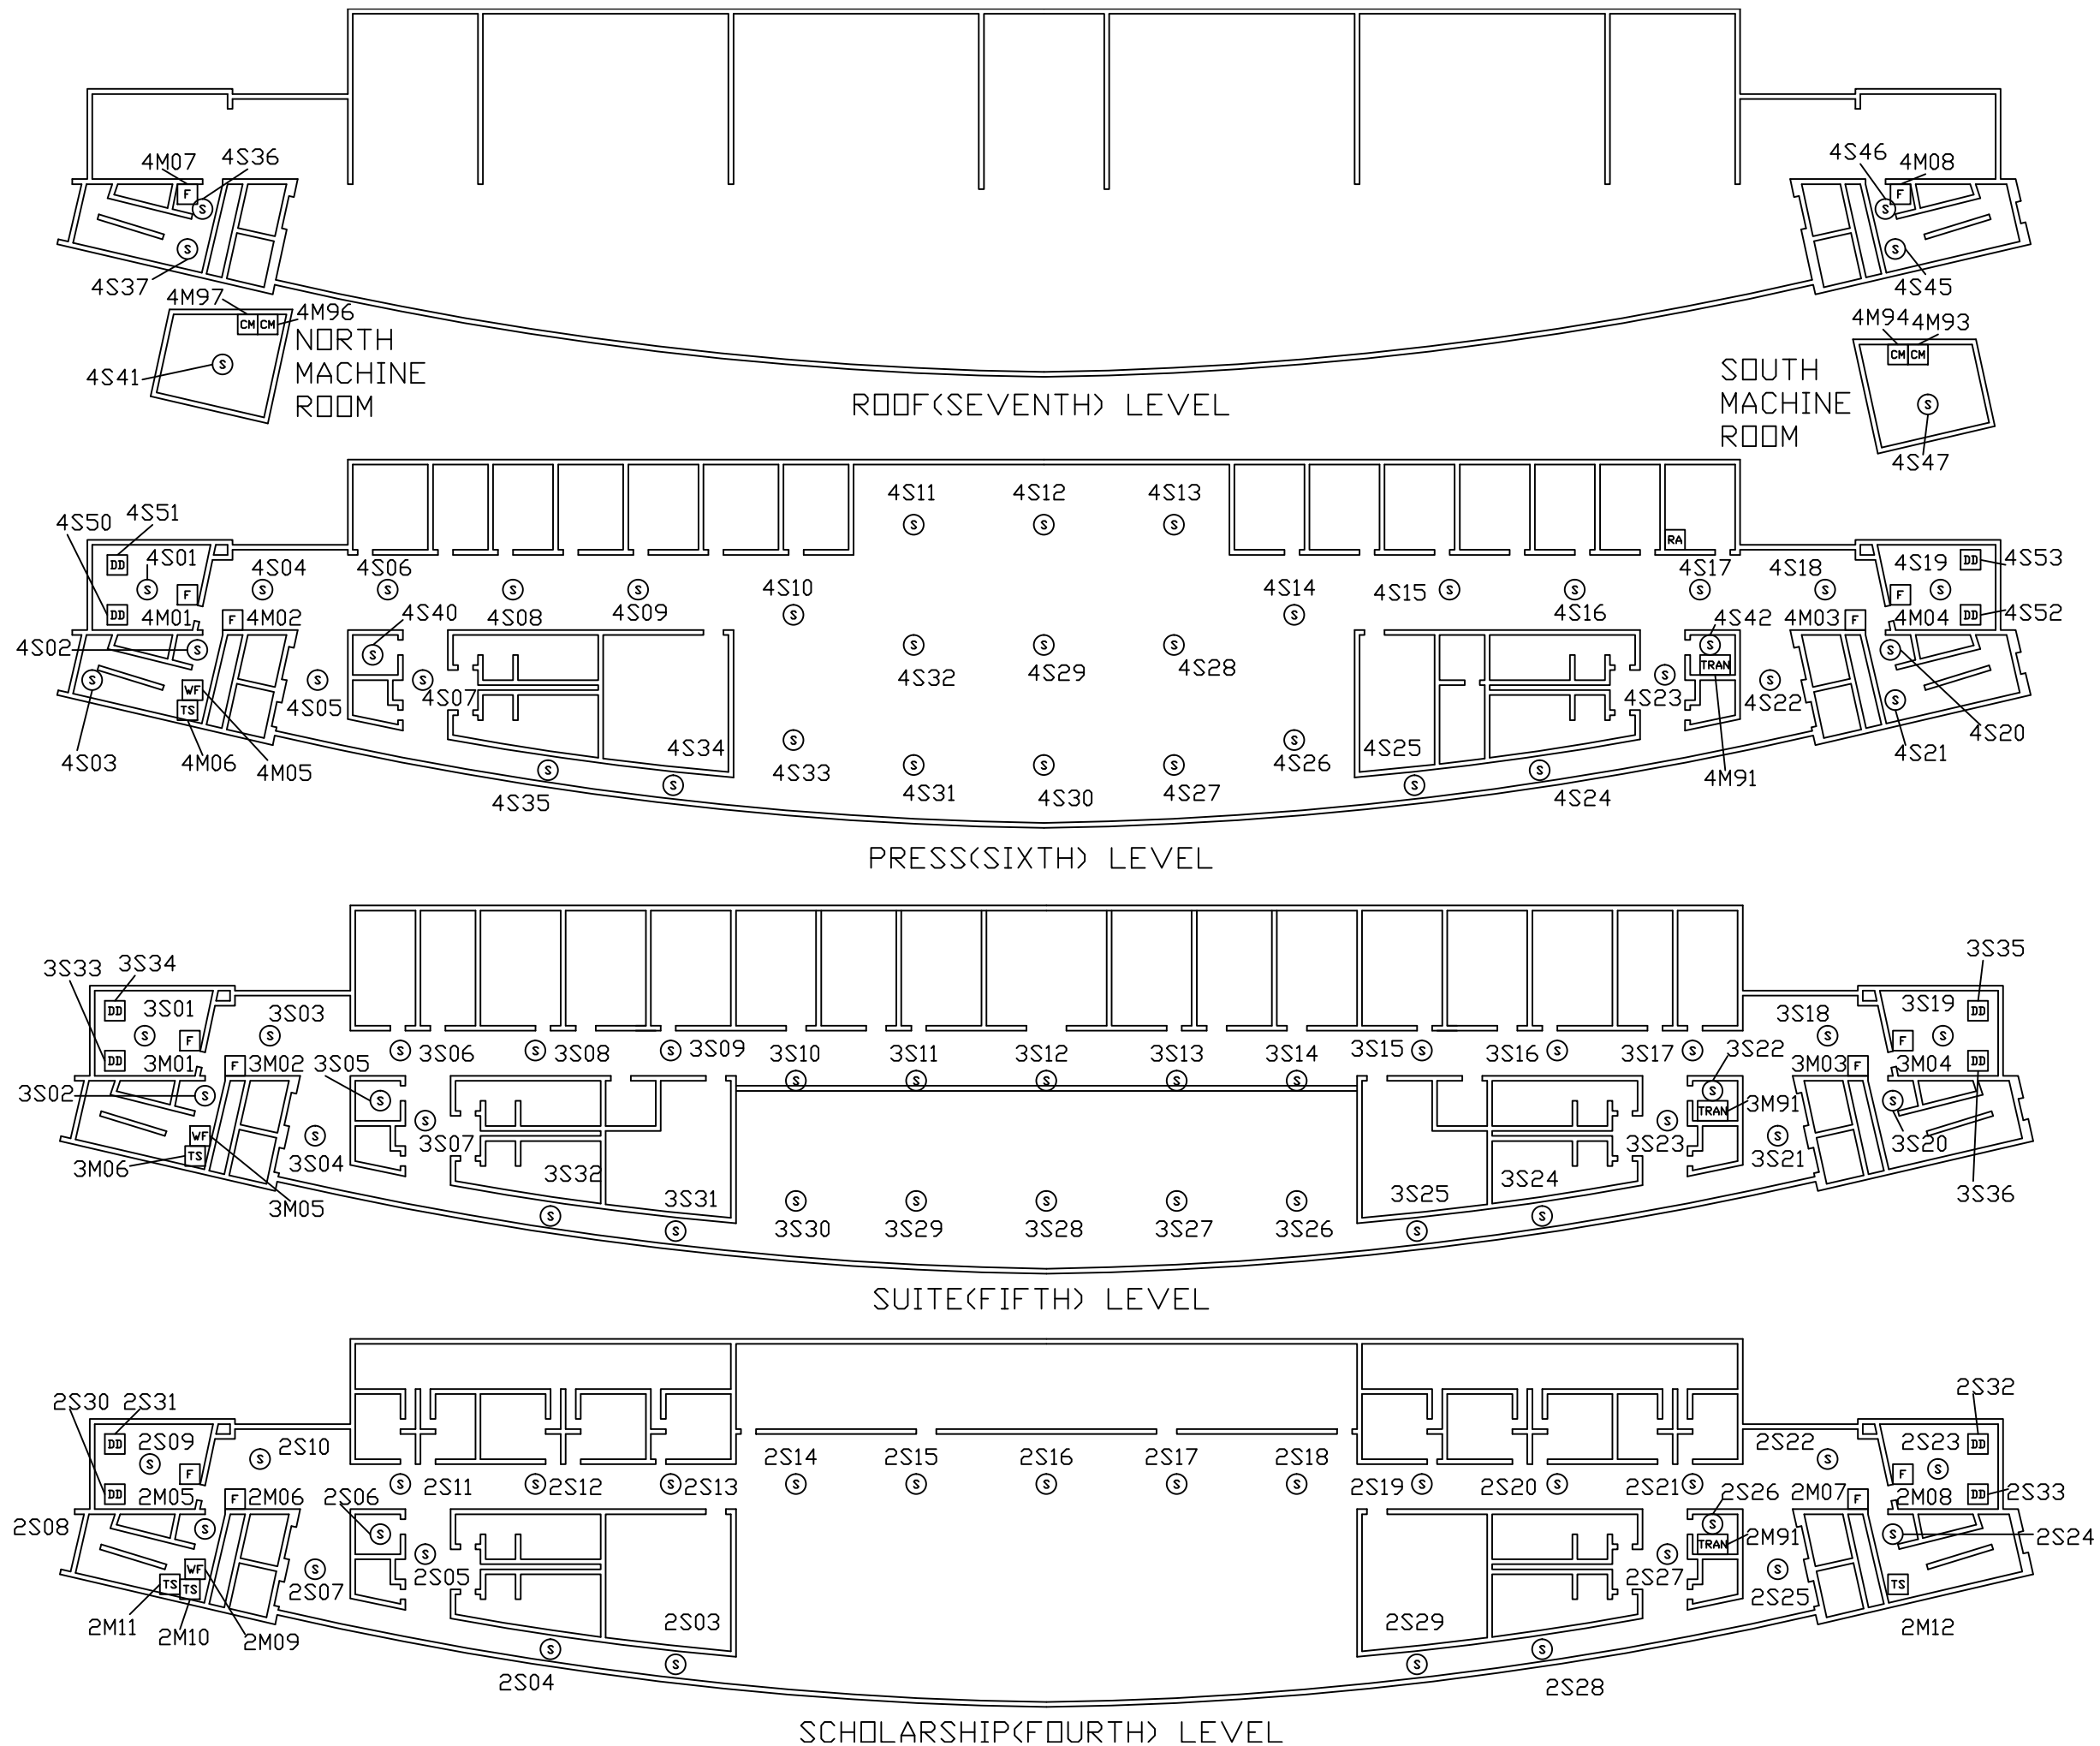

- ### LEGEND
- Ⓢ SMOKE DETECTOR
 - Ⓢ HEAT DETECTOR
 - DD DUCT DETECTOR
 - F MANUAL PULL STATION
 - WF WATERFLOW SWITCH
 - TS TAMPER SWITCH
 - CM CONTROL MODULE
 - SS SPEAKER/STROBE
 - R RELAY
 - △ FIRE PHONE JACK
 - RA REMOTE ANNUNCIATOR
 - TRAN TRANSPONDER PANEL

RICE STADIUM EXPANSION
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
SEPTEMBER 11, 1998
RICETDWR.DWG

NFS
NELSON FIRE SYSTEMS
288-9905



GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLAN. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

SYSTEM NOTES:


◊ TIE TO EXISTING ADDRESSABLE DEVICE

WIRE SCHEDULE




SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED

DEVICE LEGEND


SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓚ	KITCHENHOOD MONITOR MODULE
EX	EXISTING DEVICE




NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

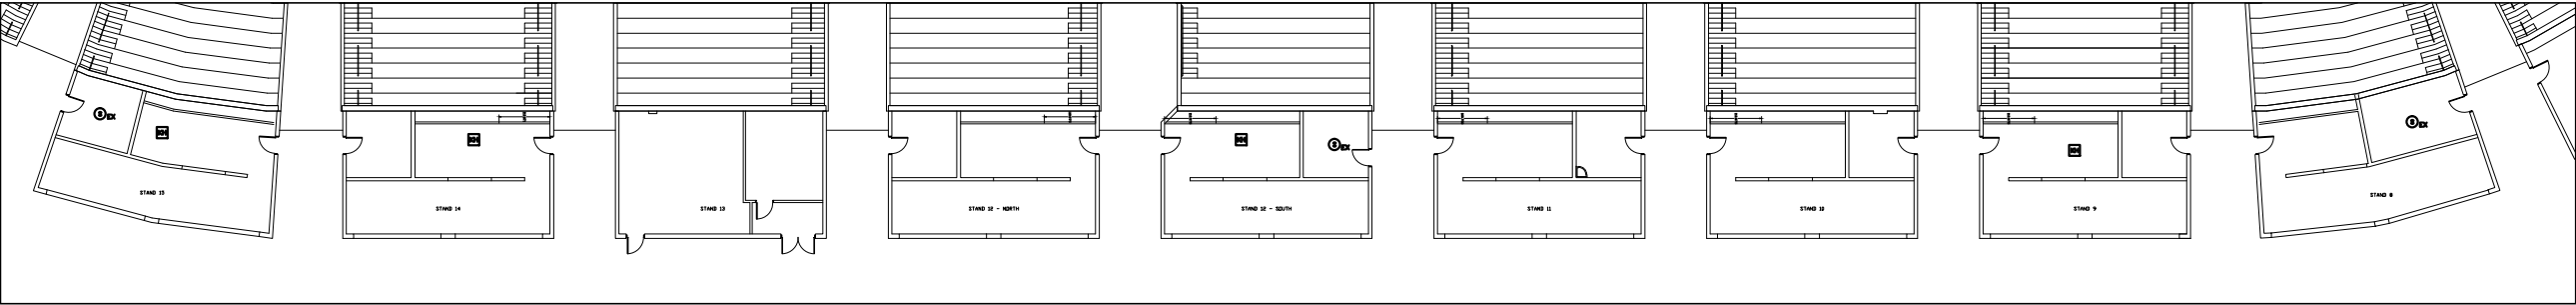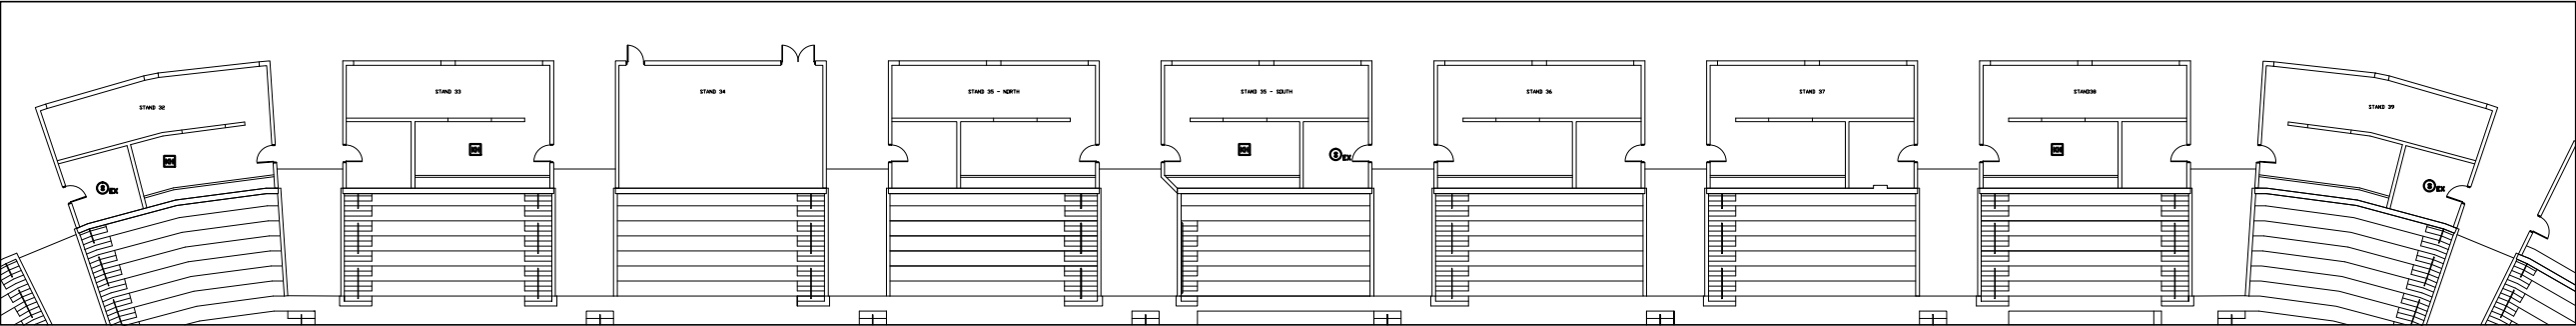


WARMING KITCHEN LEVEL 4



WARMING KITCHEN LEVEL 5




WARMING KITCHEN LEVEL 6

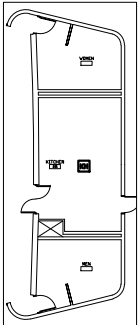

CLARK BUILDING CROCKER KITCHEN

0' 5' 10' 15' 25' 50'
SCALE




RICE-ECCLES STADIUM
CONCESSIONS UPGRADE
UNIVERSITY OF UTAH
451 SOUTH 1400 EAST
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: RS
DATE: 6/23/14
SCALE: (ARCH D) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
UofU CONCESSIONS UPGRADE.DWG

FIRE ALARM SYSTEM

PAGE:




RICE-ECCLES STADIUM SOUTH ENDZONE
UNIVERSITY OF UTAH
451 SOUTH 1400 EAST
SALT LAKE CITY, UT 84112
FIRE ALARM SYSTEM

DRAWN BY:	AK
DESIGNED BY:	
APPROVED BY:	KK
DATE:	
SCALE:	
PROJECT NO:	
REVISION NO:	
DRAWING NAME:	UOFU SOUTH ENDZONE 1.DWG

PAGE:
FINAL MAP

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	HEAT DETECTOR
	PULL STATION
	DUCT DETECTOR
	TAMPER SWITCH
	WATERFLOW SWITCH
	PRESSURE SWITCH
	LOW AIR
	KITCHEN HOOD MONITOR MODULE
	CONTROL MODULE
	CONTROL MODULE SUPERVISED
	FIRE ALARM CONTROL UNIT
	NAC
	ELEVATOR CONTROL PANEL



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECTURE/ENGINEER (A/E) PLANS AND
SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY
RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE,
LOCATION, AND SUITABILITY OF ALL FIRE ALARMS,
CONTROL PANELS, AND OTHER DEVICES SHOWN ON
THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY
THE WIRING DIAGRAMS BETWEEN FIRE ALARM
DEVICES AND CONTROL PANELS. NFS IS NOT
RESPONSIBLE FOR THE INFORMATION SHOWN ON THE
A/E PLANS.

RICE-ECCLES STADIUM SOUTH ENDZONE
UNIVERSITY OF UTAH
451 SOUTH 1400 EAST
SALT LAKE CITY, UT 84112
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: AK
DESIGNED BY:
APPROVED BY: KK
DATE:
SCALE:
PROJECT NO:
REVISION NO:
DRAWING NAME:
UOFU SOUTH ENDZONE 2.DWG

NELSON FIRE SYSTEMS

SEZ SUITE & MEZZANINE

PAGE:

FINAL MAP

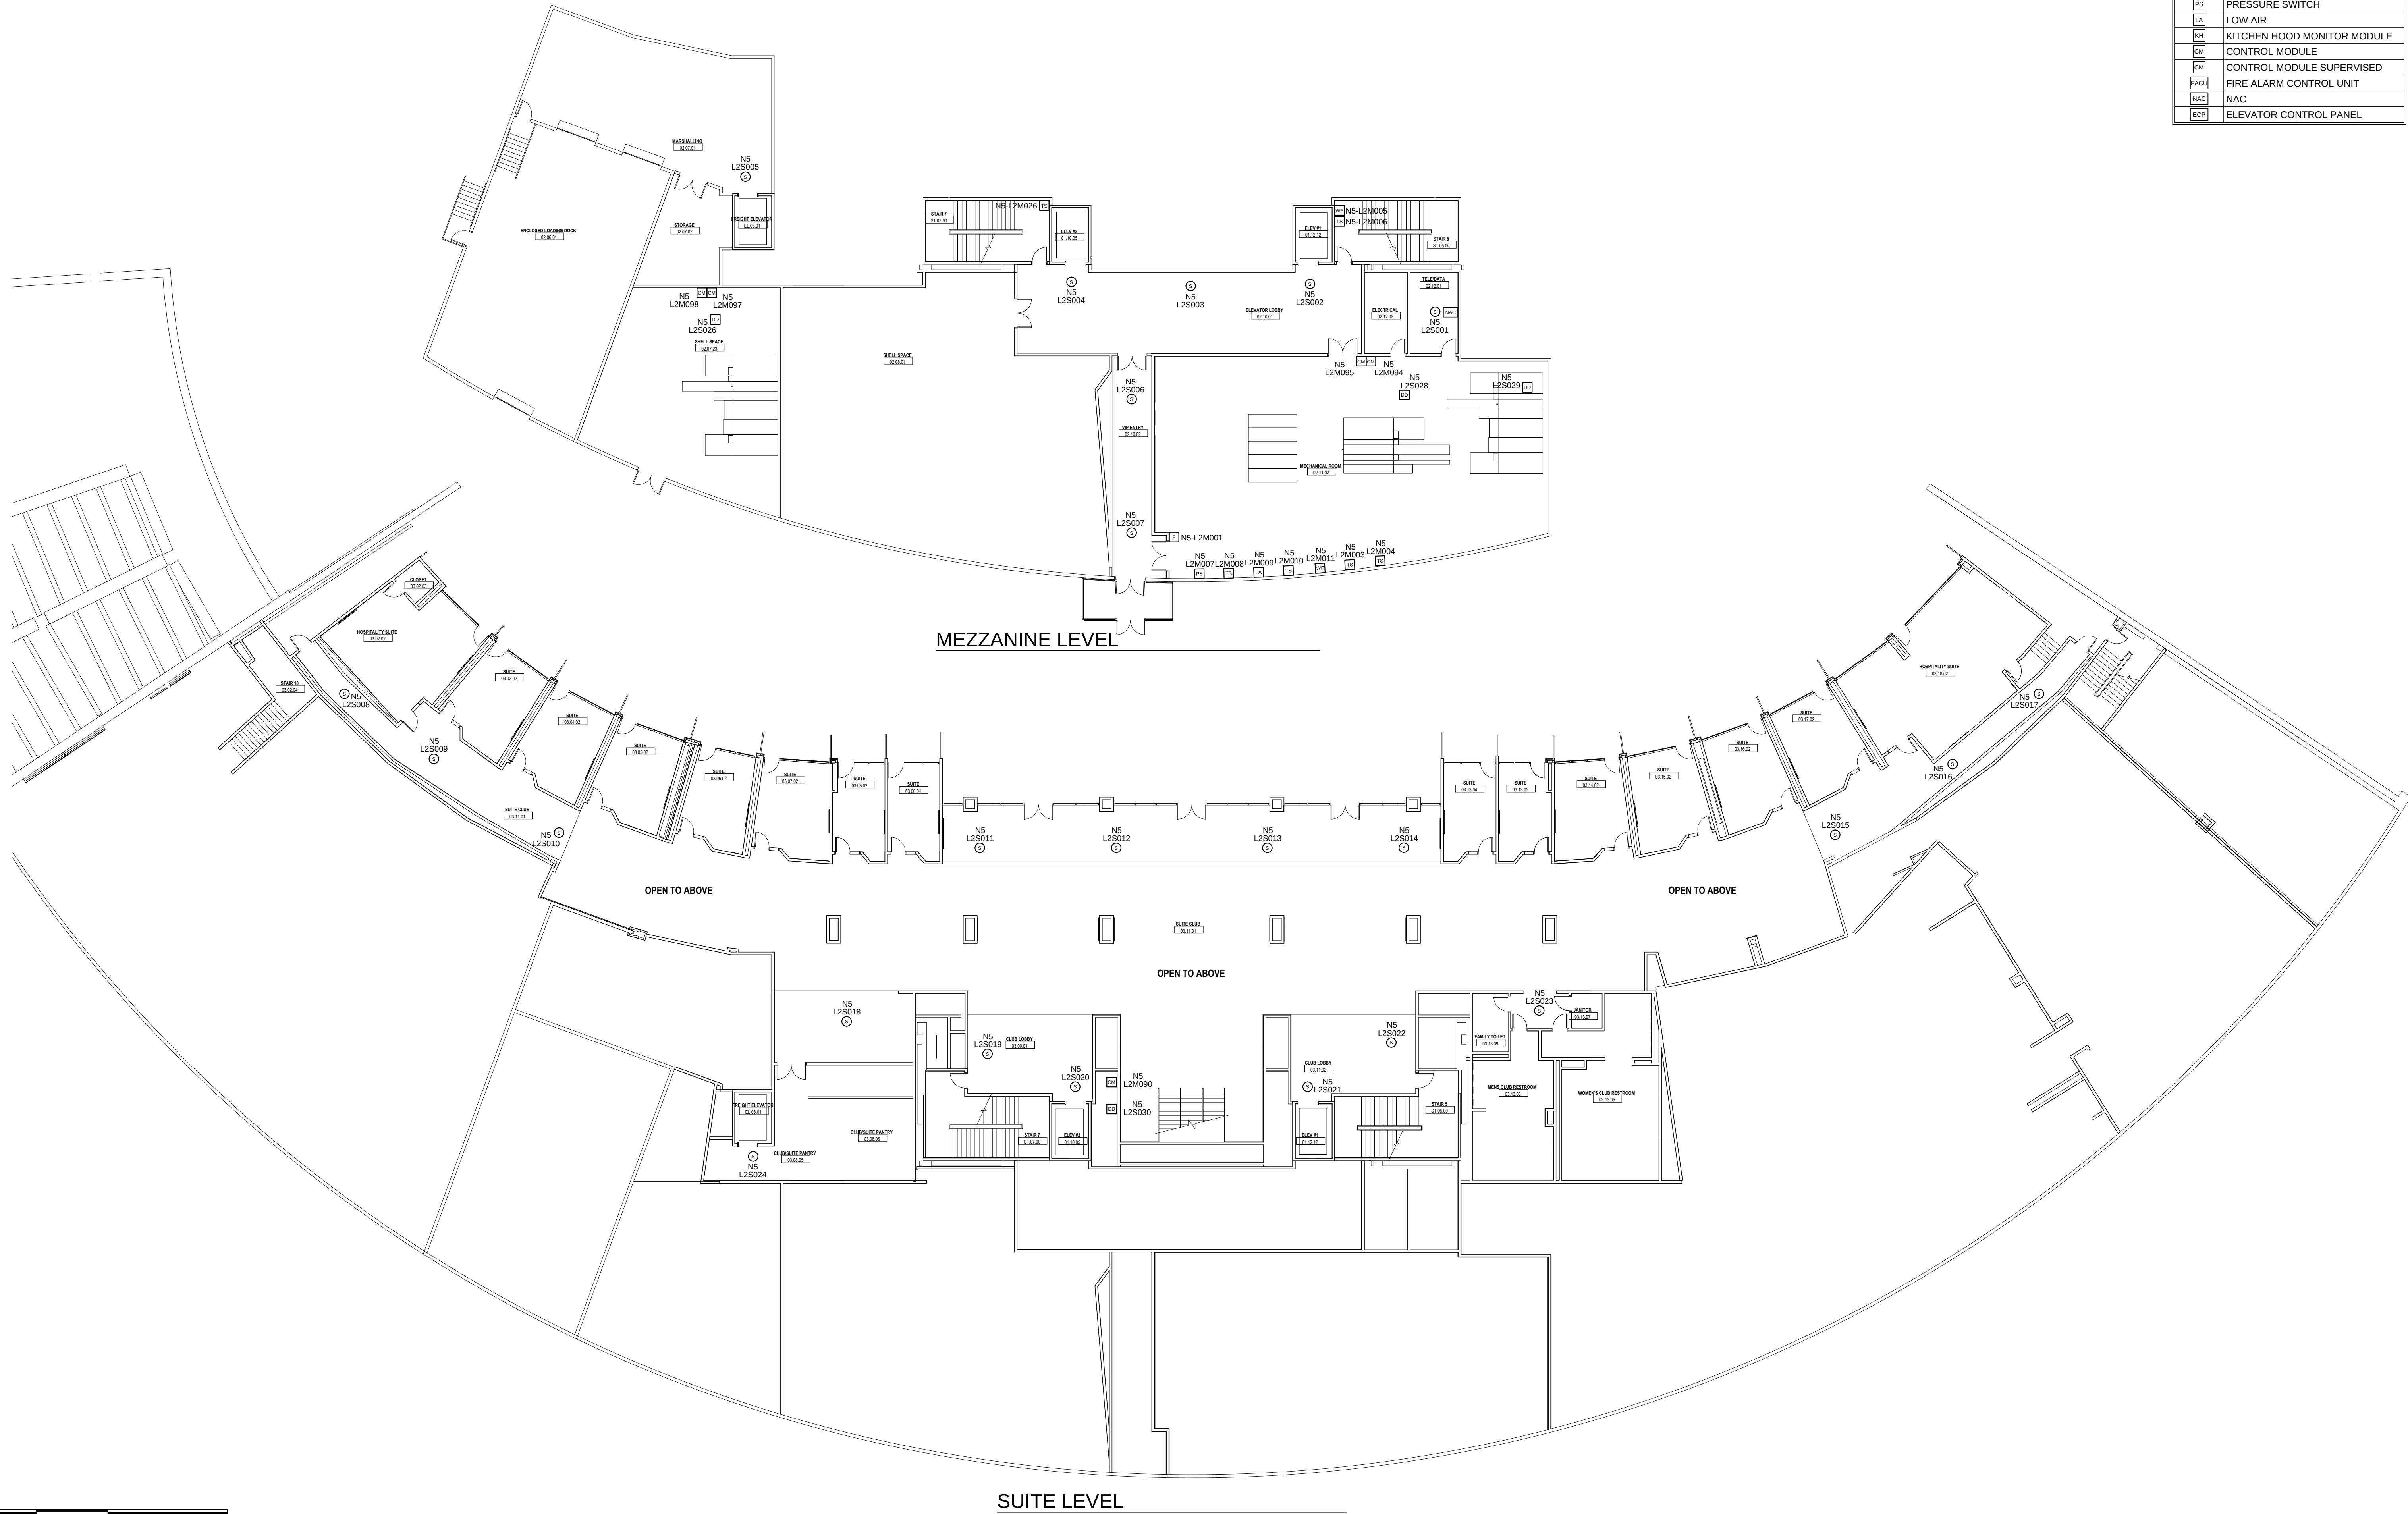

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	HEAT DETECTOR
	PULL STATION
	DUCT DETECTOR
	TAMPER SWITCH
	WATERFLOW SWITCH
	PRESSURE SWITCH
	LOW AIR
	KITCHEN HOOD MONITOR MODULE
	CONTROL MODULE
	CONTROL MODULE SUPERVISED
	FIRE ALARM CONTROL UNIT
	NAC
	ELEVATOR CONTROL PANEL

N

W

E

S

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECTURE/ENGINEER (A/E) PLANS AND
SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY
RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE,
LOCATION, AND SUITABILITY OF ALL FIRE ALARMS,
CONTROL PANELS, AND OTHER DEVICES SHOWN ON
THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY
THE WIRING DIAGRAMS BETWEEN FIRE ALARM
DEVICES AND CONTROL PANELS. NFS IS NOT
RESPONSIBLE FOR THE INFORMATION SHOWN ON THE
A/E PLANS.

RICE-ECCLES STADIUM SOUTH ENDZONE

UNIVERSITY OF UTAH

451 SOUTH 1400 EAST

SALT LAKE CITY, UT 84112

FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS

801-468-8300

DRAWN BY:AK

DESIGNED BY:

APPROVED BY:KK

DATE:

SCALE:

PROJECT NO:

REVISION NO:


DRAWING NAME:
UOFU SOUTH ENDZONE 3.DWG

NELSON FIRE SYSTEMS

CONCOURSE LEVEL

PAGE:

FINAL MAP

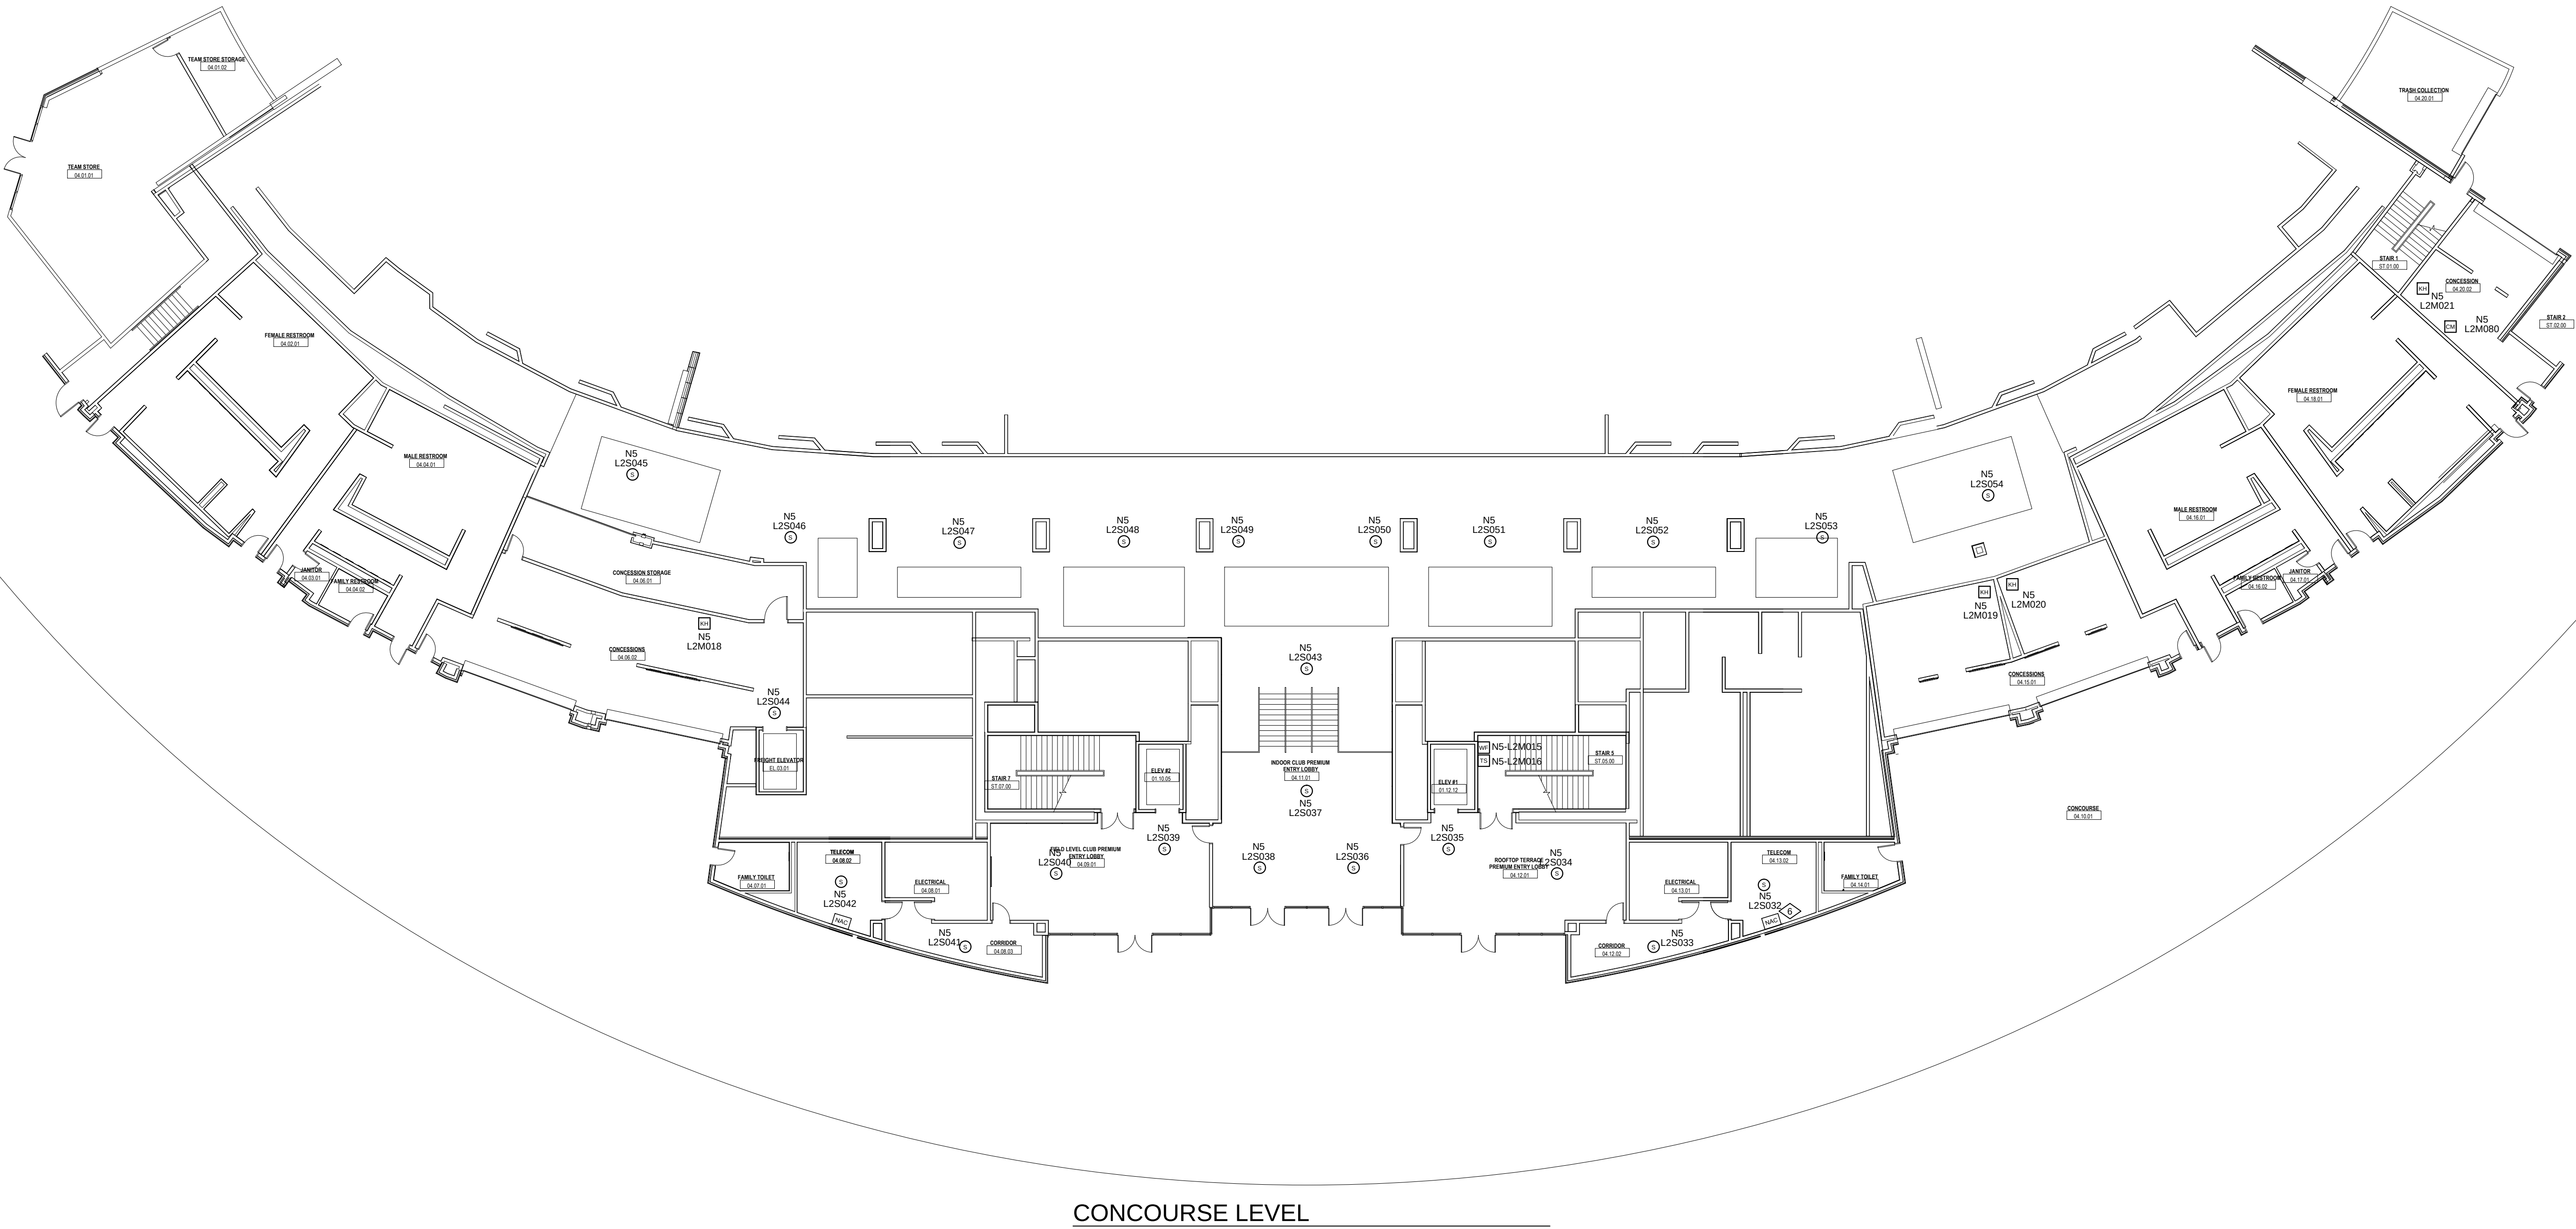

CONCOURSE LEVEL

RICE-ECCLES STADIUM SOUTH ENDZONE
UNIVERSITY OF UTAH
451 SOUTH 1400 EAST
SALT LAKE CITY, UT 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	AK
DESIGNED BY:	
APPROVED BY:	KK
DATE:	
SCALE:	
PROJECT NO:	
REVISION NO:	
DRAWING NAME:	UOFU SOUTH ENDZONE 4.DWG

NELSON FIRE SYSTEMS

ROOFTOP TERRACE

PAGE: FINAL MAP

