

DEVICE LEGEND

SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(F)	MANUAL PULL STATION
(DD)	DUCT SMOKE DETECTOR
(WF)	WATERFLOW SWITCH MONITOR MODULE
(TS)	TAMPER SWITCH MONITOR MODULE
(MM)	MONITOR MODULE
(CM)	CONTROL MODULE
(BD)	BEAM DETECTOR
(BD TS)	BEAM DETECTOR TEST SWITCH
(RA)	REMOTE ANNUNCIATOR
(FACP)	FIRE ALARM CONTROL PANEL
(TRAN)	TRANSPONDER PANEL

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL DEVICES, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

STUDENT SERVICES BUILDING
BASEMENT
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY:	DS
DESIGNED BY:	XXXX
APPROVED BY:	XXXX
DATE:	11/20/2008
SCALE:	NONE
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	STUDENTSERVICESB.DWG

FIRE ALARM SYSTEM
BASEMENT
NUMBERS


PAGE:
NFS

EXISTING ZONE SCHEDULE

- L1M008 - ROOM #80 WATERFLOW SWITCH
- L1M012 - DOCK STORAGE AREA TAMPER SWITCH
- L1M013 - SPRINKLER RISER WATERFLOW / TAMPER
- L1M014 - SPRINKLER AUXILLARY TAMPER SWITCH
- L1M015 - SOUTH MECHANICAL ROOM FLOOD DETECTOR
- L1M016 - NORTH ELEVATOR SHAFT FLOOD DETECTOR
- L1M017 - SOUTH ELEVATOR SHAFT FLOOD DETECTOR
- L1M018 - HI TEMP. ROOM FLOOD DETECTOR
- L1M019 - NORTH ELECTRICAL ROOM FLOOD DETECTOR
- L1M020 - NORTH MECHANICAL ROOM FLOOD DETECTOR
- L1M021 - ROOM #80 TAMPER SWITCH
- L1M022 - ROOM #83 TAMPER SWITCH

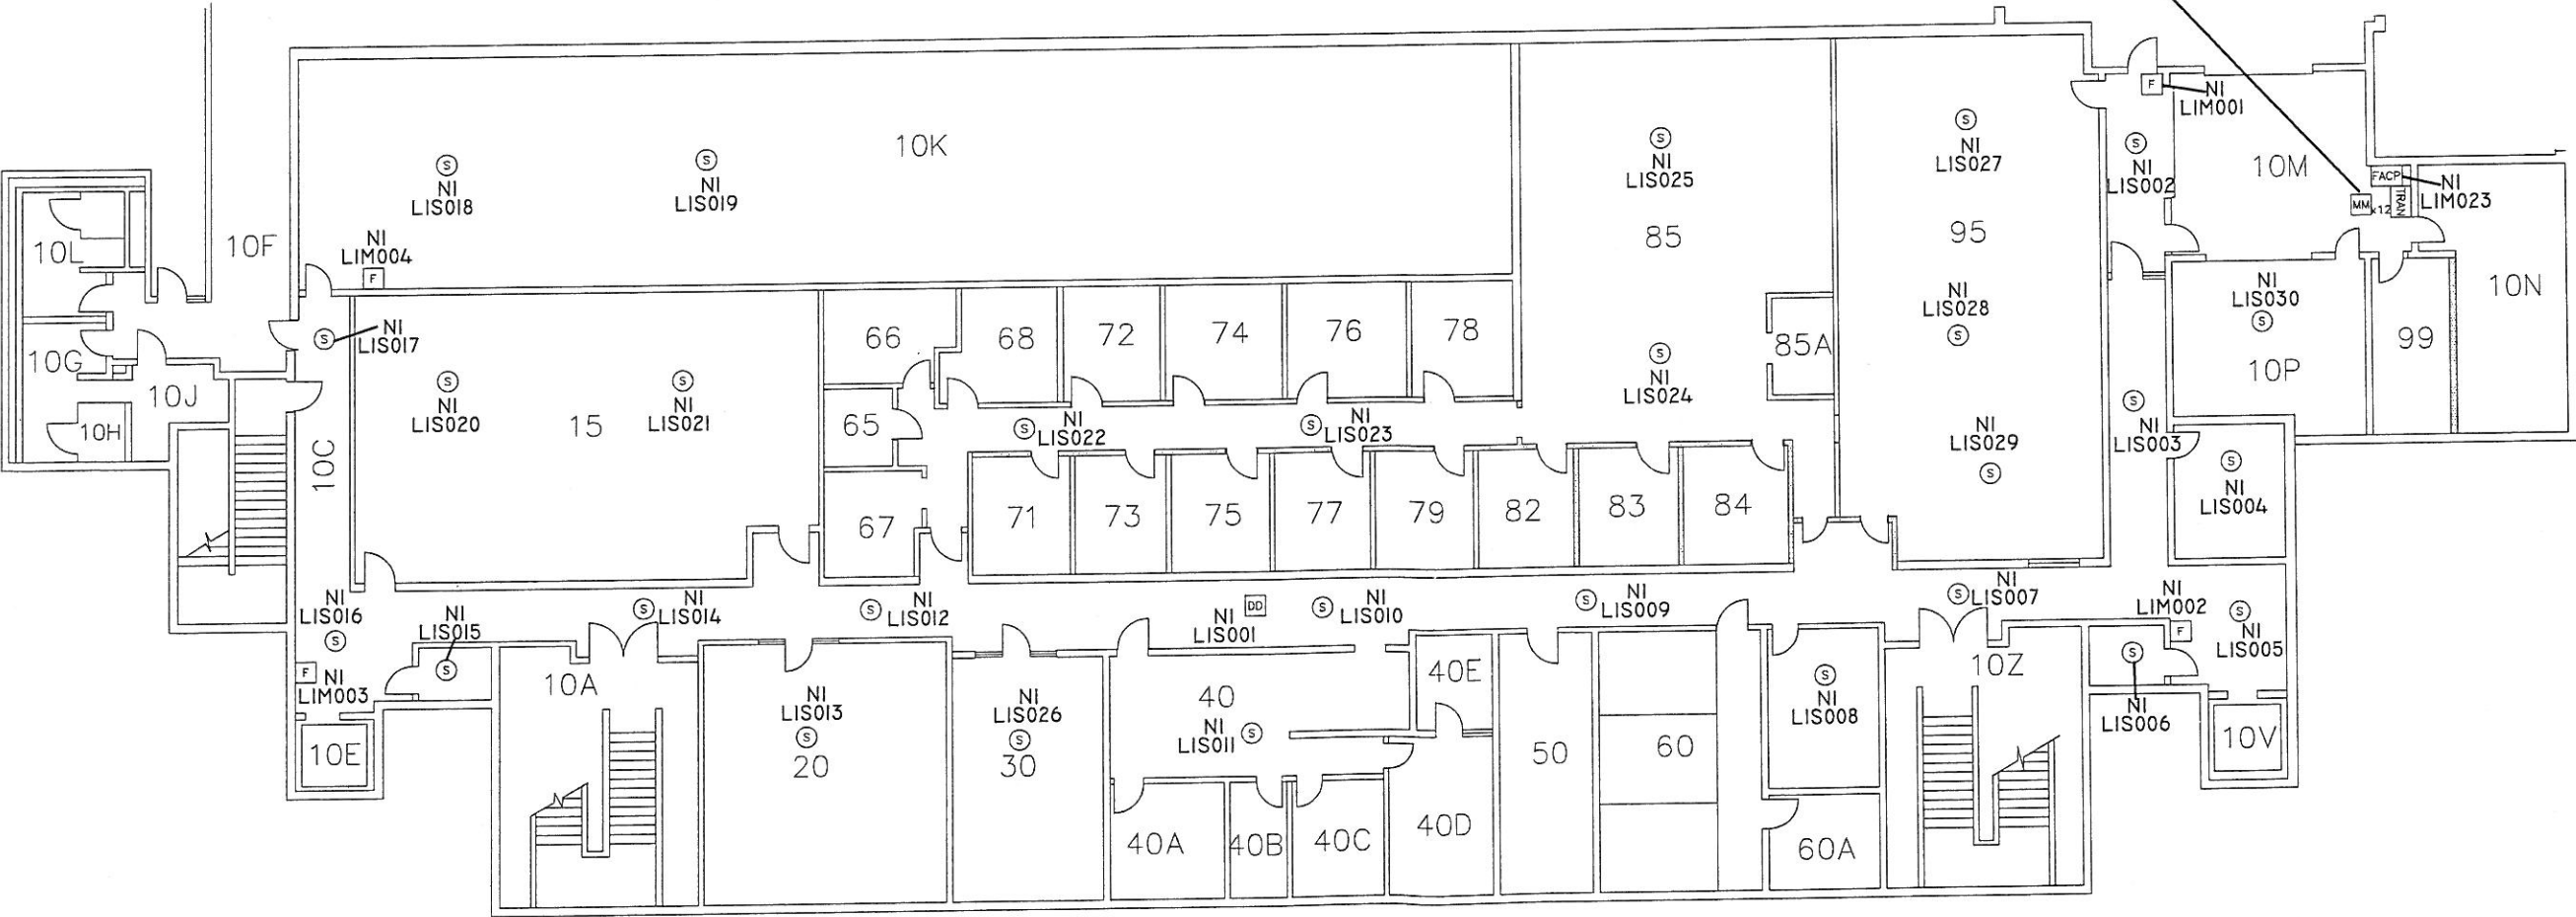

BASEMENT



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.


STUDENT SERVICES BUILDING
FIRST FLOOR AND SECOND FLOOR
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM



NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	DS
DESIGNED BY:	XXXX
APPROVED BY:	XXXX
DATE:	11/20/2008
SCALE:	NONE
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	STUDENTSERVICES 1 AND 2.DWG

FIRE ALARM SYSTEM
FIRST / SECOND FLOORS
NUMBERS

PAGE:
NFS

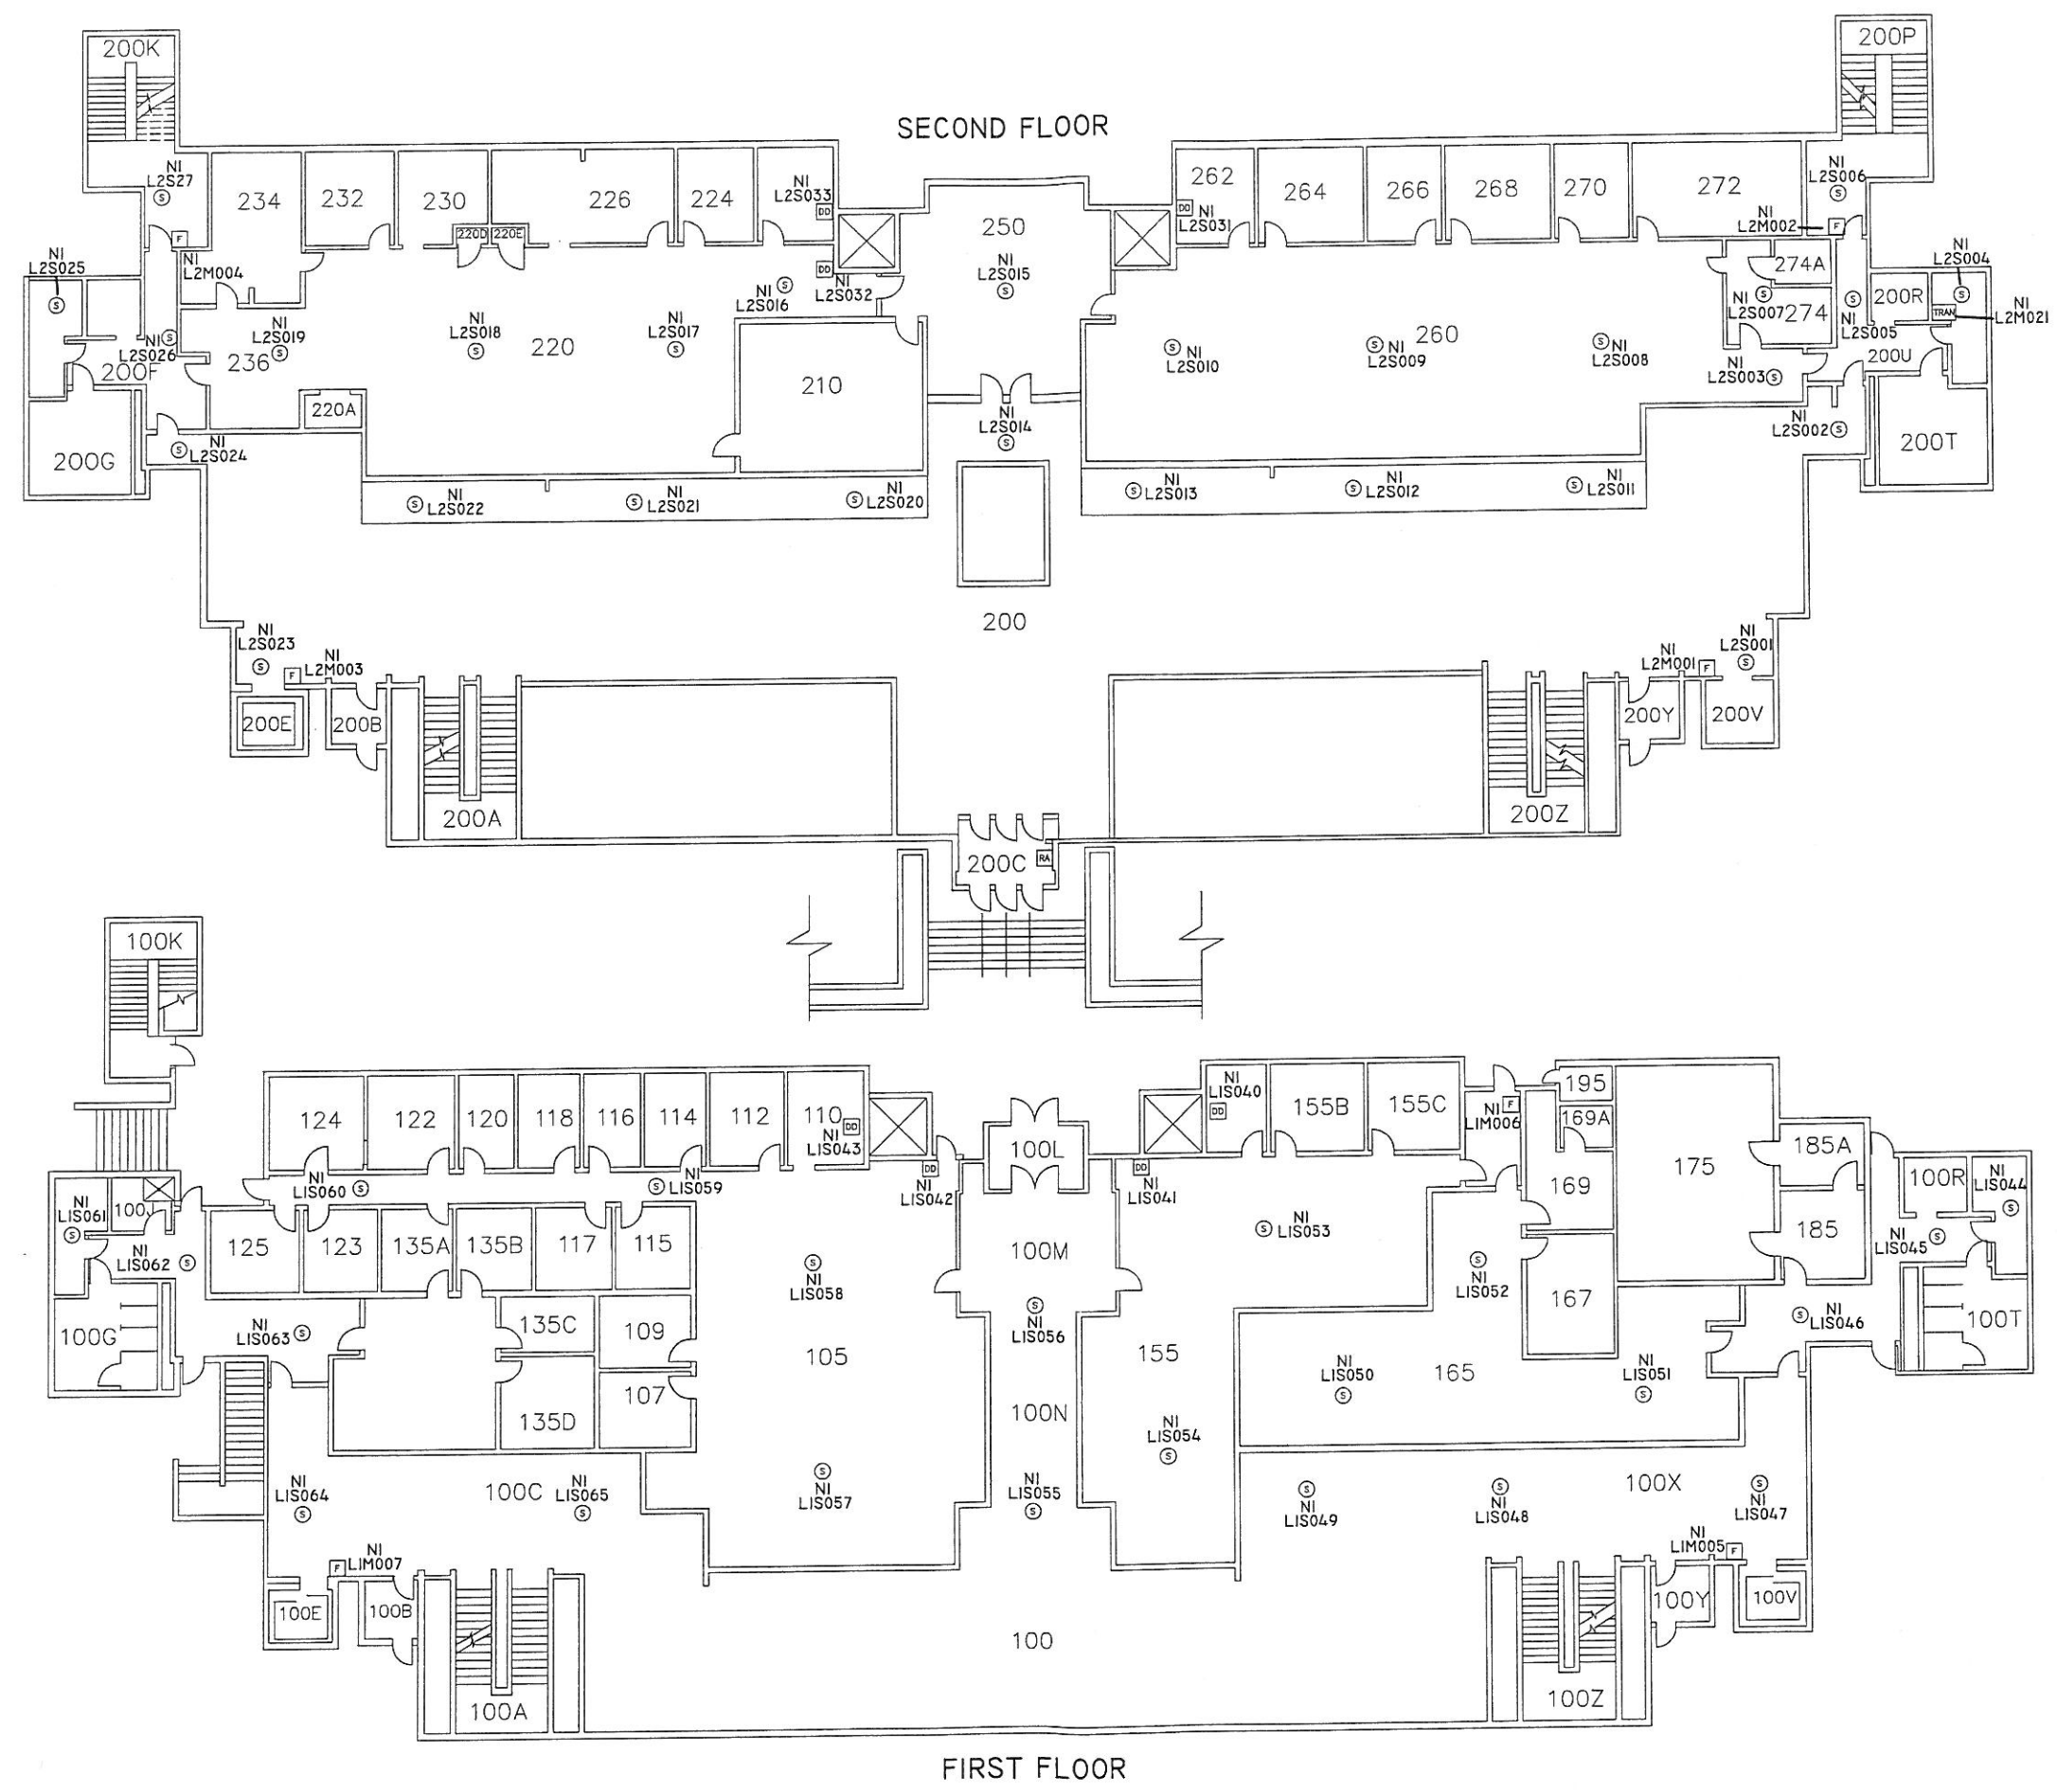

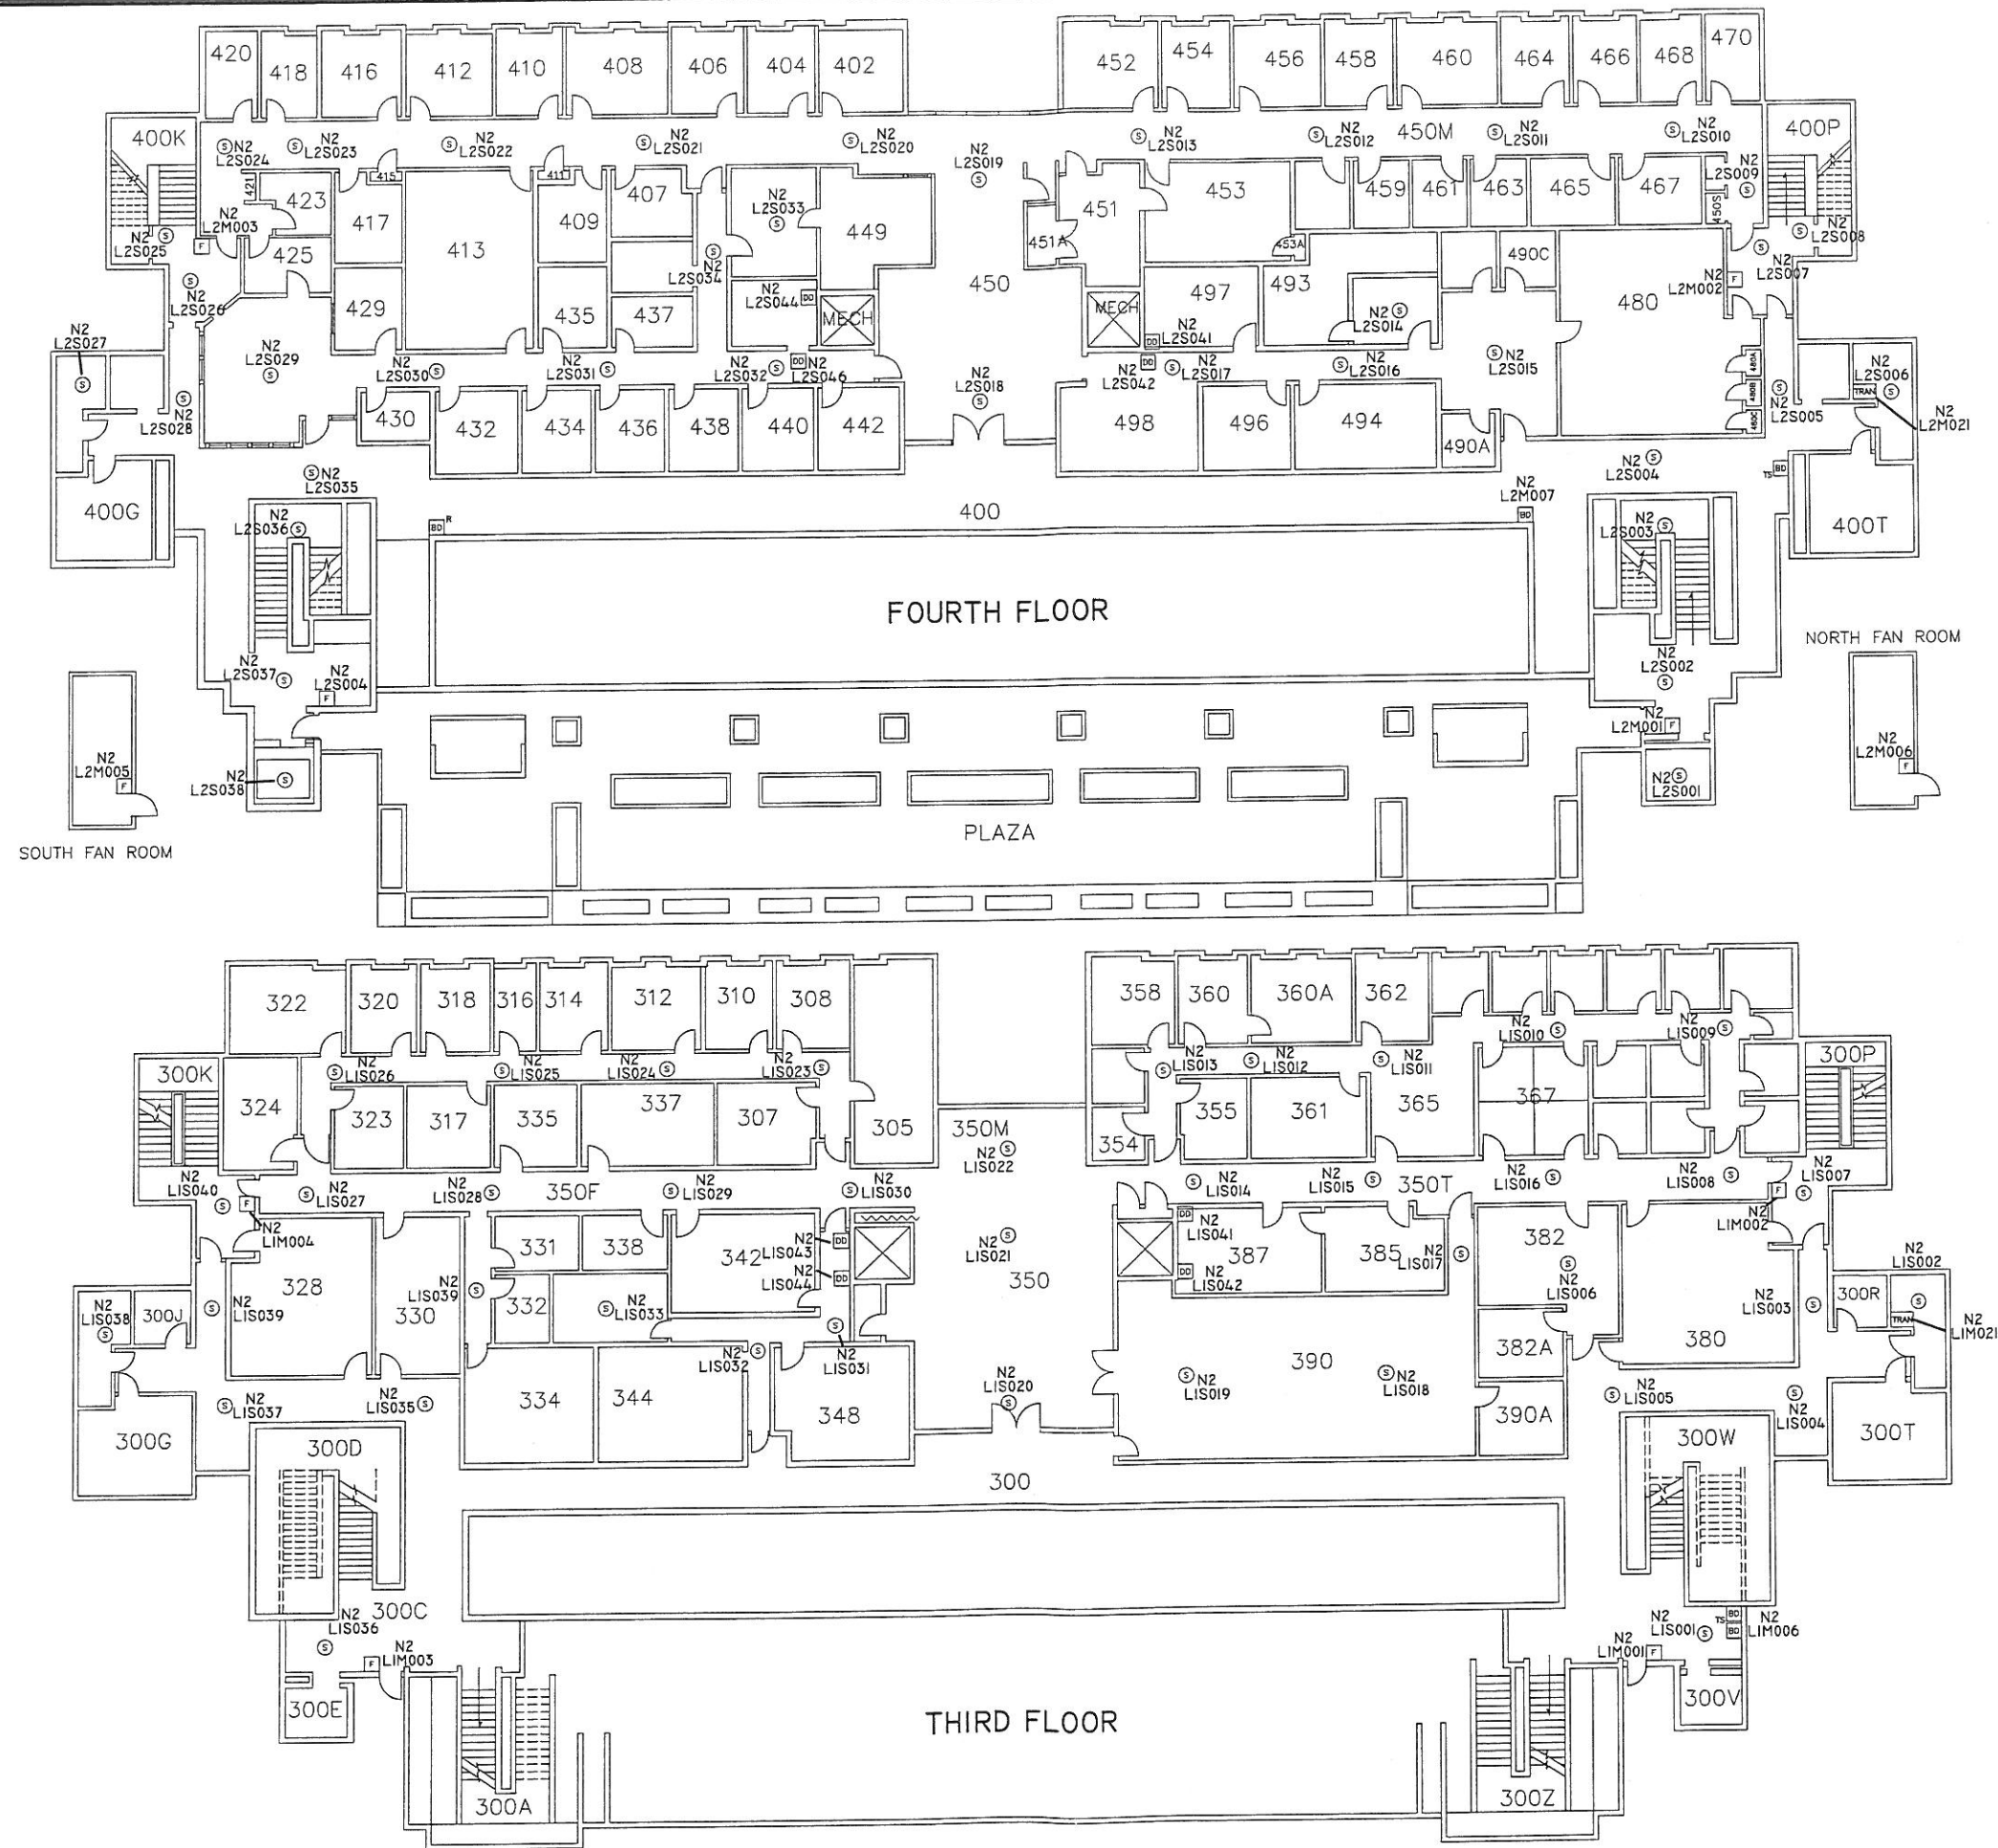

NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

STUDENT SERVICES BUILDING
THIRD FLOOR AND FOURTH FLOOR
UNIVERSITY OF UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	DS
DESIGNED BY:	XXXX
APPROVED BY:	XXXX
DATE:	8/29/2008
SCALE:	NONE
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	STUDENTSERVICES 3 AND 4.DWG

FIRE ALARM SYSTEM
THIRD / FOURTH FLOORS
NUMBERS

PAGE:
NFS