

UNIVERSITY OF UTAH
NORTHWEST PARKING STRUCTURE
FIRE ALARM SYSTEM

INDEX OF DRAWINGS

PAGE	SHEET NO.	DESCRIPTION	
1	FA-C-01	PROJECT COVER SHEET / INDEX OF DRAWINGS	NELSON FIRE SYSTEMS
2	FA-R-01	FIRE ALARM BUILDING RISER DIAGRAM / MATRIX	NELSON FIRE SYSTEMS
3	FA-1-01	GROUND LEVEL- ADDRESSABLE CIRCUIT	NELSON FIRE SYSTEMS
4	FA-2-01	LEVEL 2- ADDRESSABLE / NOTIFICATION CIRCUITS	NELSON FIRE SYSTEMS
5	FA-3-01	LEVEL 3- ADDRESSABLE CIRCUIT	NELSON FIRE SYSTEMS
6	FA-4-01	LEVEL 4- ADDRESSABLE CIRCUIT	NELSON FIRE SYSTEMS

DEVICE SCHEDULE

SYMBOL	DESCRIPTION	PART NUMBER	MOUNTING REQUIREMENTS
Ⓢ	SMOKE DETECTOR W/BASE	ASD-PL2F/B210LP	3/0 MUD RING
Ⓣ	HEAT DETECTOR W/BASE	ATD-RL2F/B210LP	3/0 MUD RING
Ⓣ _{200°}	HIGH TEMP. HEAT DETECTOR W/BASE	ATD-HL2F/B210LP	3/0 MUD RING
CM	CONTROL MODULE	ADM-2RF	4 SQ. 2-1/8" MINIMUM
MM	MONITOR MODULE	AMM-4F	4 SQ. 2-1/8" MINIMUM
HS _{VP}	WEATHERPROOF HORN/STROBE	P2RK	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS
FACU	FIRE ALARM CONTROL UNIT	E3 SERIES	SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS. NFS IS NOT RESPONSIBLE FOR THE ACCURACY OF THE A/E PLANS (NOT NFS) FOR THE TYPE, SIZE, LOCATION AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
NORTHWEST PARKING STRUCTURE
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: RS
DATE: 1/7/14
SCALE: (ARCH C) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
UoFU NORTHWEST PS COVER.DWG


FIRE ALARM SYSTEM
COVER SHEET

PAGE:





FA-C-01



DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(T)	HEAT DETECTOR
(T) 200*	HIGH TEMP. HEAT DETECTOR
CM	CONTROL MODULE
HS WP	WEATHERPROOF HORN/STROBE
FACU	FIRE ALARM CONTROL UNIT

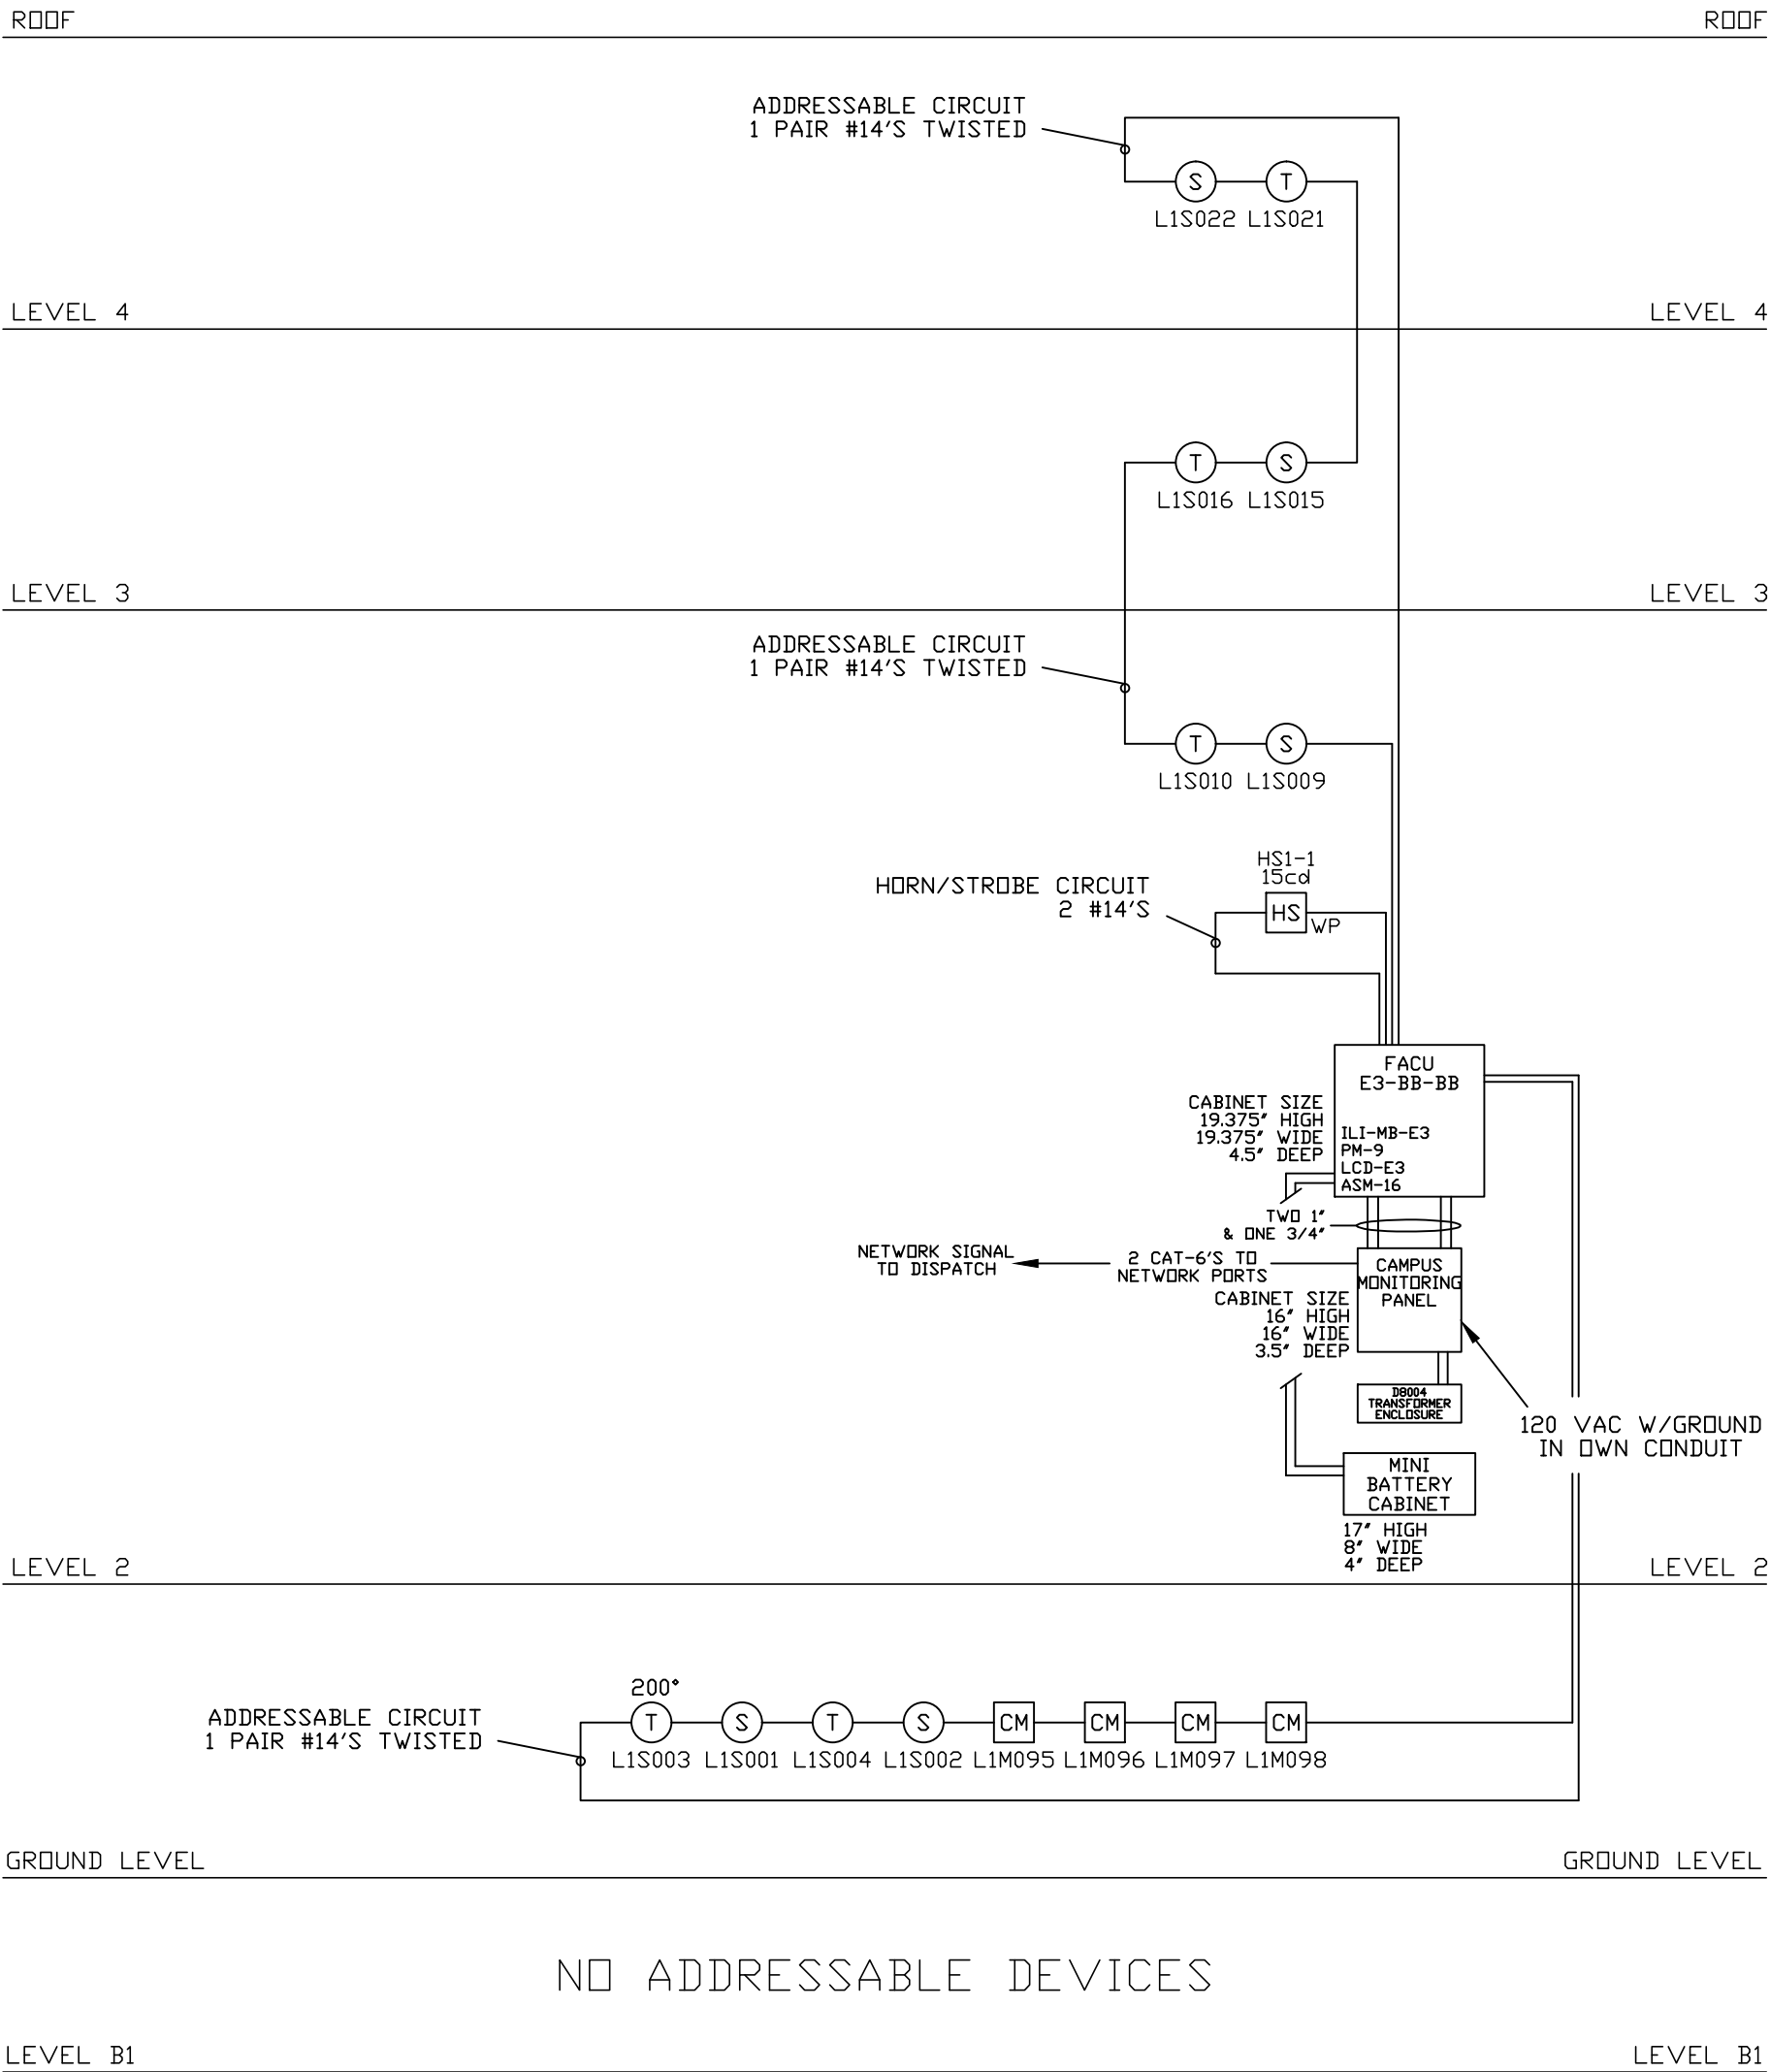

DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUIT

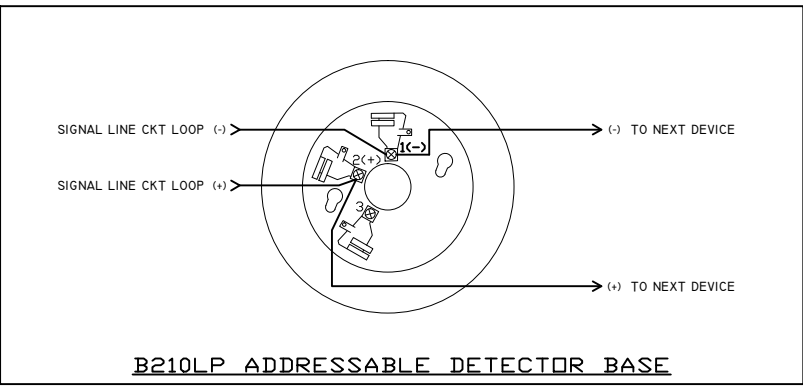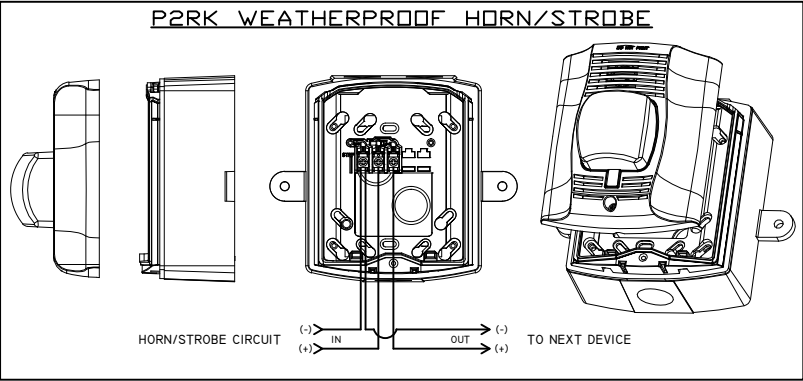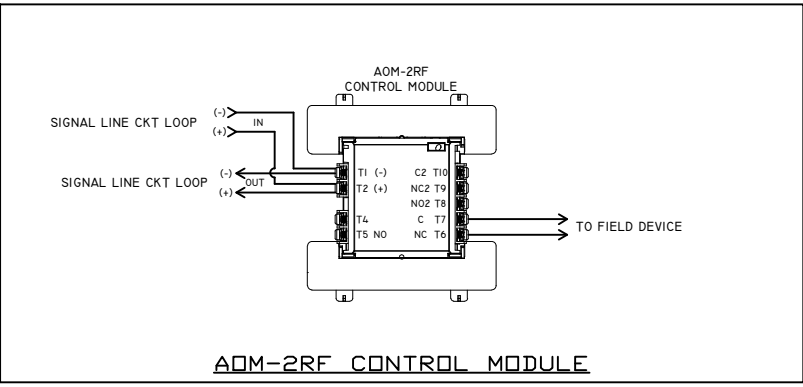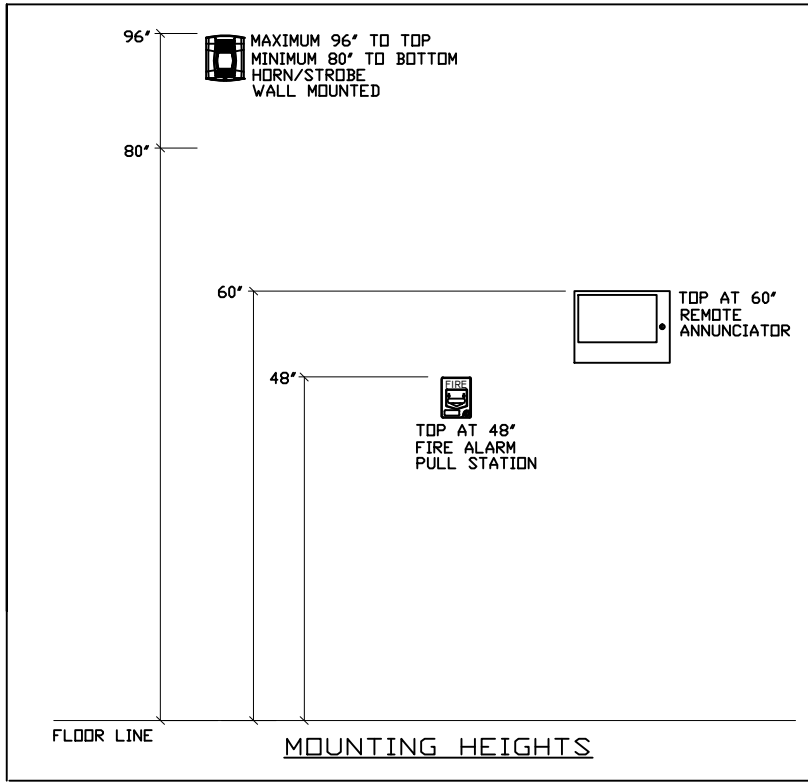

FIRE ALARM INPUT/OUTPUT MATRIX	SYSTEM OUTPUTS											
	FACU ANNUNCIATION			NOTIFICATION			FIRE SAFETY CONTROL			AUX. SIGNALS		REPORTING
ALARM SIGNAL TO FIRE ALARM DISPLAY												
SUPERVISORY SIGNAL TO FIRE ALARM DISPLAY												
TROUBLE SIGNAL TO FIRE ALARM DISPLAY												
LEVEL 2 HORN/STROBE												
ELEVATOR PRIMARY RECALL												
ELEVATOR ALTERNATE RECALL												
ELEVATOR HAT FLASH												
ELEVATOR SHUNT TRIP												
ALARM SIGNAL TO CAMPUS DISPATCH												
SUPERVISORY SIGNAL TO CAMPUS DISPATCH												
TROUBLE SIGNAL TO CAMPUS DISPATCH												
GROUND LEVEL- SMOKE DETECTOR												
GROUND LEVEL- HEAT DETECTORS												
GROUND LEVEL- ELEVATOR LOBBY HEAT DETECTOR												
LEVEL 2- SMOKE DETECTOR												
LEVEL 2- ELEVATOR LOBBY HEAT DETECTOR												
LEVEL 3- SMOKE DETECTOR												
LEVEL 3- ELEVATOR LOBBY HEAT DETECTOR												
LEVEL 4- ELEVATOR LOBBY HEAT DETECTOR												
ELEVATOR EQUIPMENT ROOM SMOKE DETECTOR												
ELEVATOR EQUIPMENT ROOM HEAT DETECTOR												
TOP OF ELEVATOR SHAFT SMOKE DETECTOR												
LOSS OF POWER ANY PANEL OR NAC												
LOW BATTERY CONDITIONS												
OPEN CIRCUIT CONDITIONS												
GROUND FAULTS												

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
SPECIFICATIONS. THE USER SHALL BE RESPONSIBLE
FOR VERIFYING THE PROJECT SPECIFICATIONS
FURNISHED TO NFS ARE COMPLETE, CORRECT,
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
NORTHWEST PARKING STRUCTURE
FIRE ALARM RISER DIAGRAM / MATRIX
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: AK
DESIGNED BY: XXXX
APPROVED BY: RS
DATE: 1/7/14
SCALE: (ARCH C) 1/16"=1'
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
UofU NORTHWEST PS RISER.DWG

FIRE ALARM SYSTEM
RISER DIAGRAM

PAGE:
FA-R-01



GENERAL NOTES:


1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC – ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLAN. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

SYSTEM NOTES:

◊ TO MAIN FACU ON LEVEL 2

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓡ	HEAT DETECTOR
Ⓡ 200°	HIGH TEMP. HEAT DETECTOR
CM	CONTROL MODULE
HS VP	WEATHERPROOF HORN/STROBE
FACU	FIRE ALARM CONTROL UNIT



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING INFORMATION AND NOT THE PHYSICAL DEVICES OR CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.



UNIVERSITY OF UTAH
NORTHWEST PARKING STRUCTURE
GROUND LEVEL
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	AK
DESIGNED BY:	XXXX
APPROVED BY:	RS
DATE:	1/7/14
SCALE:	(ARCH C) 1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	UoFU NORTHWEST PS 1.DWG

FIRE ALARM SYSTEM
GROUND LEVEL

PAGE:
FA-I-01

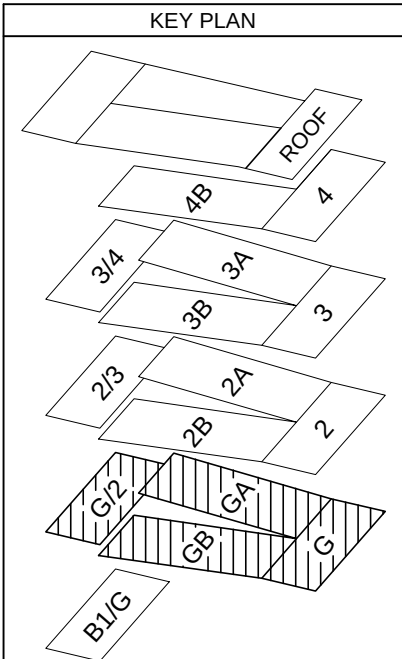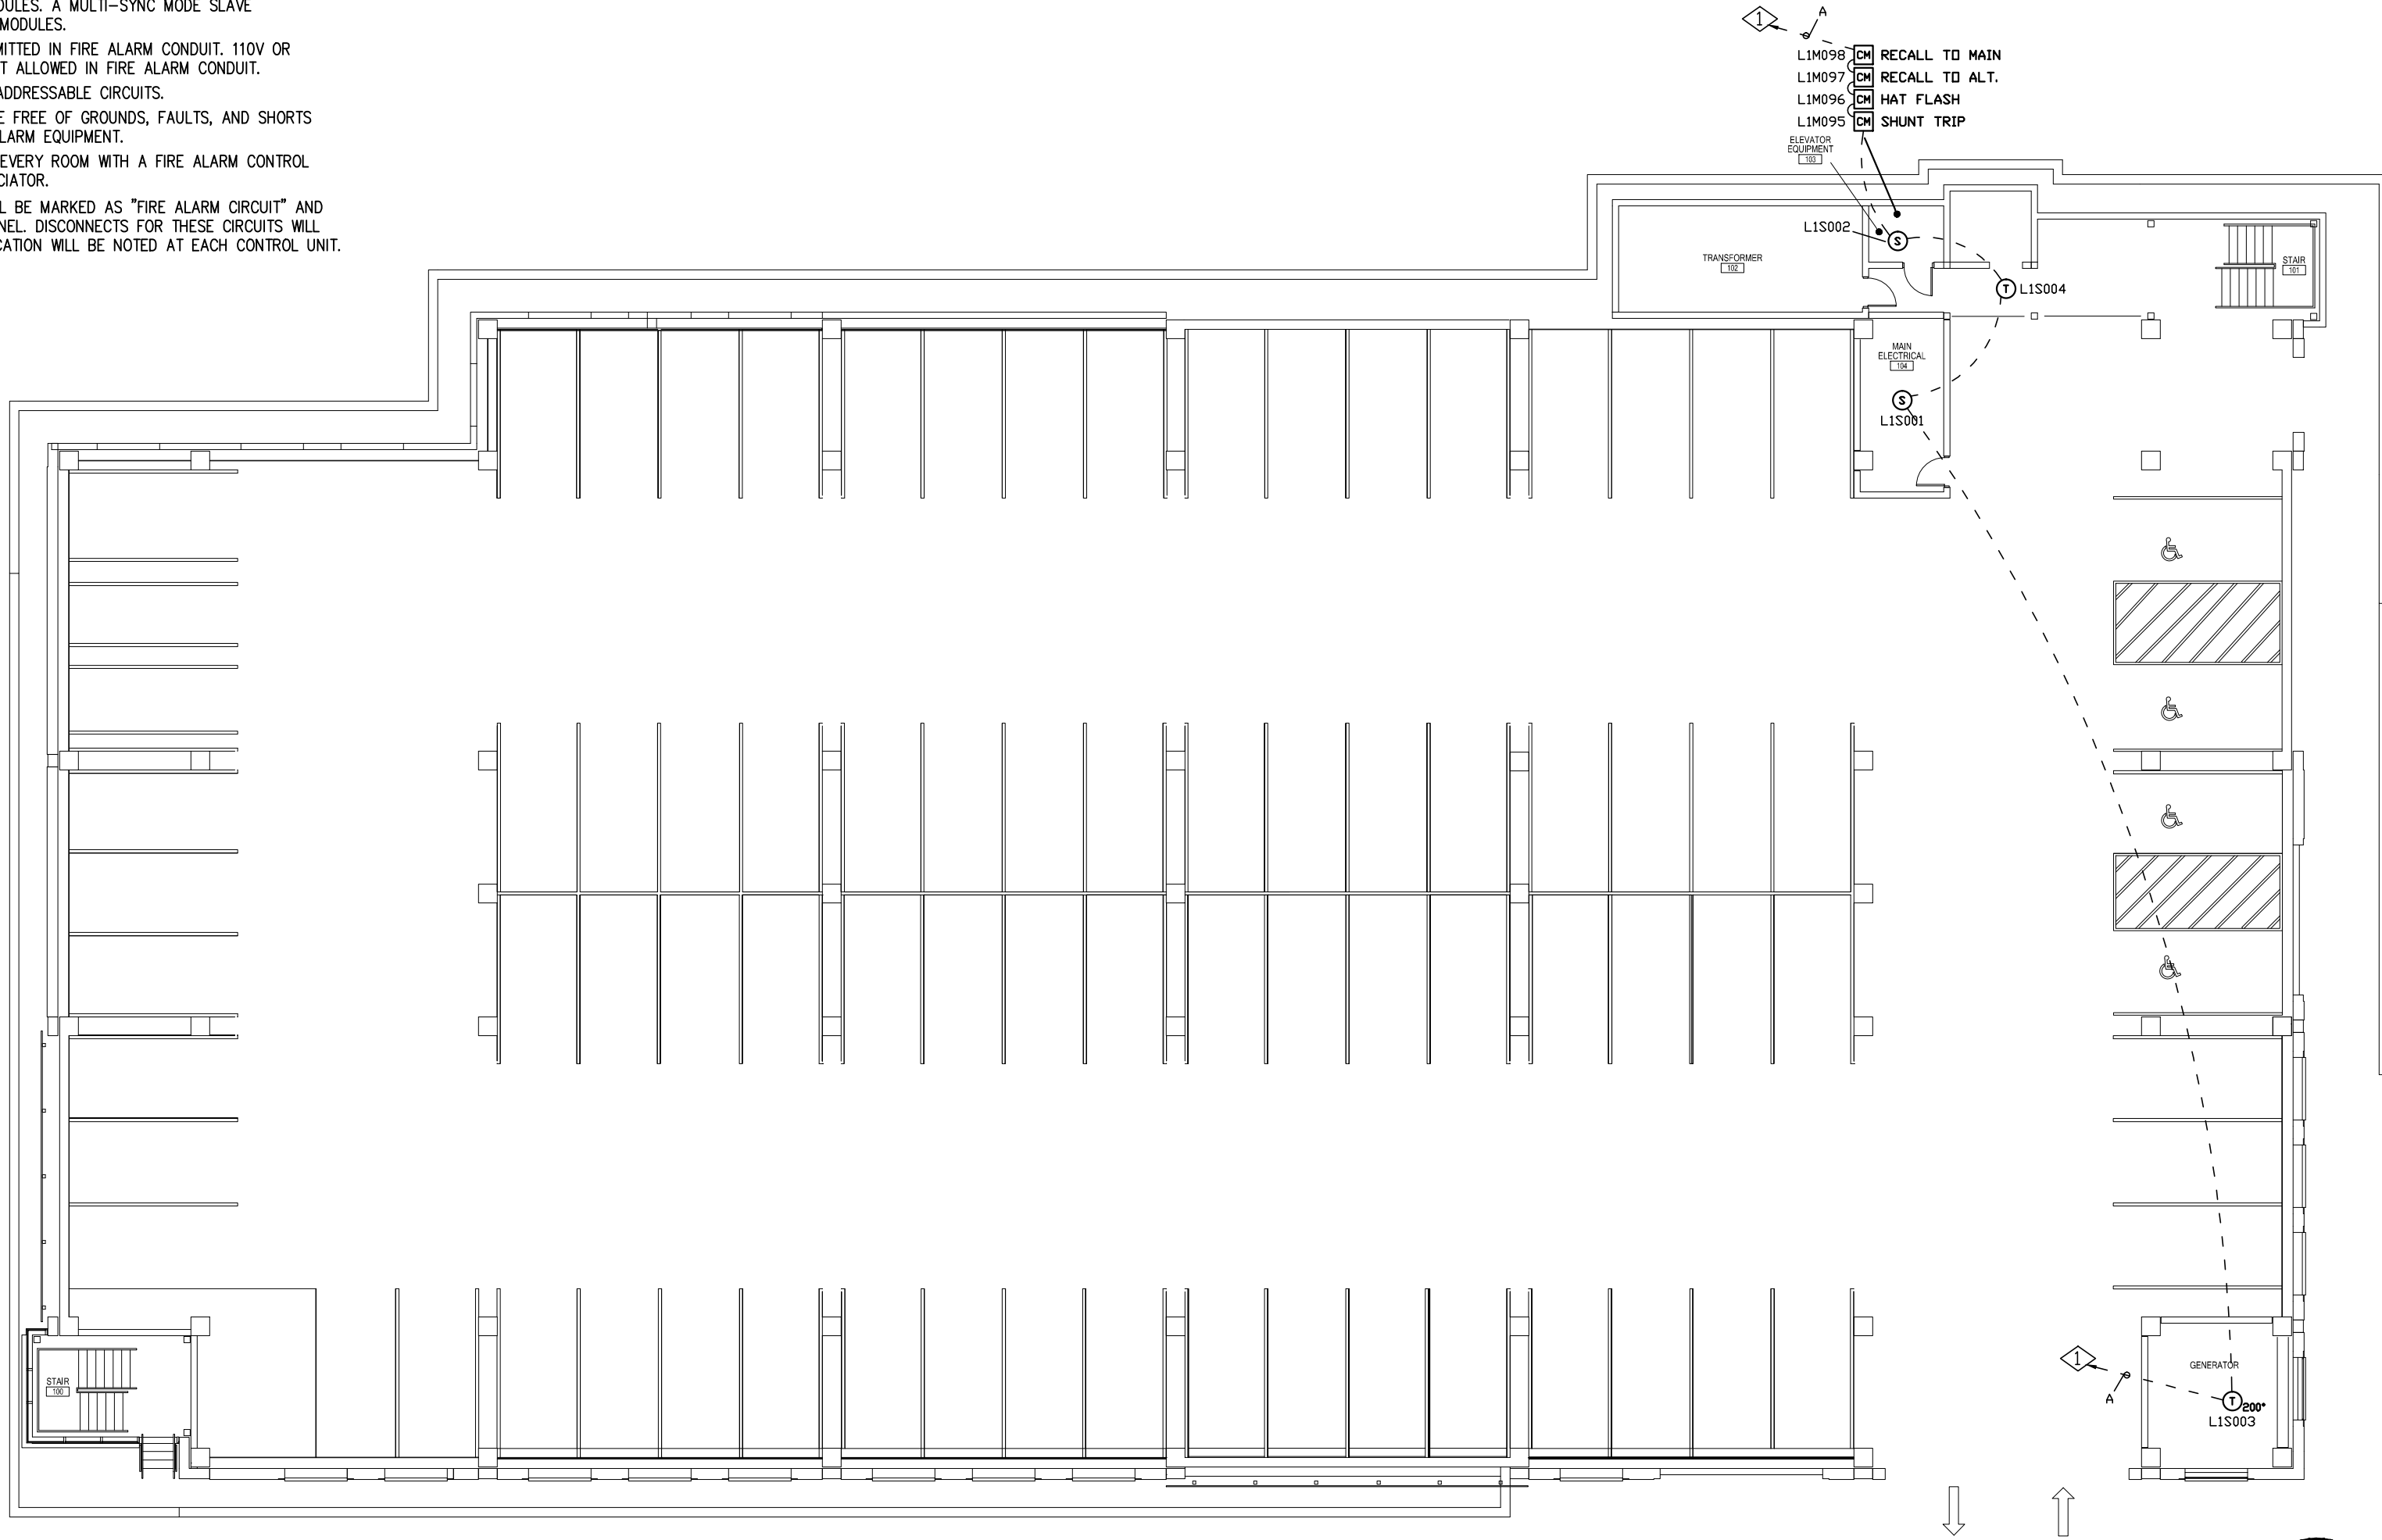

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
RUSTY SELIN
#92414

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC – ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLAN. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

SYSTEM NOTES:

- ◇ TO MAIN FACU ON LEVEL 2
- ◇ TO DEVICE ON LEVEL 3


REVISION NOTES:

- △ ADDED TO MEET CODE (12/30/14)

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S

* SEE RISER FOR INTERCONNECT WIRING

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓡ	HEAT DETECTOR
Ⓡ 200°	HIGH TEMP. HEAT DETECTOR
CM	CONTROL MODULE
HS VP	WEATHERPROOF HORN/STROBE
FACU	FIRE ALARM CONTROL UNIT



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING AND CONNECTIONS TO THE DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.




UNIVERSITY OF UTAH
NORTHWEST PARKING STRUCTURE
LEVEL 2
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	AK
DESIGNED BY:	XXXX
APPROVED BY:	RS
DATE:	1/7/14
SCALE:	(ARCH C) 1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	UofU NORTHWEST PS 2.DWG

FIRE ALARM SYSTEM
LEVEL 2

PAGE:
FA-2-01

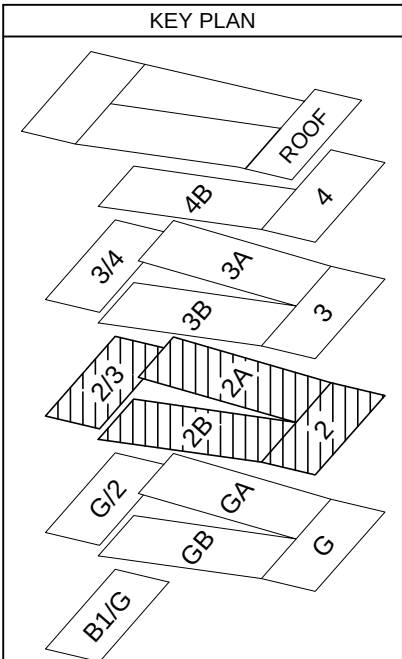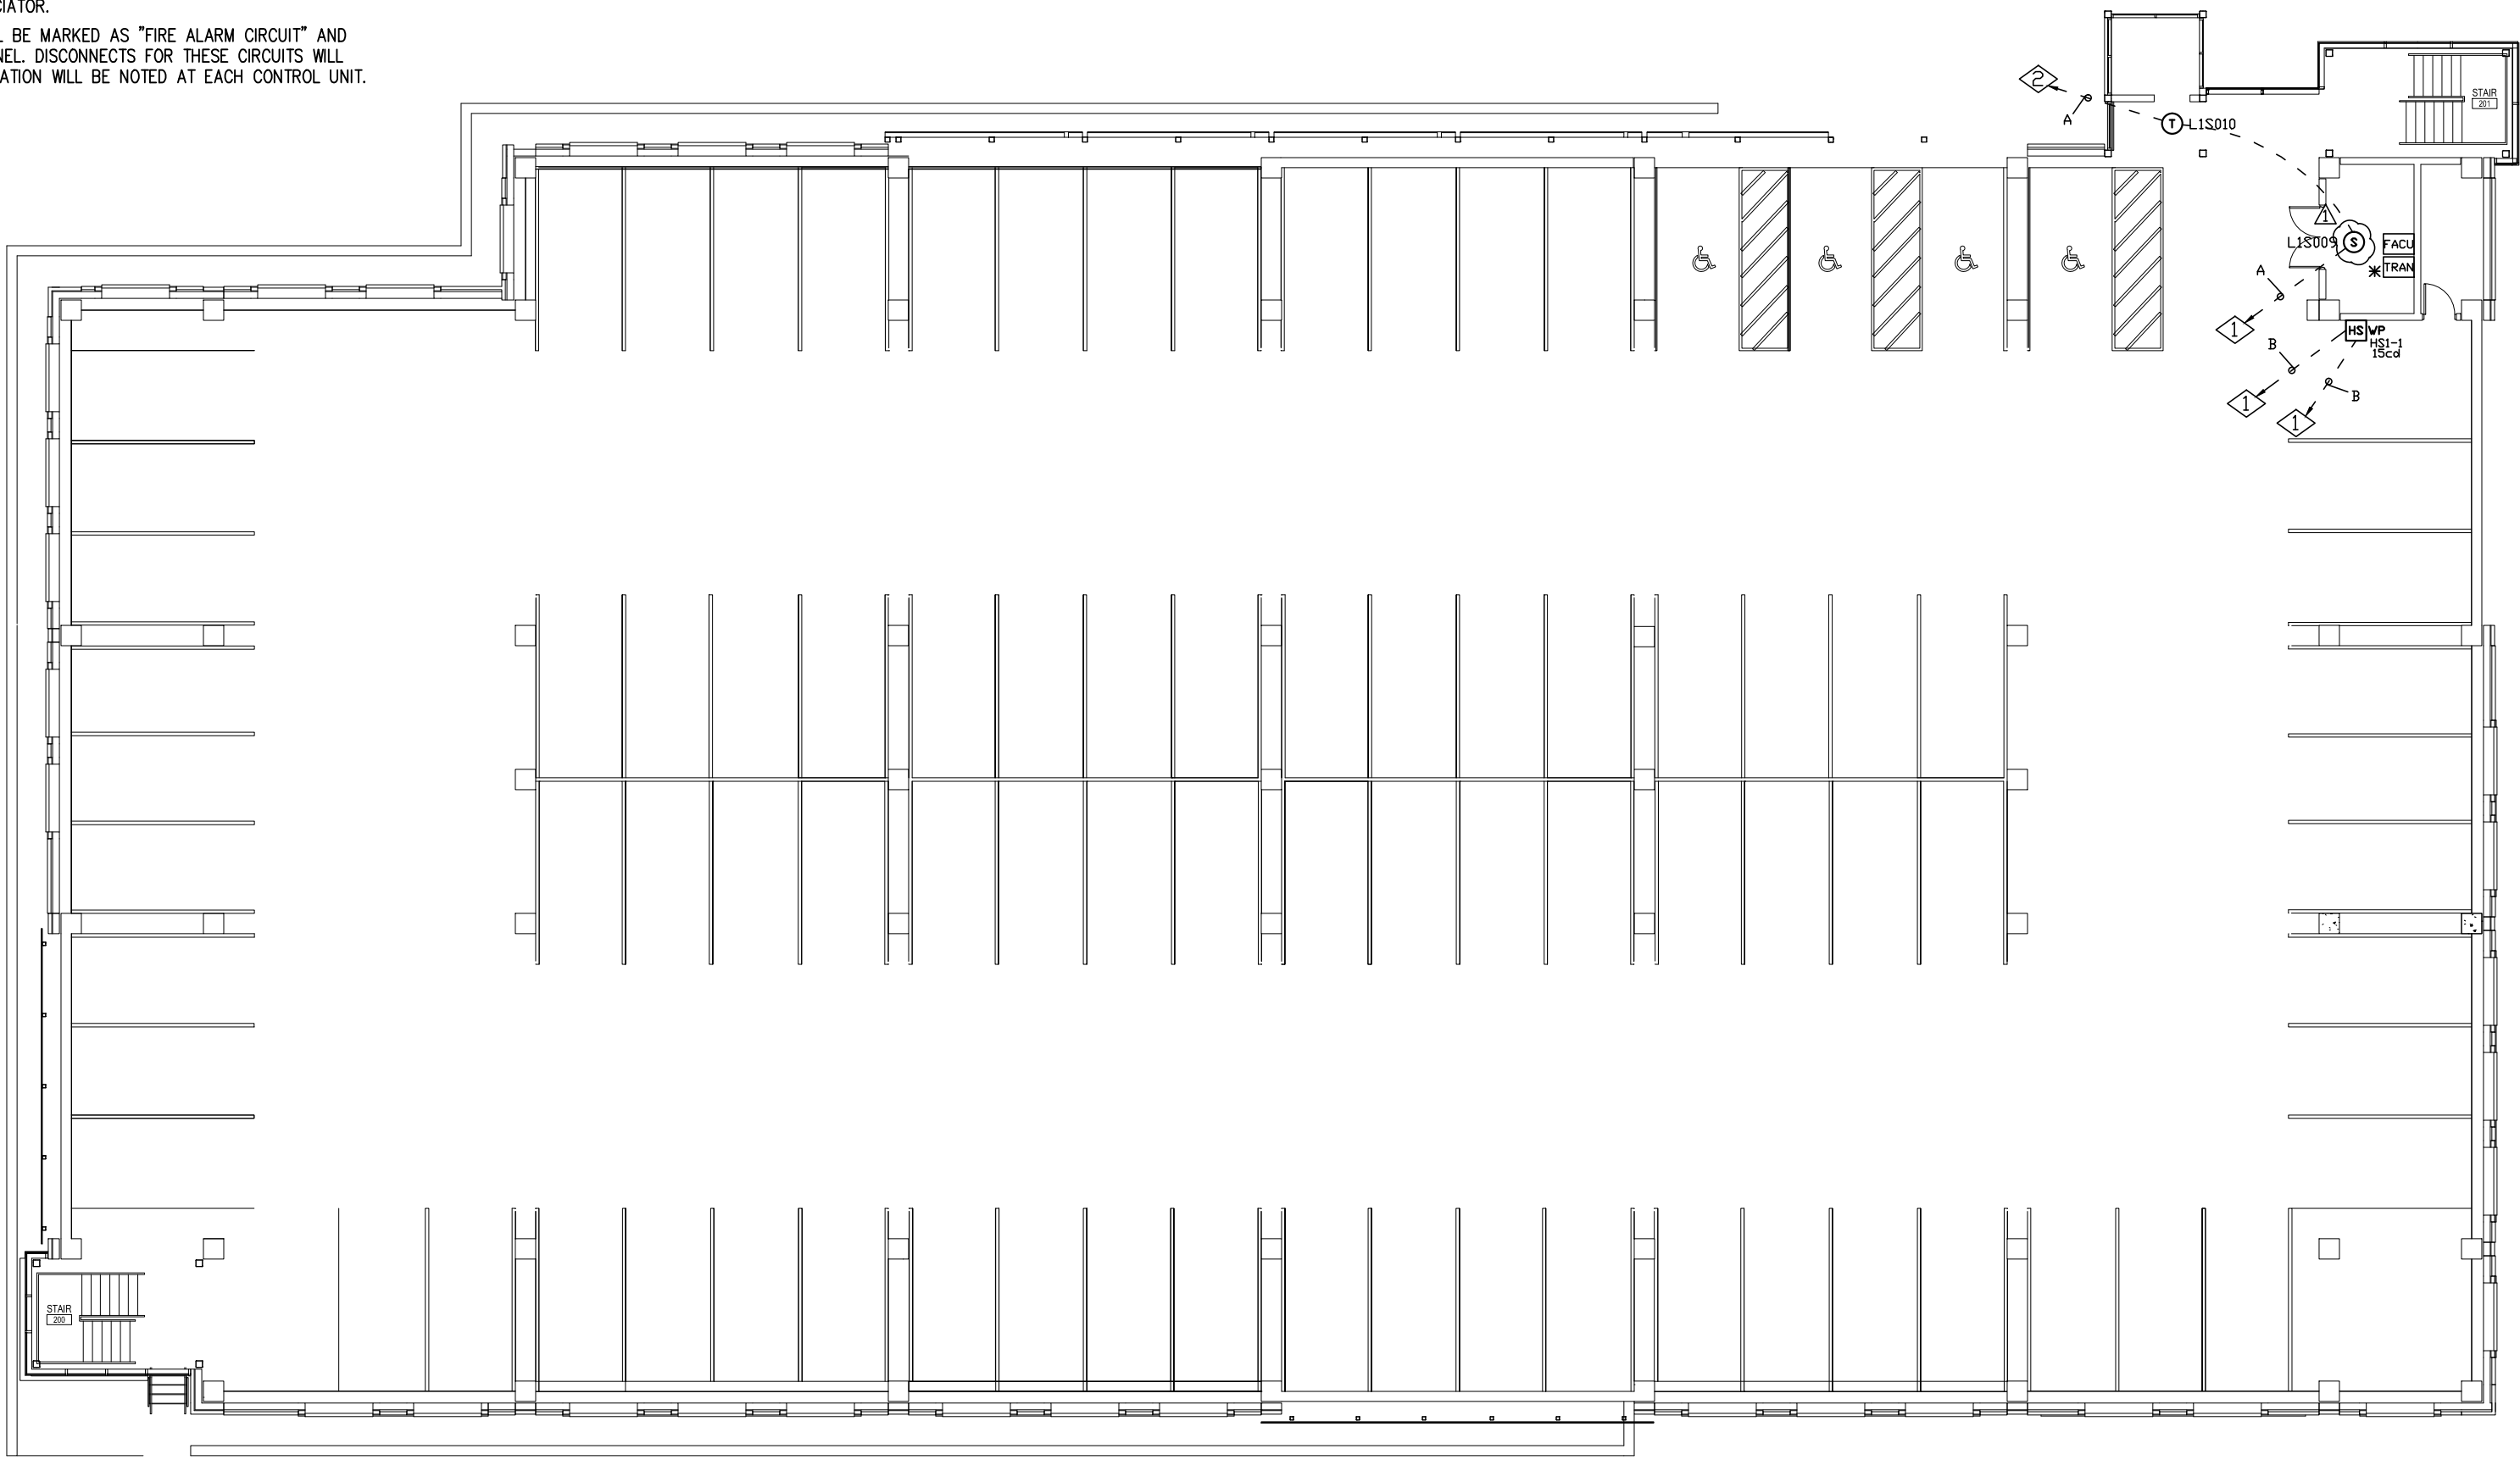

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLAN. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

SYSTEM NOTES:


- ◇ TO MAIN FACU ON LEVEL 2
- ◇ FROM DEVICE ON LEVEL 2
- ◇ TO DEVICE ON LEVEL 4

REVISION NOTES:

- △ ADDED TO MEET CODE (12/30/14)

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⑤	SMOKE DETECTOR
①	HEAT DETECTOR
① 200'	HIGH TEMP. HEAT DETECTOR
CM	CONTROL MODULE
HS WP	WEATHERPROOF HORN/STROBE
FACU	FIRE ALARM CONTROL UNIT



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING INFORMATION. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.




UNIVERSITY OF UTAH
NORTHWEST PARKING STRUCTURE
LEVEL 3
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	AK
DESIGNED BY:	XXXX
APPROVED BY:	RS
DATE:	1/7/14
SCALE:	(ARCH C) 1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	UofU NORTHWEST PS 3.DWG

FIRE ALARM SYSTEM
LEVEL 3

PAGE:
FA-3-01

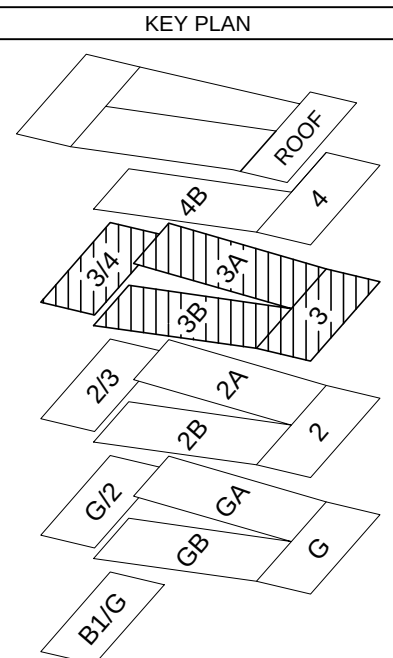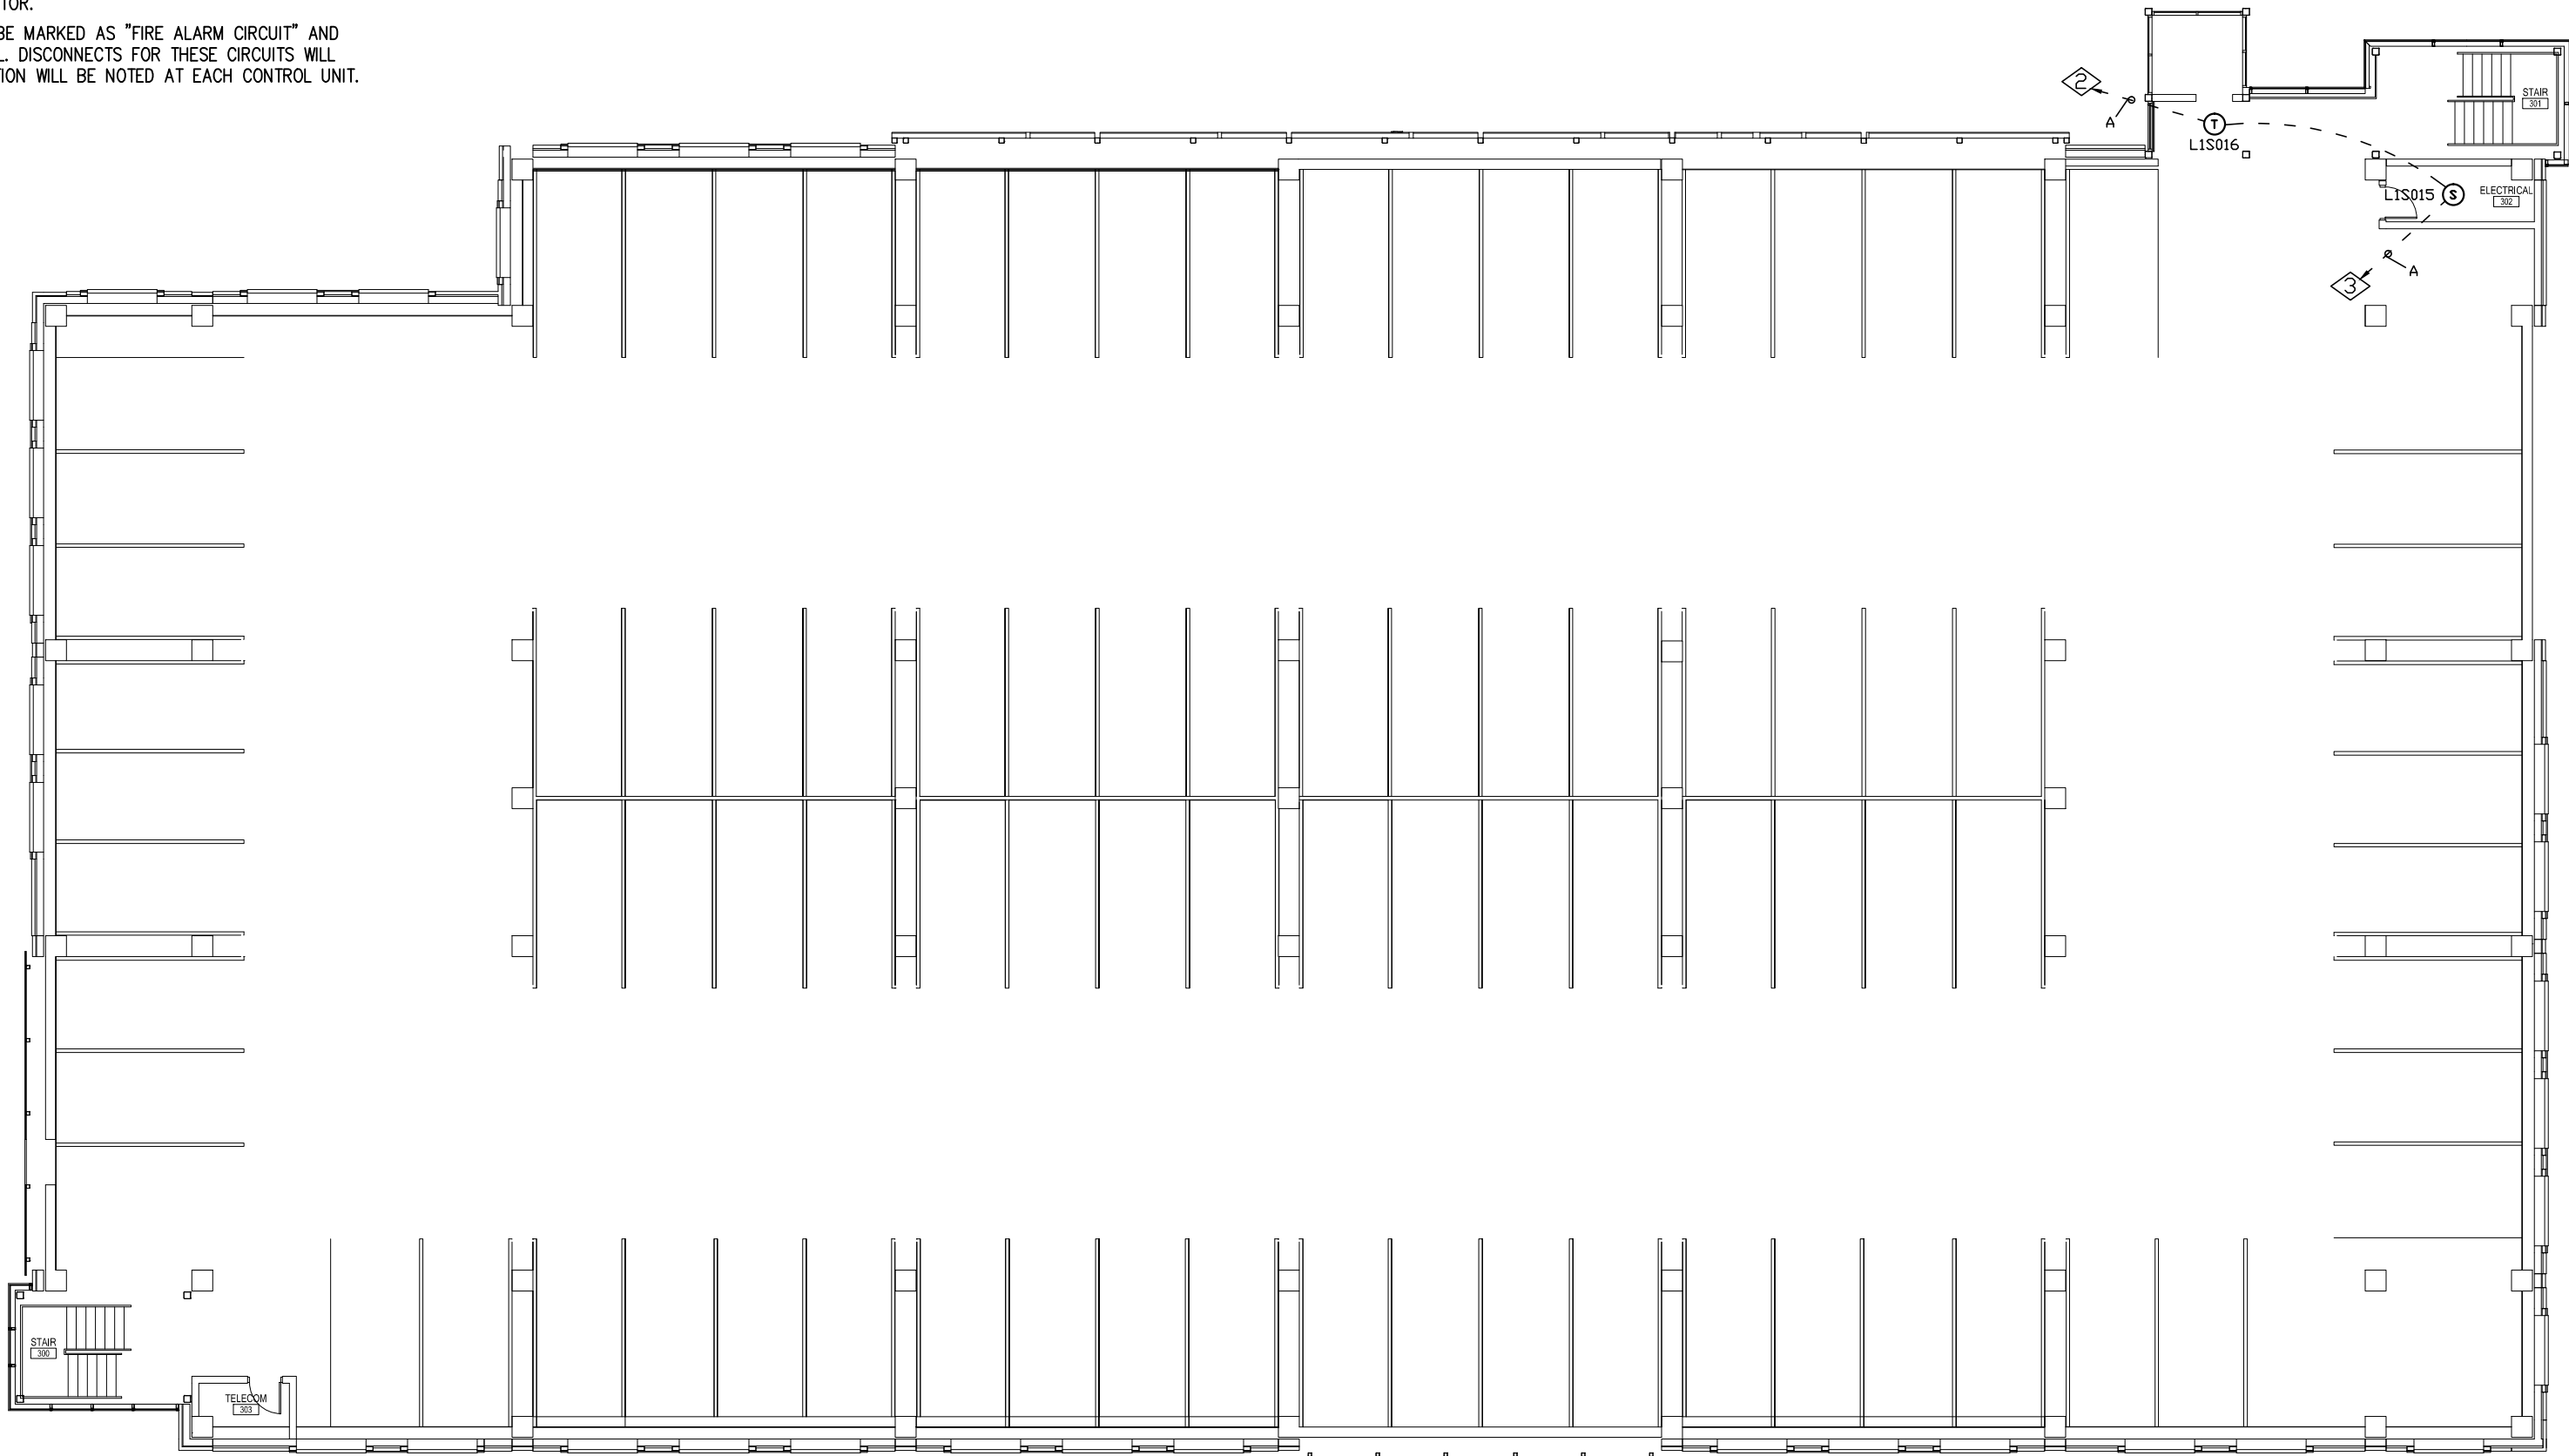


1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC – ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

① TO MAIN FACU ON LEVEL 2
② FROM DEVICE ON LEVEL 3

⚠ DELETED - NOT REQUIRED BY CODE (12/30/14)

WIRE SCHEDULE		
SYMBOL	DESCRIPTION	SIZE
A	ADDRESSABLE CIRCUIT	1 PAIR #14 TWISTED
B	HORN/STROBE CIRCUIT	2 #14'S

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⑤	SMOKE DETECTOR
①	HEAT DETECTOR
⑦ 200°	HIGH TEMP. HEAT DETECTOR
EM	CONTROL MODULE
HS _{VP}	WEATHERPROOF HORN/STROBE
FAU	FIRE ALARM CONTROL UNIT



NOTE: NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.



UNIVERSITY OF UTAH
NORTHWEST PARKING STRUCTURE
LEVEL 4
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	AK
DESIGNED BY:	XXXX
APPROVED BY:	RS
DATE:	1/7/14
SCALE:	(ARCH C) 1/16"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	UoFU NORTHWEST PS 4.DWG

EVEL 4

FA-4-01

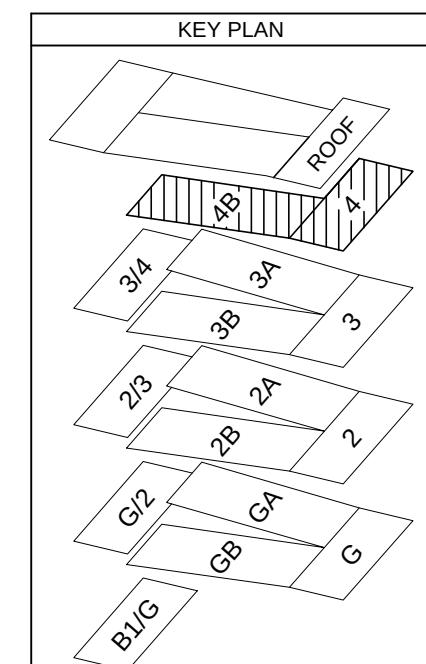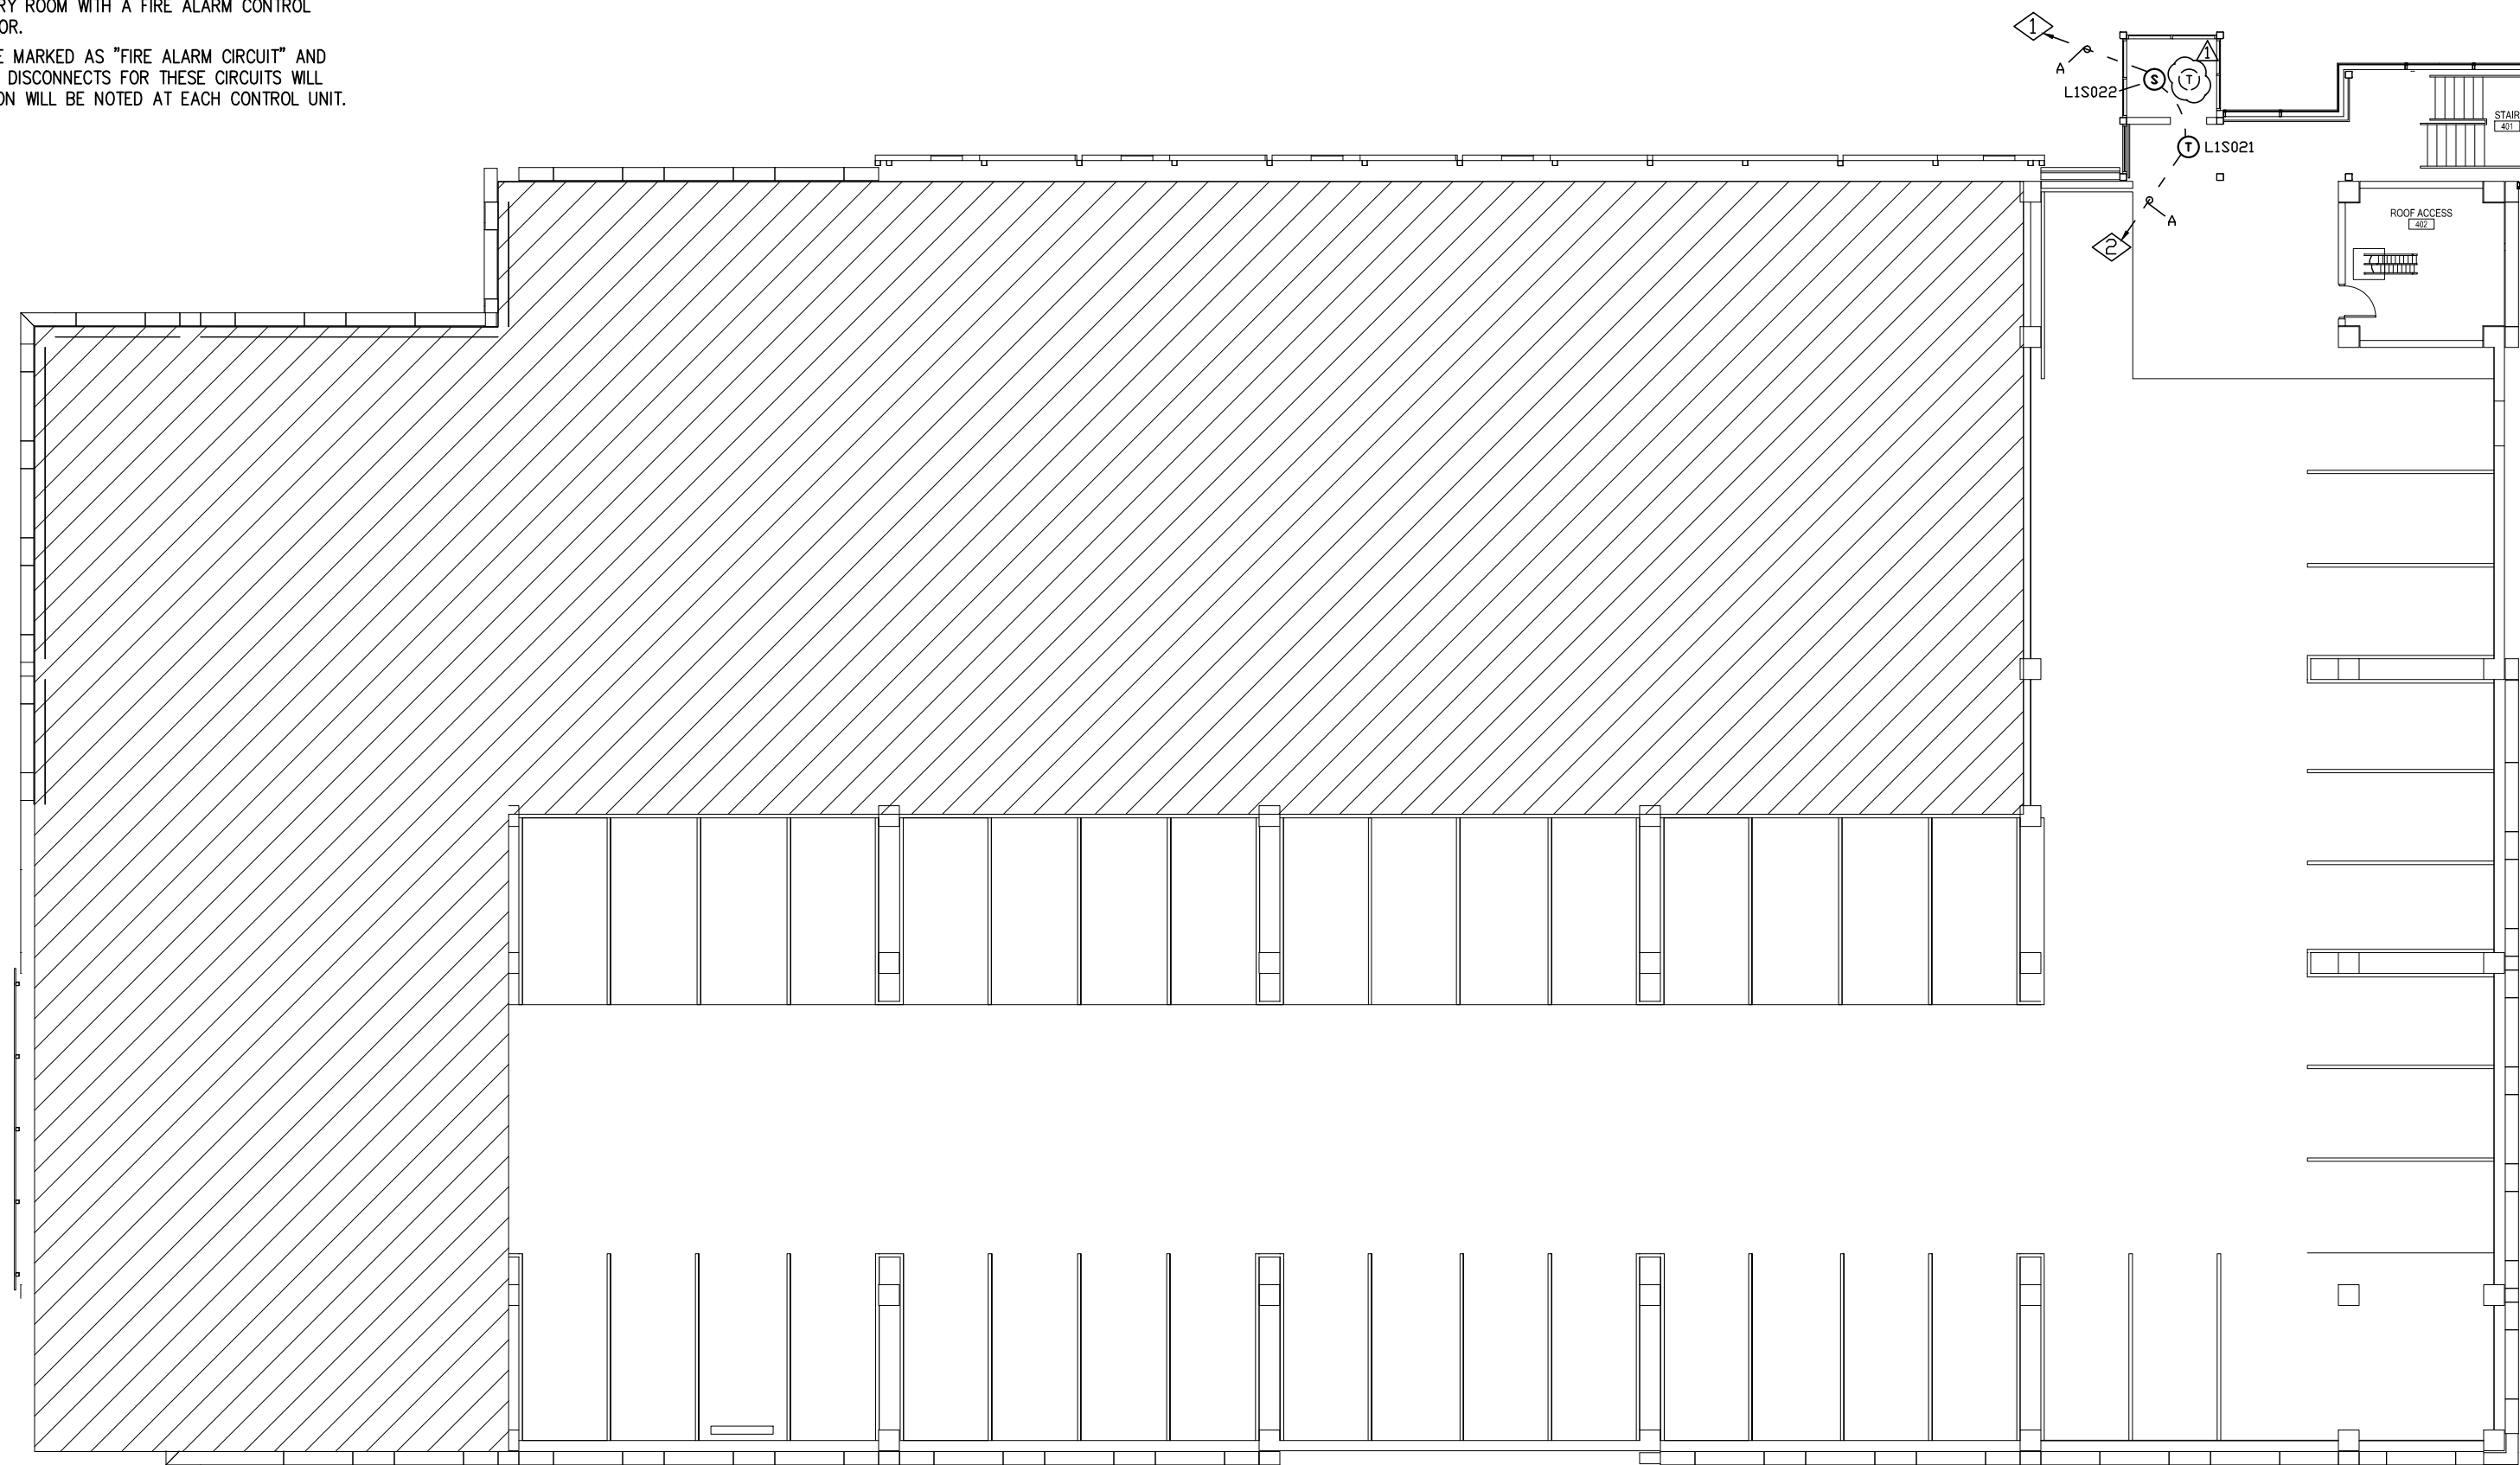

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEM
RUSTY SELIN
#92414

