


LEGEND

- Ⓢ HEAT DETECTOR- 601
- Ⓛ MANUAL PULL STATION- MS-2
- Ⓜ STROBE/HORN- HMF/STD-P
- Ⓛ STROBE- STD-4F-P
- TRAN TRANSPONDER PANEL- EN-24
- Ⓜ<sub>EX</sub> EXISTING STROBE/HORN

MOUNTING REQUIREMENTS


- 3/0 MUD RING
- 1 GANG MUD RING ON 2-1/8" DEEP BOX
- 4 SQ. 2-1/8" MINIMUM
- 4 SQ. 2-1/8" MINIMUM
- SUPPLIED BY NFS. FOLLOW MANUFACTURERS INSTRUCTIONS

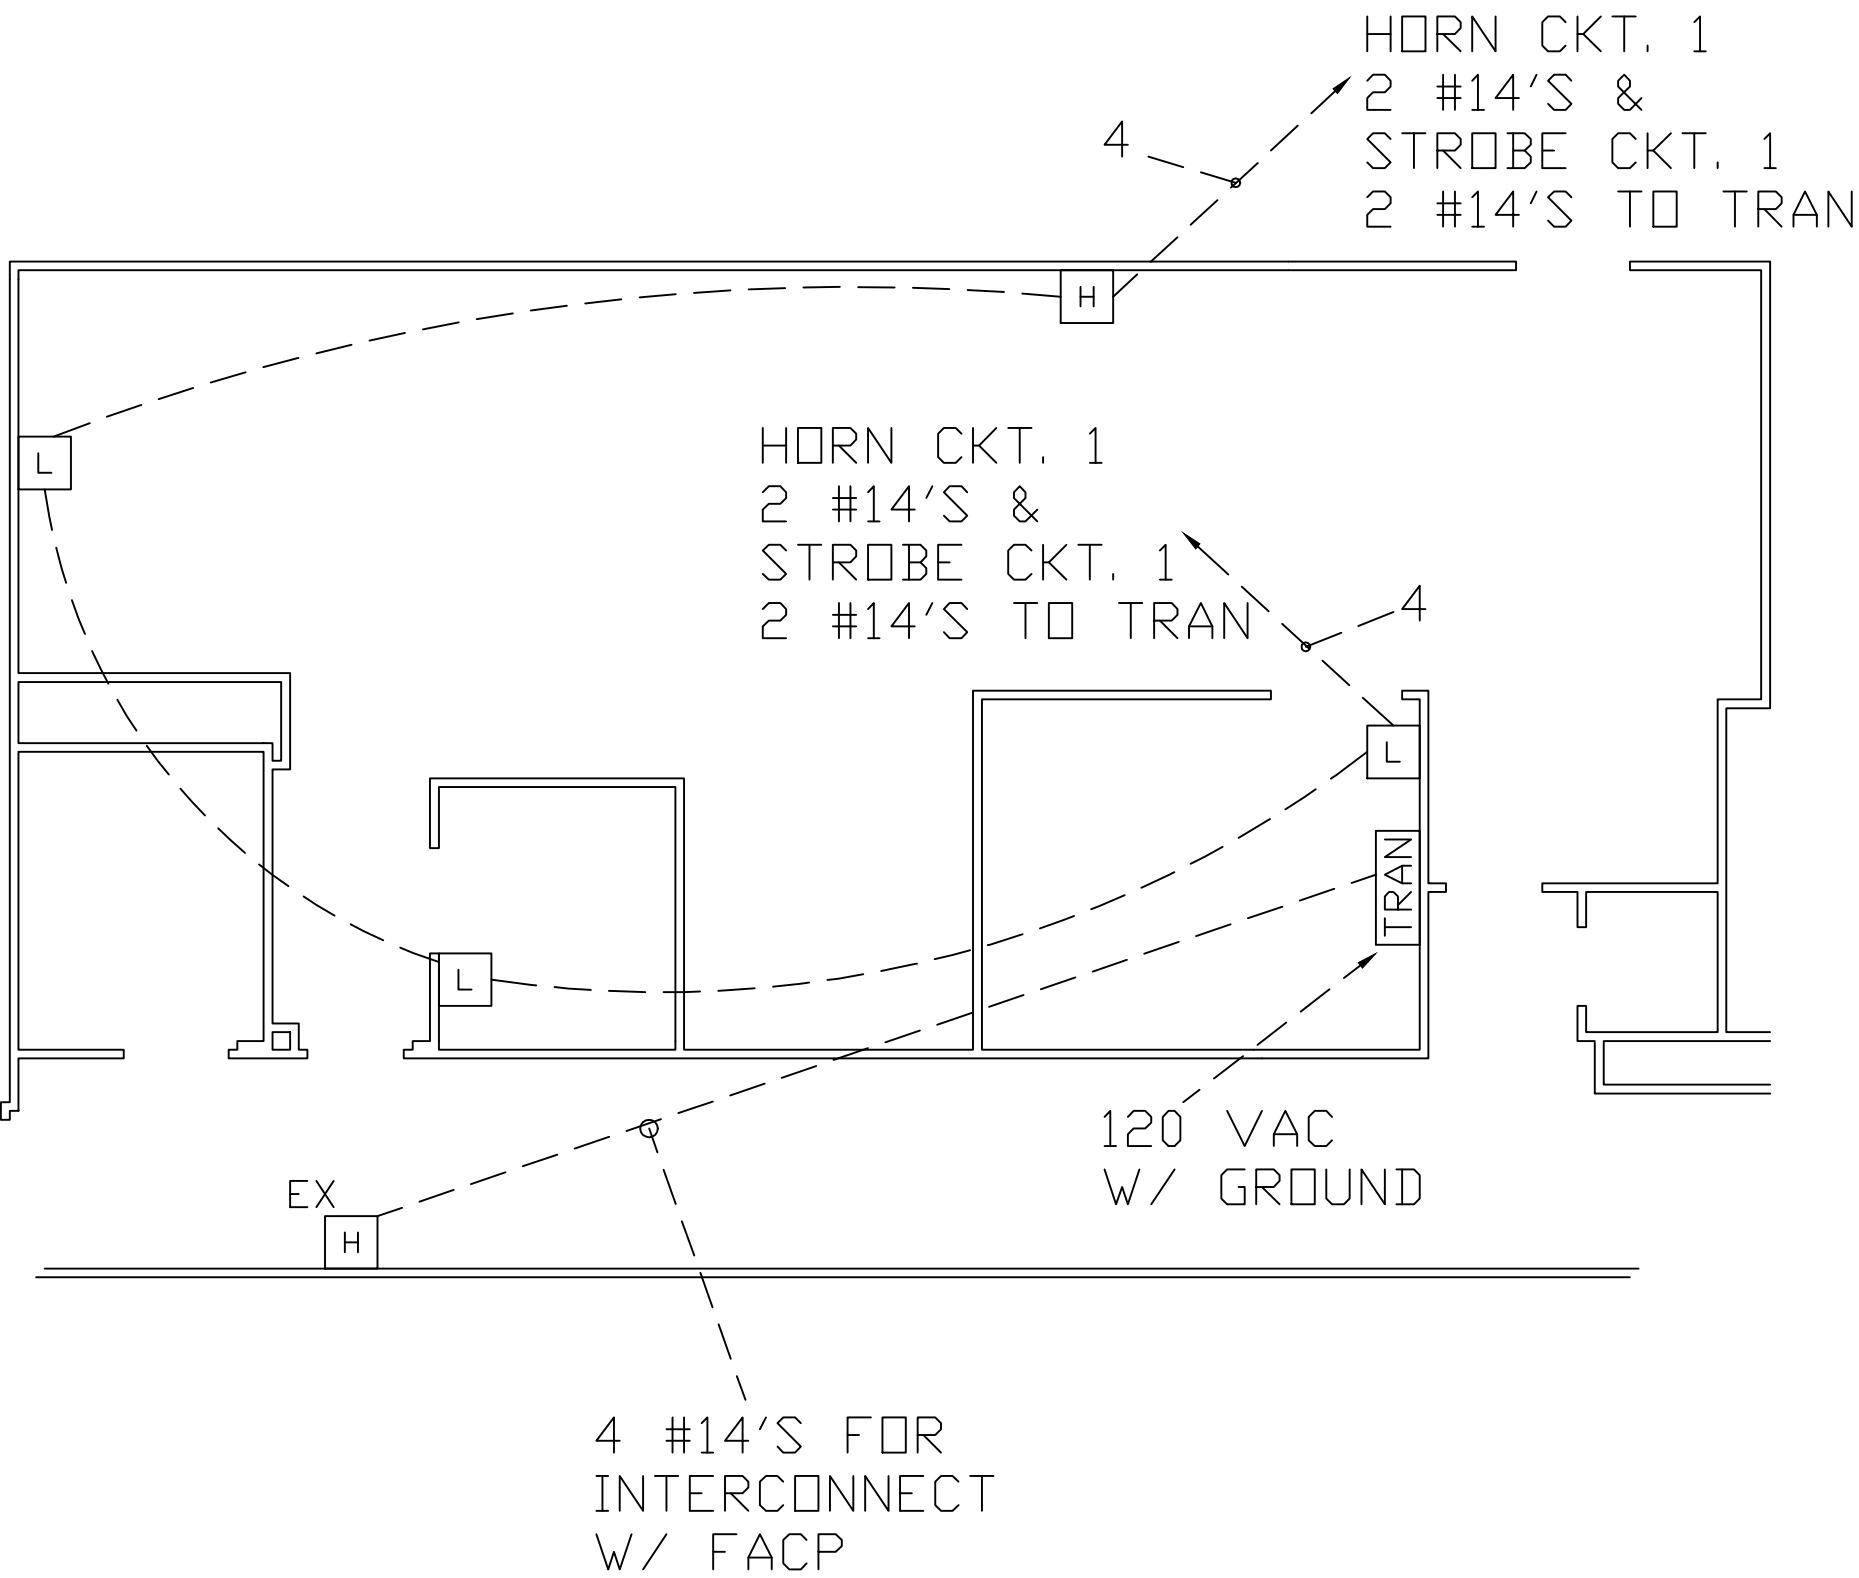

NFS

NELSON FIRE SYSTEMS

801-288-9905

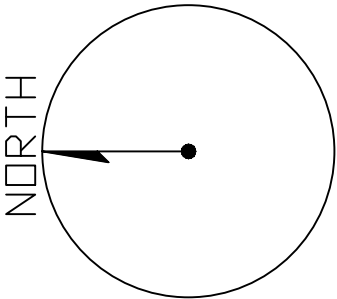

BIO-KIDS DAY CARE CENTER  
UNIVERSITY OF UTAH  
FIRE ALARM SYSTEM  
APRIL 8, 1999  
BIOKIDS.DWG