

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

SYSTEM NOTES:

- ◇ TO FACU IN 1ST FLOOR TELECOM ROOM 1430
- ◇ TO TRANSPONDER IN 2ND FLOOR WEST SIDE COMM ROOM 20001
- ◇ TO TRANSPONDER IN 2ND FLOOR EAST SIDE COMM ROOM 2000X
- ◇ TO TRANSPONDER IN 4TH FLOOR WEST SIDE COMM ROOM 40001
- ◇ TO TRANSPONDER IN 4TH FLOOR EAST SIDE COMM ROOM 4000X
- ◇ 120 VAC w/GROUND TO RELAY FOR FIRE/SMOKE DAMPERS
- ◇ 120 VAC w/GROUND TO RELAY FOR DOOR HOLDERS
- ◇ SEE RISER FA-R-03 FOR TWO WAY COMMUNICATION WIRING
- ◇ SLIDING DOOR POWER MONITORING
- ◇ 120 VAC FOR SPRINKLER RISER HORN/STROBE
- ◇ TO TRANSPONDER IN 1ST FLOOR TELECOM ROOM 1430

REVISION NOTES:

- △ DEVICE REMOVED PER CACHE VALLEY ELECTRIC REVIEW (6/20/17)
- △ CHANGED CANDELA PER CACHE VALLEY ELECTRIC REVIEW (6/20/17)

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	RELAY CIRCUIT	2 #14'S
C	24 VDC AUX POWER	2 #14'S
D	120 VAC POWER	3 #12'S
E	SPEAKER CIRCUIT	1 PAIR #14'S TWISTED/SHIELDED
F	STROBE CIRCUIT	2 #14'S
G	LOCAL OPERATING CONSOLE	1 PAIR #14'S TWISTED 1 PAIR #14'S TWISTED/SHIELDED

* SEE RISER FA-R-04 FOR INTERCONNECT DETAILS

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	HEAT DETECTOR
Ⓛ	PULL STATION
Ⓢ	DUCT DETECTOR
Ⓢ	TAMPER SWITCH
Ⓢ	WATERFLOW SWITCH
Ⓢ	MONITOR MODULE
Ⓢ	FIRE EXTINGUISHER
Ⓢ	CONTROL MODULE
Ⓢ	STROBE ONLY
Ⓢ	SPEAKER/STROBE WALL MOUNT
Ⓢ	SPEAKER/STROBE CEILING MOUNT
Ⓢ	RELAY
Ⓢ	DOOR HOLDER
Ⓢ	LOCAL OPERATING CONSOLE
Ⓢ	FIRE ALARM CONTROL UNIT
Ⓢ	TRANSPONDER PANEL
Ⓢ	TWO WAY COMMUNICATION PANEL
Ⓢ	TWO WAY CALL STATION
Ⓢ	FIRE/SMOKE DAMPER
Ⓢ	VESDA LASER PLUS
Ⓢ	WEATHERPROOF DEVICE
Ⓢ	VESDA SAMPLING PORTS: ○ CEILING PORT ● ABOVE CEILING PORT



0' 10' 25' 50'
SCALE



CAROLYN AND KEM GARDNER BUILDING
UNIVERSITY OF UTAH
LEVEL 1
260 CENTRAL CAMPUS DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: KLM
DESIGNED BY: DPS
APPROVED BY: DPS
DATE: 11/28/2017
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: CKG BUILDING LEVEL 1.DWG

NELSON FIRE SYSTEMS
LEVEL 1
NUMBERS

PAGE:
FA-I-03

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLAN. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

SYSTEM NOTES:

- ◇ TO FACU
- ◇ TO TRANSPONDER IN 2ND FLOOR WEST SIDE COMM ROOM 20001
- ◇ TO TRANSPONDER IN 2ND FLOOR EAST SIDE COMM ROOM 2000X
- ◇ TO TRANSPONDER IN 4TH FLOOR WEST SIDE COMM ROOM 40001
- ◇ TO TRANSPONDER IN 4TH FLOOR EAST SIDE COMM ROOM 4000X
- ◇ 120 VAC w/GROUND TO RELAY FOR FIRE/SMOKE DAMPERS
- ◇ 120 VAC w/GROUND TO RELAY FOR DOOR HOLDERS
- ◇ SEE RISER FA-R-03 FOR TWO WAY COMMUNICATION WIRING
- ◇ PLACE TEST POINTS IN ACCESSABLE CEILING


REVISION NOTES:

- ⚠ ADDED MISSED DEVICE PER CACHE VALLEY ELECTRIC REVIEW (6/20/17)
- ⚠ CHANGED CANDELA PER CACHE VALLEY ELECTRIC REVIEW (6/20/17)

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	RELAY CIRCUIT	2 #14'S
C	24 VDC AUX POWER	2 #14'S
D	120 VAC POWER	3 #12'S
E	SPEAKER CIRCUIT	1 PAIR #14'S TWISTED/SHIELDED
F	STROBE CIRCUIT	2 #14'S
G	LOCAL OPERATING CONSOLE	1 PAIR #14'S TWISTED 1 PAIR #14'S TWISTED/SHIELDED 2 #14'S

* SEE RISER FA-R-04 FOR INTERCONNECT WIRING

DEVICE LEGEND	
SYMBOL	DESCRIPTION
SD	SMOKE DETECTOR
TD	HEAT DETECTOR
PS	PULL STATION
DD	DUCT DETECTOR
TS	TAMPER SWITCH
WT	WATERFLOW SWITCH
MM	MONITOR MODULE
FE	FIRE EXTINGUISHER
CM	CONTROL MODULE
L	STROBE ONLY
SS	SPEAKER/STROBE WALL MOUNT
SSC	SPEAKER/STROBE CEILING MOUNT
R	RELAY
DH	DOOR HOLDER
LDC	LOCAL OPERATING CONSOLE
FACU	FIRE ALARM CONTROL UNIT
TRAN	TRANSPONDER PANEL
TW2	TWO WAY COMMUNICATION PANEL
TW	TWO WAY CALL STATION
FSD	FIRE/SMOKE DAMPER
VLP	VESDA LASER PLUS
VP	WEATHERPROOF DEVICE
○	VESDA SAMPLING PORTS:
○	CEILING PORT
●	ABOVE CEILING PORT

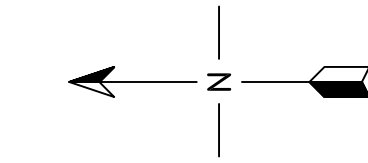

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION AND SUITABILITY OF ALL FIRE ALARMS. CONTROL PANELS AND OTHER DEVICES SHOWN ON THE PLANS AND DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

CAROLYN AND KEM GARDNER BUILDING
UNIVERSITY OF UTAH
LEVEL 2
260 CENTRAL CAMPUS DRIVE
SALT LAKE CITY, UTAH
FIRE ALARM SYSTEM

NFS


NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: KLM
DESIGNED BY: DPS
APPROVED BY: DPS
DATE: 11/28/2017
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
CKG BUILDING LEVEL 2.DWG

NELSON FIRE SYSTEMS
LEVEL 2
NUMBERS

PAGE:

FA-2-03

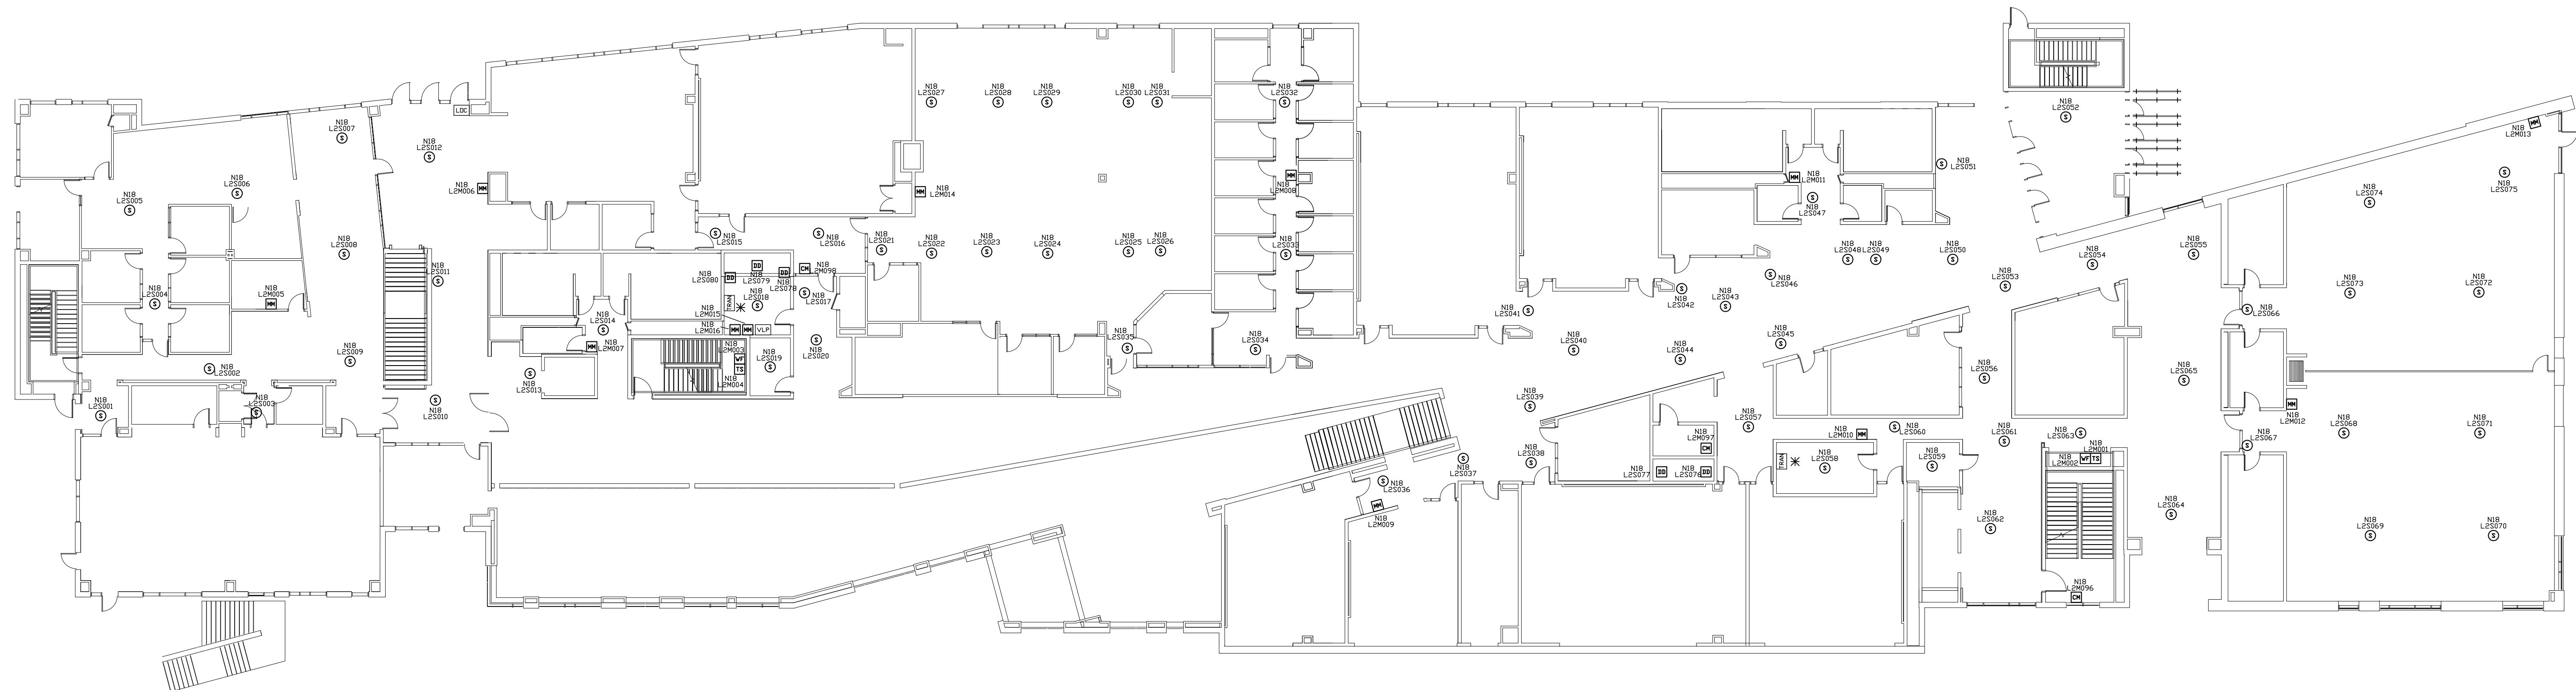

0' 10' 25' 50'
SCALE

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25' AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

SYSTEM NOTES:


- ◇ TO FACU
- ◇ TO TRANSPONDER IN 2ND FLOOR WEST SIDE COMM ROOM 20001
- ◇ TO TRANSPONDER IN 2ND FLOOR EAST SIDE COMM ROOM 2000X
- ◇ TO TRANSPONDER IN 4TH FLOOR WEST SIDE COMM ROOM 40001
- ◇ TO TRANSPONDER IN 4TH FLOOR EAST SIDE COMM ROOM 4000X
- ◇ 120 VAC w/GROUND TO RELAY FOR FIRE/SMOKE DAMPERS
- ◇ 120 VAC w/GROUND TO RELAY FOR DOOR HOLDERS
- ◇ SEE RISER FA-R-03 FOR TWO WAY COMMUNICATION WIRING

REVISION NOTES:

- ▲ ADDED MISSED DEVICE PER CACHE VALLEY ELECTRIC REVIEW (6/20/17)

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	RELAY CIRCUIT	2 #14'S
C	24 VDC AUX POWER	2 #14'S
D	120 VAC POWER	3 #12'S
E	SPEAKER CIRCUIT	1 PAIR #14'S TWISTED/SHIELDED
F	STROBE CIRCUIT	2 #14'S
G	LOCAL OPERATING CONSOLE	1 PAIR #14'S TWISTED 2 #14'S TWISTED/SHIELDED

DEVICE LEGEND	
SYMBOL	DESCRIPTION
SD	SMOKE DETECTOR
TD	HEAT DETECTOR
PS	PULL STATION
DD	DUCT DETECTOR
TS	TAMPER SWITCH
WF	WATERFLOW SWITCH
MM	MONITOR MODULE
FE	FIRE EXTINGUISHER
CM	CONTROL MODULE
LI	STROBE ONLY
SS	SPEAKER/STROBE WALL MOUNT
SSC	SPEAKER/STROBE CEILING MOUNT
R	RELAY
DH	DOOR HOLDER
LDC	LOCAL OPERATING CONSOLE
FACU	FIRE ALARM CONTROL UNIT
TRAN	TRANSPONDER PANEL
TV2	TWO WAY COMMUNICATION PANEL
TV	TWO WAY CALL STATION
FSB	FIRE/SMOKE DAMPER
VLP	VESDA LASER PLUS
VP	WEATHERPROOF DEVICE
○	VESDA SAMPLING PORTS:
○	CEILING PORT
●	ABOVE CEILING PORT

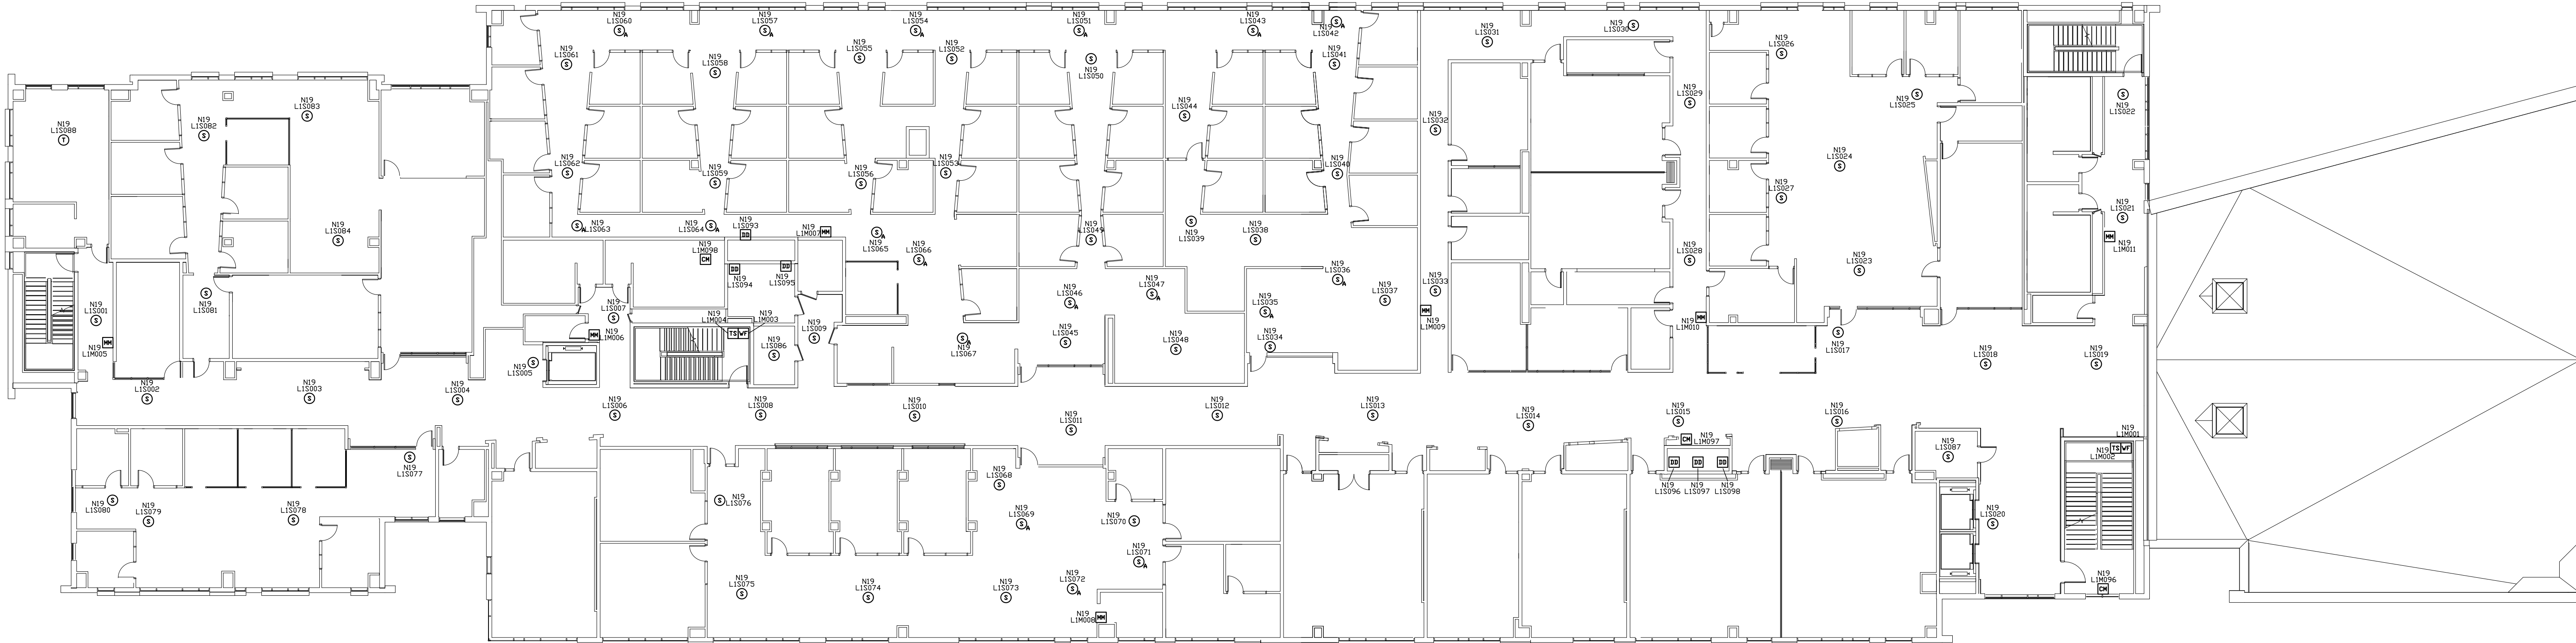

CAROLYN AND KEM GARDNER BUILDING
UNIVERSITY OF UTAH
LEVEL 3
260 CENTRAL CAMPUS DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: KLM
DESIGNED BY: DPS
APPROVED BY: DPS
DATE: 11/28/2017
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
CKG BUILDING LEVEL 3.DWG

NELSON FIRE SYSTEMS

LEVEL 3
NUMBERS

PAGE:

FA-3-03

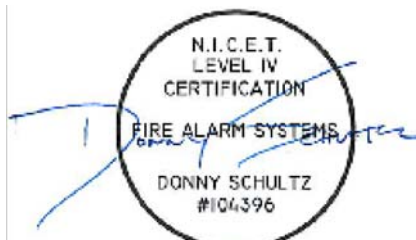

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

SYSTEM NOTES:

- ① TO FACU
- ② TO TRANSPONDER IN 2ND FLOOR WEST SIDE COMM ROOM 2000I
- ③ TO TRANSPONDER IN 2ND FLOOR EAST SIDE COMM ROOM 2000X
- ④ TO TRANSPONDER IN 4TH FLOOR WEST SIDE COMM ROOM 4000I
- ⑤ TO TRANSPONDER IN 4TH FLOOR EAST SIDE COMM ROOM 4000X
- ⑥ 120 VAC w/GROUND TO RELAY FOR FIRE/SMOKE DAMPERS
- ⑦ 120 VAC w/GROUND TO RELAY FOR DOOR HOLDERS
- ⑧ SEE RISER FA-R-03 FOR TWO WAY COMMUNICATION WIRING

REVISION NOTES:

- △ ADDED MISSED DEVICE PER CACHE VALLEY ELECTRIC REVIEW (6/20/17)

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	RELAY CIRCUIT	2 #14'S
C	24 VDC AUX POWER	2 #14'S
D	120 VAC POWER	3 #12'S
E	SPEAKER CIRCUIT	1 PAIR #14'S TWISTED/SHIELDED
F	STROBE CIRCUIT	2 #14'S
G	LOCAL OPERATING CONSOLE	1 PAIR #14'S TWISTED 1 PAIR #14'S TWISTED/SHIELDED 2 #14'S

* SEE RISER FA-R-04 INTERCONNECT WIRING

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓡ	HEAT DETECTOR
Ⓟ	PULL STATION
Ⓣ	DUCT DETECTOR
Ⓣ	TAMPER SWITCH
Ⓦ	WATERFLOW SWITCH
Ⓜ	MONITOR MODULE
Ⓛ	FIRE EXTINGUISHER
Ⓢ	CONTROL MODULE
Ⓛ	STROBE ONLY
Ⓢ	SPEAKER/STROBE WALL MOUNT
Ⓢ	SPEAKER/STROBE CEILING MOUNT
Ⓡ	RELAY
Ⓜ	DOOR HOLDER
Ⓛ	LOCAL OPERATING CONSOLE
Ⓛ	FIRE ALARM CONTROL UNIT
Ⓛ	TRANSPONDER PANEL
Ⓛ	TWO WAY COMMUNICATION PANEL
Ⓛ	TWO WAY CALL STATION
Ⓛ	FIRE/SMOKE DAMPER
Ⓛ	VESDA LASER PLUS
Ⓛ	WEATHERPROOF DEVICE
Ⓛ	VESDA SAMPLING PORTS:
Ⓛ	CEILING PORT
Ⓛ	ABOVE CEILING PORT

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS AND OTHER DEVICES SHOWN ON THE PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

CAROLYN AND KEM GARDNER BUILDING
UNIVERSITY OF UTAH
LEVEL 4
260 CENTRAL CAMPUS DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: KLM
DESIGNED BY: DPS
APPROVED BY: DPS
DATE: 11/28/2017
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME: CKG BUILDING LEVEL 4.DWG

NELSON FIRE SYSTEMS
LEVEL 4
NUMBERS


PAGE:

FA-4-03

0' 10' 25' 50'
SCALE



0' 10' 25' 50'
SCALE

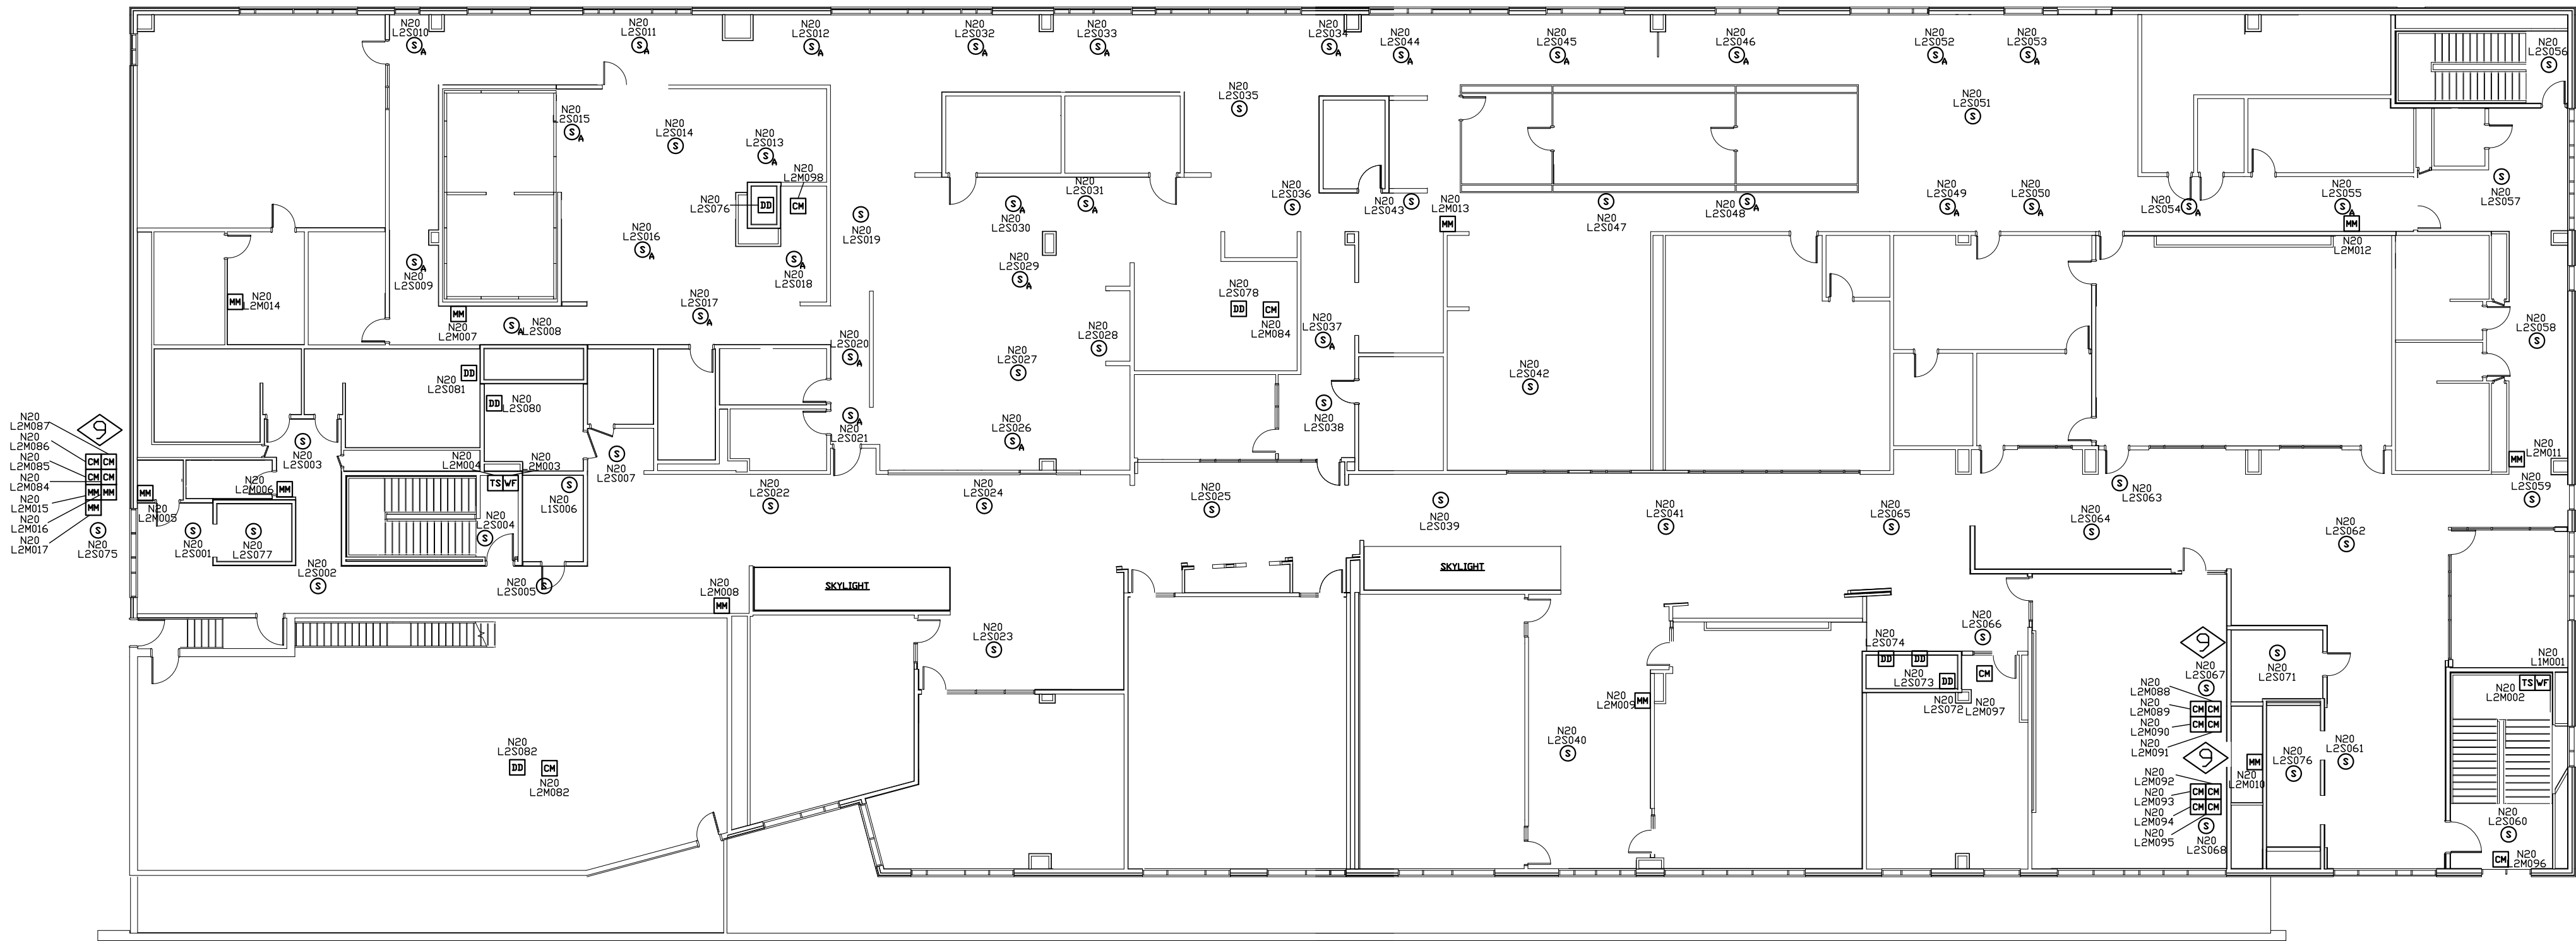

GENERAL NOTES:

1. INSTALLATION SHALL COMPLY WITH NEC, NFPA 72 AND ALL OTHER APPLICABLE CODES AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION. CLASS "A" WIRING IS REQUIRED.
2. WIRING DEPICTED ON THESE PLANS IS SCHEMATIC - ACTUAL WIRE LOCATIONS MAY DIFFER FROM THESE PLANS. WIRING SHALL BE PERFORMED AS ACTUAL BUILDING CONSTRUCTION CONDITIONS ALLOW AND TO MINIMIZE PENETRATIONS THROUGH AREA SEPARATION WALLS AND FIRE WALLS. THE USE OF A RACEWAY IS PERMITTED AS LONG AS NO 110V OR HIGHER VOLTAGE CABLES ARE IN THE SAME RACEWAY.
3. POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST REMAIN SEPARATED IN CABINET. ALL POWER-LIMITED CIRCUIT WIRING MUST REMAIN AT LEAST 0.25" AWAY FROM ANY NONPOWER-LIMITED CIRCUIT WIRING. FURTHERMORE, ALL POWER-LIMITED AND NONPOWER-LIMITED CIRCUIT WIRING MUST ENTER AND EXIT THE CABINET THROUGH DIFFERENT KNOCK OUTS AND/OR SEPARATE CONDUITS.
4. SMOKE DETECTORS SHALL BE INSTALLED AND COVERED UNTIL TESTING AND FINAL INSPECTION ARE COMPLETED. DO NOT INSTALL SMOKE DETECTORS UNTIL BUILDING IS CLEAN.
5. LOCATE SMOKE DETECTORS A MINIMUM OF THREE (3) FEET FROM MECHANICAL DIFFUSERS.
6. PROVIDE SYNCHRONIZATION OF ALL VISUAL NOTIFICATION APPLIANCE CIRCUITS. PROVIDE ALL REQUIRED SYNC MODULES. A MULTI-SYNC MODE SLAVE CONNECTION BETWEEN ALL SYNC MODULES.
7. ONLY FIRE ALARM WIRING IS PERMITTED IN FIRE ALARM CONDUIT. 110V OR HIGHER VOLTAGE CABLES ARE NOT ALLOWED IN FIRE ALARM CONDUIT.
8. DO NOT USE SHIELDED WIRE ON ADDRESSABLE CIRCUITS.
9. FIRE ALARM CIRCUITS NEED TO BE FREE OF GROUNDS, FAULTS, AND SHORTS PRIOR TO CONNECTION TO FIRE ALARM EQUIPMENT.
10. A SMOKE DETECTOR MUST BE IN EVERY ROOM WITH A FIRE ALARM CONTROL UNIT, POWER SUPPLY, OR ANNUNCIATOR.
11. DEDICATED 120 VAC CIRCUITS WILL BE MARKED AS "FIRE ALARM CIRCUIT" AND BE ACCESSIBLE ONLY TO PERSONNEL. DISCONNECTS FOR THESE CIRCUITS WILL BE RED IN COLOR AND THEIR LOCATION WILL BE NOTED AT EACH CONTROL UNIT.

SYSTEM NOTES:

- ① TO FACU
- ② TO TRANSPONDER IN 2ND FLOOR WEST SIDE COMM ROOM 2000I
- ③ TO TRANSPONDER IN 2ND FLOOR EAST SIDE COMM ROOM 2000X
- ④ TO TRANSPONDER IN 4TH FLOOR WEST SIDE COMM ROOM 4000I
- ⑤ TO TRANSPONDER IN 4TH FLOOR EAST SIDE COMM ROOM 4000X
- ⑥ 120 VAC w/GROUND TO RELAY FOR FIRE/SMOKE DAMPERS
- ⑦ 120 VAC w/GROUND TO RELAY FOR DOOR HOLDERS
- ⑧ SEE RISER FA-R-03 FOR TWO WAY COMMUNICATION WIRING
- ⑨ LOCATE DEVICES IN ELEVATOR EQUIPMENT ROOM
- ⑩ LOCATED ON ROOF. CONTROL MODULE AND RELAY FOR FAN SHUTDOWN

REVISION NOTES:

- ▲ ADDED MISSED DEVICE PER CACHE VALLEY ELECTRIC REVIEW (6/20/17)

WIRE SCHEDULE		
NOTE	DESCRIPTION	WIRES
A	ADDRESSABLE CIRCUIT	1 PAIR #14'S TWISTED
B	RELAY CIRCUIT	2 #14'S
C	24 VDC AUX POWER	2 #14'S
D	120 VAC POWER	3 #12'S
E	SPEAKER CIRCUIT	1 PAIR #14'S TWISTED/SHIELDED
F	STROBE CIRCUIT	2 #14'S
G	LOCAL OPERATING CONSOLE	1 PAIR #14'S TWISTED 1 PAIR #14'S TWISTED/SHIELDED 2 #14'S

DEVICE LEGEND	
SYMBOL	DESCRIPTION
S	SMOKE DETECTOR
T	HEAT DETECTOR
F	PULL STATION
DD	DUCT DETECTOR
TS	TAMPER SWITCH
WF	WATERFLOW SWITCH
MM	MONITOR MODULE
FE	FIRE EXTINGUISHER
CM	CONTROL MODULE
L	STROBE ONLY
SS	SPEAKER/STROBE WALL MOUNT
SSC	SPEAKER/STROBE CEILING MOUNT
R	RELAY
DH	DOOR HOLDER
LOC	LOCAL OPERATING CONSOLE
FACU	FIRE ALARM CONTROL UNIT
TRAN	TRANSPONDER PANEL
TW2	TWO WAY COMMUNICATION PANEL
TW	TWO WAY CALL STATION
FSD	FIRE/SMOKE DAMPER
VLP	VESDA LASER PLUS
VP	WEATHERPROOF DEVICE
VSP	VESDA SAMPLING PORTS: ○ CEILING PORT ● ABOVE CEILING PORT

CAROLYN AND KEM GARDNER BUILDING
UNIVERSITY OF UTAH
LEVEL 5
260 CENTRAL CAMPUS DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: KLM
DESIGNED BY: DPS
APPROVED BY: DPS
DATE: 11/28/2017
SCALE: (ARCH D) 1/16" = 1'
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
CKG BUILDING LEVEL 5.DWG

NELSON FIRE SYSTEMS
LEVEL 5
NUMBERS

PAGE:

FA-5-03



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION AND SUITABILITY OF ALL FIRE ALARMS. CONTROL PANELS AND OTHER DEVICES SHOWN ON THE PLANS AND DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARMS DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.