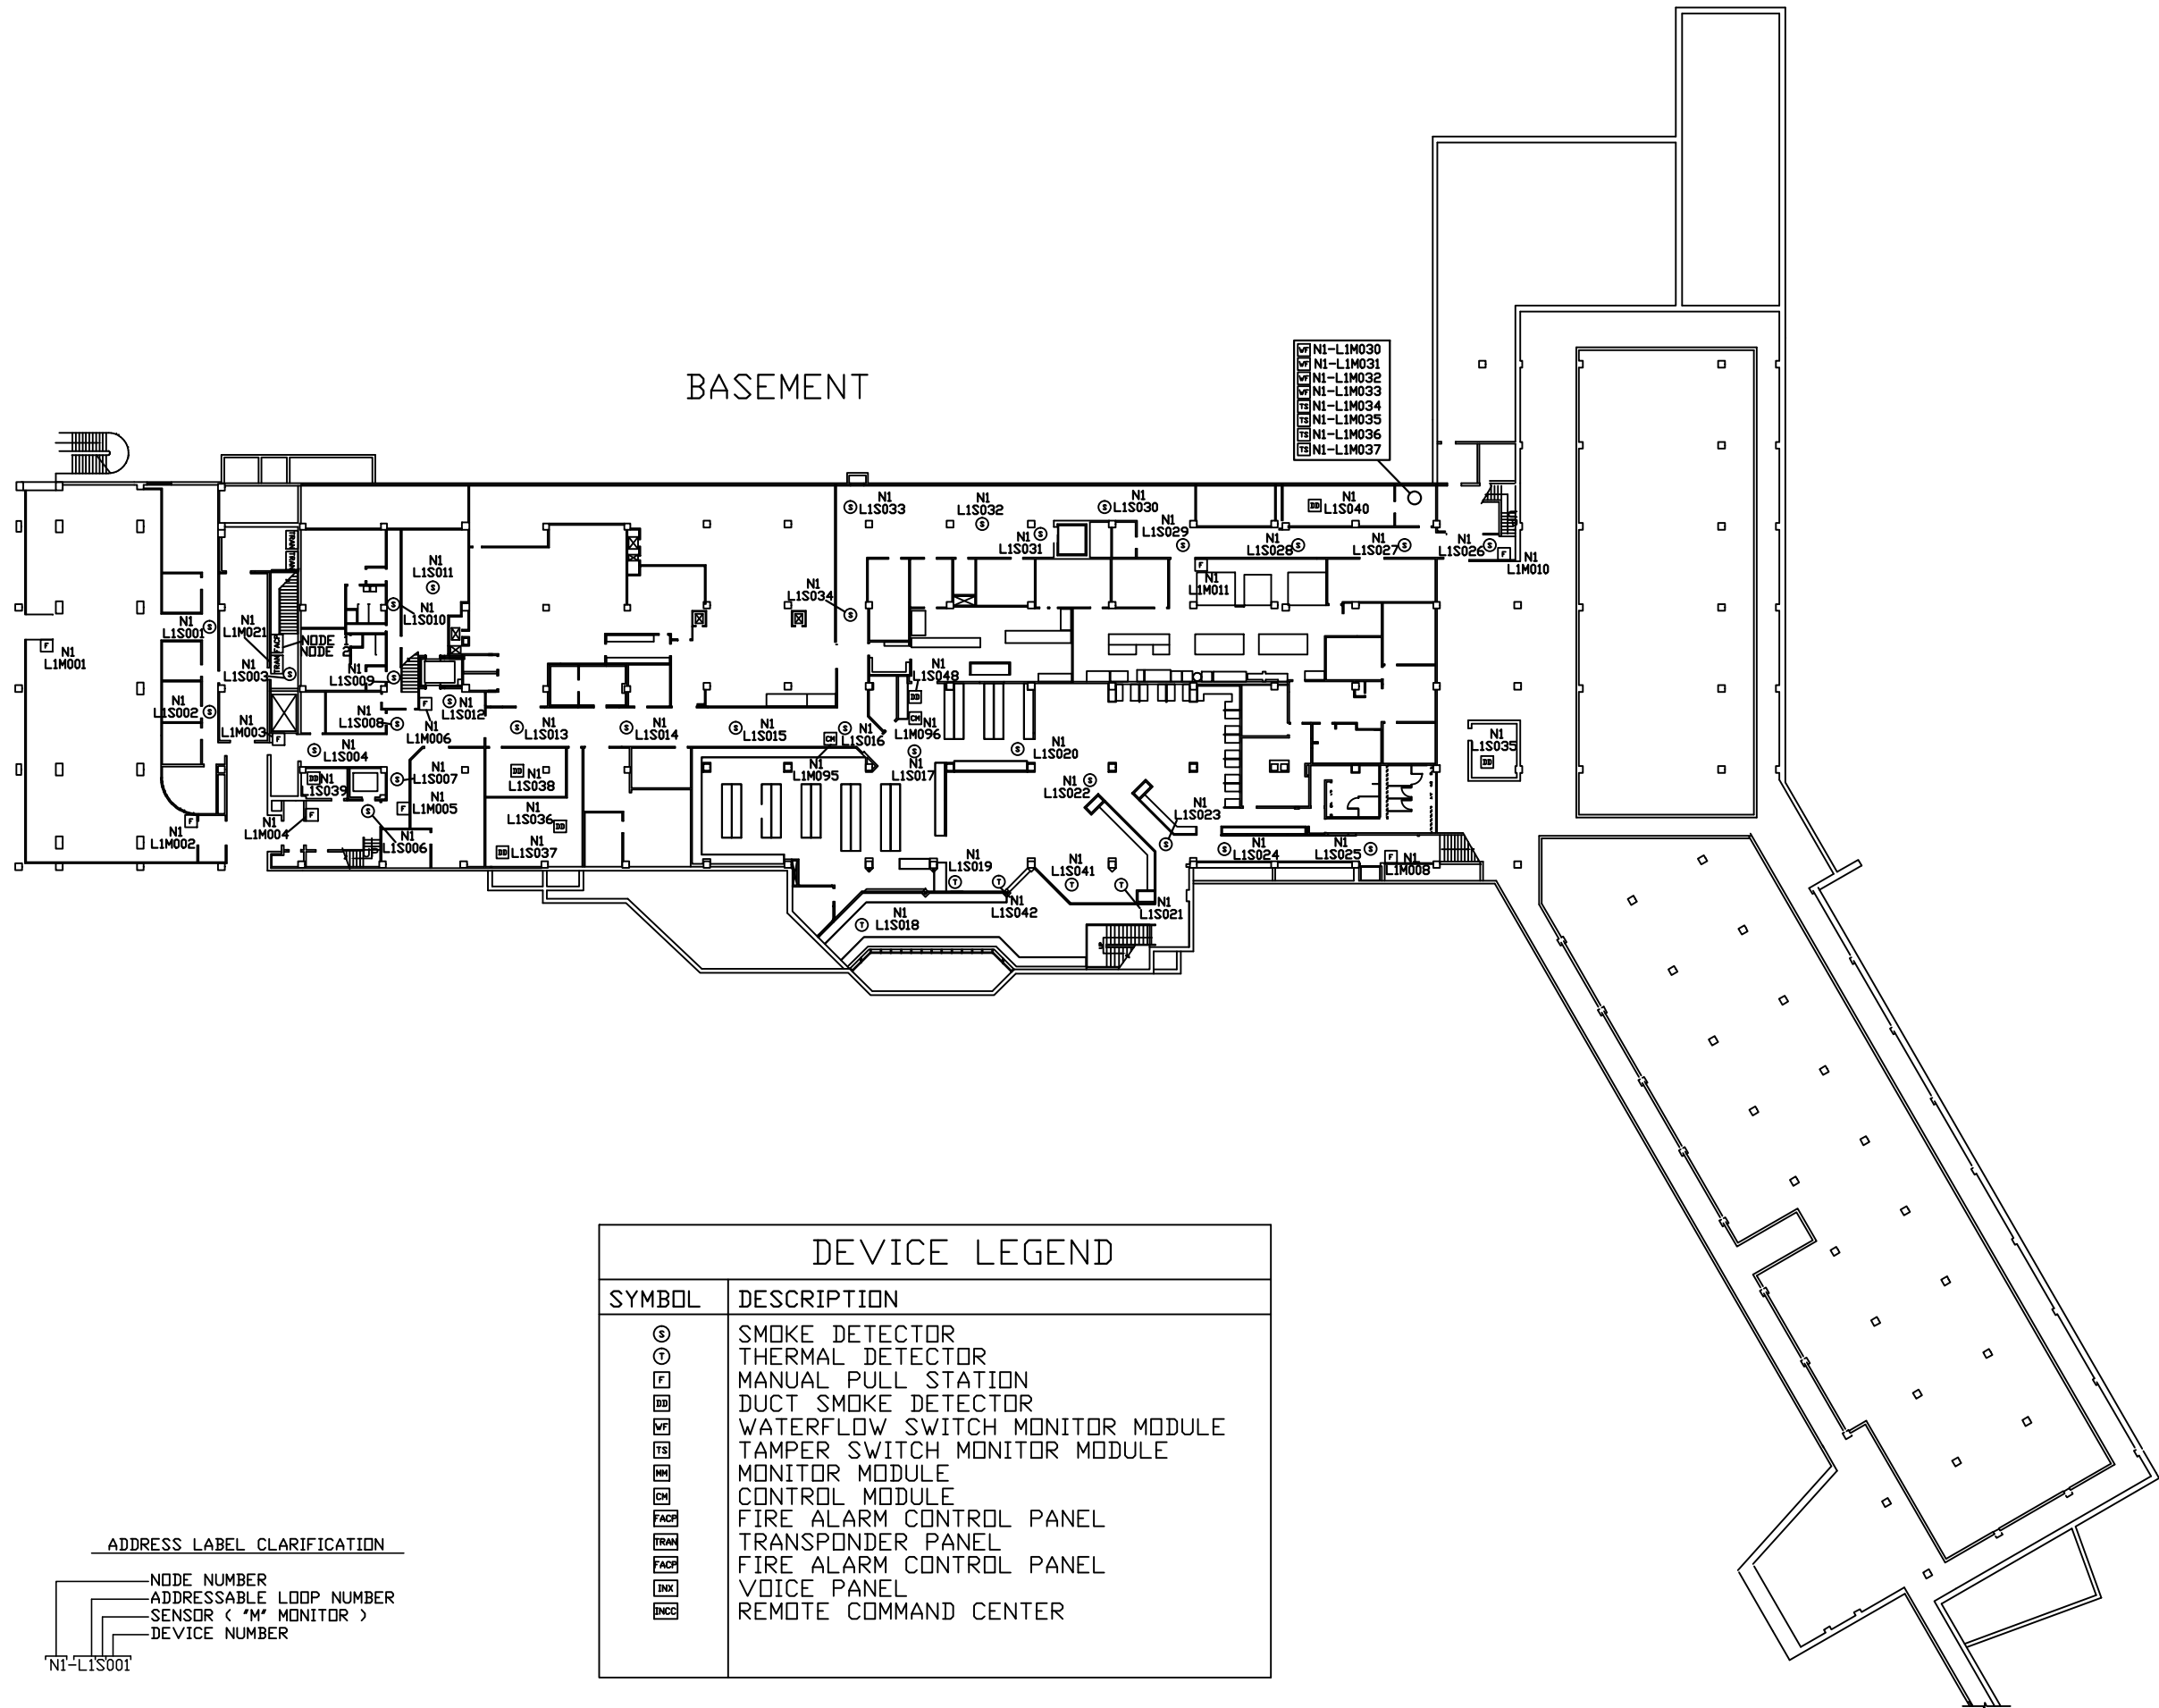


NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

OLPIN UNION PHASE 2
UNIVERSITY OF UTAH
BASEMENT LEVEL
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY:	DS
DESIGNED BY:	XXXX
APPROVED BY:	TCT
DATE:	12/30/2009
SCALE:	NTS
PROJECT NO:	0053-13095
REV NO:	I
DRAWING NAME:	UNIONPHASE2BASEMENT.DWG

FIRE ALARM SYSTEM
BASEMENT
ADDRESSABLE NUMBERS

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396



PAGE:

NFS

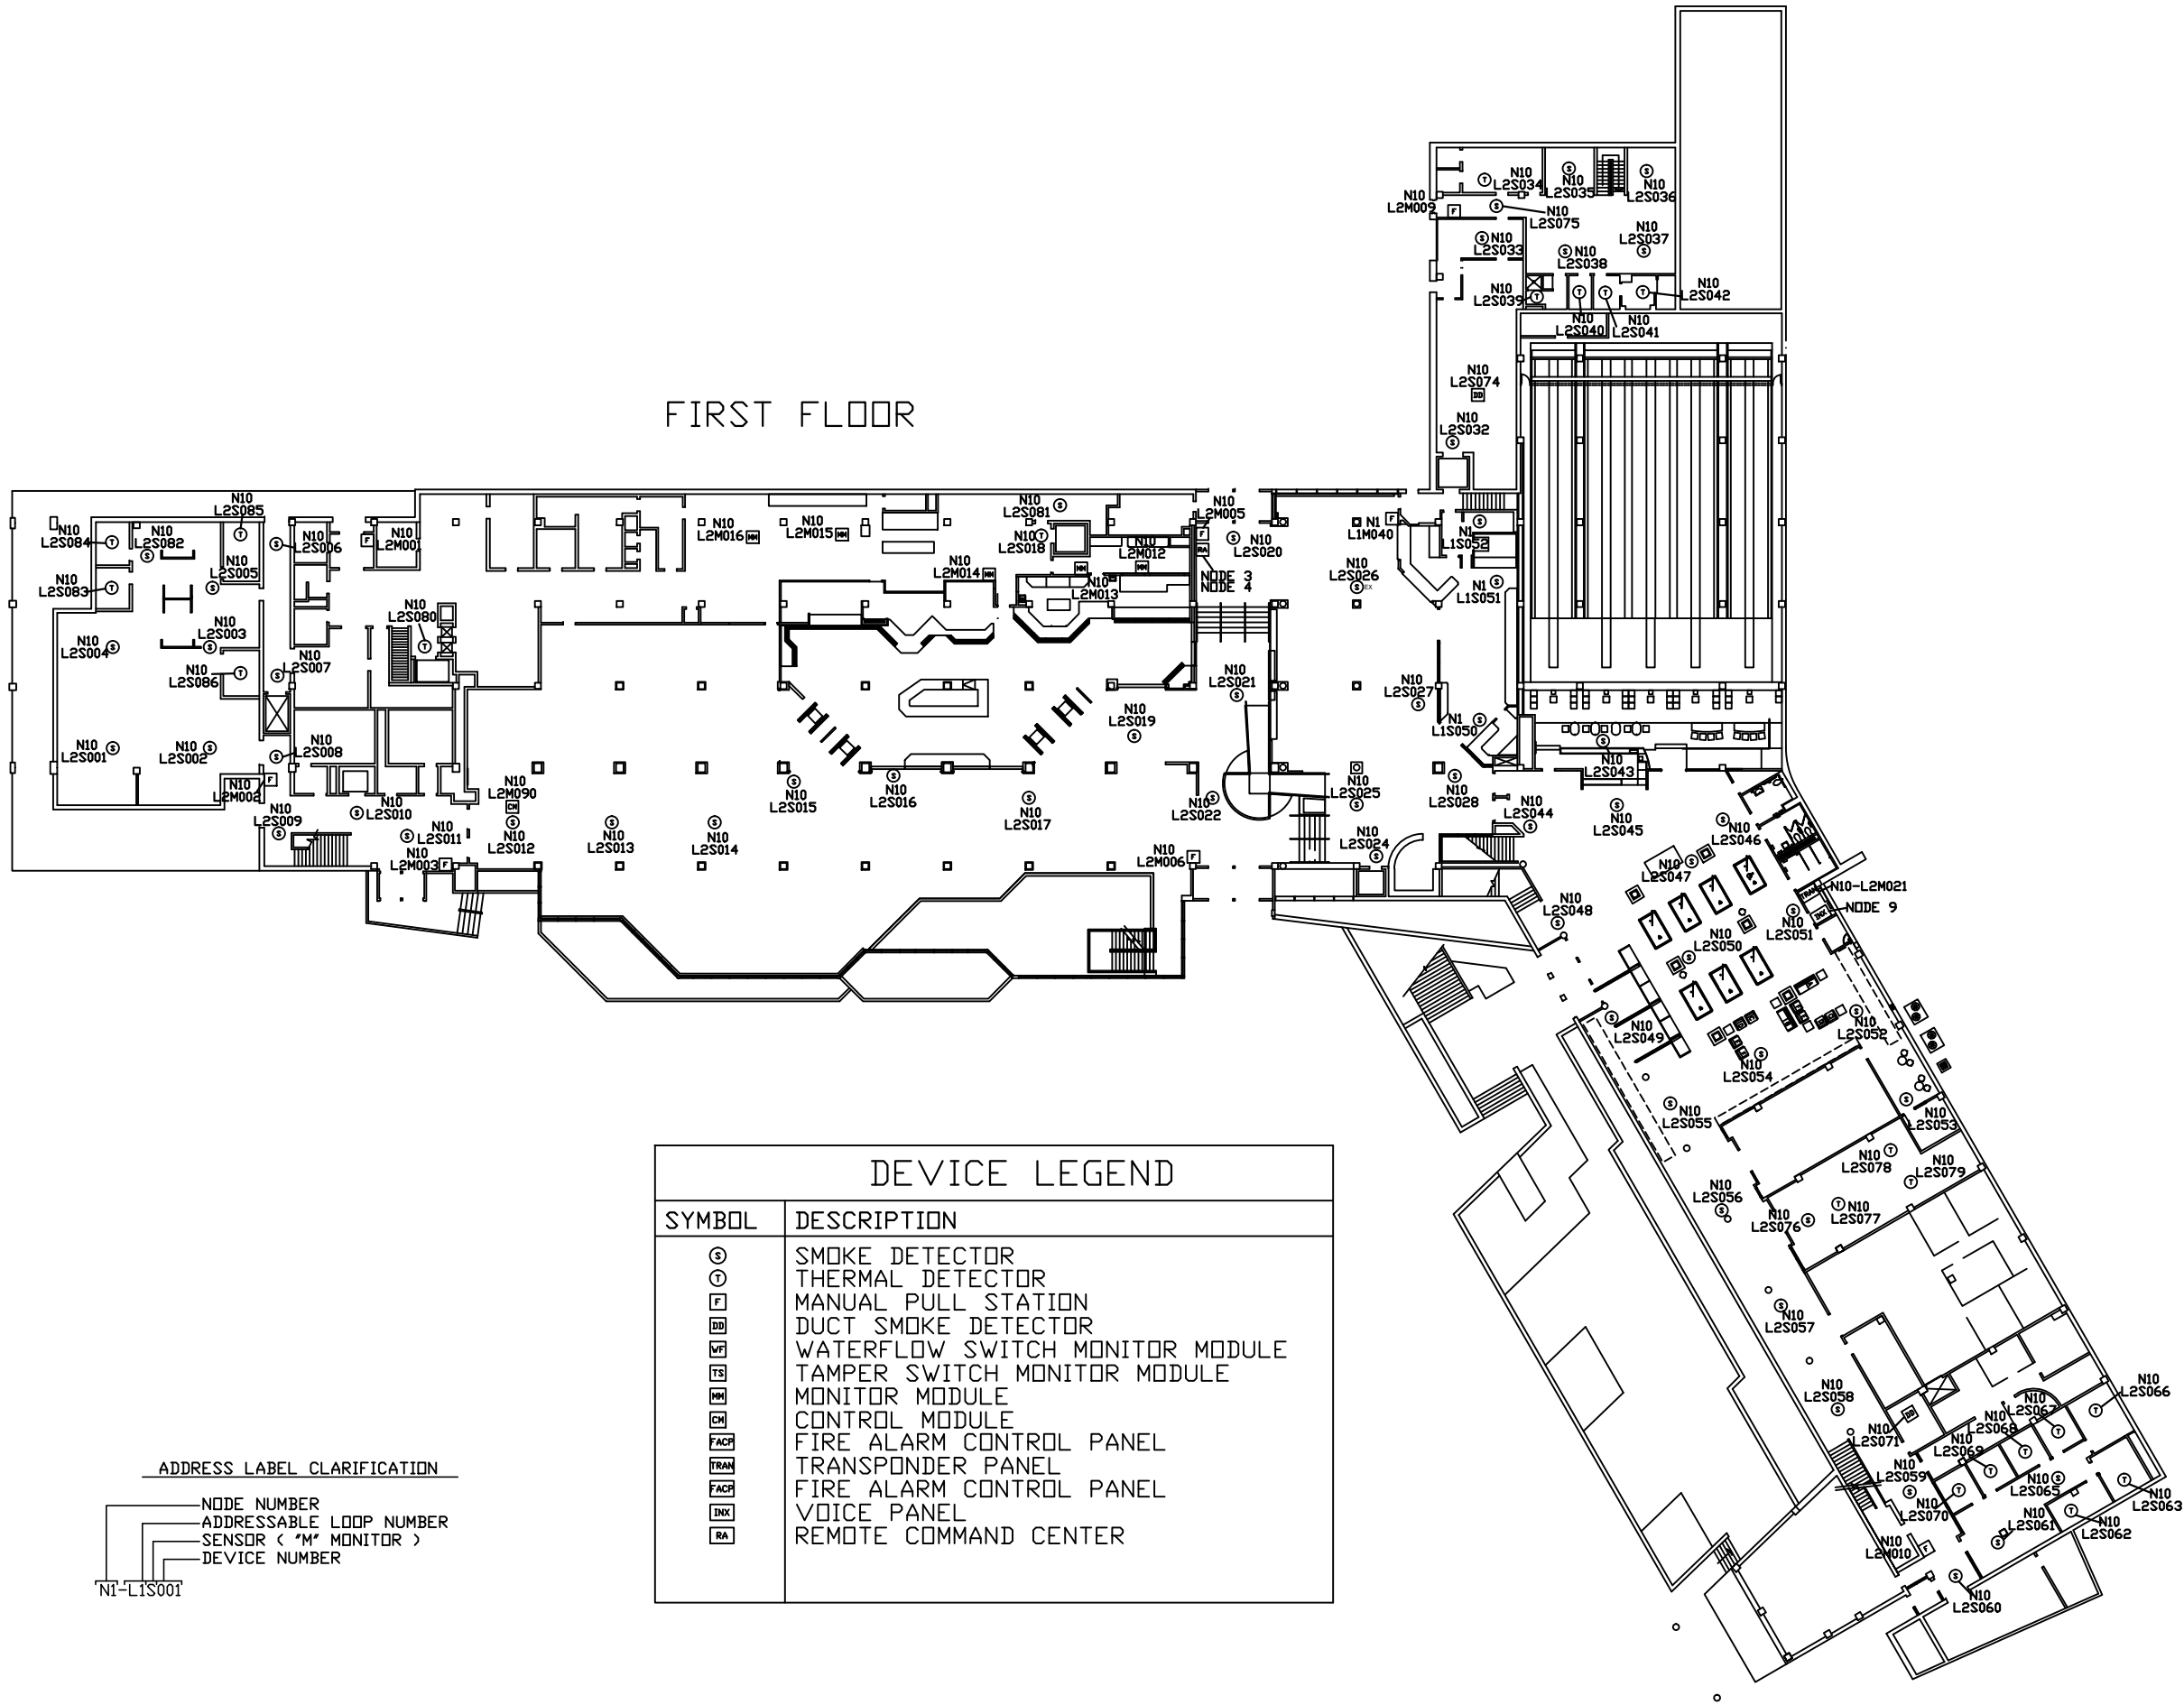

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
DB	DUCT SMOKE DETECTOR
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
FACP	FIRE ALARM CONTROL PANEL
INX	VOICE PANEL
RA	REMOTE COMMAND CENTER

ADDRESS LABEL CLARIFICATION



NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

OLPIN UNION PHASE 2
UNIVERSITY OF UTAH
FIRST FLOOR
FIRE ALARM SYSTEM

NFS

NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: XXXX
APPROVED BY: TCT
DATE: 12/30/2009
SCALE: NTS
PROJECT NO: 0053-13301
REV NO: 1
DRAWING NAME:
UNIONPHASE21STFLOR.DWG

FIRE ALARM SYSTEM
FIRST FLOOR
ADDRESSABLE NUMBERS

PAGE:


NFS

N.I.C.E.T.
LEVEL III
CERTIFICATION

FIRE ALARM SYSTEMS



DONNY SCHULTZ
#104396

SECOND FLOOR

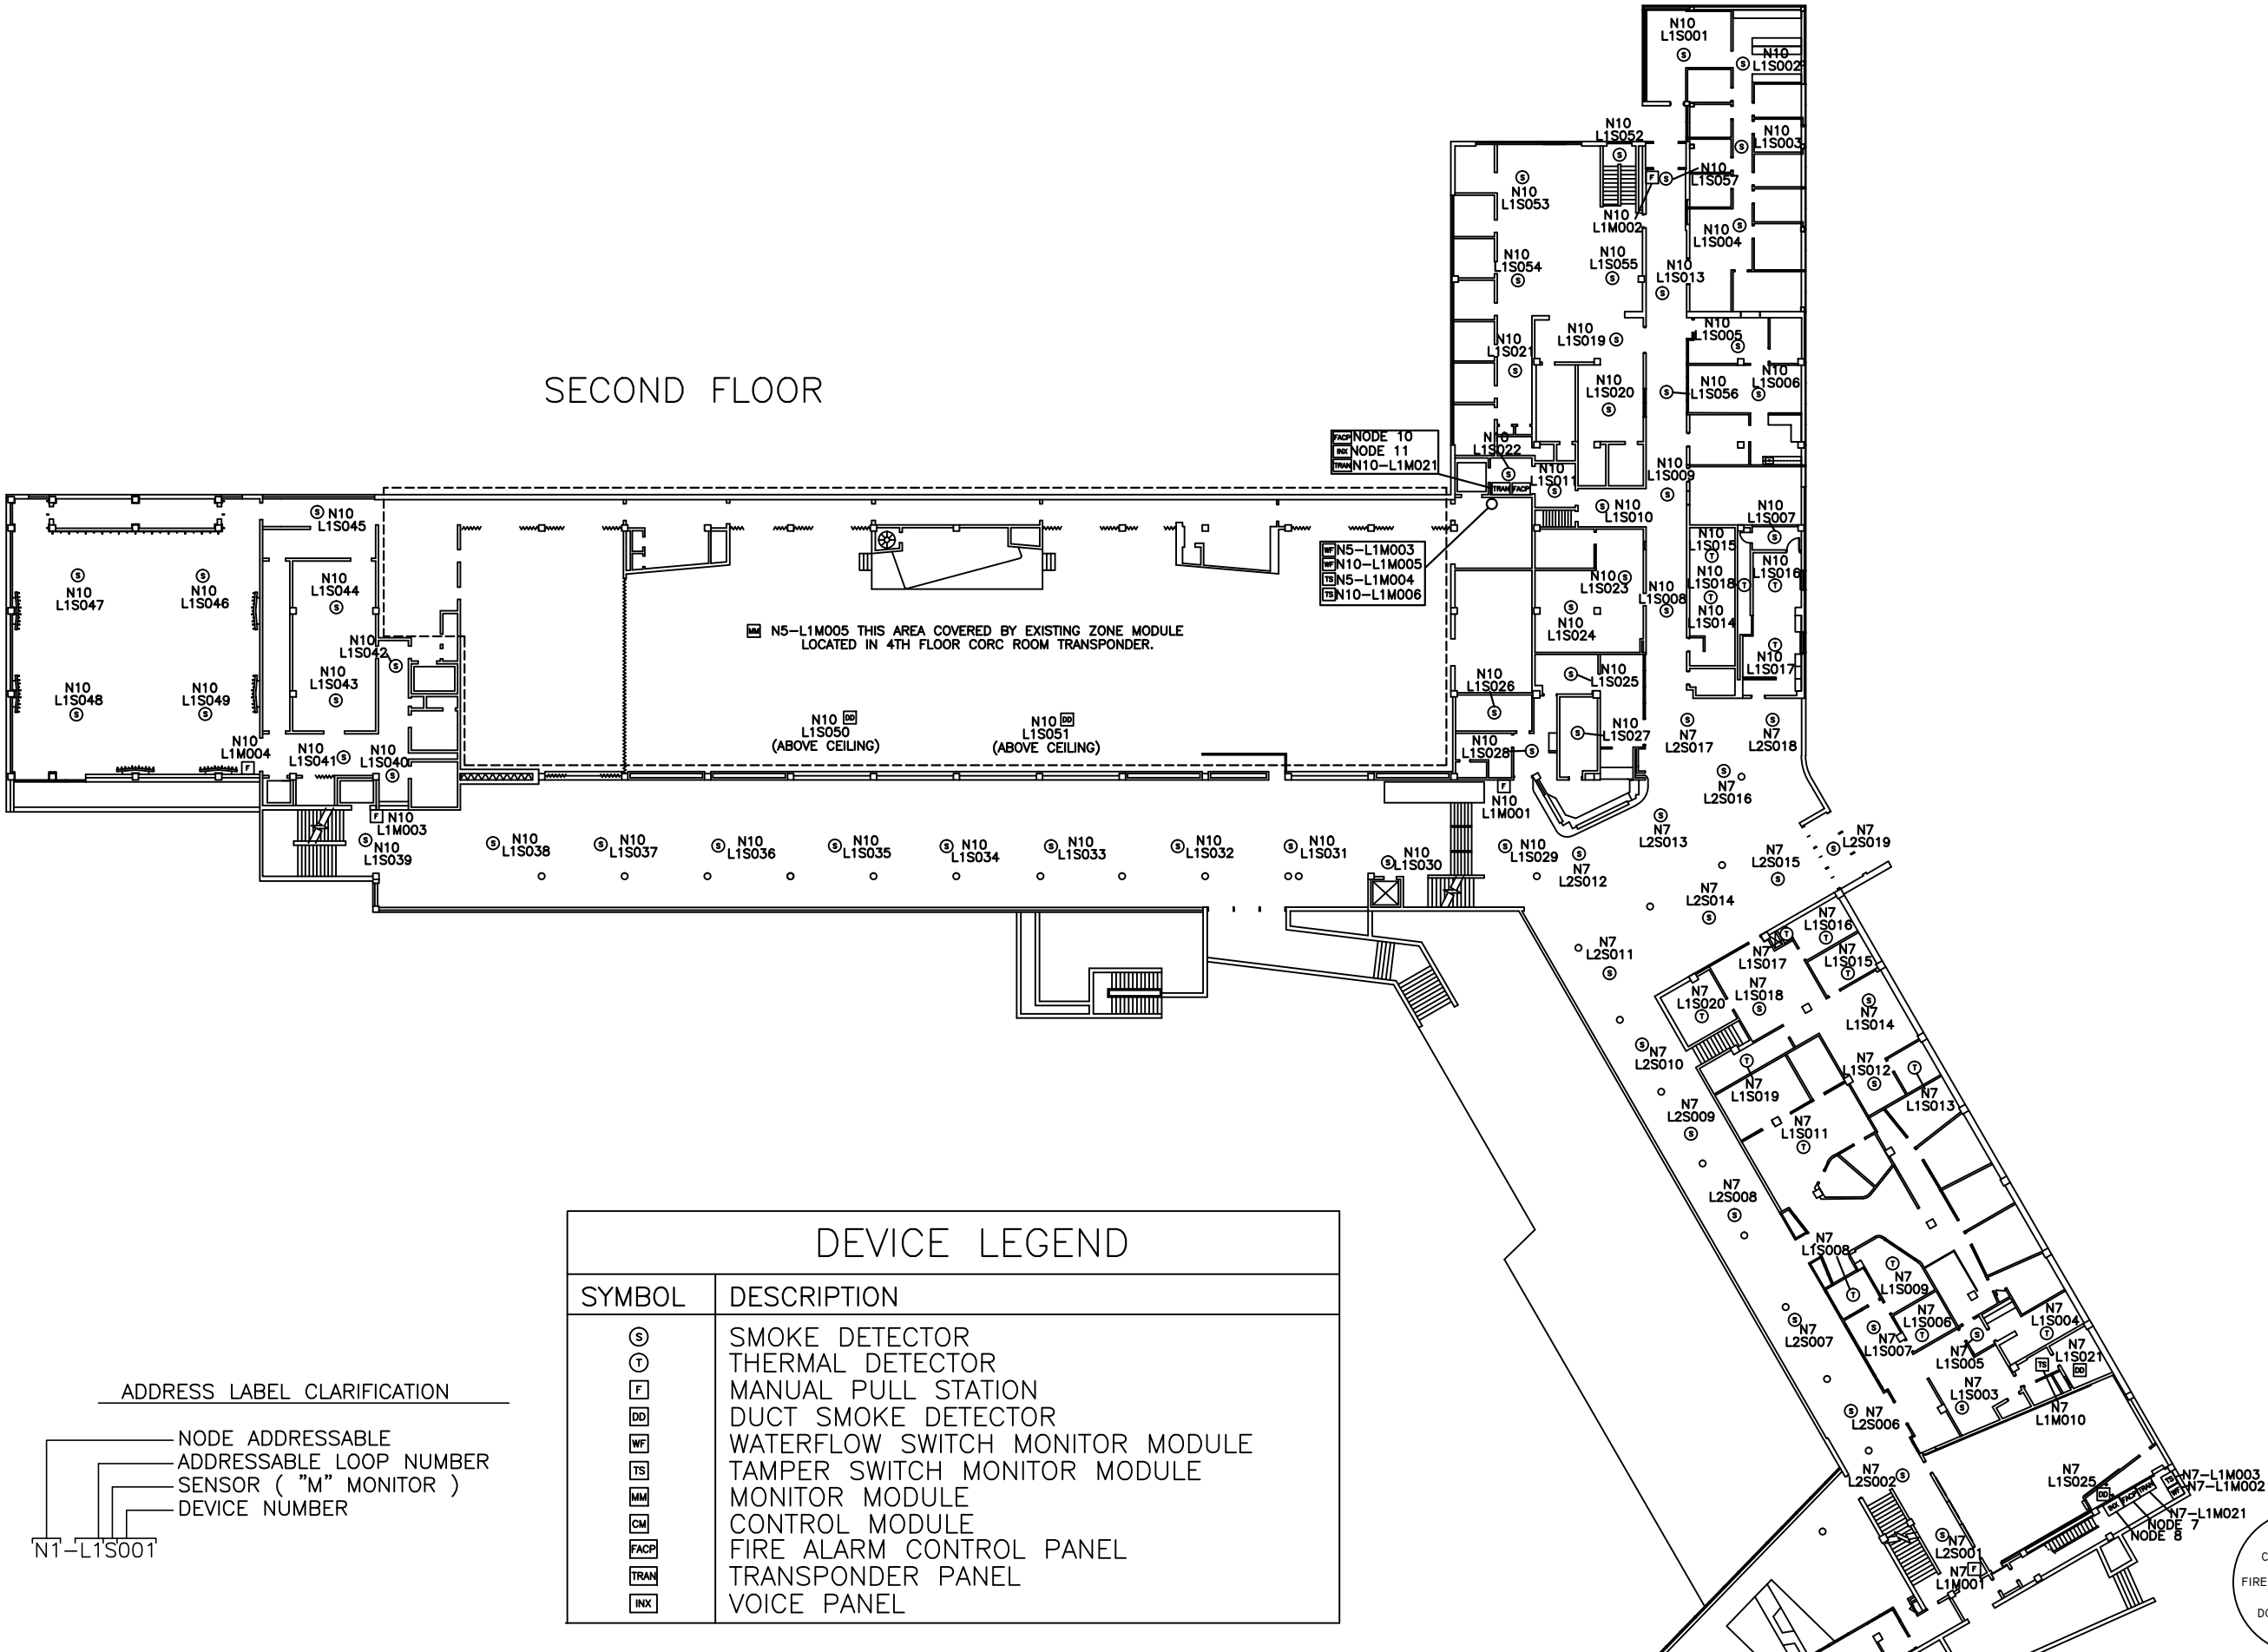

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
DD	DUCT SMOKE DETECTOR
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
INX	VOICE PANEL

ADDRESS LABEL CLARIFICATION

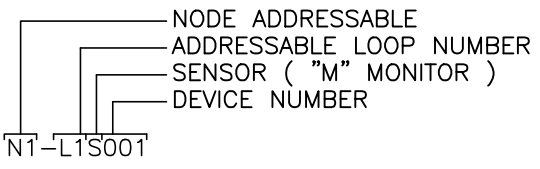

NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

OLPIN UNION PHASE III
UNIVERSITY OF UTAH
SECOND FLOOR
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	TCT
DESIGNED BY:	XXXX
APPROVED BY:	DS
DATE:	12/30/2009
SCALE:	1/16"=1'
PROJECT NO:	0053-13301
REV NO:	1
DRAWING NAME:	UNION PH 3 2ND FLOOR.DWG

FIRE ALARM SYSTEM
2ND FLOOR
ADDRESSABLE NUMBERS

PAGE:
NFS

N.I.C.E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
DONNY SCHULTZ
#104396

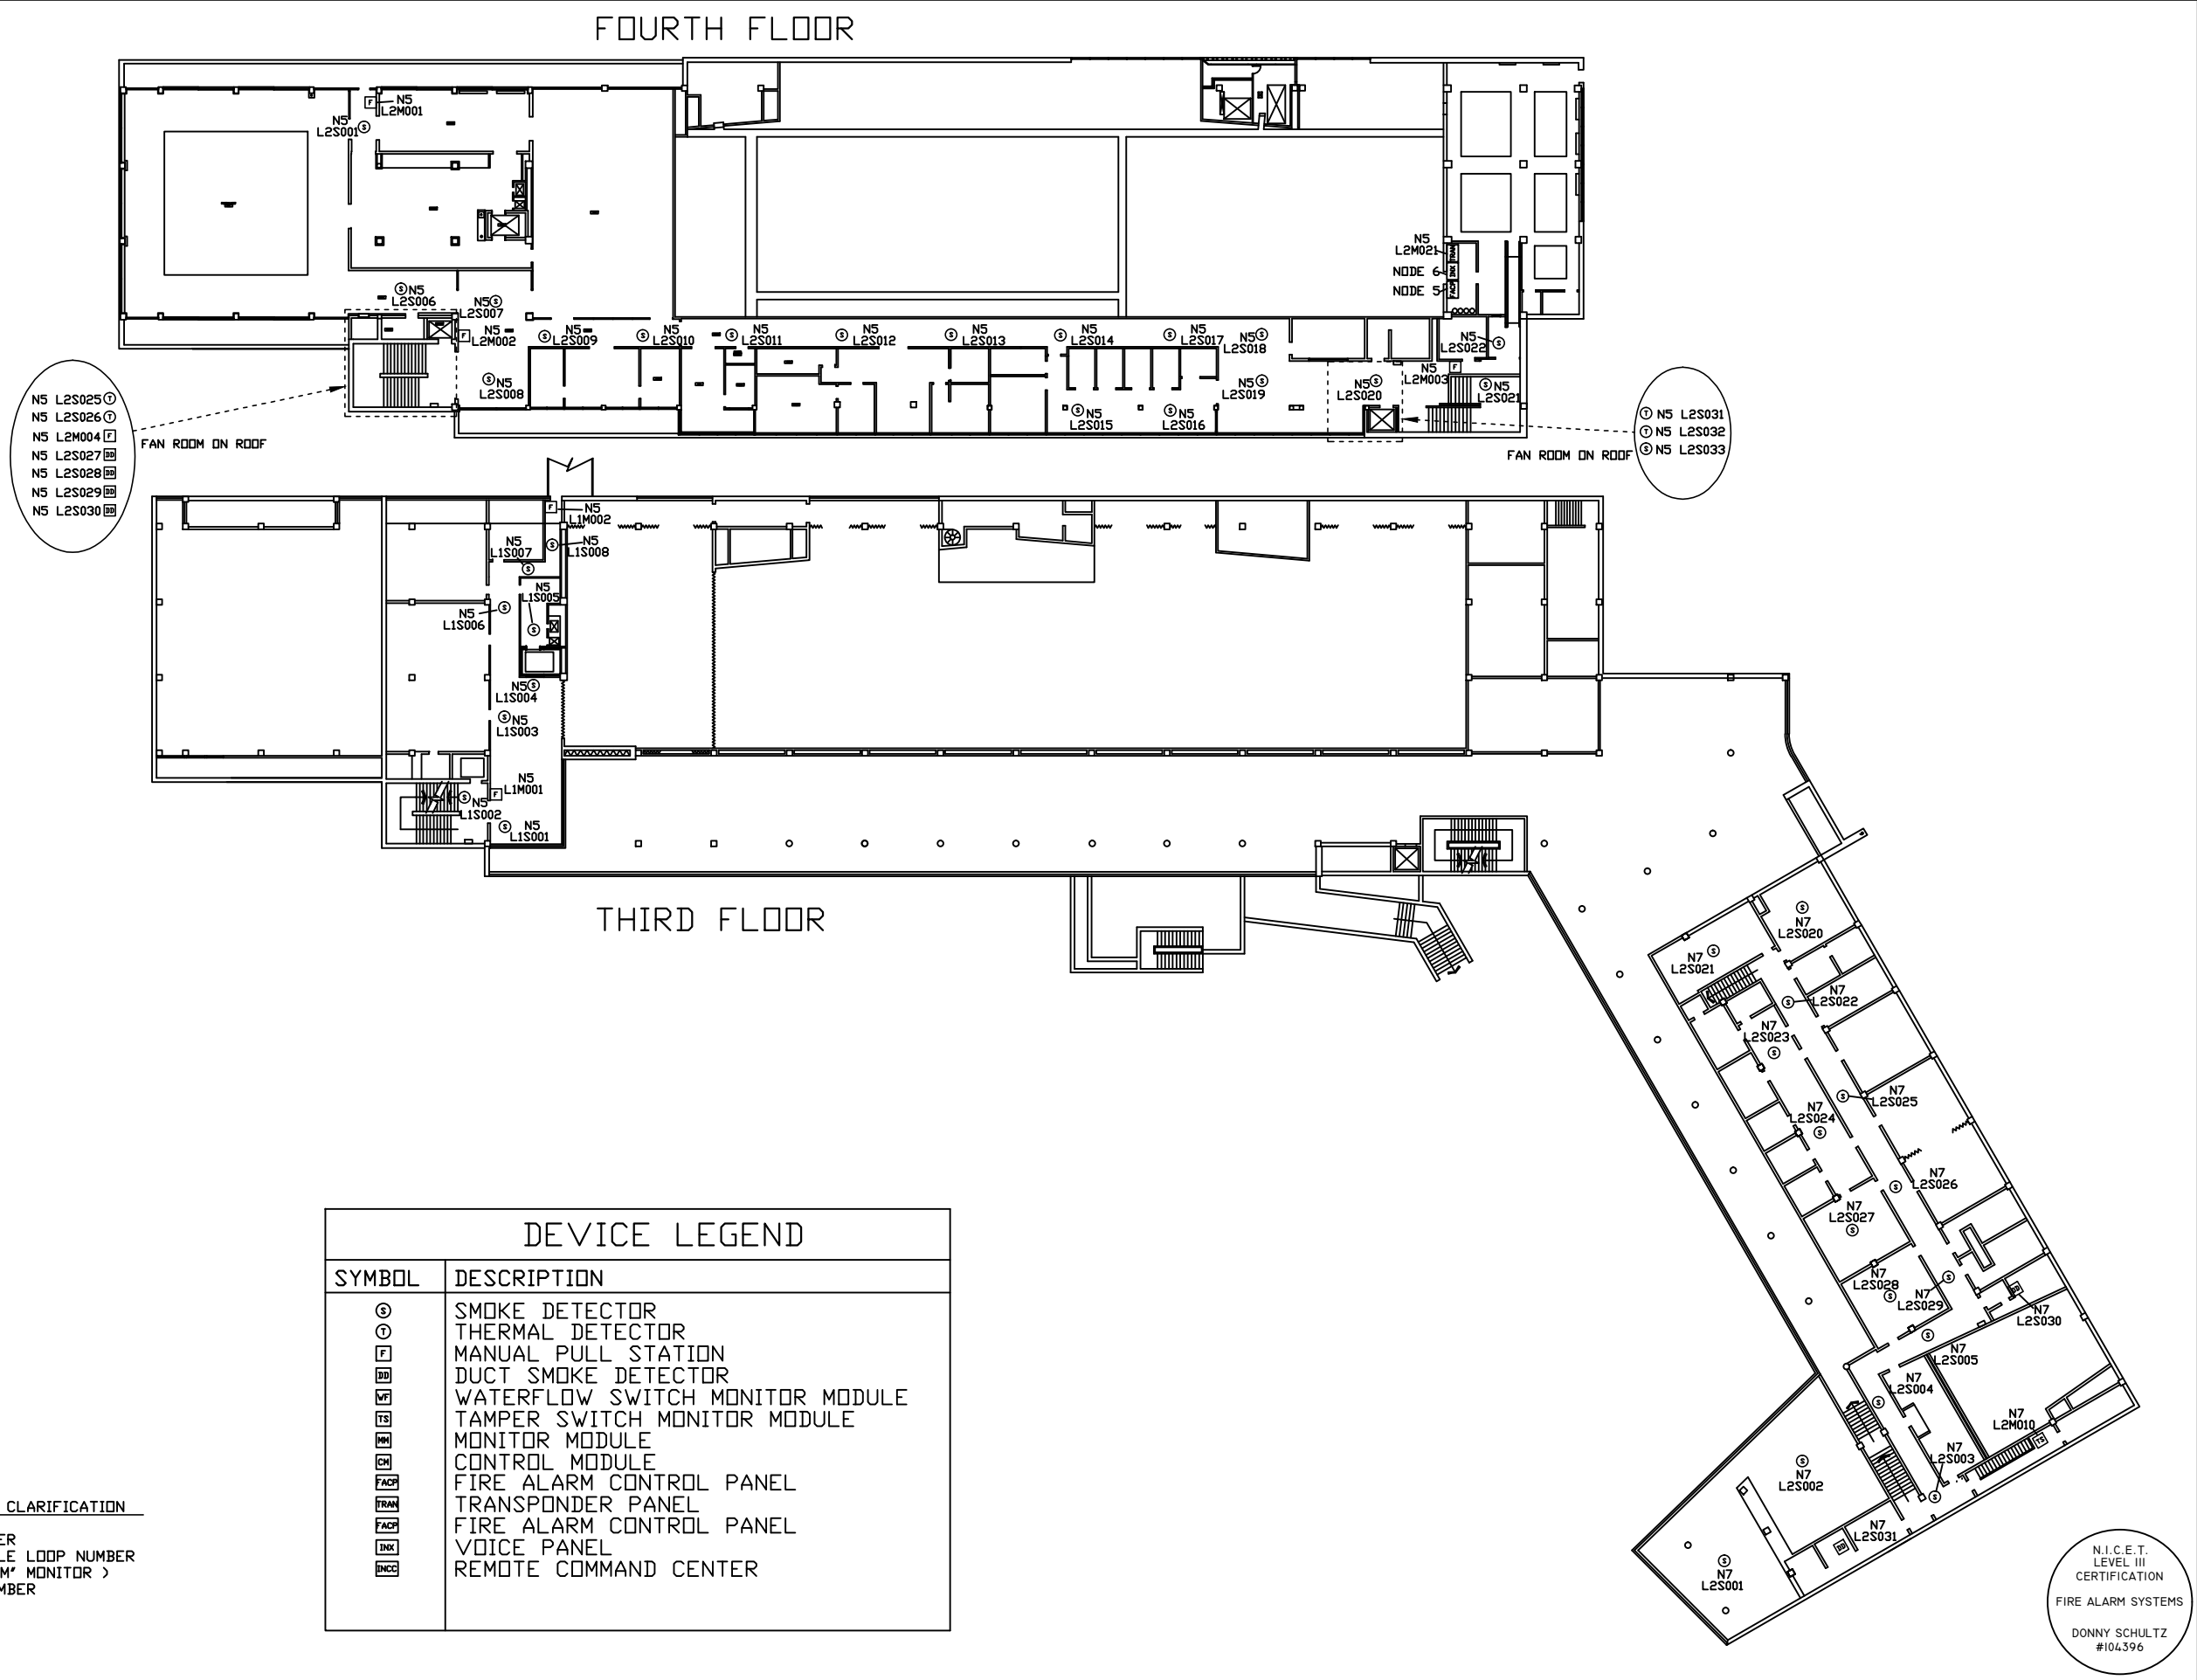

- N5 L2S025
- N5 L2S026
- N5 L2M004
- N5 L2S027
- N5 L2S028
- N5 L2S029
- N5 L2S030

- N5 L2S031
- N5 L2S032
- N5 L2S033

DEVICE LEGEND	
SYMBOL	DESCRIPTION
Ⓢ	SMOKE DETECTOR
Ⓣ	THERMAL DETECTOR
F	MANUAL PULL STATION
DB	DUCT SMOKE DETECTOR
WF	WATERFLOW SWITCH MONITOR MODULE
TS	TAMPER SWITCH MONITOR MODULE
MM	MONITOR MODULE
CM	CONTROL MODULE
FACP	FIRE ALARM CONTROL PANEL
TRAN	TRANSPONDER PANEL
FACP	FIRE ALARM CONTROL PANEL
INX	VOICE PANEL
DNCC	REMOTE COMMAND CENTER

ADDRESS LABEL CLARIFICATION

— NODE NUMBER
— ADDRESSABLE LOOP NUMBER
— SENSOR ("M" MONITOR)
— DEVICE NUMBER

N1-L1S001

NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

OLPIN UNION PHASE I
UNIVERSITY OF UTAH
THIRD FLOOR AND FOURTH FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: XXXX
APPROVED BY: TCT
DATE: 12/30/2009
SCALE: NTS
PROJECT NO: 0053-13095
REV NO: I
DRAWING NAME:
UNION 3RD AND 4TH .DWG

FIRE ALARM SYSTEM
THIRD-FOURTH FLOORS
ADDRESSABLE NUMBERS

PAGE:
NFS