


ADDRESS LABEL CLARIFICATION
 ADDRESSABLE LOOP NUMBER
 SENSOR ("M" MONITOR)
 DEVICE NUMBER

DEVICE LEGEND	
SYMBOL	DESCRIPTION
⊙	SMOKE DETECTOR W/BASE
⊙	MANUAL PULL STATION
⊙	DUCT SMOKE DETECTOR
⊙	WATERFLOW SWITCH MONITOR MODULE
⊙	TAMPER SWITCH MONITOR MODULE
⊙	STROBE LIGHT
⊙	SPEAKER/STROBE
⊙	WEATHERPROOF SPEAKER
⊙	MONITOR MODULE
⊙	CONTROL MODULE
⊙	DOORHOLDER
⊙	REMOTE ANNUNCIATOR ENCLOSURE
⊙	FIRE ALARM CONTROL PANEL
⊙	TRANSPONDER PANEL

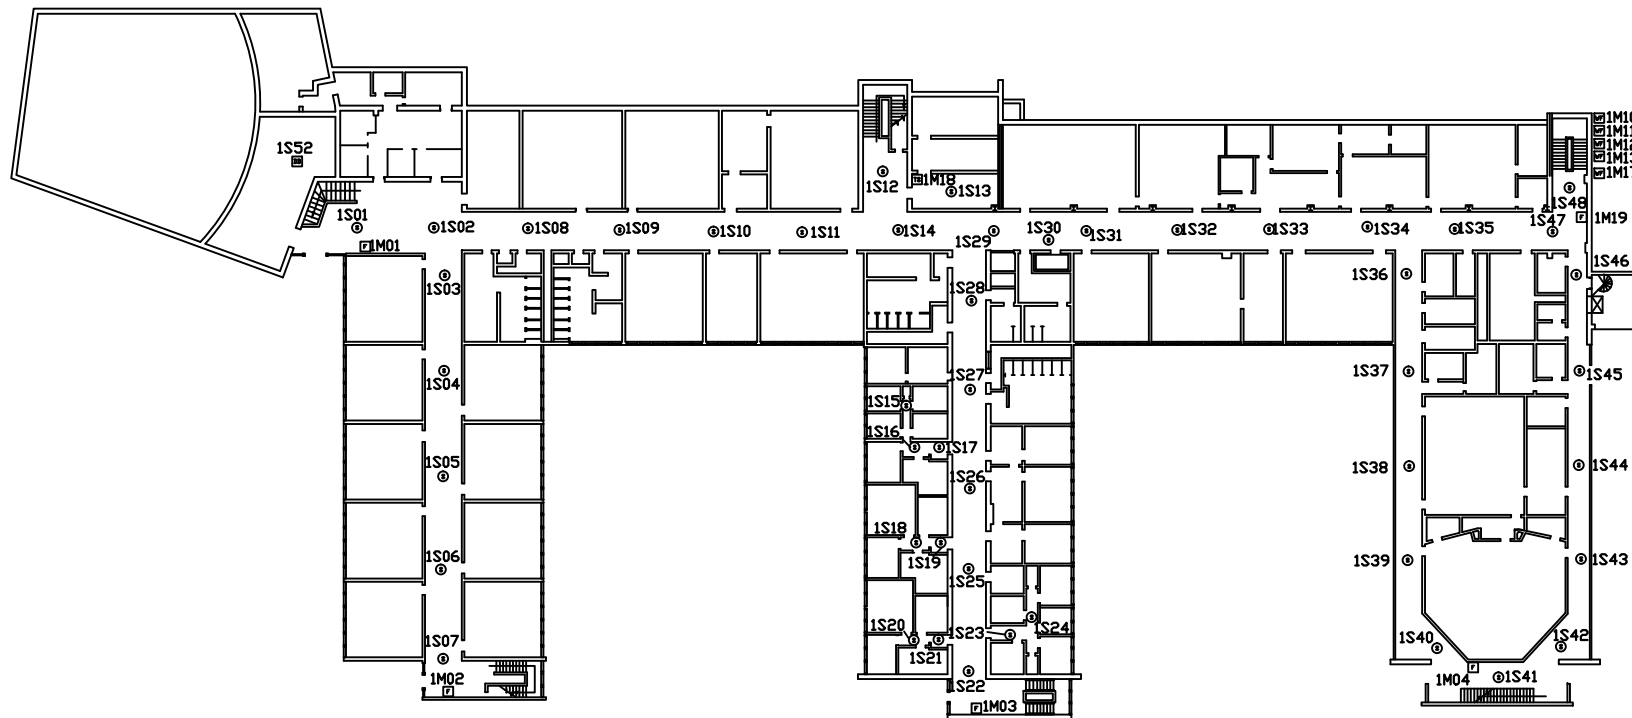

1M05
1M06
1M07
1M08
1M09
1M16

NOTE:
 NFS DRAWINGS ARE BASED ON THE PROJECT
 INFORMATION PROVIDED BY THE CLIENT. NFS
 ASSUMES NO LIABILITY FOR ANY DISCREPANCIES
 (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
 QUANTITY OF DEVICES SHOWN ON THE A/E PLANS.
 NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
 AND OTHER DEVICES SHOWN ON THE A/E PLANS.
 NFS IS NOT RESPONSIBLE FOR THE
 CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
 THE INFORMATION SHOWN ON THE A/E PLANS.

ORSON SPENCER HALL
 LEVEL 1
 FIRE ALARM SYSTEM
 UNIVERSITY OF UTAH
 SALT LAKE CITY, UTAH


NFS
 NELSON FIRE SYSTEMS
 801-468-8300

DRAWN BY: DB
 DESIGNED BY: XXXX
 APPROVED BY: XXXX
 DATE: 5/23/05
 SCALE: N.T.S.
 PROJECT NO: XXXX
 REV NO: XXXX
 DRAWING NAME: OSH 1ST.DWG.

FIRE ALARM SYSTEM
 1ST FLR DEVICE NUMBERS

PAGE:

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR W/BASE
	MANUAL PULL STATION
	DET SMOKE DETECTOR
	WATERPROOF SWITCH MONITOR MODULE
	TAMPER SWITCH MONITOR MODULE
	STROBE LIGHT
	SPEAKER/STROBE
	WEATHERPROOF SPEAKER
	MONITOR MODULE
	CONTROL MODULE
	DOORHOLDER
	REMOTE ANNUNCIATOR ENCLOSURE
	FIRE ALARM CONTROL PANEL
	TRANSPONDER PANEL

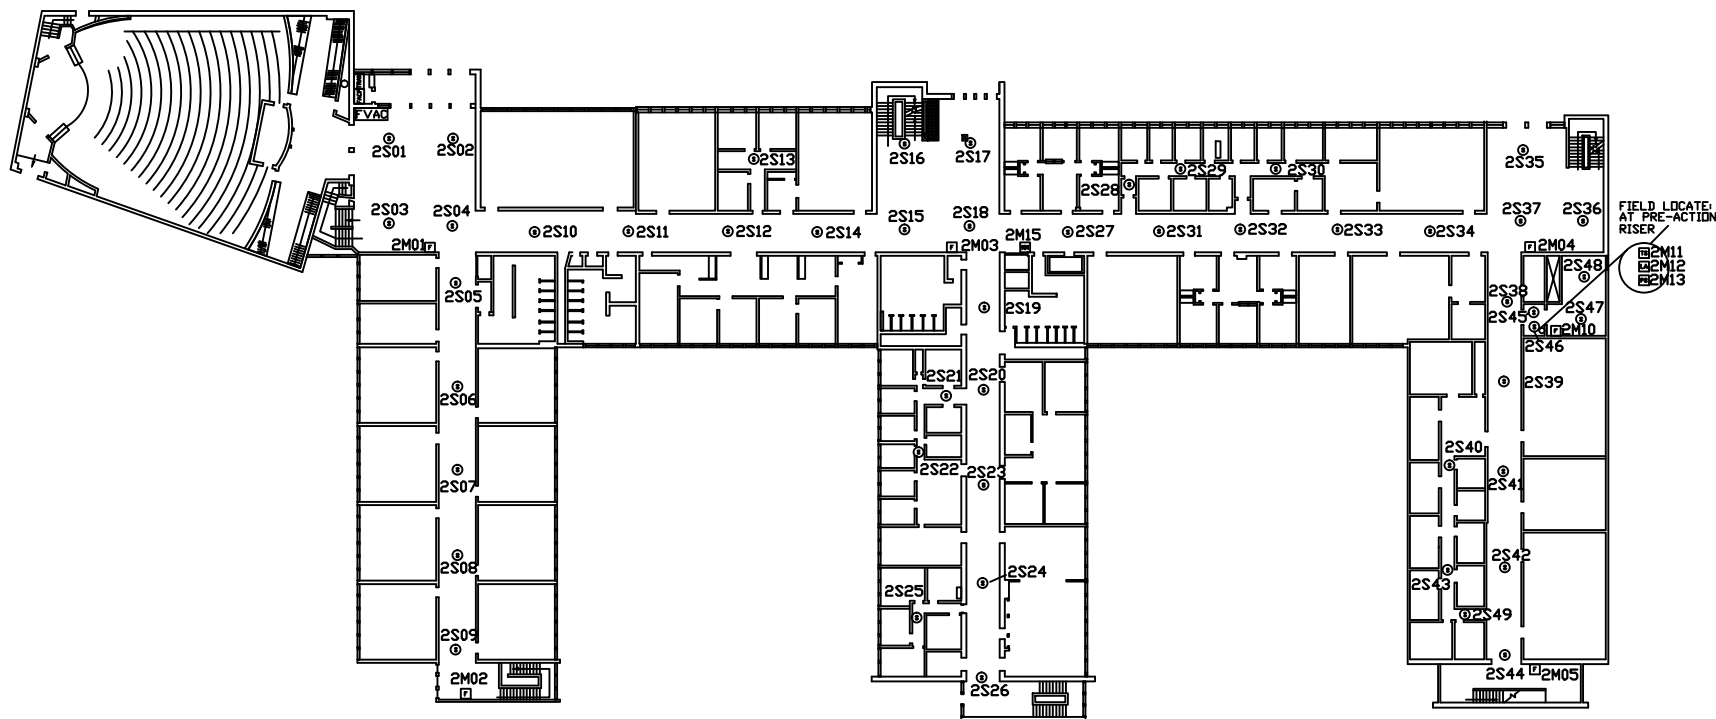

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
FOR THE TYPE, SIZE, LOCATION, AND
QUANTITY OF THE DEVICES SHOWN ON THE PANELS.
OTHER DEVICES SHOWN ON THE PANELS,
WHICH ARE NOT SHOWN ON THE A/E PLANS,
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
CONNECTIONS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

ORSON SPENCER HALL
LEVEL 2
FIRE ALARM SYSTEM
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH

NFS
NELSON FIRE SYSTEM
801-468-8300

DRAWN BY:	DB
DESIGNED BY:	XXXX
APPROVED BY:	XXXX
DATE:	1/8/2010
SCALE:	N.T.S.
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	
	OSH 2ND.DWG

FIRE ALARM SYSTEM


2ND FLR DEVICE NUMBER

PAGE:


ADDRESS LABEL CLARIFICATION
 ADDRESSABLE LOOP NUMBER
 SENSOR ("M" MONITOR)
 DEVICE NUMBER

SYMBOL	DESCRIPTION
①	SMOKE DETECTOR W/BASE
②	MANUAL PULL STATION
③	DUCT SMOKE DETECTOR
④	WATERFLOW SWITCH MONITOR MODULE
⑤	TAMPER SWITCH MONITOR MODULE
⑥	STROBE LIGHT
⑦	SPEAKER/STROBE
⑧	WEATHERPROOF SPEAKER
⑨	MONITOR MODULE
⑩	CONTROL MODULE
⑪	DOORHOLDER
⑫	REMOTE ANNUNCIATOR ENCLOSURE
⑬	FIRE ALARM CONTROL PANEL
⑭	TRANSPONDER PANEL

BASEMENT

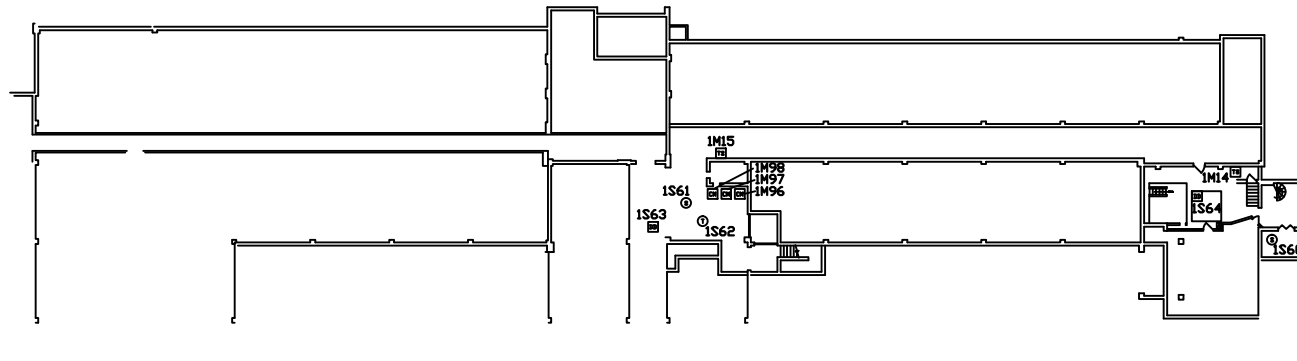

THIRD FLOOR

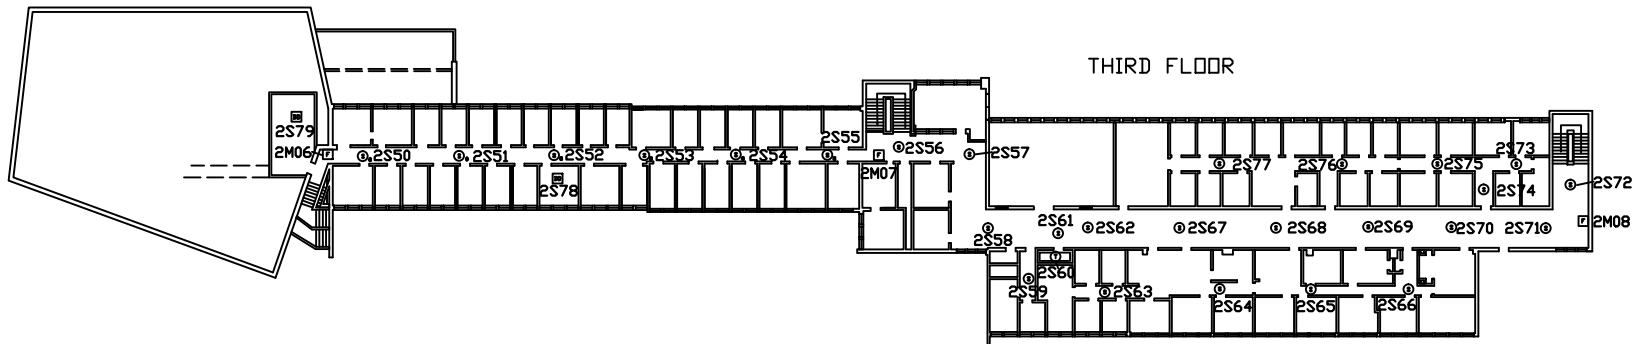

NOTE:
 NFS DRAWINGS ARE BASED ON THE PROJECT
 PROVIDED INFORMATION AND ASSUMPTIONS.
 (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
 PERFORMANCE OF THE DEVICES, PANELS,
 AND OTHER DEVICES SHOWN ON THE A/E PLANS.
 NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
 AND CONNECTIONS TO THE DEVICES AND
 CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
 THE INFORMATION SHOWN ON THE A/E PLANS.



ORSON SPENCER HALL
 LEVEL 3
 FIRE ALARM SYSTEM
 UNIVERSITY OF UTAH
 SALT LAKE CITY, UTAH

NFS
 NELSON FIRE SYSTEMS
 801-468-8300

DRAWN BY: DB
 DESIGNED BY: XXXXX
 APPROVED BY: XXXXX
 DATE: 5/23/05
 SCALE: N.T.S.
 PROJECT NO: XXXXX
 REV NO: XXXXX
 DRAWING NAME: OSH 3RD.DWG.

FIRE ALARM SYSTEM
 BASEMENT AND 3RD FLOOR
 DEVICE NUMBERS

PAGE:



FIREVAC
VOICE EVACUATION SYSTEM
(EXISTING)

- 1) ENTER ALL SPEAKER CIRCUITS THROUGH TOP OF PANEL
RIGHT AND LEFT 4 INCHES.
- 2) DO NOT ENTER CONDUIT THROUGH BOTTOM OF PANEL.

CABINET SIZE
38" HIGH
21" WIDE
4" DEEP



FIRE ALARM CONTROL PANEL
(EXISTING)

CABINET SIZE
38" HIGH
21" WIDE
4" DEEP

3/4" CONDUIT
FOR BATTERY CABLE

CABINET SIZE
10" HIGH
22" WIDE
8" DEEP

BATTERY CABINET

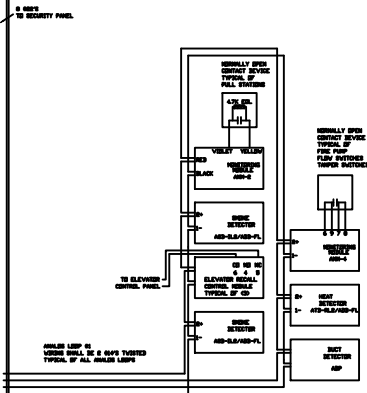

FIRE ALARM TRANSPONDER
TYPICAL OF (3)
MAXIMUM OF 8 STROBES PER CIRCUIT
MAXIMUM OF 24 SPEAKERS PER CIRCUIT
SPEAKER CIRCUIT WIRING MUST BE INSTALLED
IN SEPARATE RACEWAY FROM ALL
ADDRESSABLE LOOPS

CABINET SIZE
38" HIGH
21" WIDE
4" DEEP

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
SPECIFICATIONS AND ANY CHANGES OR
MODIFICATIONS TO THE PROJECT
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
QUANTITY OF DEVICES SHOWN ON THE A/E PLANS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
AND CONNECTIONS TO THE DEVICES SHOWN ON
THE A/E PLANS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

ORSON SPENCER HALL
FIRE ALARM SYSTEM UPGRADE
MAIN FIRE ALARM RISER DIAGRAM
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DB
DESIGNED BY: XXXXX
APPROVED BY: XXXXX
DATE: 9/8/2004
SCALE: N.T.S.
PROJECT NO.: XXXXX
REV NO.: XXXXX
DRAWING NAME:
OSH F.D.W.C.

FIRE ALARM SYSTEM

PAGE:
FA-R-01