



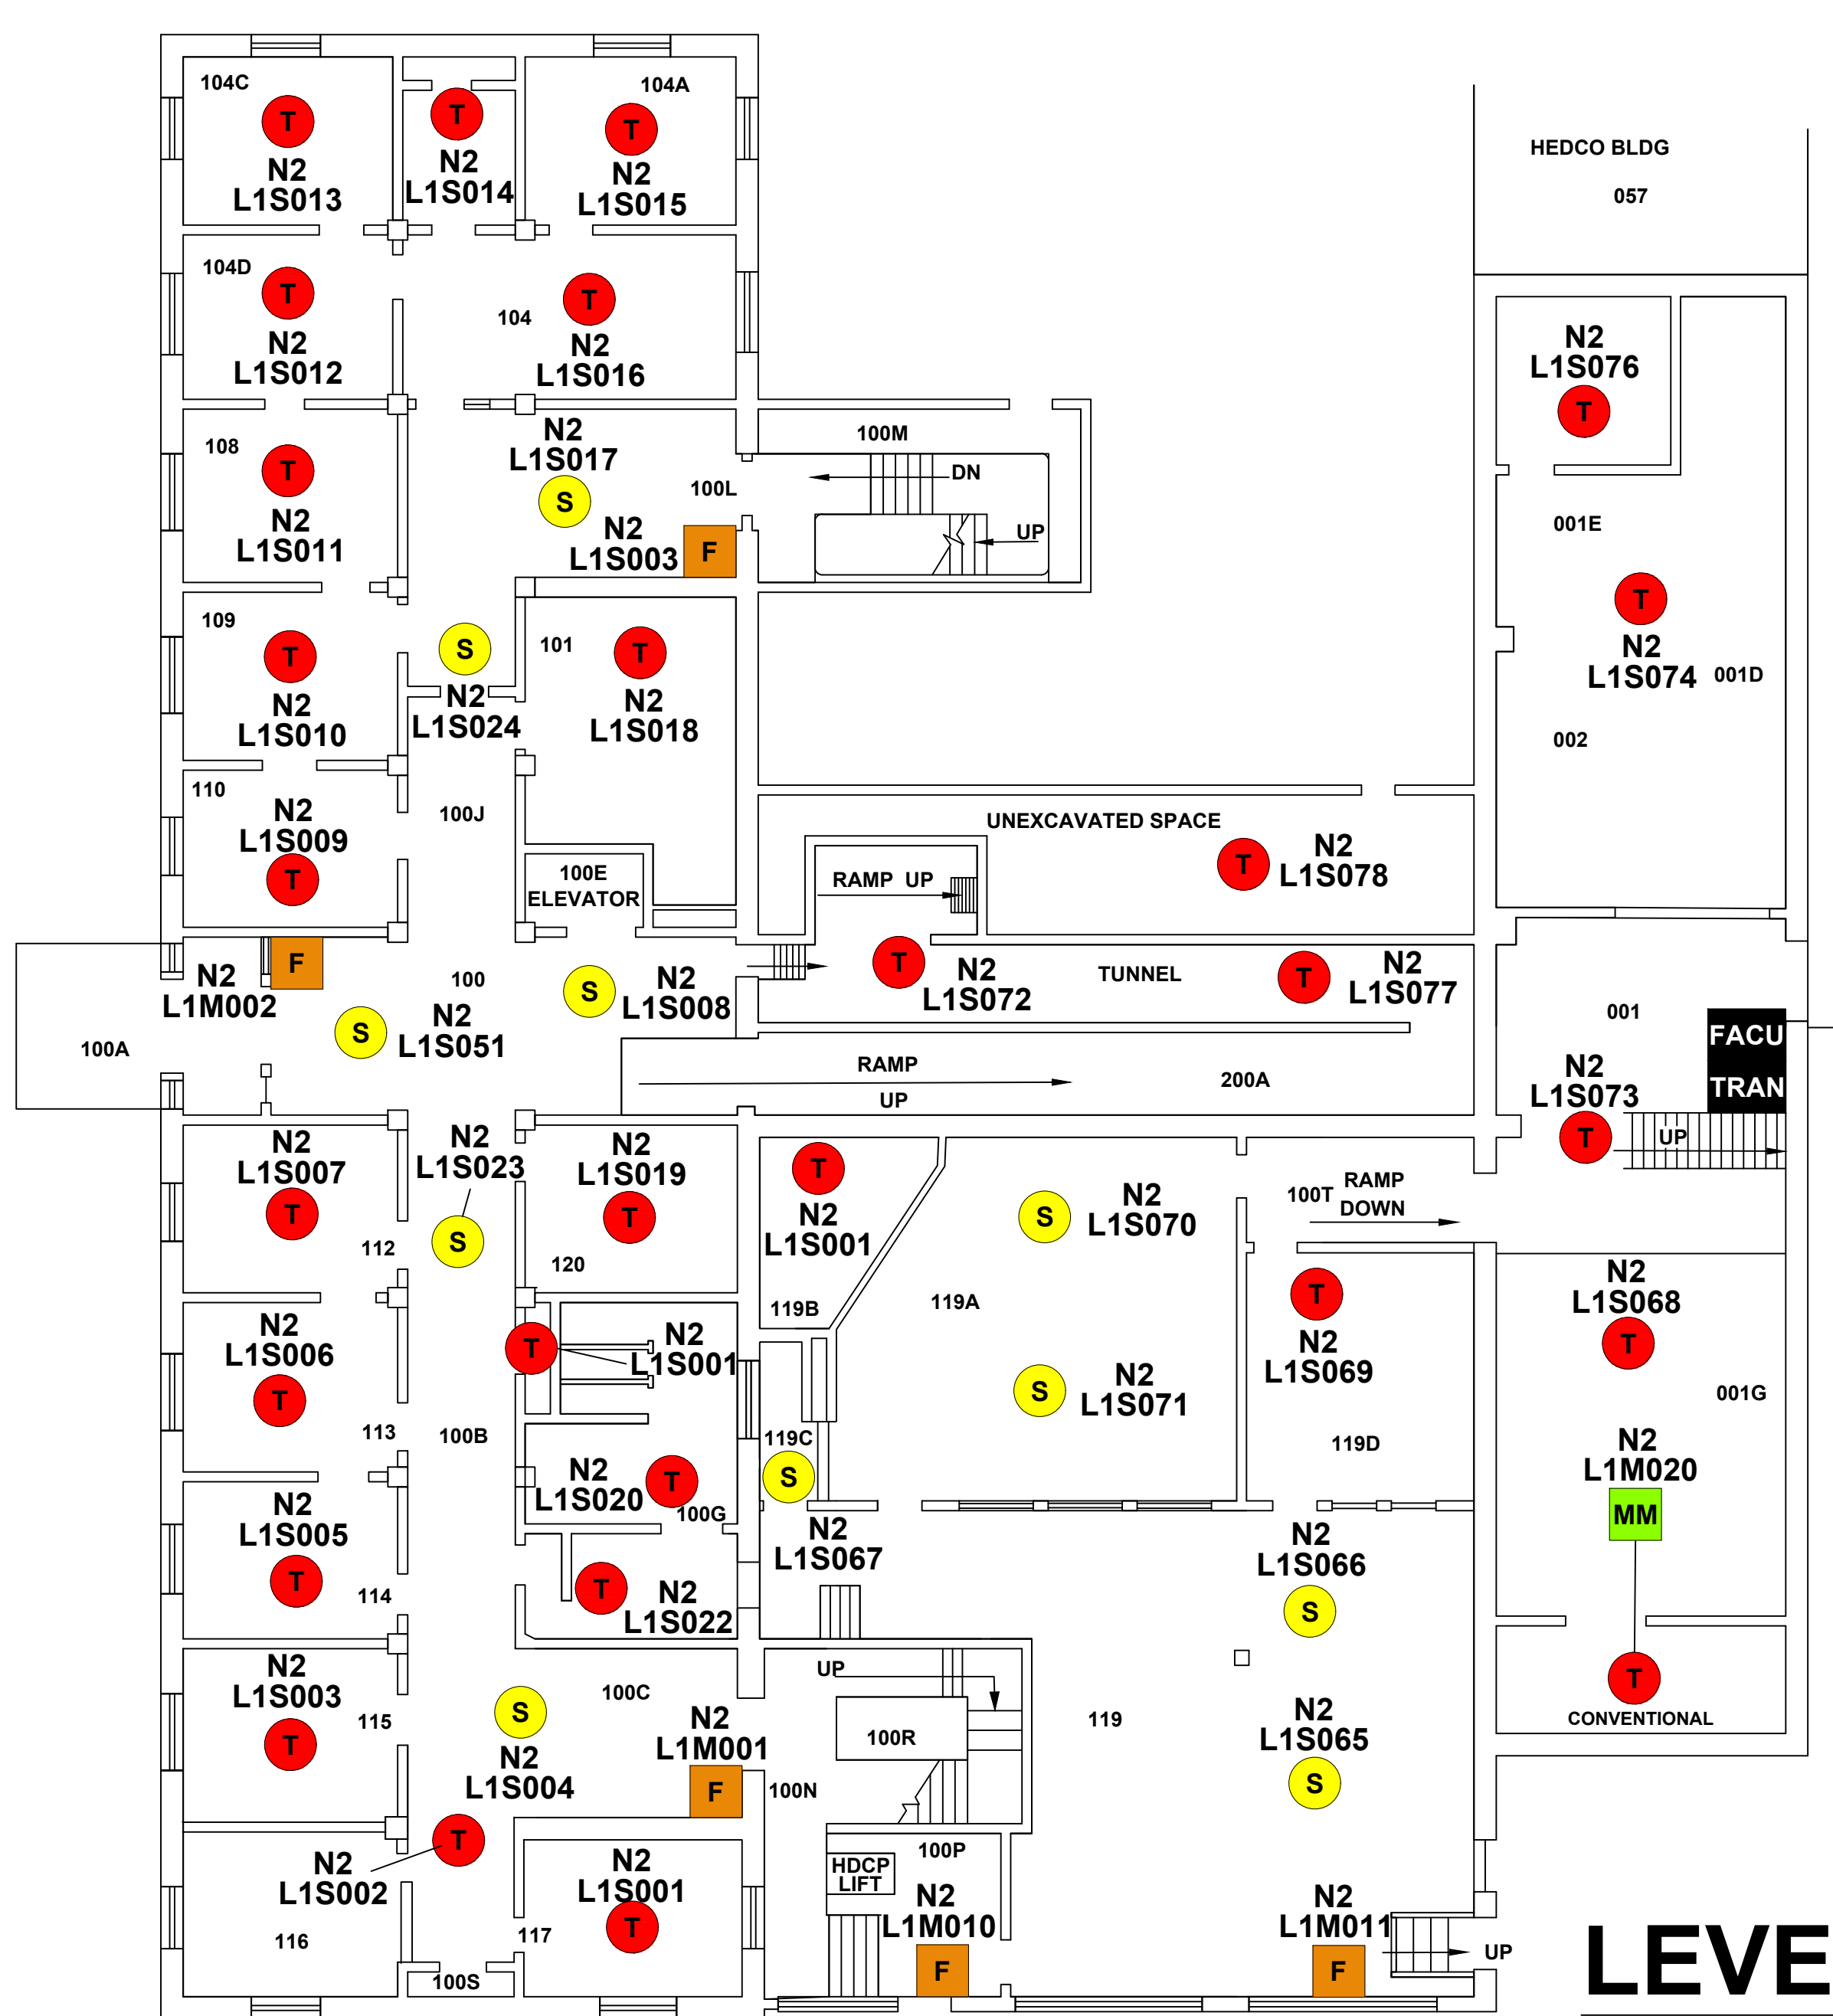

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	HEAT DETECTOR
	PULL STATION
	MONITOR MODULE
	FIRE ALARM CONTROL UNIT
	TRANSPONDER PANEL



NOTE: ALL DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. NFS IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

HEDCO BUILDING 56
UNIVERSITY OF UTAH
112 SOUTH CENTRAL CAMPUS DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: BH
DESIGNED BY: XXXX
APPROVED BY: KK
DATE: 09/11/2023
SCALE: N.T.S.
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
HEDCO 56 FINAL MAP 1.DWG

NELSON FIRE SYSTEMS
LEVEL 1

PAGE:
FINAL MAP




LEVEL 1




TAMPER SWITCH MODULE



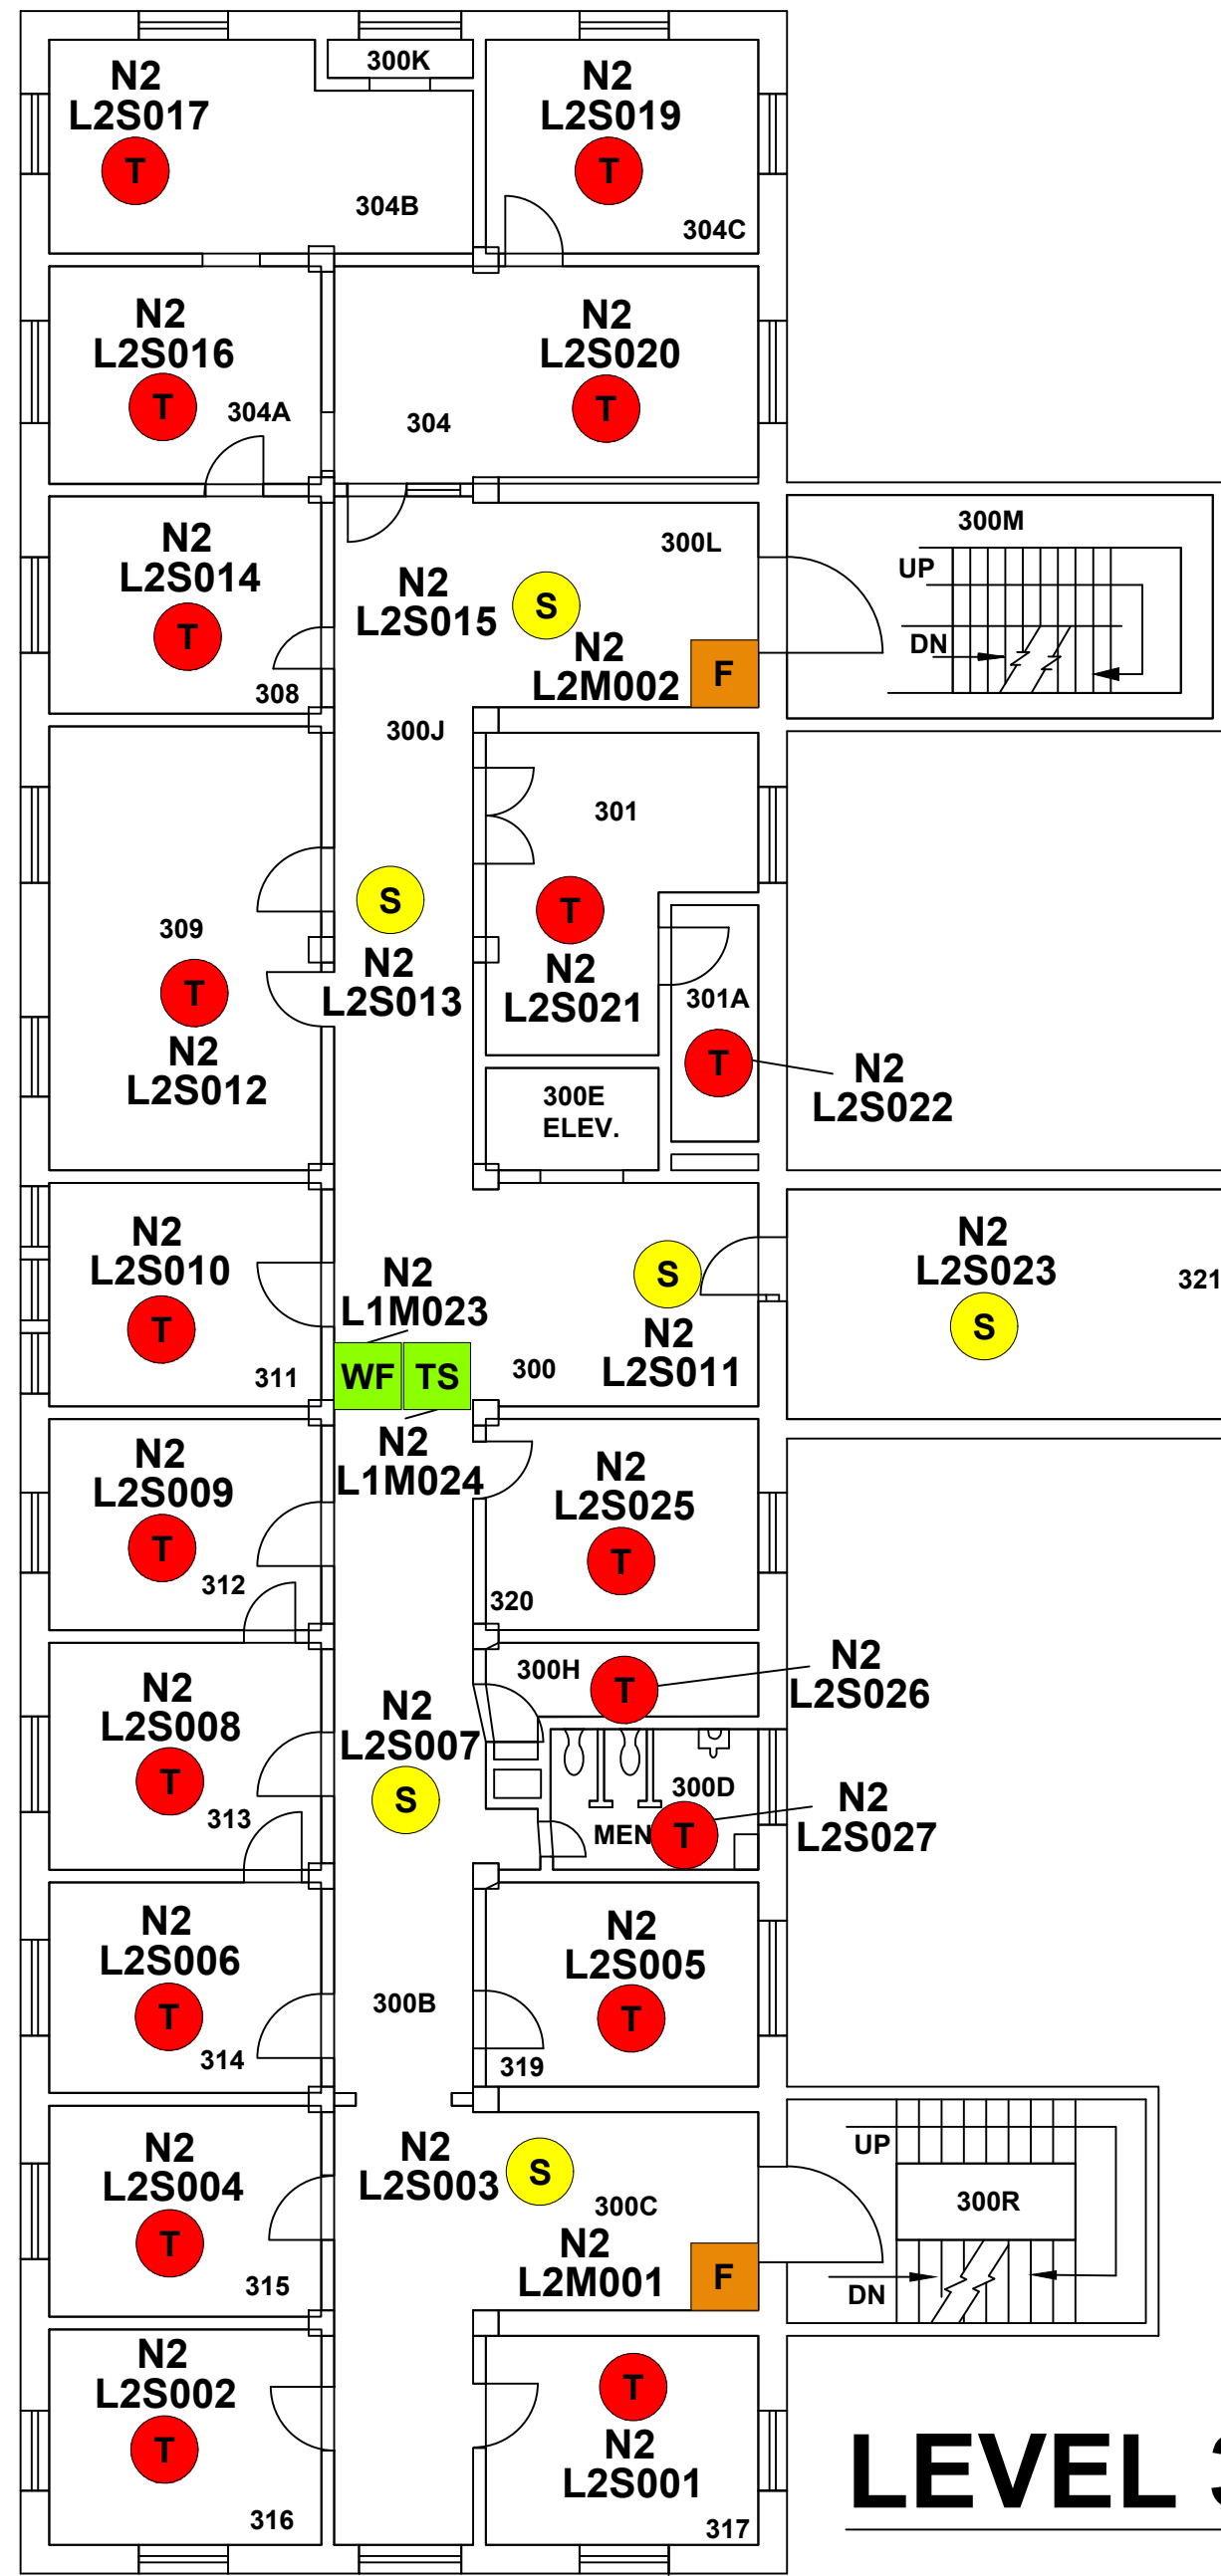

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	HEAT DETECTOR
	PULL STATION
	WATER FLOW SWITCH MODULE
	TAMPER SWITCH MODULE



NOTE: ALL DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. NFS IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

HEDCO BUILDING 56
UNIVERSITY OF UTAH
112 SOUTH CENTRAL CAMPUS DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	BH
DESIGNED BY:	XXXX
APPROVED BY:	KK
DATE:	09/11/2023
SCALE:	N.T.S.
PROJECT NO:	XXXX
REVISION NO:	XXXX
DRAWING NAME:	HEDCO 56 FINAL MAP 3.DWG

NELSON FIRE SYSTEMS
LEVEL 3


PAGE:
FINAL MAP



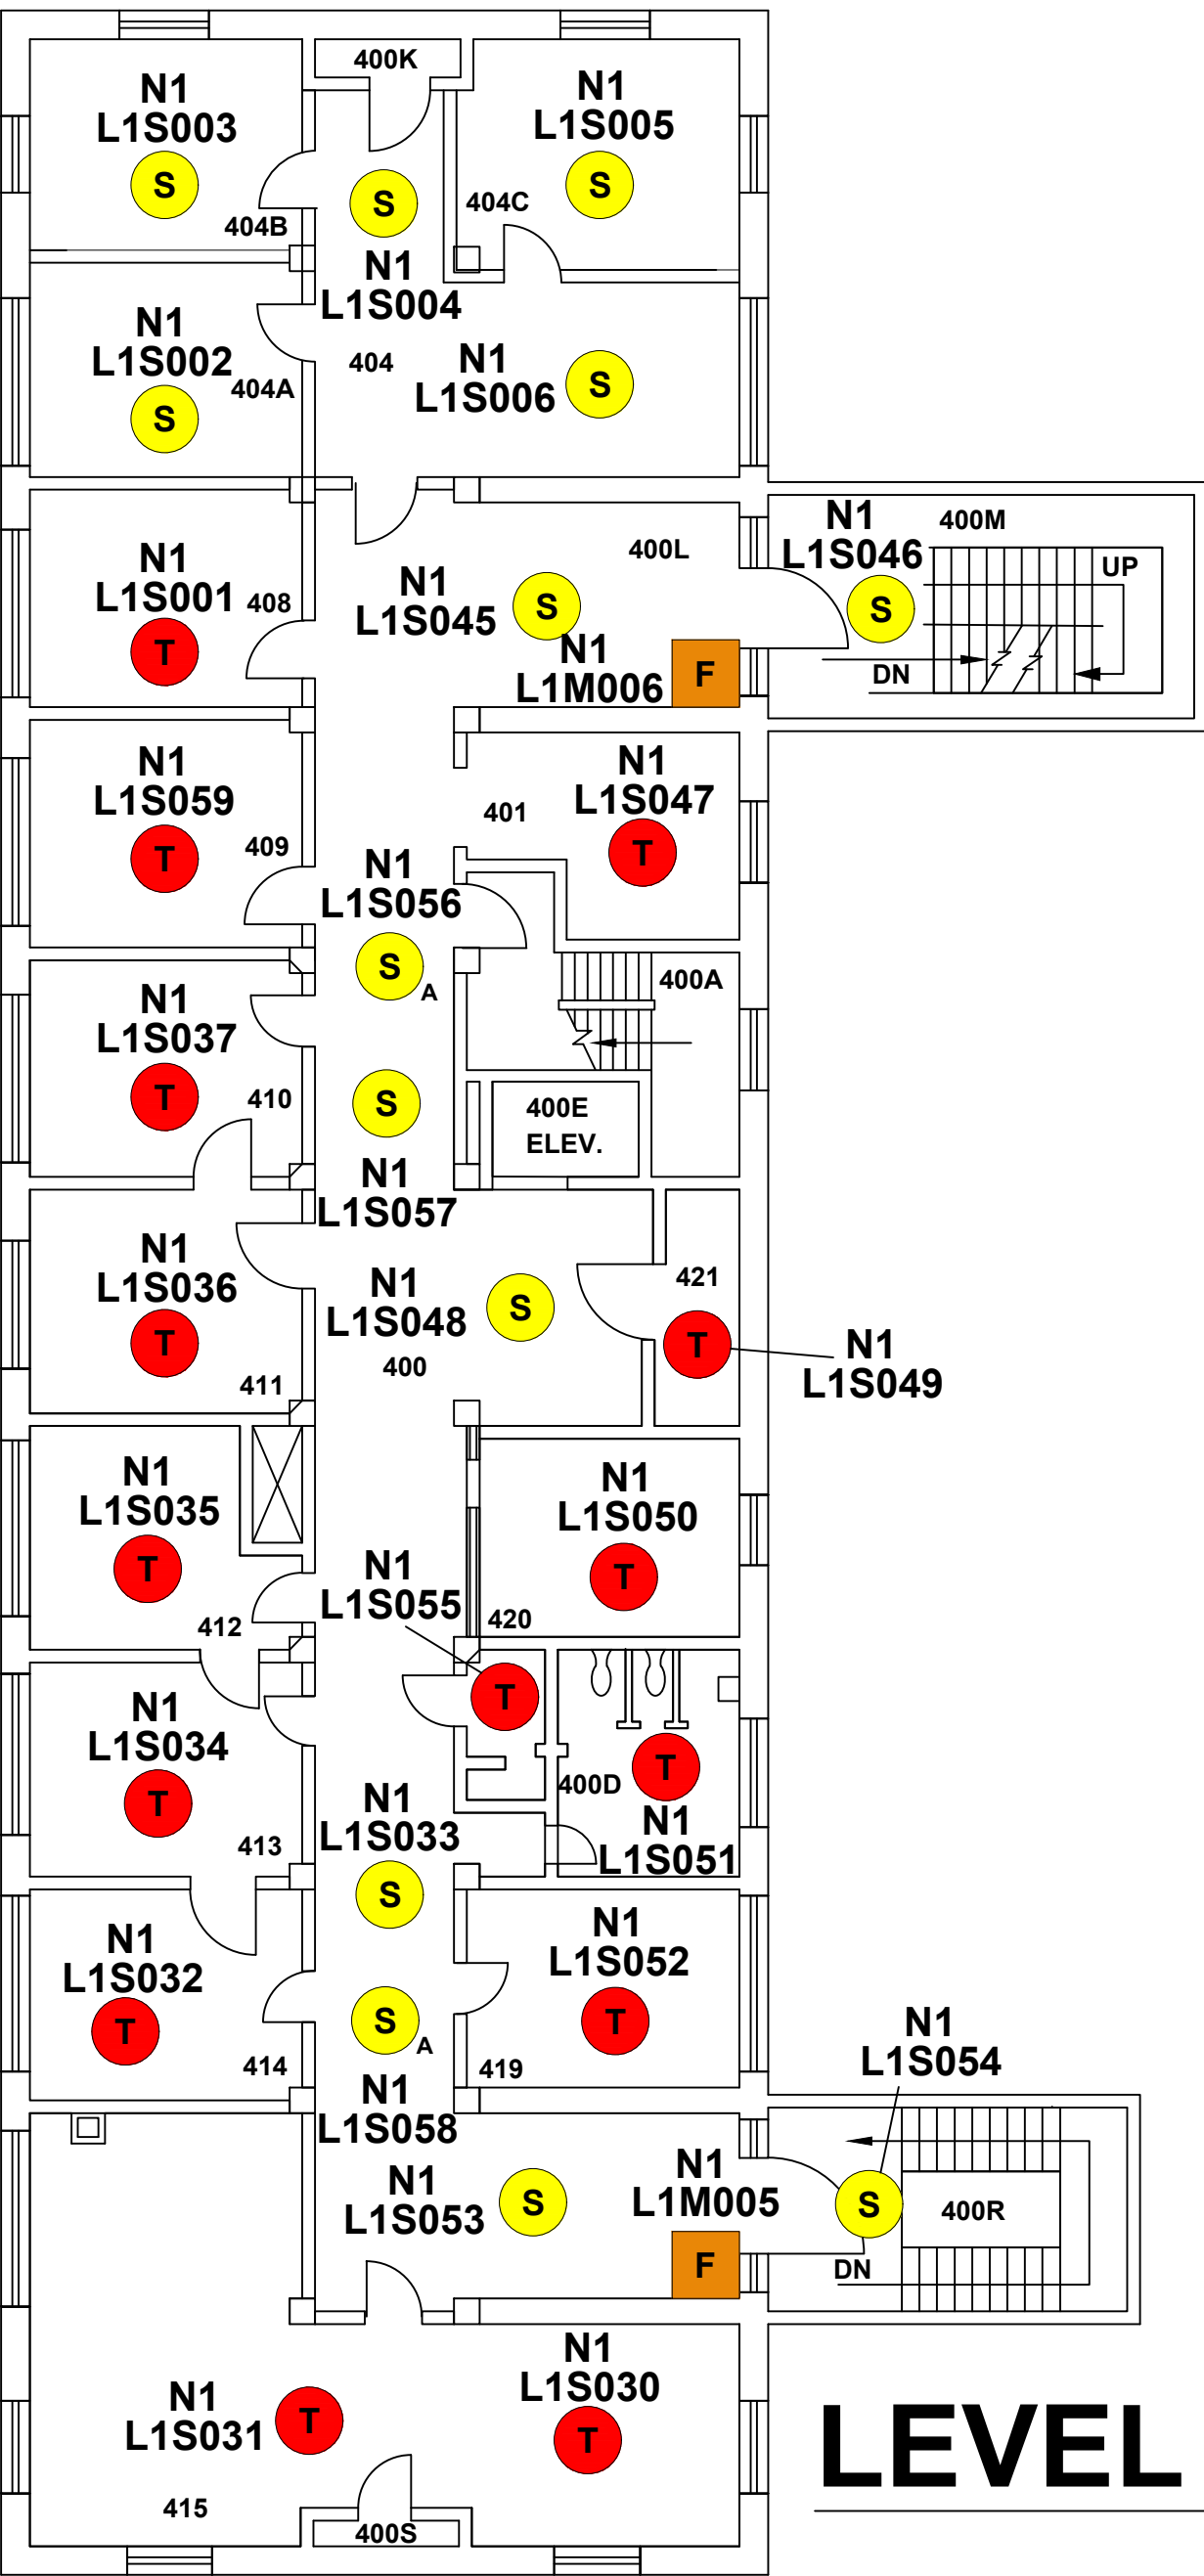

LEVEL 4

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	SMOKE DETECTOR AUDIBLE BASE
	HEAT DETECTOR
	PULL STATION



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT ARCHITECTURE (A/E) PLANS AND SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS, AND OTHER DEVICES SHOWN ON THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY THE WIRING DIAGRAMS BETWEEN FIRE ALARM DEVICES AND CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR THE INFORMATION SHOWN ON THE A/E PLANS.

HEDCO BUILDING 56
UNIVERSITY OF UTAH
112 SOUTH CENTRAL CAMPUS DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: BH
DESIGNED BY: XXXX
APPROVED BY: KK
DATE: 09/11/2023
SCALE: N.T.S.
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
HEDCO 56 FINAL MAP 4.DWG


NELSON FIRE SYSTEMS
LEVEL 4

PAGE:
FINAL MAP



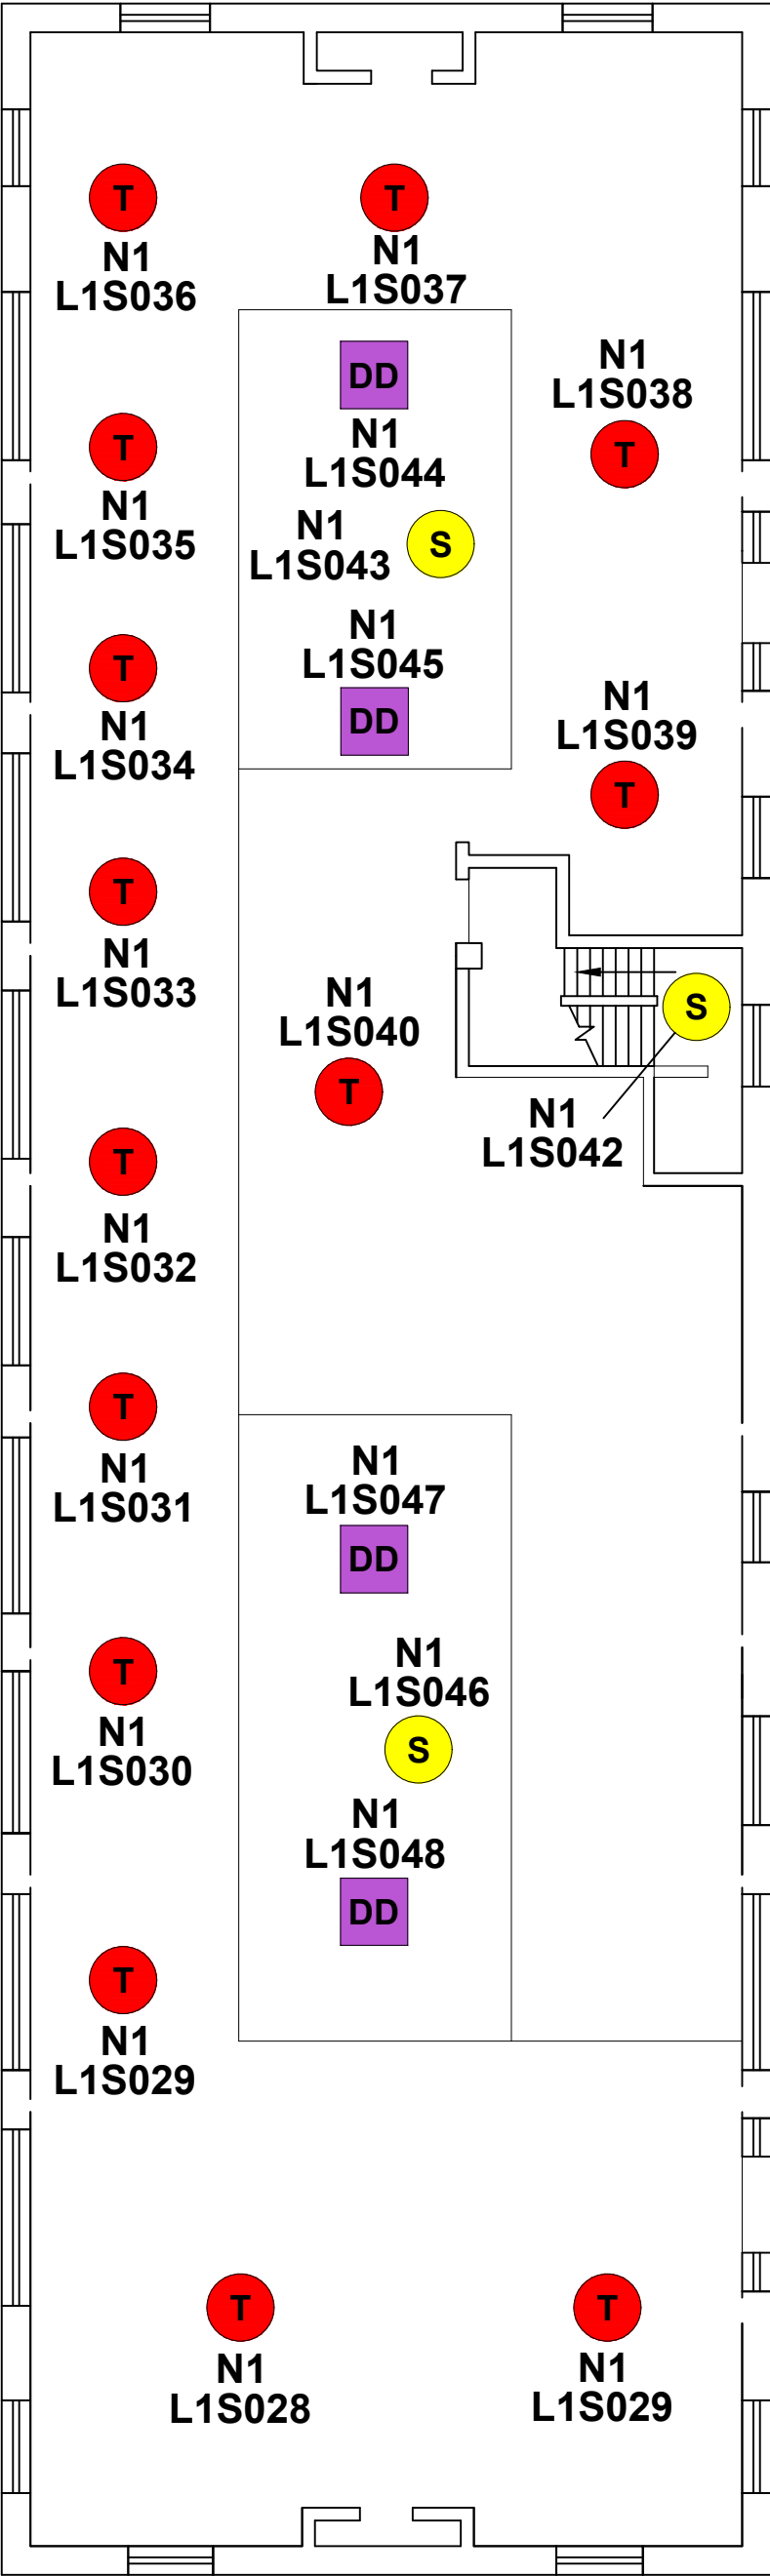

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	HEAT DETECTOR
	DUCT DETECTOR



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECTURE/ENGINEER (A/E) PLANS, AND
SPECIFICATIONS FURNISHED TO NFS. A/E IS SOLELY
RESPONSIBLE (NOT NFS) FOR THE TYPE, SIZE,
LOCATION, AND SUITABILITY OF ALL FIRE ALARMS,
CONTROL PANELS, AND OTHER DEVICES SHOWN ON
THE A/E PLANS. NFS DRAWINGS ARE TO SHOW ONLY
THE WIRING DIAGRAMS BETWEEN FIRE ALARM
DEVICES AND CONTROL PANELS. NFS IS NOT
RESPONSIBLE FOR THE INFORMATION SHOWN ON THE
A/E PLANS.

HEDCO BUILDING 56
UNIVERSITY OF UTAH
112 SOUTH CENTRAL CAMPUS DRIVE
SALT LAKE CITY, UTAH 84112
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: BH
DESIGNED BY: XXXX
APPROVED BY: KK
DATE: 09/11/2023
SCALE: N.T.S.
PROJECT NO: XXXX
REVISION NO: XXXX
DRAWING NAME:
HEDCO 56 FINAL MAP 5.DWG

NELSON FIRE SYSTEMS
LEVEL 5

PAGE:
FINAL MAP



LEVEL 5