


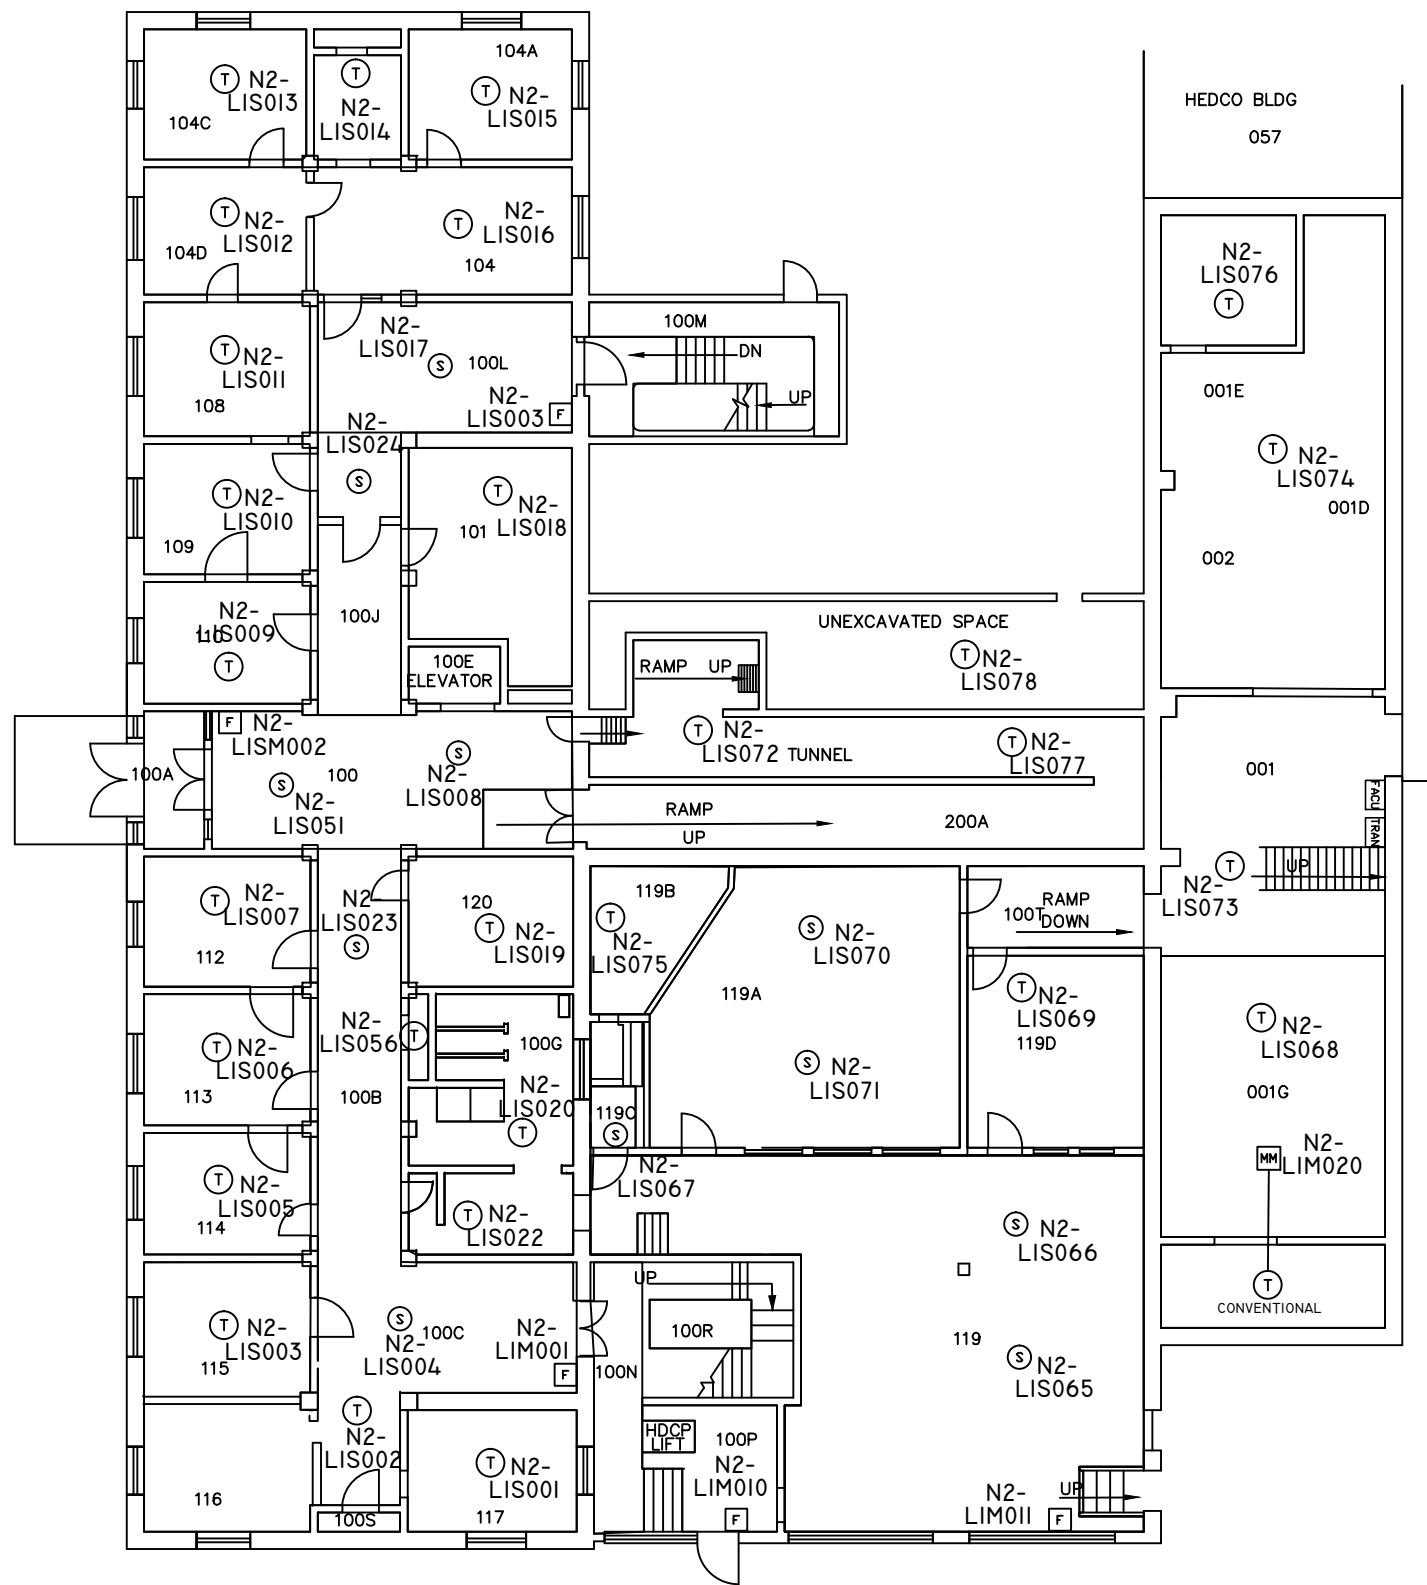

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

HEDCO BUILDING 56857
UNIVERSITY OF UTAH
1ST FLOOR
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	KN
DESIGNED BY:	KN
APPROVED BY:	RS
DATE:	9/16/2014
SCALE:	(ARCH C) 1/8"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	BLDG 56 1ST FLOOR.DWG


FIRE ALARM SYSTEM
BLDG 56 1ST FLOOR
NUMBERS

PAGE:
FA-I-03

N.F.S. E.T.
LEVEL IV
CERTIFICATION
FIRE ALARM SYSTEMS
RUSTY SELIN
#92414

BLDG 56 2ND FLOOR

BLDG 57 LOWER LEVEL

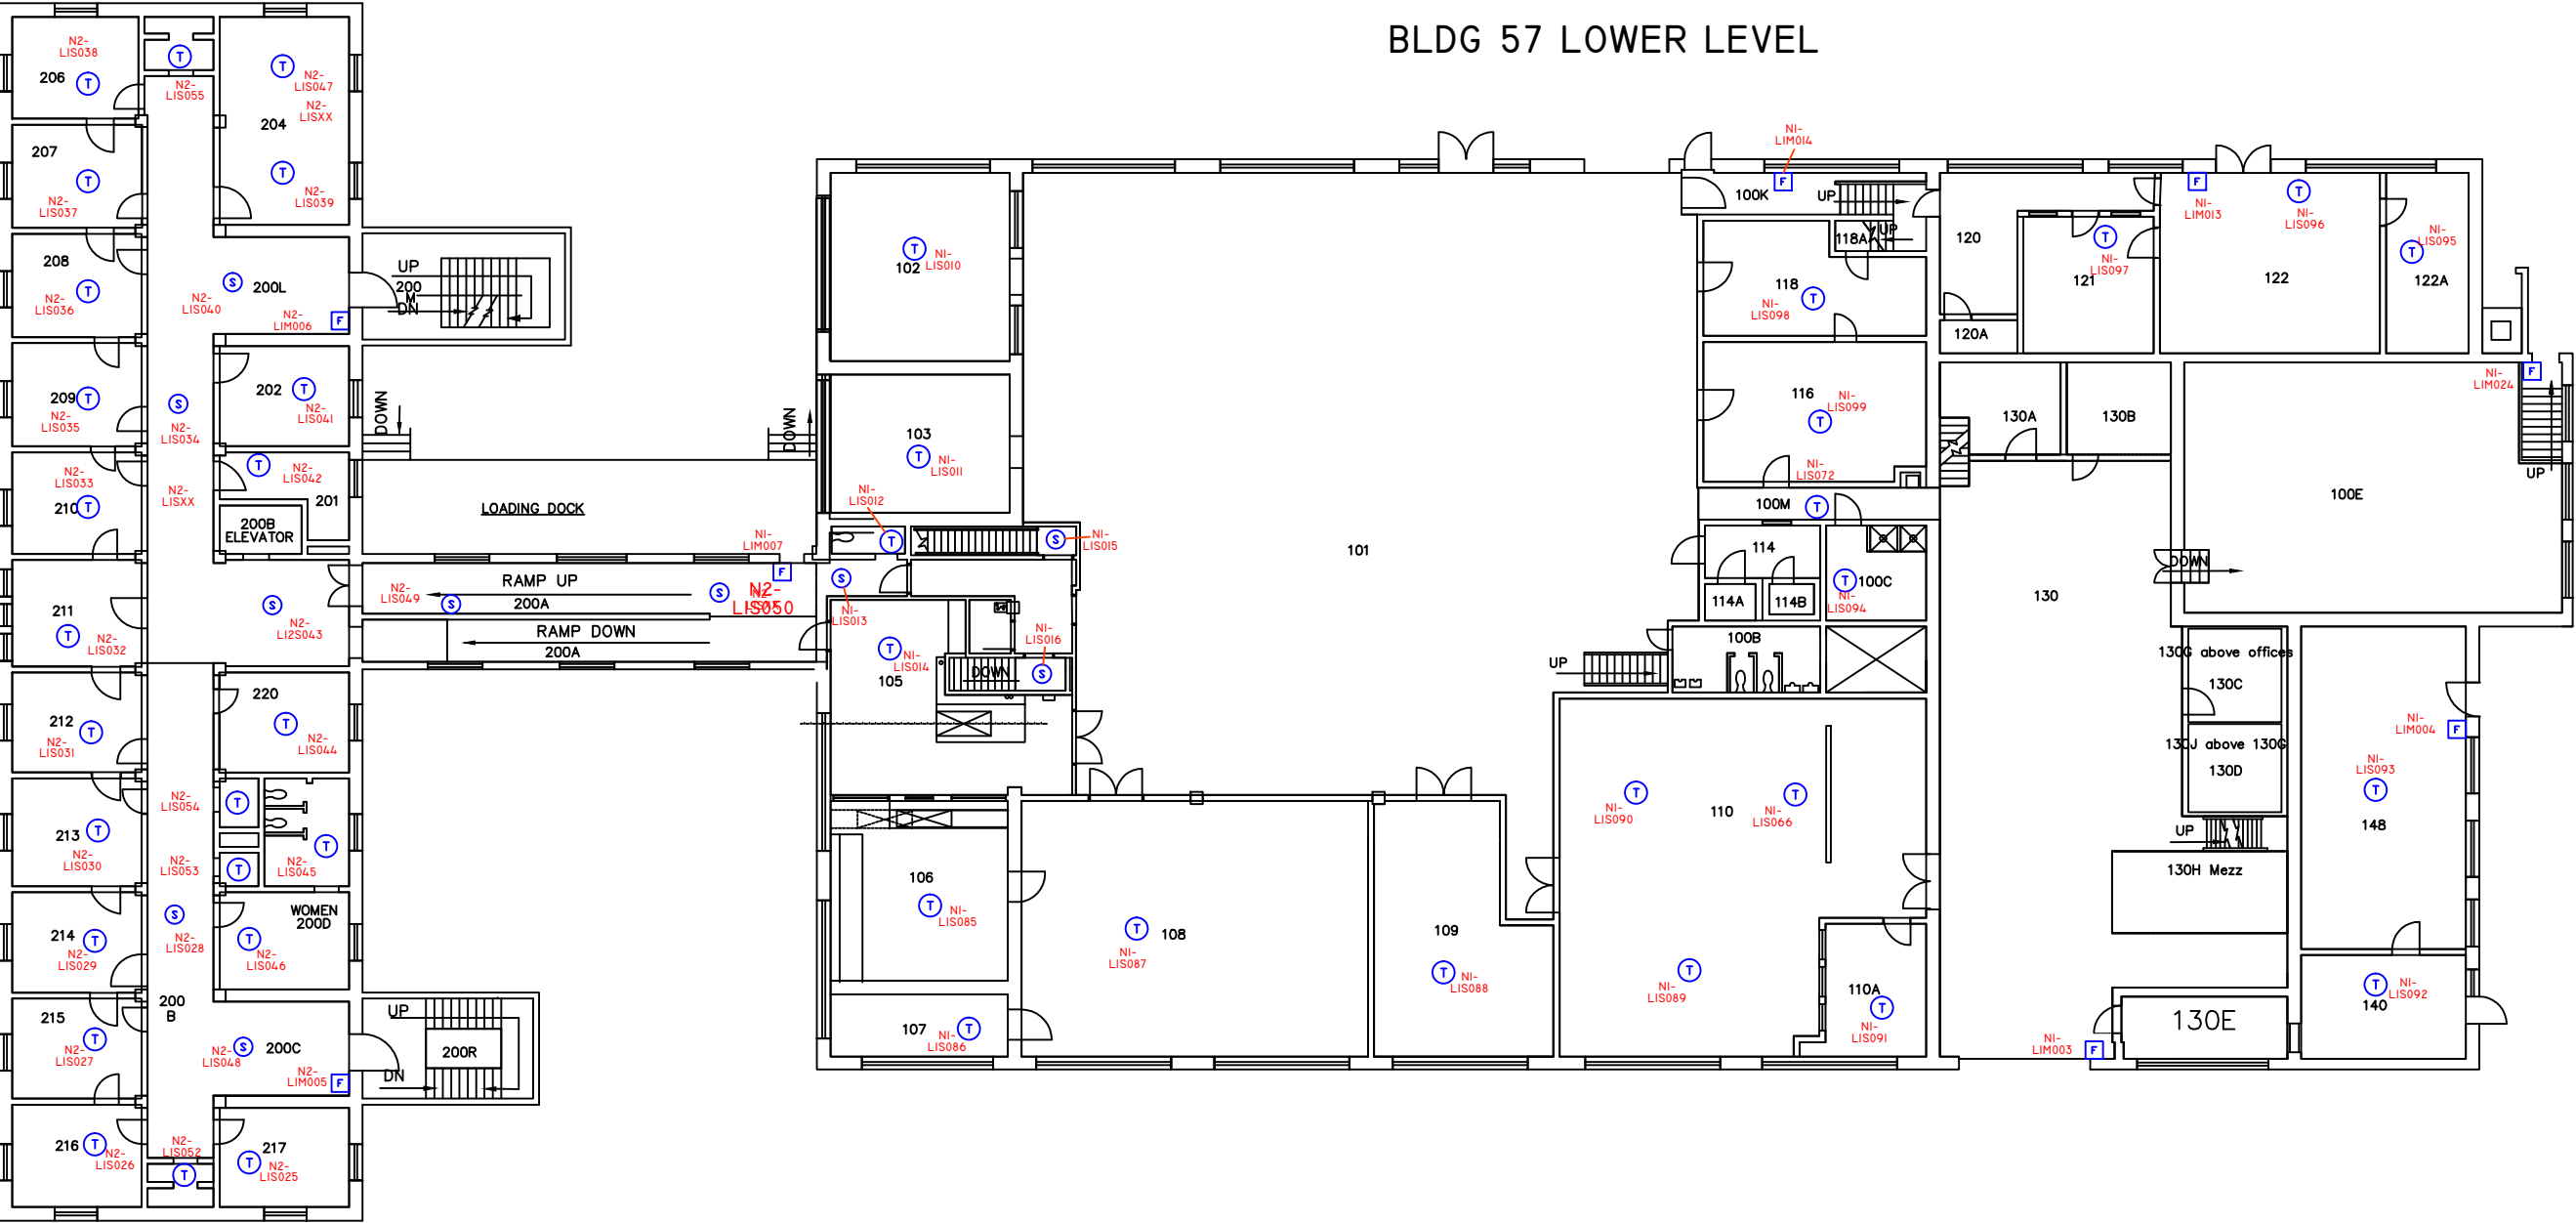

DEVICE LEGEND	
SYMBOL	DESCRIPTION
S	SMOKE DETECTOR
T	HEAT DETECTOR
TH	HIGH TEMP HEAT DETECTOR
F	MANUAL PULL STATION
DD	DUCT DETECTOR
TS	TAMPER SWITCH
WF	WATERFLOW SWITCH
CM	CONTROL MODULE
HS	HORN/STROBE
R	RELAY
TRAN	TRANSPONDER PANEL
FACU	FIRE ALARM CONTROL UNIT

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

HEDCO BUILDING 56&57
UNIVERSITY OF UTAH
BUILDING 56 & 57
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300


DRAWN BY: KN
DESIGNED BY: KN
APPROVED BY: RS
DATE: 9/16/2014
SCALE: (ARCH C) 1/8"=1'-0"
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
BLDG 56 4TH&5TH.DWG

FIRE ALARM SYSTEM
BLDG 56 2ND FLOOR
NUMBERS


PAGE:
FA-I-03



BLDG 56 3RD FLOOR

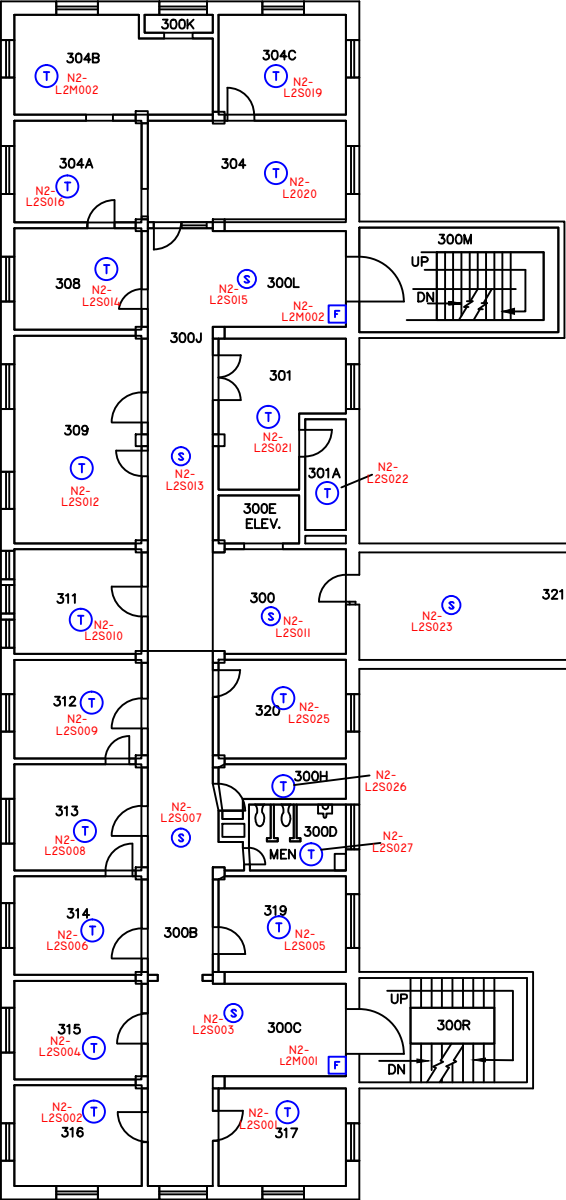

BLDG 57 UPPER LEVEL

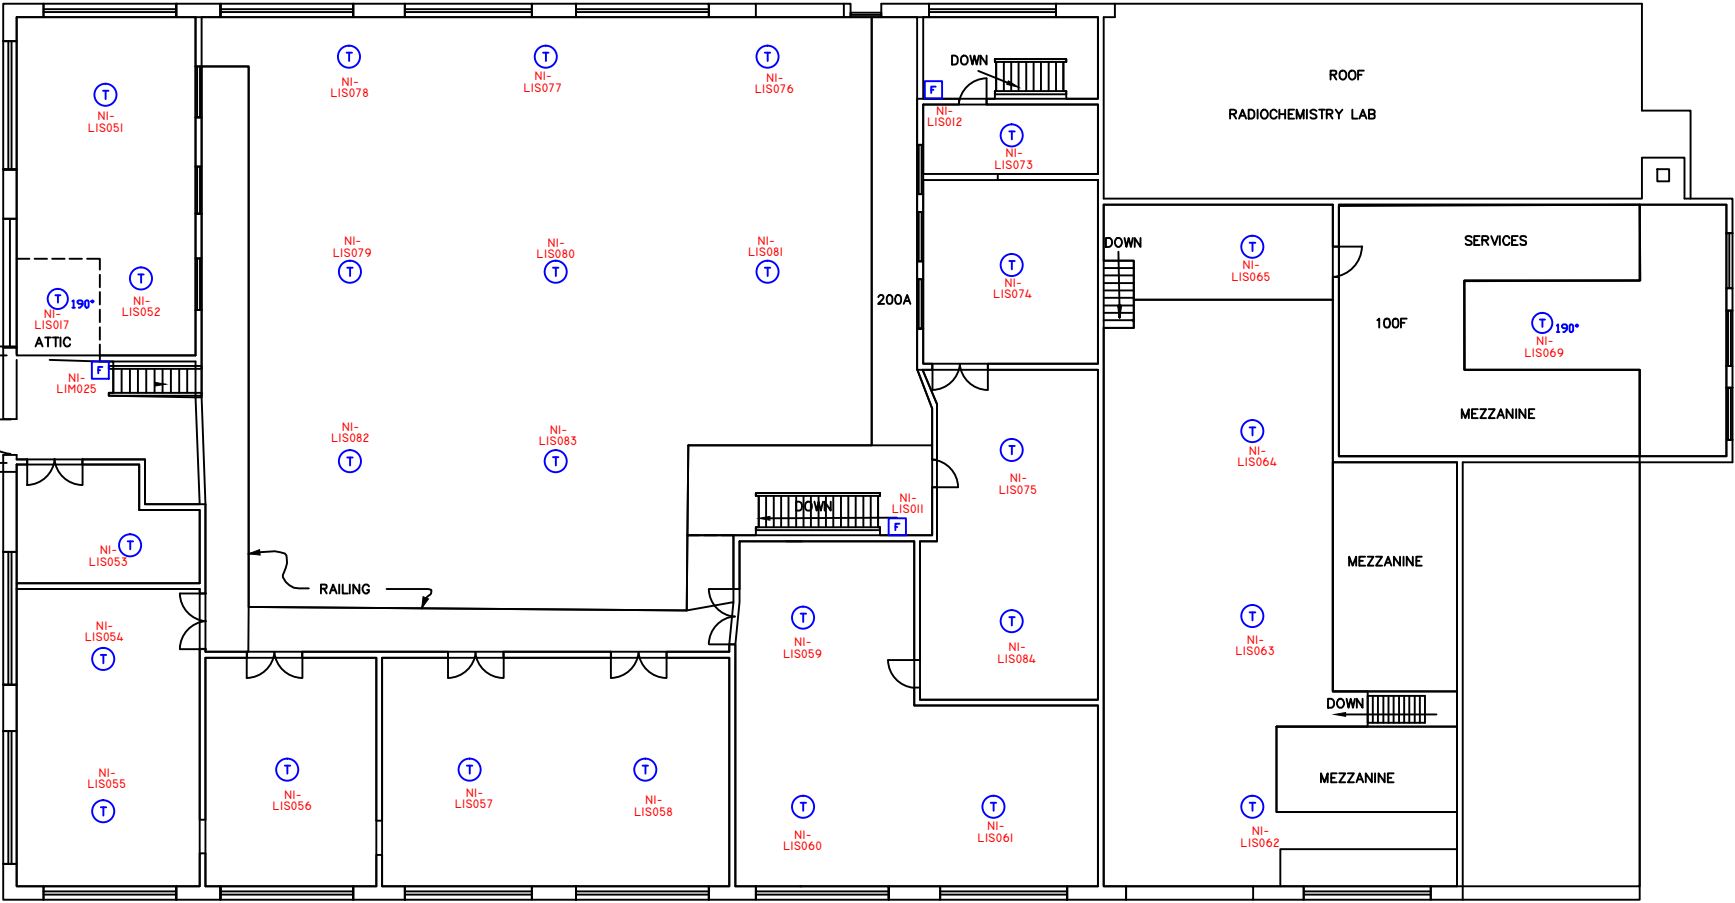

DEVICE LEGEND	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR
	HEAT DETECTOR
	HIGH TEMP HEAT DETECTOR
	MANUAL PULL STATION
	DUCT DETECTOR
	TAMPER SWITCH
	WATERFLOW SWITCH
	CONTROL MODULE
	HORN/STROBE
	RELAY
	TRANSPONDER PANEL
	FIRE ALARM CONTROL UNIT

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

HEDCO BUILDING 56&57
UNIVERSITY OF UTAH
BLDG 56 & 57
FIRE ALARM SYSTEM


NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	KN
DESIGNED BY:	KN
APPROVED BY:	RS
DATE:	9/16/2014
SCALE:	(ARCH C) 1/8"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	BLDG 56 4TH&5TH.DWG


FIRE ALARM SYSTEM
BLDG 56 2ND FLOOR
NUMBERS

PAGE:
FA-I-03



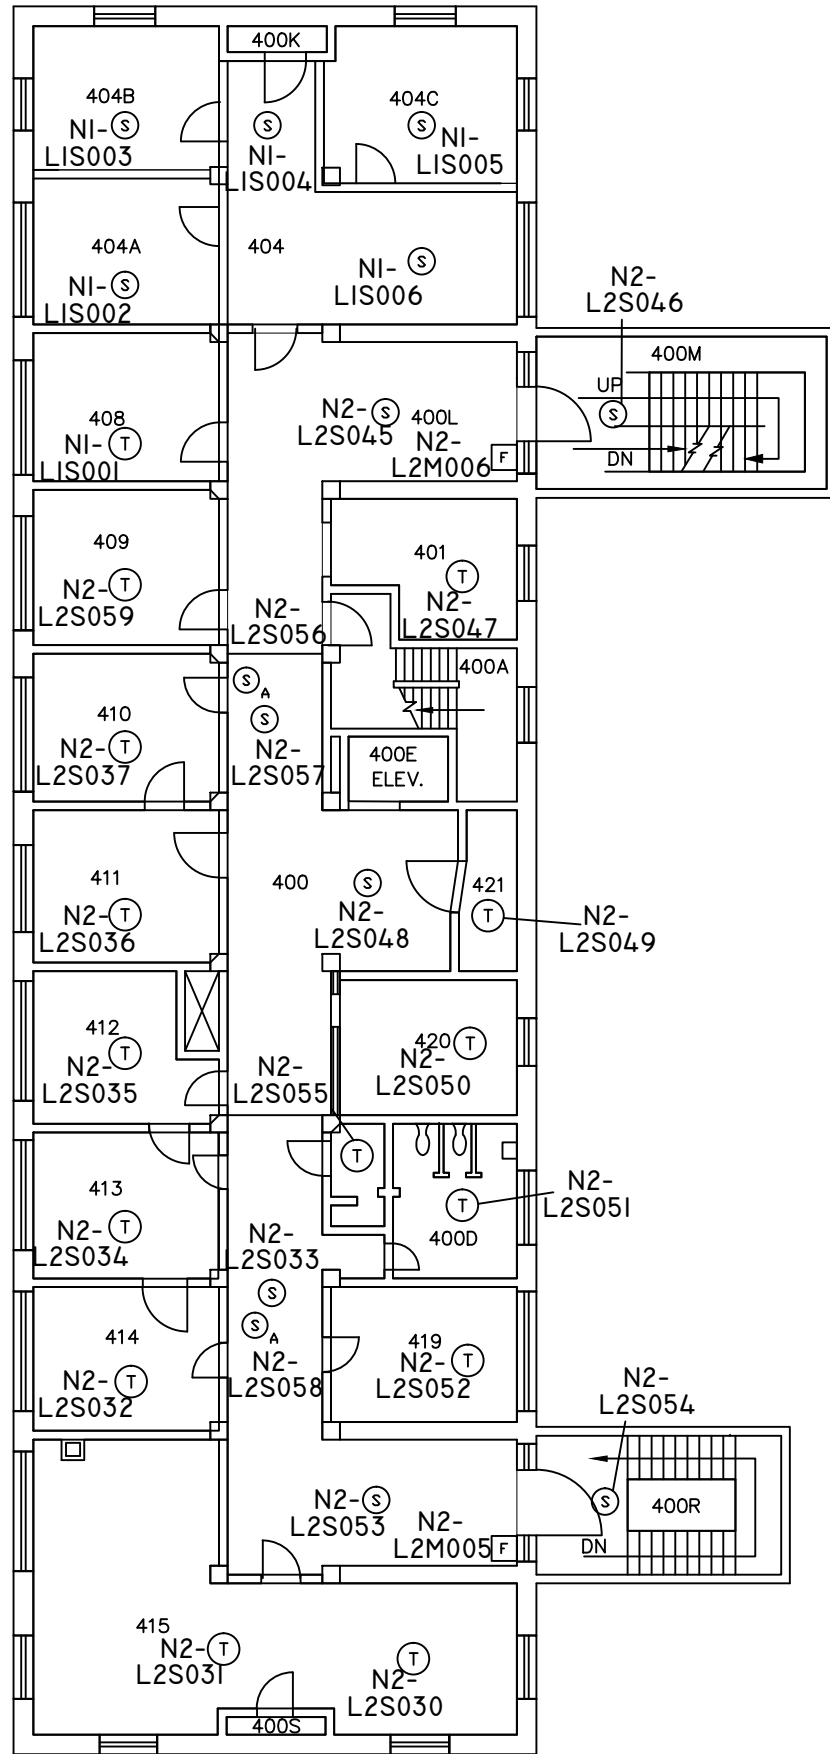

4TH FLOOR

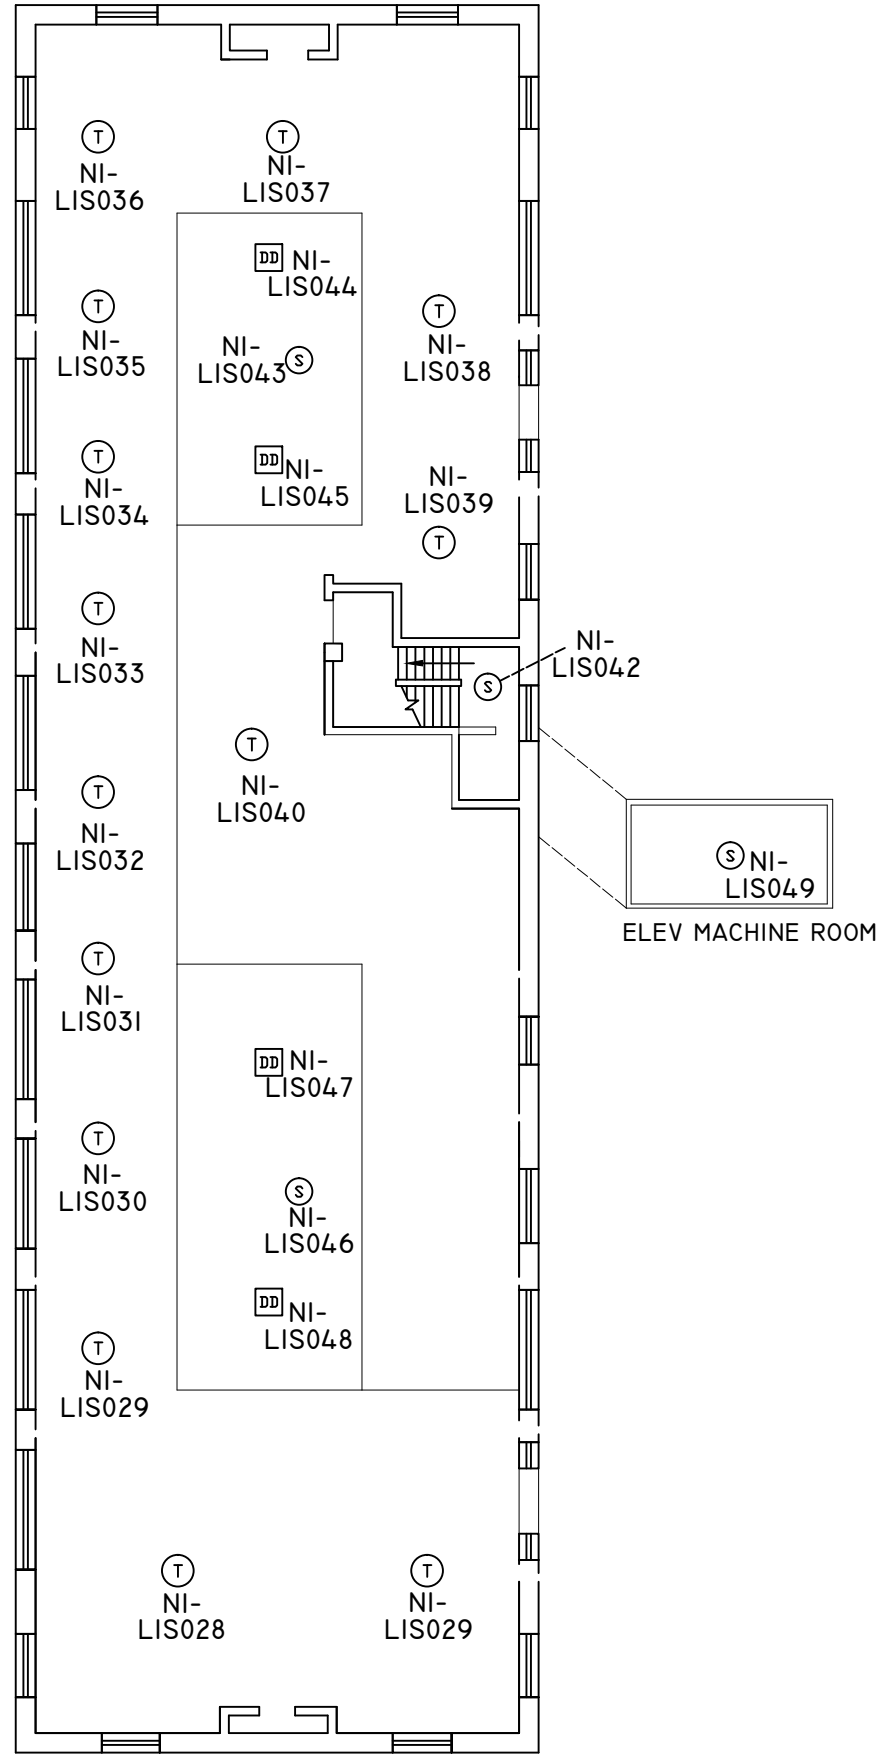

5TH FLOOR

DEVICE LEGEND	
SYMBOL	DESCRIPTION
(S)	SMOKE DETECTOR
(T)	HEAT DETECTOR
(TH)	HIGH TEMP HEAT DETECTOR
(F)	MANUAL PULL STATION
(DD)	DUCT DETECTOR
(TS)	TAMPER SWITCH
(WF)	WATERFLOW SWITCH
(CM)	CONTROL MODULE
(HS)	HORN/STROBE
(R)	RELAY
(TRAN)	TRANSPONDER PANEL
(FACU)	FIRE ALARM CONTROL UNIT

NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

HEDCO BUILDING 56857
UNIVERSITY OF UTAH
4TH & 5TH FLOORS
FIRE ALARM SYSTEM



NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY:	KN
DESIGNED BY:	KN
APPROVED BY:	RS
DATE:	9/16/2014
SCALE:	(ARCH C) 1/8"=1'
PROJECT NO:	XXXX
REV NO:	XXXX
DRAWING NAME:	BLDG 56 4TH&5TH.DWG

FIRE ALARM SYSTEM
BLDG 56 2ND FLOOR
NUMBERS



LOWER LEVEL

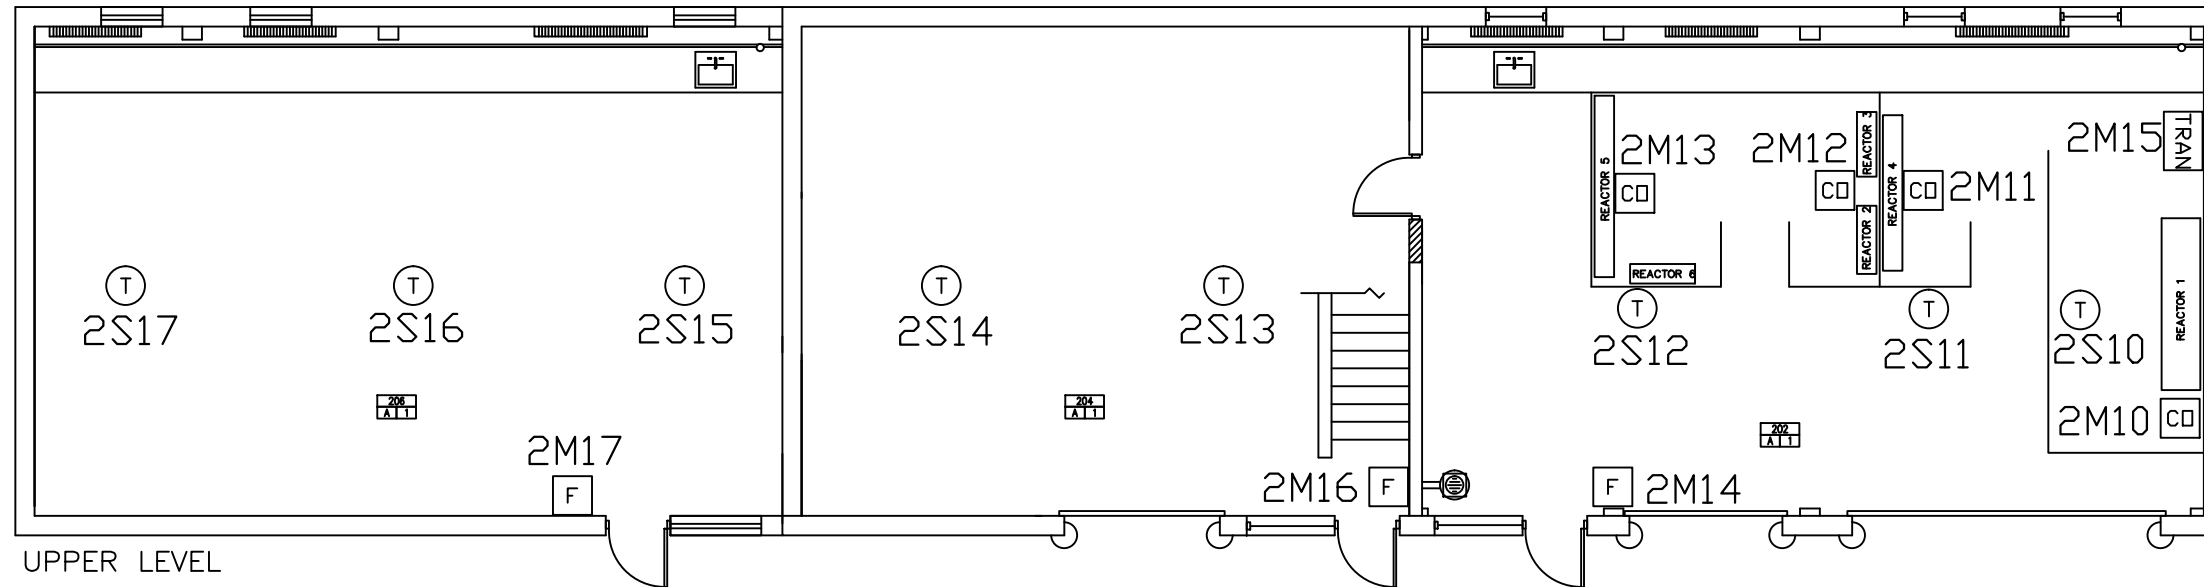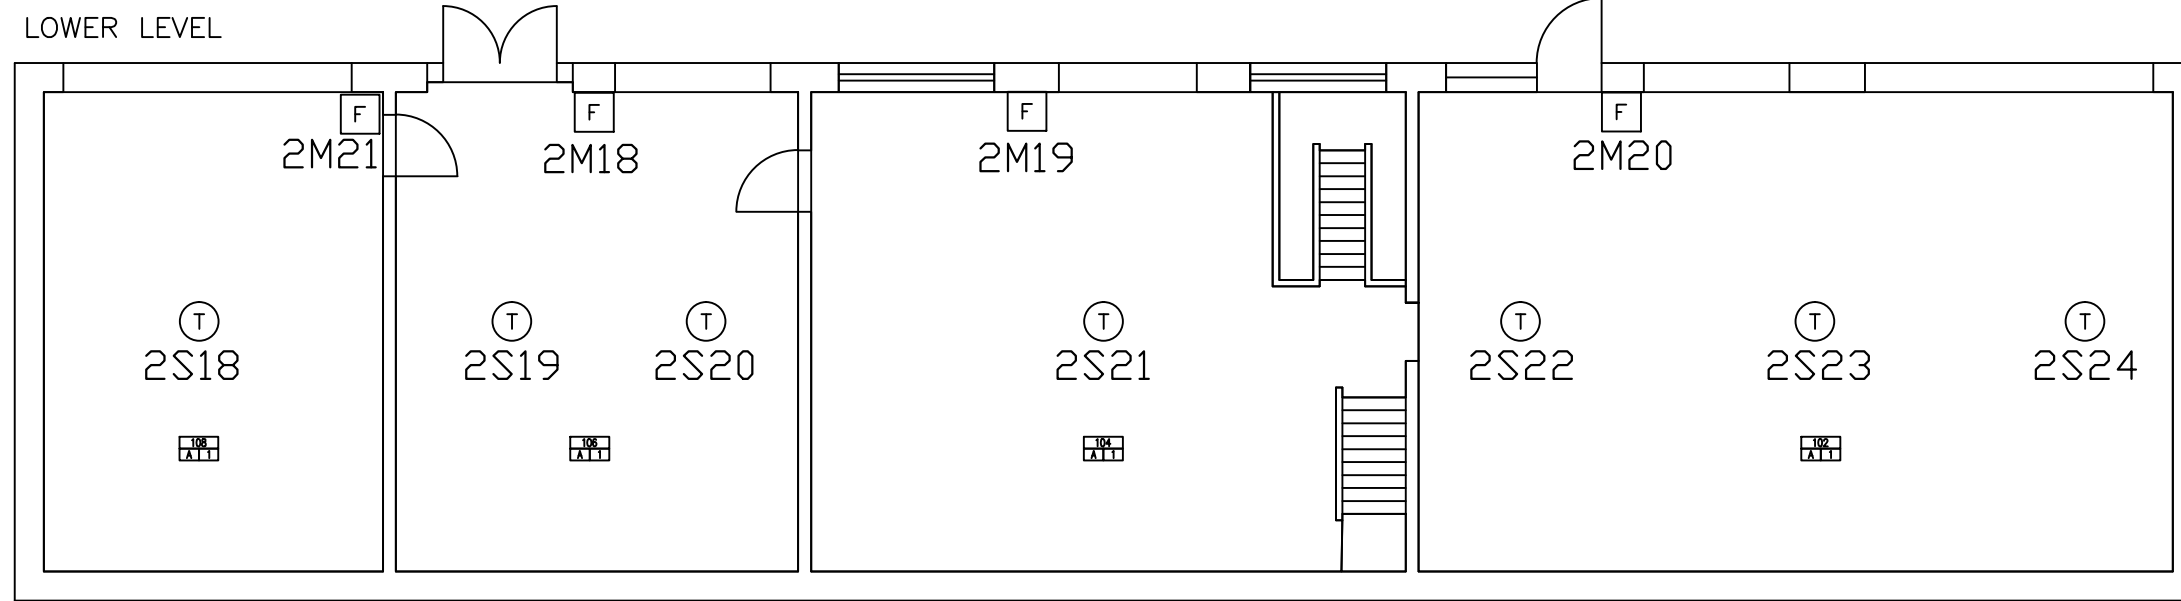


UPPER LEVEL

DEVICE LEGEND

SYMBOL	DESCRIPTION
Ⓣ	HEAT DETECTOR
F	MANUAL PULL STATION
CO	CARBON MONOXIDE DETECTOR
HS	HORN/STROBE
TRAN	TRANSPONDER PANEL

BUILDING 58



NOTE:
NFS DRAWINGS ARE BASED ON THE PROJECT
ARCHITECT/ENGINEER (A/E) PLANS AND SPECIFICATIONS
FURNISHED TO NFS. A/E IS SOLELY RESPONSIBLE
(NOT NFS) FOR THE TYPE, SIZE, LOCATION, AND
SUITABILITY OF ALL FIRE ALARMS, CONTROL PANELS,
AND OTHER DEVICES SHOWN ON THE A/E PLANS.
NFS DRAWINGS ARE TO SHOW ONLY THE WIRING
DIAGRAMS BETWEEN FIRE ALARM DEVICES AND
CONTROL PANELS. NFS IS NOT RESPONSIBLE FOR
THE INFORMATION SHOWN ON THE A/E PLANS.

UNIVERSITY OF UTAH
MINERAL PROCESSING LABS
BUILDING 58
FIRE ALARM SYSTEM

NFS
NELSON FIRE SYSTEMS
801-468-8300

DRAWN BY: DS
DESIGNED BY: XXXX
CHECKED BY: DS
DATE: 3/24/2009
SCALE: NTS
PROJECT NO: XXXX
REV NO: XXXX
DRAWING NAME:
BLDG58MINERALPROCESSING

FIRE ALARM SYSTEM

PAGE:

NFS