


LEVEL 1

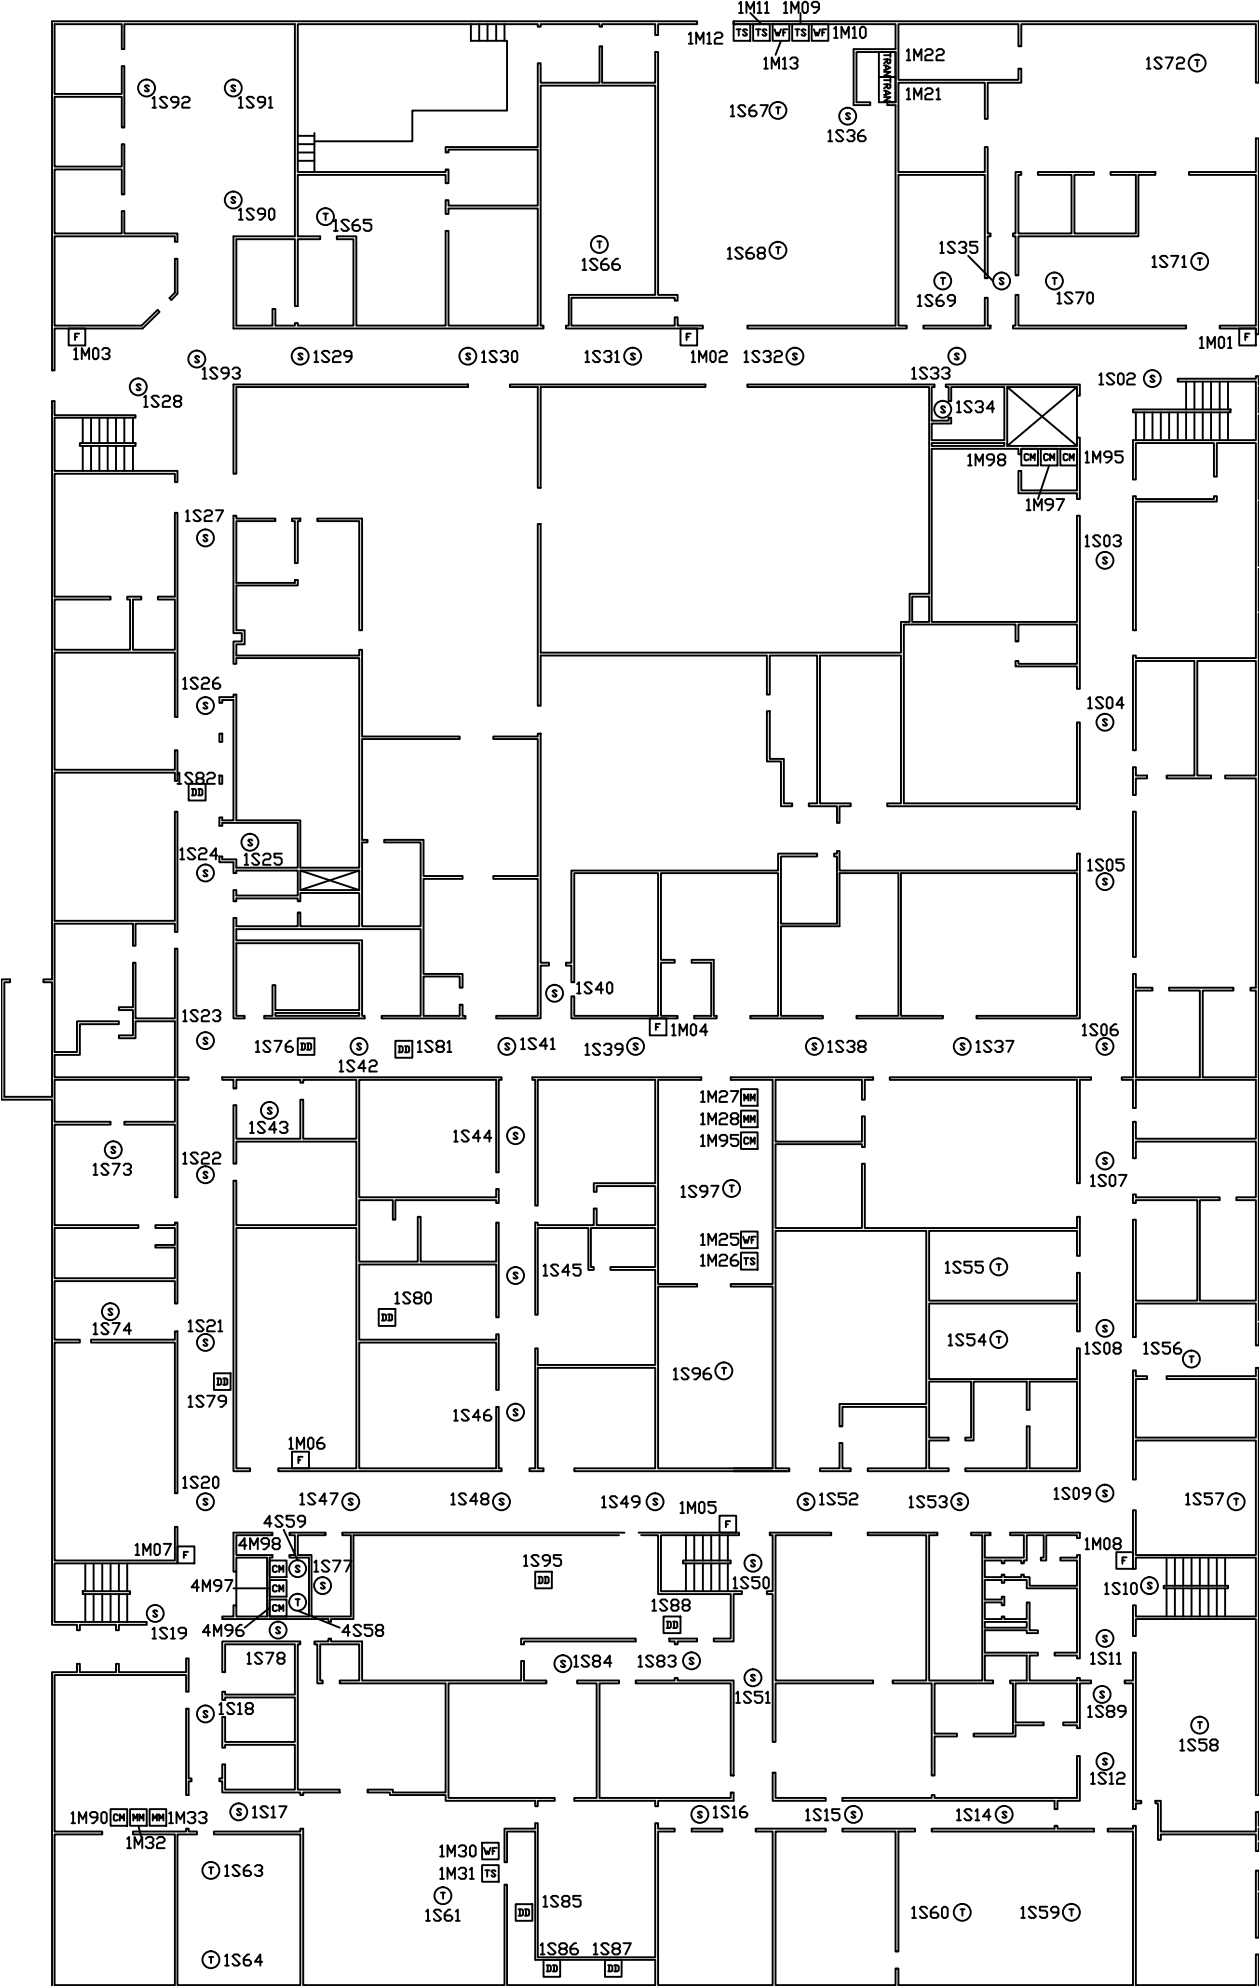


MERRILL ENGINEERING BUILDING
LEVEL 1 & 2
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
JANUARY 8, 2010
MERRILL1.DWG


- LEGEND
- ③ SMOKE DETECTOR
 - ① HEAT DETECTOR
 - F MANUAL PULL STATION
 - DD DUCT DETECTOR
 - WF WATERFLOW SWITCH
 - TS TAMPER SWITCH
 - MM MONITOR MODULE
 - CM CONTROL MODULE
 - FACP FIRE ALARM CONTROL PANEL
 - TRAN TRANSPONDER PANEL

NFS
NELSON FIRE SYSTEMS
801-468-8300


LEVEL 2

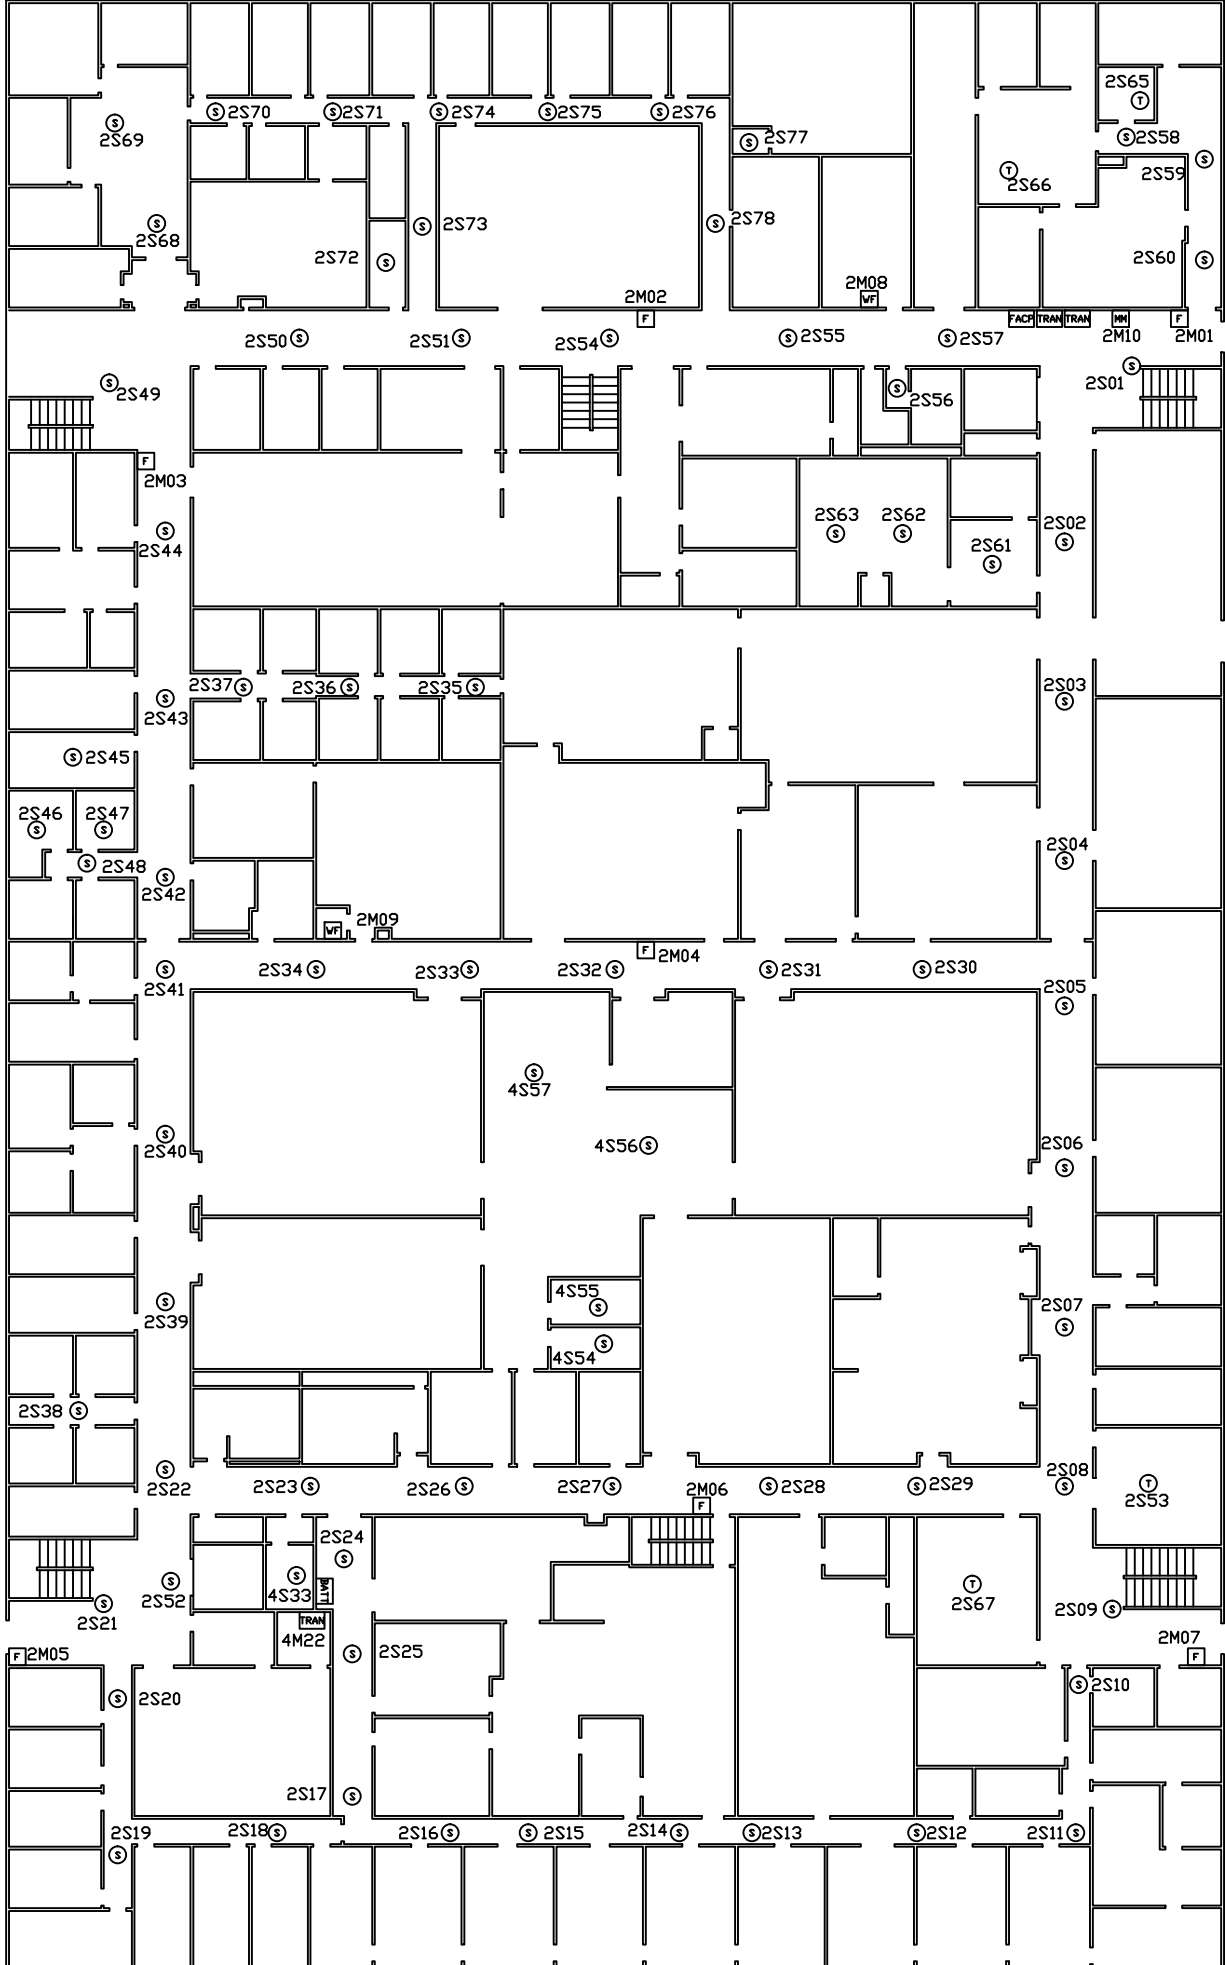

LEVEL 3

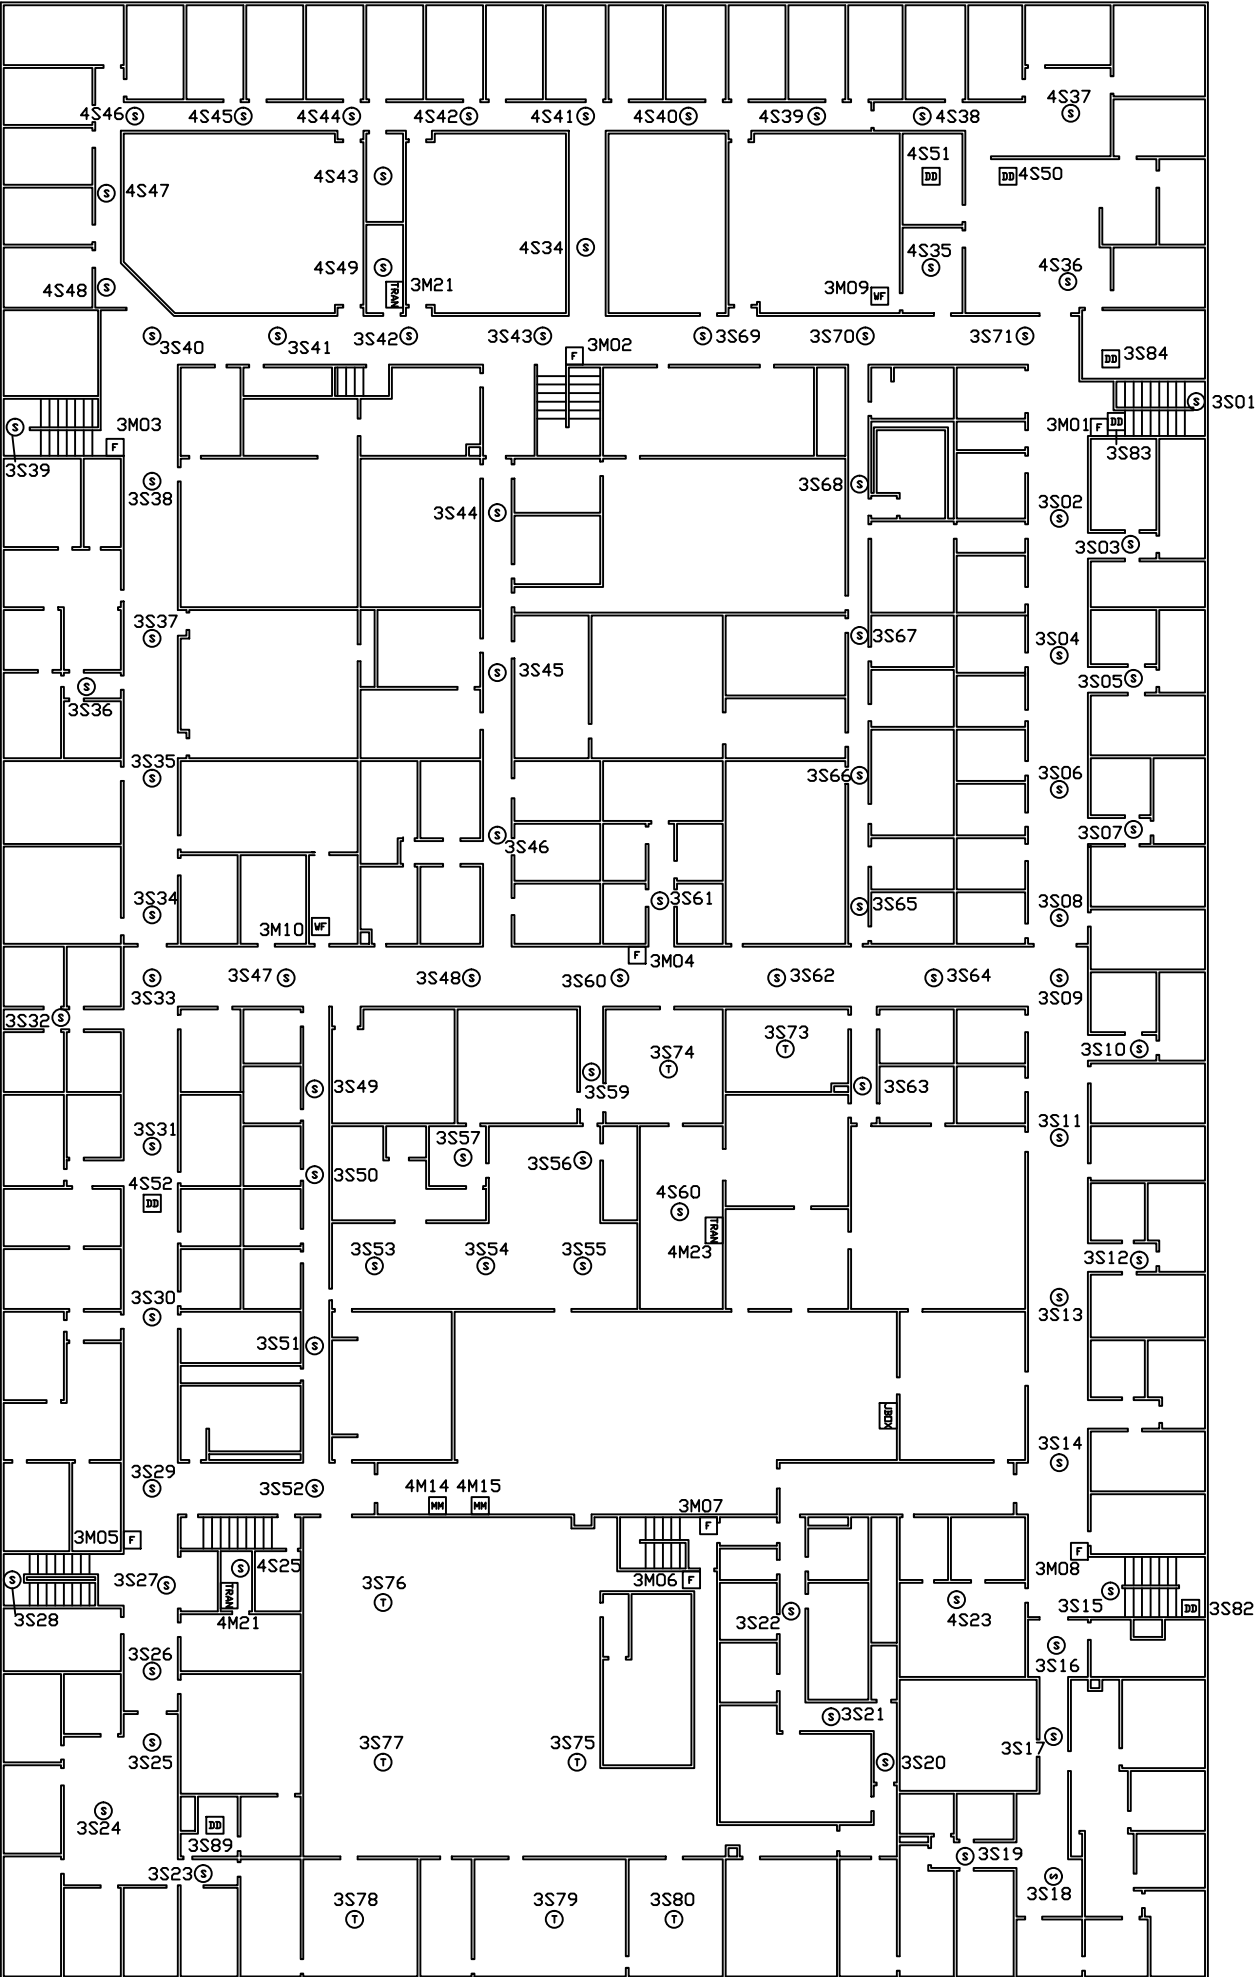


WEST PENTHOUSE

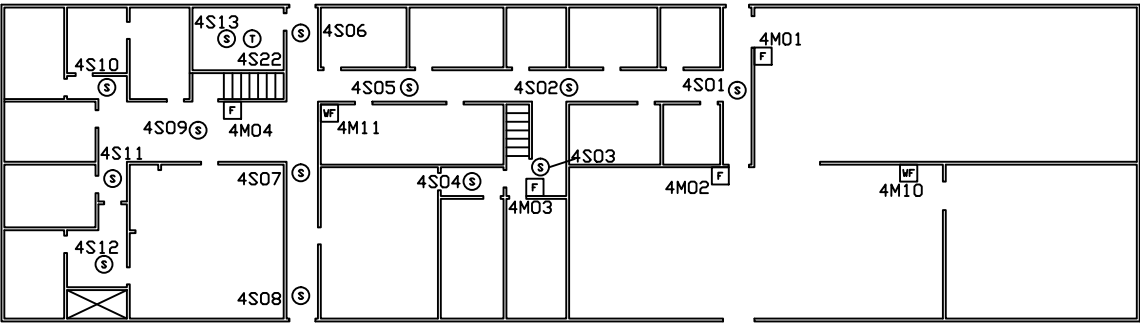


LEGEND

- Ⓢ SMOKE DETECTOR
- Ⓜ HEAT DETECTOR
- ⓕ MANUAL PULL STATION
- ⓓ DUCT DETECTOR
- Ⓦ WATERFLOW SWITCH
- Ⓣ TAMPER SWITCH
- Ⓜ MONITOR MODULE
- Ⓣ TRANSPONDER PANEL



EAST PENTHOUSE

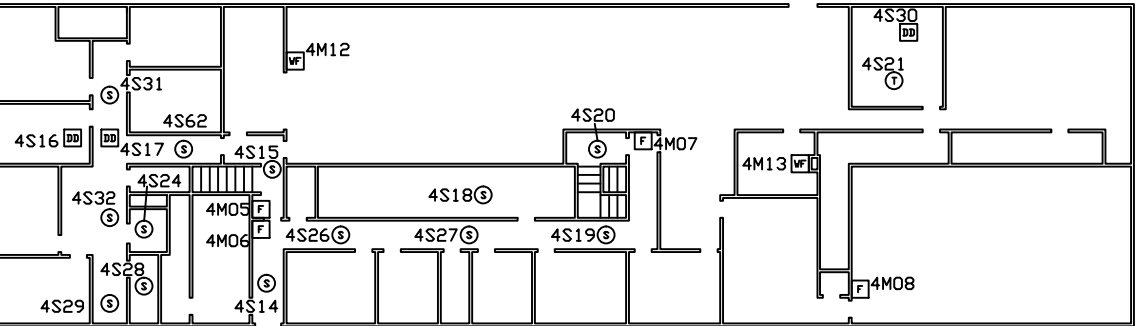

MERRILL ENGINEERING BUILDING
LEVEL 3 & PENTHOUSE
UNIVERSITY OF UTAH
SALT LAKE CITY, UTAH
DECEMBER 6, 2002
MERRILL2.DWG